


# MONITOUCH

## Connection Manual [3]

### Contents

- |                                    |                       |                                    |
|------------------------------------|-----------------------|------------------------------------|
| 1. Overview                        | 19. UNIPULSE          | 30. Slave Communication Function   |
| 2. SAIA                            | 20. UNITRONICS        | 31. Universal Serial Communication |
| 3. SAMSUNG                         | 21. ULVAC             |                                    |
| 4. SanRex                          | 22. VIGOR             |                                    |
| 5. SANMEI                          | 23. WAGO              |                                    |
| 6. SHARP                           | 24. XINJE             |                                    |
| 7. SHIMADEN                        | 25. YAMAHA            |                                    |
| 8. SHINKO TECHNOS                  | 26. Yaskawa Electric  |                                    |
| 9. Siemens                         | 27. Yokogawa Electric |                                    |
| 10. SINFONIA TECHNOLOGY            | 28. MODBUS            |                                    |
| 11. SUS                            | 29. Barcode Reader    |                                    |
| 12. TECO                           |                       |                                    |
| 13. Telemecanique                  |                       |                                    |
| 14. TOHO                           |                       |                                    |
| 15. Tokyo Chokoku Marking Products |                       |                                    |
| 16. TOSHIBA                        |                       |                                    |
| 17. TOSHIBA MACHINE                |                       |                                    |
| 18. TURCK                          |                       |                                    |

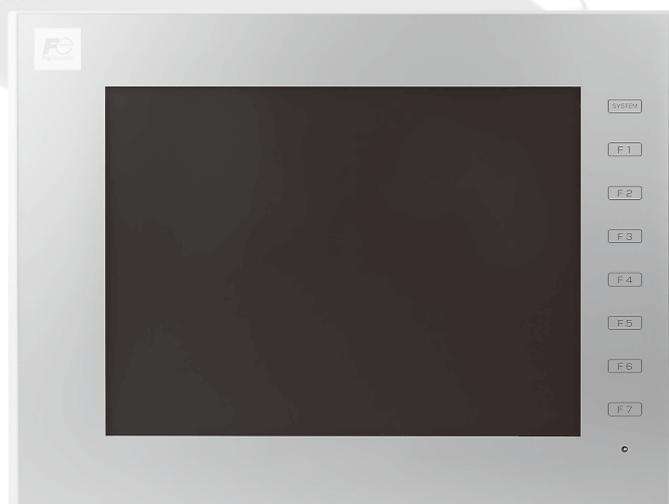

# V9 series

## Record of Revisions

Reference numbers are shown at the bottom left corner on the back cover of each manual.

Printing Date	Reference No.	Revised Contents
May, 2014	2212NE0	First edition
June, 2015	2212NE1	Second edition <ul style="list-style-type: none"><li>• V907W, V906 added</li><li>• Partial modifications</li></ul>
February, 2016	2212NE2	Third edition <ul style="list-style-type: none"><li>• "Types and Model Names of the V9 Series" added to "Preface"</li><li>• "WLAN" added to "Overview"</li><li>• Siemens connectable devices added, S7-300MPI/S7-200PPI wiring diagram modified</li><li>• Connectable devices added: SAMSUNG, SUS, Tokyo Chokoku Marking Products, TOSHIBA, ULVAC, Yokogawa Electric, Slave Communication Function</li><li>• Partial modifications</li></ul>

# Preface

Thank you for selecting the MONITOUCH V9 series.

For correct set-up of the V9 series, you are requested to read through this manual to understand more about the product.

For more information about the V9 series, refer to the following related manuals.

Manual Name	Contents	Reference No.
V9 Series Reference Manual [1]	Explains the functions and operation of the V9 series.	1065NE
V9 Series Reference Manual [2]		1066NE
V9 Series Setup Manual	Explains the installation procedure of V-SFT version 6, the creation process of simple screen programs as well as how to transfer a created screen program using V-SFT version 6.	1067NE
V9 Series Troubleshooting/Maintenance Manual	Provides an error list and explains the operating procedures for the V9 series.	1068NE
V9 Series Training Manual Beginner's Guide	Explains the screen creation process using V-SFT version 6 with examples in detail.	1069NE
V9 Series Training Manual Practical Guide		1070NE
V9 Series Macro Reference	Provides an overview of macros of V-SFT version 6 and explains macro editor operations and macro command descriptions in detail.	1071NE
V9 Series Operation Manual	Explains the configuration of V-SFT version 6, the editing process of each part and limitations regarding operation in detail.	1072NE
V9 Series Connection Manual [1]	Explains the connection and communication parameters for the V9 series and controllers in detail. Included Makers ALLEN BRADLEY, Automationdirect, Azbil, Baumuller, BECKHOFF, CHINO, CIMON, DELTA, DELTA TAU DATA SYSTEMS, EATON Cutler-Hammer, EMERSON, FANUC, FATEK AUTOMATION, FUFENG, Fuji Electric, Gammaflux, GE Fanuc, Hitachi, Hitachi Industrial Equipment Systems, HYUNDAI	2210NE
V9 Series Connection Manual [2]	Explains the connection and communication parameters for the V9 series and controllers in detail. Included Makers IAI, IDEC, JTEKT, KEYENCE, KOGANEI, KOYO ELECTRONICS, LS, MITSUBISHI ELECTRIC, MODICON, MOELLER, M-SYSTEM, OMRON, Oriental Motor, Panasonic, RKC, RS Automation	2211NE
V9 Series Connection Manual [3]	Explains the connection and communication parameters for the V9 series and controllers in detail. Included Makers SAIA, SAMSUNG, SanRex, SANMEI, SHARP, SHIMADEN, SHINKO TECHNOS, Siemens, SINFONIA TECHNOLOGY, SUS, TECO, Telemecanique, TOHO, Tokyo Chokoku Marking Products, TOSHIBA, TOSHIBA MACHINE, TURCK, ULVAC, UNIPULSE, UNITRONICS, VIGOR, WAGO, XINJE, YAMAHA, Yaskawa Electric, Yokogawa Electric, MODBUS, Barcode Reader, Slave Communication Function, Universal Serial Communication	2212NE
V9 Series Hardware Specifications	Explains hardware specifications and precautions when handling the V9 series.	2023NE

For details on devices including PLCs, inverters, and temperature controllers, refer to the manual for each device.

Notes:

1. This manual may not, in whole or in part, be printed or reproduced without the prior written consent of Hakko Electronics Co., Ltd.
2. The information in this manual is subject to change without prior notice.
3. Windows and Excel are registered trademarks of Microsoft Corporation in the United States and other countries.
4. All other company names or product names are trademarks or registered trademarks of their respective holders.
5. This manual is intended to give accurate information about MONITOUCH hardware. If you have any questions, please contact your local distributor.

---

## Types and Model Names of the V9 Series

---

The MONITOUCH V9 series comprises the following types.

Generic Name	V9 Classification	Model
V9 Series	V910W	V910xiWRLD, V910xiWLD
	V907W	V907xiWRLD, V907xiWLD
	V915	V9150iX, V9150iXD, V9150iXLD, V9150iXRD
	V912	V9120iS, V9120iSD, V9120iSLD, V9120iSRD
	V910	V9100iS, V9100iSD, V9100iSLD, V9100iSRD, V9100iC, V9100iCD
	V908	V9080iSD, V9080iSLD, V9080iSRD, V9080iCD
	V906	V9060iTD

Note that model names are differentiated according to the above descriptions in this manual for operation explanations.

---

# Notes on Safe Usage of MONITOUCH

---

In this manual, you will find various notes categorized under the following two levels with the signal words "Danger" and "Caution."



## DANGER

Indicates an imminently hazardous situation which, if not avoided, will result in death or serious injury.



## CAUTION

Indicates a potentially hazardous situation which, if not avoided, may result in minor or moderate injury and could cause property damage.

Note that there is a possibility that an item listed under  CAUTION may have serious ramifications.



## DANGER

- Never use the output signal of the V9 series for operations that may threaten human life or damage the system, such as signals used in case of emergency. Please design the system so that it can cope with a touch switch malfunction. A touch switch malfunction may result in machine accidents or damage.
- Turn off the power supply when you set up the unit, connect new cables, or perform maintenance or inspections. Otherwise, electrical shock or damage may occur.
- Never touch any terminals while the power is on. Otherwise, electrical shock may occur.
- You must cover the terminals on the unit before turning the power on and operating the unit. Otherwise, electrical shock may occur.
- The liquid crystal in the LCD panel is a hazardous substance. If the LCD panel is damaged, do not ingest the leaked liquid crystal. If leaked liquid crystal makes contact with skin or clothing, wash it away with soap and water.
- Never disassemble, recharge, deform by pressure, short-circuit, reverse the polarity of the lithium battery, nor dispose of the lithium battery in fire. Failure to follow these conditions will lead to explosion or ignition.
- Never use a lithium battery that is deformed, leaking, or shows any other signs of abnormality. Failure to follow these conditions will lead to explosion or ignition.
- Switches on the screen are operable even when the screen has become dark due to a faulty backlight or when the backlight has reached the end of its service life. If the screen is dark and hard to see, do not touch the screen. Otherwise, a malfunction may occur resulting in machine accidents or damage.



## CAUTION

- Check the appearance of the unit when it is unpacked. Do not use the unit if any damage or deformation is found. Failure to do so may lead to fire, damage, or malfunction.
- For use in a facility or as part of a system related to nuclear energy, aerospace, medical, traffic equipment, or mobile installations, please consult your local distributor.
- Operate (or store) the V9 series under the conditions indicated in this manual and related manuals. Failure to do so could cause fire, malfunction, physical damage, or deterioration.
- Observe the following environmental restrictions on use and storage of the unit. Otherwise, fire or damage to the unit may result.
  - Avoid locations where there is a possibility that water, corrosive gas, flammable gas, solvents, grinding fluids, or cutting oil can come into contact with the unit.
  - Avoid high temperatures, high humidity, and outside weather conditions, such as wind, rain, or direct sunlight.
  - Avoid locations where excessive dust, salt, and metallic particles are present.
  - Avoid installing the unit in a location where vibrations or physical shocks may be transmitted.
- Equipment must be correctly mounted so that the main terminal of the V9 series will not be touched inadvertently. Otherwise, an accident or electric shock may occur.
- Tighten the mounting screw on the fixtures of the V9 series to an equal torque of 5.31 lbf-in. Excessive tightening may distort the panel surface. Loose mounting screws may cause the unit to fall down, malfunction, or short-circuit.
- Check periodically that terminal screws on the power supply terminal block and fixtures are firmly tightened. Loosened screws or nuts may result in fire or malfunction.
- Tighten the terminal screws on the power supply terminal block of the V9 series to an equal torque of 7.1 to 8.8 lbf-in (0.8 to 1.0 N·m). Improper tightening of screws may result in fire, malfunction, or other serious trouble.
- The V9 series has a glass screen. Do not drop the unit or impart physical shocks to the unit. Otherwise, the screen may be damaged.
- Correctly connect cables to the terminals of the V9 series in accordance with the specified voltage and wattage. Overvoltage, overwattage, or incorrect cable connection could cause fire, malfunction, or damage to the unit.
- Always ground the V9 series. The FG terminal must be used exclusively for the V9 series with the level of grounding resistance less than 100 Ω. Otherwise, electric shock or a fire may occur.
- Prevent any conductive particles from entering the V9 series. Failure to do so may lead to fire, damage, or malfunction.

## CAUTION

- After wiring is finished, remove the paper used as a dust cover before starting operation of the V9 series. Operation with the dust cover attached may result in accidents, fire, malfunction, or other trouble.
- Do not attempt to repair the V9 series yourself. Contact Hakko Electronics or the designated contractor for repairs.
- Do not repair, disassemble, or modify the V9 series. Hakko Electronics Co., Ltd. is not responsible for any damages resulting from repair, disassembly, or modification of the unit that was performed by an unauthorized person.
- Do not use sharp-pointed tools to press touch switches. Doing so may damage the display unit.
- Only experts are authorized to set up the unit, connect cables, and perform maintenance and inspection.
- Lithium batteries contain combustible material such as lithium and organic solvents. Mishandling may cause heat, explosion, or ignition resulting in fire or injury. Read the related manuals carefully and correctly handle the lithium battery as instructed.
- Take safety precautions during operations such as changing settings when the unit is running, forced output, and starting and stopping the unit. Any misoperations may cause unexpected machine movement, resulting in machine accidents or damage.
- In facilities where the failure of the V9 series could lead to accidents that threaten human life or other serious damage, be sure that such facilities are equipped with adequate safeguards.
- When disposing of the V9 series, it must be treated as industrial waste.
- Before touching the V9 series, discharge static electricity from your body by touching grounded metal. Excessive static electricity may cause malfunction or trouble.
- Insert an SD card into MONITOUCH in the same orientation as pictured on the unit. Failure to do so may damage the SD card or the slot on the unit.
- The SD card access LED flashes red when the SD card is being accessed. Never remove the SD card or turn off power to the unit while the LED is flashing. Doing so may destroy the data on the SD card. Check that the LED has turned off before removing the SD card or turning off the power to the unit.
- Be sure to remove the protective sheet that is attached to the touch panel surface at delivery before use. If used with the protective sheet attached, MONITOUCH may not recognize touch operations or malfunctions may occur.
- When using an analog resistive-film type V9 series unit, do not touch two positions on the screen at the same time. If two or more positions are pressed at the same time, the switch located between the pressed positions may be activated.
- When using a capacitive V9 series unit, take note of the following cautions.
  - Use a Class 2 power supply for a 24-VDC unit. If an unstable power supply is used, MONITOUCH may not recognize touch operations or malfunctions may occur.
  - Capacitive touch panel types support two-point touch operations. If a third point is touched, the touch operation will be cancelled.
  - Capacitive touch panel types are prone to the influence of conductive material. Do not place conductive material such as metals near the touch panel surface and do not use the panel if it is wet. Otherwise, malfunctions may occur.

### [General Notes]

- Never bundle control cables or input/output cables with high-voltage and large-current carrying cables such as power supply cables. Keep control cables and input/output cables at least 200 mm away from high-voltage and large-current carrying cables. Otherwise, malfunction may occur due to noise.
- When using the V9 series in an environment where a source of high-frequency noise is present, it is recommended that the FG shielded cable (communication cable) be grounded at each end. However, when communication is unstable, select between grounding one or both ends, as permitted by the usage environment.
- Be sure to plug connectors and sockets of the V9 series in the correct orientation. Failure to do so may lead to damage or malfunction.
- If a LAN cable is inserted into the MJ1 or MJ2 connector, the device on the other end may be damaged. Check the connector names on the unit and insert cables into the correct connectors.
- Do not use thinners for cleaning because it may discolor the V9 series surface. Use commercially available alcohol.
- If a data receive error occurs when the V9 series unit and a counterpart unit (PLC, temperature controller, etc.) are started at the same time, read the manual of the counterpart unit to correctly resolve the error.
- Avoid discharging static electricity on the mounting panel of the V9 series. Static charge can damage the unit and cause malfunctions. Discharging static electricity on the mounting panel may cause malfunction to occur due to noise.
- Avoid prolonged display of any fixed pattern. Due to the characteristic of liquid crystal displays, an afterimage may occur. If prolonged display of a fixed pattern is expected, use the backlight's auto OFF function.
- The V9 series is identified as a class-A product in industrial environments. In the case of use in a domestic environment, the unit is likely to cause electromagnetic interference. Preventive measures should thereby be taken appropriately.
- The signal ground (SG) and frame ground (FG) are connected inside the V9150 series unit. Take care when designing systems.

### [Notes on the LCD]

Note that the following conditions may occur under normal circumstances.

- The response time, brightness, and colors of the V9 series may be affected by the ambient temperature.
- Tiny spots (dark or luminescent) may appear on the display due to the characteristics of liquid crystal.
- There are variations in brightness and color between units.

---

[Notes on Capacitive Touch Panels]

- Touch panel operability may not be optimal if used with dry fingers or skin. In such a case, use a capacitive stylus pen.
- Periodically clean the touch panel surface for optimum touch operations.

When cleaning, take note of the following points.

<When cleaning>

- The panel surface is made of glass. Be sure to clean the surface gently with a cloth or sponge. Otherwise, you may scratch or damage the glass.
- Take care not to let cleaning detergent seep into the touch panel unit.  
Do not directly apply or spray cleaning detergent on the panel surface.

[Notes on Wireless LAN]

For details regarding supported wireless LAN standards, radio law certifications, and countries where wireless LAN can be used, refer to the "About Wireless LAN on V9 Advanced Model" / "About Wireless LAN on V9 Standard Model" manual or the "V9 Series Hardware Specifications" provided with the V9 series unit at delivery.

---

# Contents

---

1.	Overview	
1.1	System Configuration	1-1
1.1.1	Overview	1-1
1.1.2	System Composition	1-3
	Serial Communication	1-3
	Ethernet Communication	1-4
	Mixed Serial-Ethernet Communication	1-4
1.2	Physical Ports	1-5
1.2.1	CN1	1-5
1.2.2	MJ1/MJ2	1-6
1.2.3	LAN/LAN2	1-8
1.2.4	WLAN	1-9
1.2.5	EXT1 (Connection Port for Network Communication Unit/Optional Unit)	1-11
1.2.6	USB	1-11
1.2.7	DIP Switch (DIPSW) Settings	1-12
1.3	Connection Methods	1-13
1.3.1	Serial Communication	1-13
	1 : 1 Connection	1-13
	1 : n Connection (Multi-drop)	1-20
	n : 1 Connection (Multi-link2)	1-23
	n : 1 Connection (Multi-link2 (Ethernet))	1-32
	n : n Connection (1 : n Multi-link2 (Ethernet))	1-35
	n : 1 Connection (Multi-link)	1-38
1.3.2	Ethernet Communication	1-43
1.3.3	Network Communication	1-48
1.3.4	Slave Communication	1-49
	V-Link	1-49
	MODBUS RTU	1-49
	MODBUS TCP/IP	1-49
1.3.5	Other Connections	1-49
1.4	Hardware Settings	1-50
1.4.1	PLC Settings	1-50
	Selecting a Device to be Connected	1-51
	PLC Properties	1-51
1.4.2	MONITOUCH Settings	1-53
	Select Edit Model	1-53
	Control Area	1-54
	Buzzer	1-56
	Backlight	1-56
	Local IP Address	1-56
	Video/RGB	1-58
	Local Mode Screen	1-58
	Ladder Transfer	1-59
1.4.3	Other Equipment	1-60
	Printer	1-60
	Touch Switch (CH5)	1-62
	Simulator	1-62
1.5	System Device Memory for Communication Confirmation	1-63
1.5.1	\$Pn (For 8-way Communication)	1-63
1.5.2	\$s518 (Ethernet Status Confirmation)	1-71

2.	SAIA	
2.1	PLC Connection	2-1
	Serial Connection	2-1
	Ethernet Connection	2-1
2.1.1	PCD	2-2
2.1.2	PCD S-BUS (Ethernet)	2-3
2.1.3	Wiring Diagrams	2-4
	When Connected at CN1:	2-4
	When Connected at MJ1/MJ2:	2-5
3.	SAMSUNG	
3.1	PLC Connection	3-1
	Serial Connection	3-1
3.1.1	SPC Series	3-3
3.1.2	N_plus	3-4
3.1.3	SECNET	3-8
3.1.4	Wiring Diagrams	3-9
	When Connected at CN1:	3-9
	When Connected at MJ1/MJ2:	3-12
4.	SanRex	
4.1	Temperature Controller / Servo / Inverter Connection	4-1
	Serial Connection	4-1
4.1.1	DC AUTO (HKD type)	4-2
4.1.2	Wiring Diagrams	4-3
	When Connected at CN1:	4-3
	When Connected at MJ1/MJ2:	4-3
5.	SANMEI	
5.1	Temperature Controller/Servo/Inverter Connection	5-1
	AC Servo Driver	5-1
5.1.1	Cuty Axis	5-2
5.1.2	Wiring Diagrams	5-7
	When Connected at CN1:	5-7
	When Connected at MJ1/MJ2:	5-8
6.	SHARP	
6.1	PLC Connection	6-1
	Serial Connection	6-1
	Ethernet Connection	6-2
6.1.1	JW Series	6-3
6.1.2	JW100/70H COM Port	6-6
6.1.3	JW20 COM Port	6-8
6.1.4	JW300 Series	6-10
6.1.5	JW Series (Ethernet)	6-13
6.1.6	JW311/312/321/322 Series (Ethernet)	6-17
6.1.7	JW331/332/341/342/352/362 Series (Ethernet)	6-18
6.1.8	Wiring Diagrams	6-19
	When Connected at CN1:	6-19
	When Connected at MJ1/MJ2:	6-22
6.2	Temperature Controller/Servo/Inverter Connection	6-25
	ID Controller	6-25
6.2.1	DS-30D	6-26
6.2.2	DS-32D	6-31
6.2.3	Wiring Diagrams	6-36
	When Connected at CN1:	6-36
	When Connected at MJ1/MJ2:	6-37

7.	SHIMADEN	
7.1	Temperature Controller / Servo / Inverter Connection	7-1
	Controller / Indicator / Servo Controller	7-1
7.1.1	SHIMADEN Standard Protocol	7-2
7.1.2	Wiring Diagrams	7-7
	When Connected at CN1:	7-7
	When Connected at MJ1/MJ2:	7-8
8.	SHINKO TECHNOS	
8.1	Temperature Controller/Servo/Inverter Connection	8-1
	Serial Connection	8-1
8.1.1	C Series	8-2
8.1.2	FC Series	8-4
8.1.3	GC Series	8-5
8.1.4	JCx-300 Series	8-6
8.1.5	ACS-13A	8-7
8.1.6	ACD/ACR Series	8-8
8.1.7	WCL-13A	8-9
8.1.8	DCL-33A	8-10
8.1.9	PCD-33A	8-11
8.1.10	PC-900	8-12
8.1.11	Wiring Diagrams	8-13
	When Connected at CN1:	8-13
	When Connected at MJ1/MJ2:	8-14
9.	Siemens	
9.1	PLC Connection	9-1
	Serial Connection	9-1
	Ethernet Connection	9-2
9.1.1	S5 (PG Port)	9-3
9.1.2	S7	9-5
9.1.3	S7-200PPI	9-7
9.1.4	S7-200(Ethernet ISOTCP)	9-9
9.1.5	S7-300/400MPI	9-12
9.1.6	S7-300/400 (Ethernet ISOTCP)	9-13
9.1.7	S7-300/400 (Ethernet TCP/IP PG Protocol)	9-15
9.1.8	S7-1200/1500 (Ethernet ISOTCP)	9-17
9.1.9	TI500 / 505 Series	9-22
9.1.10	Wiring Diagrams	9-24
	When Connected at CN1:	9-24
	When Connected at MJ1/MJ2:	9-28
10.	SINFONIA TECHNOLOGY	
10.1	PLC Connection	10-1
	Serial Connection	10-1
10.1.1	SELMART	10-2
10.1.2	Wiring Diagrams	10-4
	When Connected at CN1:	10-4
	When Connected at MJ1/MJ2:	10-4
11.	SUS	
11.1	Thermo Controller/Servo/Inverter	11-1
	Electric Actuator	11-1
11.1.1	XA-A*	11-2
11.1.2	Wiring Diagrams	11-6
	When Connected at CN1:	11-6
	When Connected at MJ1/MJ2:	11-6

12.	TECO	
12.1	PLC Connection	12-1
	Serial Connection	12-1
12.1.1	TP03 (MODBUS RTU)	12-2
12.1.2	Wiring Diagrams	12-4
	When Connected at CN1:	12-4
	When Connected at MJ1/MJ2:	12-5
13.	Telemecanique	
13.1	PLC Connection	13-1
	Serial Connection	13-1
13.1.1	TSX Micro	13-2
13.1.2	Wiring Diagrams	13-3
	When Connected at CN1:	13-3
	When Connected at MJ1/MJ2:	13-3
14.	TOHO	
14.1	Temperature Controller/Servo/Inverter Connection	14-1
	Digital Temperature Controller	14-1
14.1.1	TTM-000	14-2
14.1.2	TTM-00BT	14-4
14.1.3	TTM-200 (MODBUS RTU)	14-6
14.1.4	Wiring Diagrams	14-7
	When Connected at CN1:	14-7
	When Connected at MJ1/MJ2:	14-9
15.	Tokyo Chokoku Marking Products	
15.1	Thermo Controller/Servo/Inverter	15-1
	Portable Dot Marker	15-1
15.1.1	MB3315/1010	15-2
15.1.2	Wiring Diagrams	15-4
	When Connected at CN1:	15-4
	When Connected at MJ1/MJ2:	15-4
16.	TOSHIBA	
16.1	PLC Connection	16-1
	Serial Connection	16-1
	Ethernet Connection	16-2
16.1.1	T Series / V Series (T Compatible)	16-3
16.1.2	T Series / V Series (T Compatible) (Ethernet UDP/IP)	16-7
16.1.3	EX Series	16-9
16.1.4	nv Series (Ethernet UDP/IP)	16-11
16.1.5	Wiring Diagrams	16-13
	When Connected at CN1:	16-13
	When Connected at MJ1/MJ2:	16-15
16.2	Temperature Controller/Servo/Inverter Connection	16-17
	Inverter	16-17
16.2.1	VF-S7	16-18
16.2.2	VF-S9	16-20
16.2.3	VF-S11	16-22
16.2.4	VF-S15	16-25
16.2.5	VF-A7	16-26
16.2.6	VF-AS1	16-28
16.2.7	VF-P7	16-29
16.2.8	VF-PS1	16-29
16.2.9	VF-FS1	16-30
16.2.10	VF-MB1	16-31
16.2.11	VF-nC1	16-32
16.2.12	VF-nC3	16-34
16.2.13	Wiring Diagrams	16-36
	When Connected at CN1:	16-36
	When Connected at MJ1/MJ2:	16-38

17.	TOSHIBA MACHINE	
17.1	PLC Connection	17-1
	Serial Connection	17-1
17.1.1	TC200	17-2
17.1.2	Wiring Diagrams	17-7
	When Connected at CN1:	17-7
	When Connected at MJ1/MJ2:	17-9
17.2	Temperature Controller/Servo/Inverter Connection	17-11
	Servo Amplifier	17-11
17.2.1	VELCONIC Series	17-12
17.2.2	Wiring Diagrams	17-15
	When Connected at CN1:	17-15
	When Connected at MJ1/MJ2:	17-15
18.	TURCK	
18.1	PLC Connection	18-1
	Ethernet Connection	18-1
18.1.1	BL Series Distributed I/O (MODBUS TCP/IP)	18-2
19.	UNIPULSE	
19.1	Temperature Controller/Servo/Inverter Connection	19-1
	Digital Indicator	19-1
	Load Cell Indicator	19-1
	Weighing Controller	19-1
19.1.1	F340A	19-2
19.1.2	F371	19-4
19.1.3	F800	19-7
19.1.4	F805A	19-11
19.1.5	F720A	19-16
19.1.6	Wiring Diagrams	19-20
	When Connected at CN1:	19-20
	When Connected at MJ1/MJ2:	19-21
20.	UNITRONICS	
20.1	PLC Connection	20-1
	Serial Connection	20-1
	Ethernet Connection	20-1
20.1.1	M90/M91/Vision Series (ASCII)	20-2
20.1.2	Vision Series (ASCII Ethernet TCP/IP)	20-8
20.1.3	Wiring Diagrams	20-12
	When Connected at CN1:	20-12
	When Connected at MJ1/MJ2:	20-13
21.	ULVAC	
21.1	Thermo Controller/Servo/Inverter	21-1
	Vacuum Gauge	21-1
21.1.1	G-TRAN Series	21-2
21.1.2	Wiring Diagrams	21-5
	When Connected at CN1:	21-5
	When Connected at MJ1/MJ2:	21-7
22.	VIGOR	
22.1	PLC Connection	22-1
	Serial Connection	22-1
22.1.1	M Series	22-2
22.1.2	Wiring Diagrams	22-3
	When Connected at CN1:	22-3
	When Connected at MJ1/MJ2:	22-4

23.	WAGO	
23.1	PLC Connection	23-1
	Serial Connection	23-1
	Ethernet Connection	23-1
23.1.1	750 Series (MODBUS RTU)	23-2
23.1.2	750 Series (MODBUS Ethernet)	23-6
23.1.3	Wiring Diagrams	23-10
	When Connected at CN1:	23-10
	When Connected at MJ1/MJ2:	23-10
24.	XINJE	
24.1	PLC Connection	24-1
	Serial Connection	24-1
24.1.1	XC Series (MODBUS RTU)	24-2
24.1.2	Wiring Diagrams	24-4
	When Connected at CN1:	24-4
	When Connected at MJ1/MJ2:	24-5
25.	YAMAHA	
25.1	Temperature Controller/Servo/Inverter Connection	25-1
	Serial Connection	25-1
25.1.1	RCX142	25-2
25.1.2	Wiring Diagrams	25-16
	When Connected at CN1:	25-16
	When Connected at MJ1/MJ2:	25-16
26.	Yaskawa Electric	
26.1	PLC Connection	26-1
	Serial Connection	26-1
	Ethernet Connection	26-1
26.1.1	Memobus	26-2
26.1.2	CP9200SH/MP900	26-3
26.1.3	MP2300 (MODBUS TCP/IP)	26-5
26.1.4	CP/MP Expansion Memobus (UDP/IP)	26-7
26.1.5	MP2000 Series	26-9
26.1.6	MP2000 Series (UDP/IP)	26-10
26.1.7	Wiring Diagrams	26-11
	When Connected at CN1:	26-11
	When Connected at MJ1/MJ2:	26-14
27.	Yokogawa Electric	
27.1	PLC Connection	27-1
	Serial Connection	27-1
	Ethernet Connection	27-2
27.1.1	FA-M3/FA-M3R	27-3
27.1.2	FA-M3/FA-M3R (Ethernet UDP/IP)	27-10
27.1.3	FA-M3/FA-M3R (Ethernet UDP/IP ASCII)	27-12
27.1.4	FA-M3/FA-M3R (Ethernet TCP/IP)	27-14
27.1.5	FA-M3/FA-M3R (Ethernet TCP/IP ASCII)	27-16
27.1.6	FA-M3V	27-18
27.1.7	FA-M3V (Ethernet)	27-20
27.1.8	FA-M3V (Ethernet ASCII)	27-22
27.1.9	Wiring Diagrams	27-24
	When Connected at CN1:	27-24
	When Connected at MJ1/MJ2:	27-25

27.2	Temperature Controller/Servo/Inverter Connection	27-26
	Temperature Controller	27-26
	Digital Indicating Controller	27-26
	Multi-point Temperature Controller	27-27
	Chart Recorder	27-27
27.2.1	UT100	27-28
27.2.2	UT750	27-29
27.2.3	UT550	27-30
27.2.4	UT520	27-30
27.2.5	UT350	27-30
27.2.6	UT320	27-30
27.2.7	UT450	27-30
27.2.8	UT32A/35A (MODBUS RTU)	27-31
27.2.9	UT52A/55A (MODBUS RTU)	27-31
27.2.10	UT75A (MODBUS RTU)	27-31
27.2.11	UT2400/2800	27-32
27.2.12	μR10000/20000 (Ethernet TCP/IP)	27-34
27.2.13	Wiring Diagrams	27-52
	When Connected at CN1:	27-52
	When Connected at MJ1/MJ2:	27-53
28.	MODBUS	
28.1	PLC Connection	28-1
	Serial Connection	28-1
	Ethernet Connection	28-1
28.1.1	MODBUS RTU	28-2
28.1.2	MODBUS RTU EXT Format	28-4
28.1.3	MODBUS ASCII	28-8
28.1.4	MODBUS TCP/IP (Ethernet)	28-9
28.1.5	MODBUS TCP/IP (Ethernet) EXT Format	28-10
28.1.6	MODBUS TCP/IP (Ethernet) Sub Station	28-14
28.1.7	Wiring Diagrams	28-16
	When Connected at CN1:	28-16
	When Connected at MJ1/MJ2:	28-17
29.	Barcode Reader	
29.1	Barcode Reader Connection	29-1
	Serial Connection	29-1
	USB Connection	29-1
29.1.1	Communication Setting	29-2
29.1.2	I/F Device Memory	29-3
29.1.3	Control Device Memory	29-4
29.1.4	Wiring Diagrams	29-5
	When Connected at CN1:	29-5
	When Connected at MJ1/MJ2:	29-5
30.	Slave Communication Function	
30.1	V-Link	30-1
30.1.1	Overview	30-1
30.1.2	Communication Setting	30-2
	Editor	30-2
	MONITOUCH	30-3
30.1.3	Wiring Diagrams	30-4
	When Connected at CN1:	30-4
	When Connected at MJ1/MJ2:	30-6
30.1.4	Protocol	30-8
	Read (with Sum Check and CR/LF)	30-8
	Write (with Sum Check and CR/LF)	30-9
	Items for Protocols	30-10
	Sum Check Code (SUM): 2 Bytes	30-11
30.1.5	1-byte Character Code List	30-13

---

30.2	Modbus RTU Slave Communication.....	30-14
30.3	Modbus TCP/IP Slave Communication .....	30-14
30.4	Modbus ASCII Slave Communication.....	30-14
31.	Universal Serial Communication	
31.1	Overview .....	31-1
	Overview of Communication.....	31-1
	Differences between Connecting to General-purpose Computer and Connecting to PLC .....	31-2
	System Configuration.....	31-2
31.2	Wiring Diagrams .....	31-3
	When Connected at CN1:.....	31-3
	When Connected at MJ1/MJ2: .....	31-5
31.3	Hardware Settings .....	31-7
	PLC Settings .....	31-7
	Control Device Memory.....	31-10
31.4	Standard Type Protocol .....	31-17
31.4.1	Standard Type Protocol .....	31-17
	Connection (1 : 1), Transmission Mode (with Sum Check).....	31-18
	Connection (1 : 1), Transmission Mode (with Sum Check and CR/LF) .....	31-19
	Connection (1 : n), Transmission Mode (with Sum Check).....	31-20
	Connection (1 : n), Transmission Mode (with Sum Check and CR/LF) .....	31-21
31.4.2	Protocol Contents .....	31-22
	Transmission Control Code .....	31-22
	Port Number.....	31-22
	Command .....	31-22
	Sum Check Code (SUM).....	31-23
	Error Codes.....	31-23
	Response Time and BUSY .....	31-24
31.4.3	Command.....	31-25
	RC: Read CHR.....	31-25
	RM: Read Memory.....	31-26
	WC: Write CHR.....	31-27
	WM: Write Memory.....	31-28
	TR: Retry Command .....	31-29
	WI: Interrupt Setting Command .....	31-30
	RI: Interrupt Status Read Command .....	31-31
31.4.4	Interrupt (ENQ) .....	31-32
	1-byte Character Code List .....	31-34
31.5	Device Memory Map.....	31-35
	Device Memory .....	31-35
	User Device Memory (\$u).....	31-35
	System Device Memory (\$s) .....	31-36

## Connection Compatibility List

# 1. Overview

---

- 1.1 System Configuration
- 1.2 Physical Ports
- 1.3 Connection Methods
- 1.4 Hardware Settings
- 1.5 System Device Memory for Communication Confirmation


# 1.1 System Configuration

## 1.1.1 Overview

The V9 series is equipped with nine physical ports consisting of three serial ports, two LAN ports <sup>\*1</sup>, one WLAN port <sup>\*2</sup>, one USB-A port, one USB mini-B port, and one network communication port <sup>\*3</sup>. The LAN port can open eight ports simultaneously.

You can use the physical ports to connect a maximum of eight different models of devices and allow the V9 series to communicate with them at the same time. This is called 8-way communication.

- \*1 Only models with an "L" in the model name have two LAN ports.
- \*2 Only for models with an "R" in the model name.
- \*3 A communication interface unit (CUR-xx) is required to enable network communication.

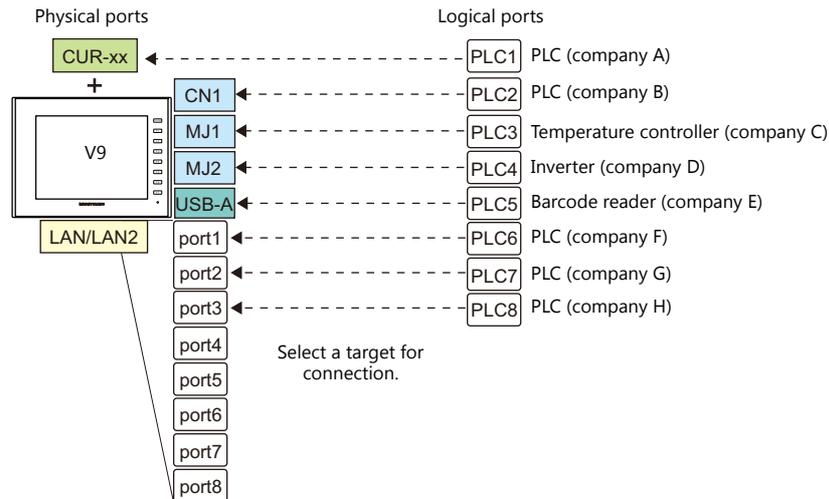

Physical Ports				No. of Ports	Applicable Devices	
					8-way Communication	Other than 8-way
Serial	CN1	RS-232C / RS-422/485	All models (The "DUR-00" is required for V907W and V906.)	1	PLC, temperature controller, servo, inverter, barcode reader, V-Link, slave communication (Modbus RTU)	-
	MJ1	RS-232C/RS-485 (2-wire connection)	All models	1		Computer (screen program transfer, MJ1), serial printer
	MJ2	RS-232C/RS-485 (2-wire connection)	Except V907W/V906	1		
RS-232C/RS-422 (4-wire connection), RS-485 (2-wire connection)		V907W/V906				
Ethernet	LAN	All models		8	PLC, slave communication (Modbus TCP/IP)	Computer, network camera
	LAN2	Models with "L" in model name		8	PLC, slave communication (Modbus TCP/IP)	Computer
	WLAN	Models with "R" in model name		1	-	Computer
USB	USB-A	All models		1	Barcode reader	Printer (EPSON ESC/P-R compatible), USB flash drive, keyboard, mouse, USB-hub
	USB mini-B	All models		1	-	Printer (PictBridge), computer (screen program transfer)
Network	EXT1	OPCN-1	CUR-00	1	PLC	-
		T-Link	CUR-01			
		CC-LINK	CUR-02			
		Ethernet	CUR-03			
		PROFIBUS-DP	CUR-04			
		SX BUS	CUR-06			
		DeviceNet	CUR-07			
	FL-Net	CUR-08				
	Serial (CN1)	DUR-00 (V907W and V906 only)			PLC, temperature controller, servo, inverter, barcode reader, V-Link, slave communication (Modbus RTU)	-

- Only the logical port PLC1 can be selected for the following devices and functions. Thus, they cannot be connected at the same time.
  - Devices
    - Network connection (CUR-xx), without PLC connection, Mitsubishi Electric A-Link + Net10, AB Control Logix, Allen-Bradley Micro800 controllers, Siemens S7-200PPI, Siemens S7-300/400 MPI connection
  - Functions
    - Multi-link2, Multi-link, ladder transfer, ladder monitor, MICREX SX variable name cooperation function

## 1.1.2 System Composition

### Serial Communication

- 1 : 1 Connection

A communication port is selectable from CN1, MJ1, and MJ2.


For more information, refer to "1 : 1 Connection" (page 1-13) in "1.3 Connection Methods".



- 1 : n Connection

A communication port is selectable from CN1, MJ1, and MJ2. A maximum of 31 units of the same model can be connected to each port.


For more information, refer to "1 : n Connection (Multi-drop)" (page 1-20) in "1.3 Connection Methods".

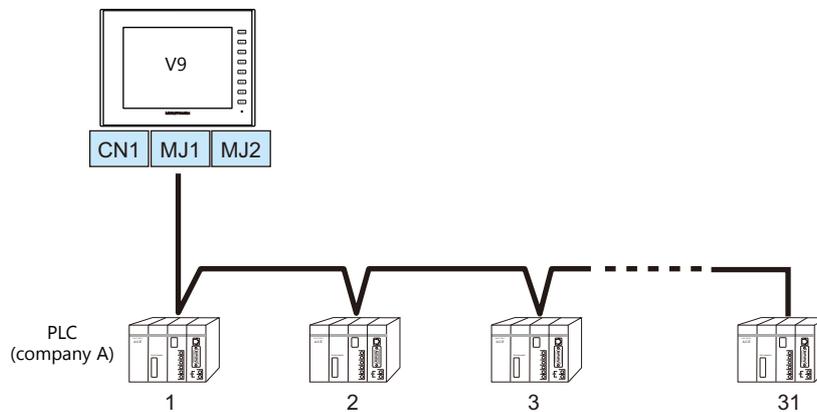

- 3-way Connection

The V9 series is allowed to communicate with three different models of devices at the same time via three serial ports. A maximum of 31 units of the same model can be connected to each port.

The connection method is the same as those for 1 : 1 and 1 : n.

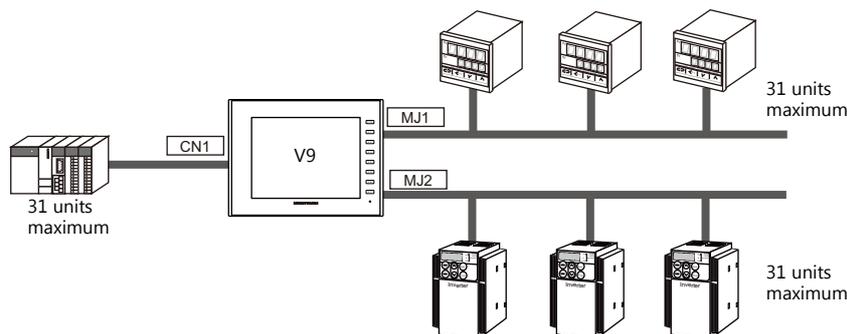

- n : 1 Connection

Multiple V9 units can be connected to one PLC or temperature controller.

For more information, refer to "n : 1 Connection (Multi-link2)" (page 1-23), "n : 1 Connection (Multi-link2 (Ethernet))" (page 1-32), "n : 1 Connection (Multi-link)" (page 1-38) in "1.3 Connection Methods".


- n : n Connection

Multiple V9 units can be connected to multiple PLCs.


For more information, refer to "n : n Connection (1 : n Multi-link2 (Ethernet))" (page 1-35) in "1.3 Connection Methods".

## Ethernet Communication

Because eight communication ports can be opened, the V9 series is allowed to communicate with eight models of PLCs at the same time.

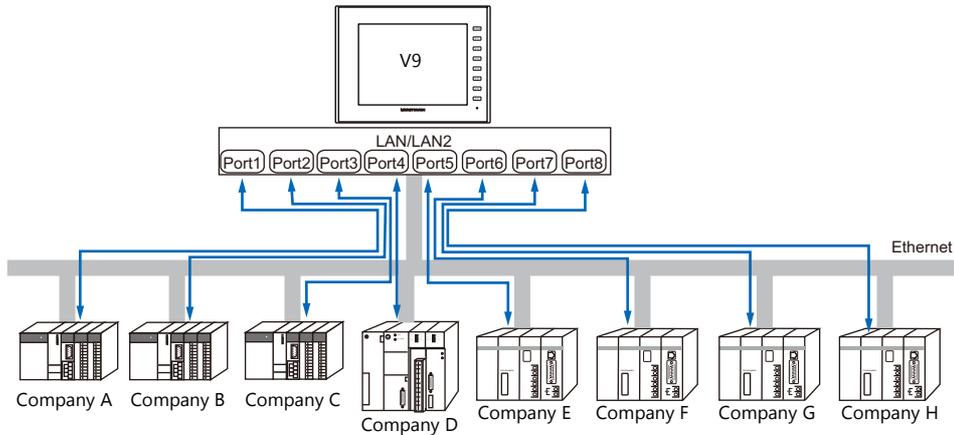

When there are two or more PLCs of the same model, the V9 series is allowed to carry out 1 : n communication via one port.

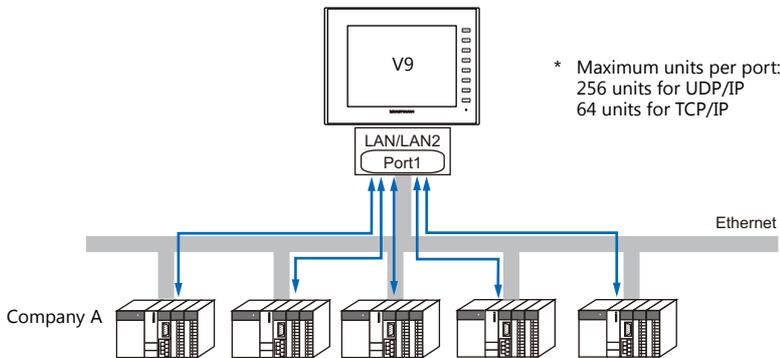


\* Maximum units per port:  
256 units for UDP/IP  
64 units for TCP/IP

\* For more information, refer to "1.3.2 Ethernet Communication" (page 1-43) in "1.3 Connection Methods".

## Mixed Serial-Ethernet Communication

In the case of mixed serial-Ethernet communication, the V9 series is allowed to communicate with eight different models of devices at the same time.

- Connection of 3 models for serial communication and 5 models for Ethernet communication

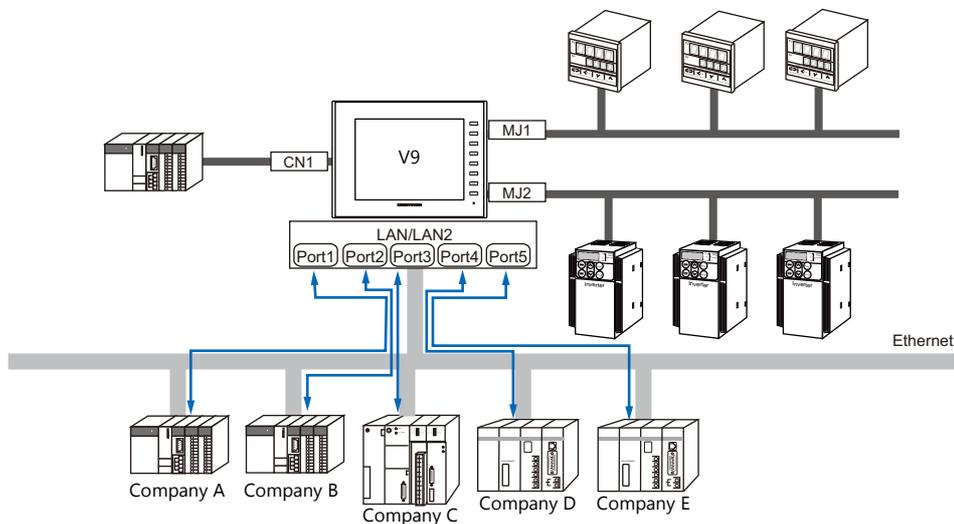

\* For the connection method, refer to "1.3.1 Serial Communication" and "1.3.2 Ethernet Communication".

## 1.2 Physical Ports

### 1.2.1 CN1

The CN1 port supports communication via RS-232C, RS-422 (4-wire system), and RS-485 (2-wire system). The optional unit "DUR-00" is required for V907W and V906. (The "DUR-00" cannot be used together with the "CUR-xx".) The signal level can be changed between RS-232C and RS-422/485 under [Communication Setting] of the editor.

\* The signal level can be changed between RS-232C and RS-422/485 in the Local mode on the V9 unit as well. For details, refer to the separate V9 Series Hardware Specifications manual.


#### CAUTION

When executing communication via RS-232C, set the terminating resistance DIP switches to OFF.

- Other than V907W or V906: Set DIP switches 5 and 7 to OFF.
- V907W and V906: Set DIP switches 1 and 2 on the optional "DUR-00" to OFF.

For more information on DIP switches, refer to "1.2.7 DIP Switch (DIPSW) Settings" (page 1-12).

### Pin Arrangement

CN1 Dsub 9pin, Female	No.	RS-232C		RS-422/RS-485	
		Name	Contents	Name	Contents
	1	NC	Not used	+RD	Receive data (+)
	2	RD	Receive data	-RD	Receive data (-)
	3	SD	Send data	-SD	Send data (-)
	4	NC	Not used	+SD	Send data (+)
	5	0V	Signal ground	0V	Signal ground
	6	NC	Not used	+RS	RS send data (+)
	7	RS	RS request to send	-RS	RS send data (-)
	8	CS	CS clear to send	NC	Not used
	9	NC	Not used	+5V	Terminating resistance

### Recommended Connector for Communication Cable

Recommended Connector	
DDK's 17JE-23090-02(D8C)-CG	D-sub 9-pin, male, inch screw thread, with hood, RoHS compliant

### Applicable Devices

Applicable Devices
PLC, temperature controller, inverter, servo, barcode reader

## 1.2.2 MJ1/MJ2

The MJ1 and MJ2 ports support communication via RS-232C, RS-485 (2-wire system), RS-422 (4-wire system, supported by the MJ2 port of V907W/V906 only).


MJ1 is also usable as a screen program transfer port.

### CAUTION

- MJ1 and MJ2 use the same type RJ-45 connector as the LAN connector. To prevent damage to the device from an external power supply of the MJ, check the indication on the unit and insert a cable in the correct position.
- RS-422 (4-wire system) is supported by the MJ2 port of V907W and V906 only. The MJ1 and MJ2 ports except these units are not usable for connection via RS-422 (4-wire system). Use the CN1 port instead or a commercially available RS-232C-to-RS-422 converter.

### Pin Arrangement

#### MJ1 (All Models) / MJ2 (V910W/V915/V912/V910/V908)


MJ1/MJ2 RJ-45 8pin	No.	Signal	Contents
	1	+SD/RD	RS-485 + data
	2	-SD/RD	RS-485 - data
	3	+5V	Externally supplied +5 V*
	4		
	5	SG	Signal ground
	6		
	7	RD	RS-232C receive data
	8	SD	RS-232C send data

\* For MJ1, MJ2 and USB A, the maximum allowable current is 150 mA in total (only when the installation angle of MONITOUCH is within 60° to 120°).

#### MJ2 (V907W/V906)

### CAUTION

Before using MJ2, select whether it is used as an RS-232C/RS-485 (2-wire system) or RS-422 (4-wire system) port using the slide switch. The switch is factory-set to RS-232C/RS-485 (2-wire system).

MJ2 RJ-45 8-pin	No.	Slide Switch (RS-232C/RS-485)		Slide Switch (RS-422)	
		Signal	Contents	Signal	Contents
	1	+SD/RD	RS-485 + data	+SD	RS-422 + send data
	2	-SD/RD	RS-485 - data	-SD	RS-422 - send data
	3	+5 V	Externally supplied +5 V * Max. 150 mA	+5V	Externally supplied +5 V * Max. 150 mA
	4				
	5	SG	Signal ground	SG	Signal ground
	6				
	7	RD	RS-232C receive data	+RD	RS-422 + receive data
	8	SD	RS-232C send data	-RD	RS-422 - receive data

\* For MJ1, MJ2 and USB A, the maximum allowable current is 150 mA in total (only when the installation angle of MONITOUCH is within 60° to 120°).

### Recommended Cable

Recommended Cable
Hakko Electronics' cable "V6-TMP" 3, 5, 10 m


## Notes on Configuring a Cable




### CAUTION

Pins No. 3 and 4 are provided for external power supply. To prevent damage to the device due to wrong connection, check the pin numbers and connect wires correctly.

Pin arrangement  
on MONITOUCH




87654321



Pin arrangement  
on the cable



12345678



## Applicable Devices

Port	Applicable Devices
MJ1	Computer (screen program transfer)
	PLC, temperature controller, inverter, servo, barcode reader, V-Link, slave communication (Modbus RTU), serial printer
MJ2	PLC, temperature controller, inverter, servo, barcode reader, V-Link, slave communication (Modbus RTU), serial printer

### 1.2.3 LAN/LAN2




The LAN/LAN2 connector uses the same type RJ-45 connector as MJ1 and MJ2. Check the indication on the unit and insert a cable into the correct position.

#### LAN Port Specifications

Item	Specifications	
	100BASE-TX (IEEE802.3u)	10BASE-T (IEEE802.3)
Baud Rate	100 Mbps	10 Mbps
Transmission method	Base band	
Maximum segment length	100 m (between the node and the hub, or between hubs)	
Connecting cable	100 Ω, UTP cable, category 5	
Protocol	UDP/IP, TCP/IP	
Port	Auto-MDIX, Auto-Negotiation functions compatible	
Number of concurrently opened ports	8 ports	
Maximum number of connectable devices	UDP/IP: 256 units via each of ports PLC1 to PLC8 TCP/IP: 64 units via each of ports PLC1 to PLC8	

#### Maximum number of connectable devices

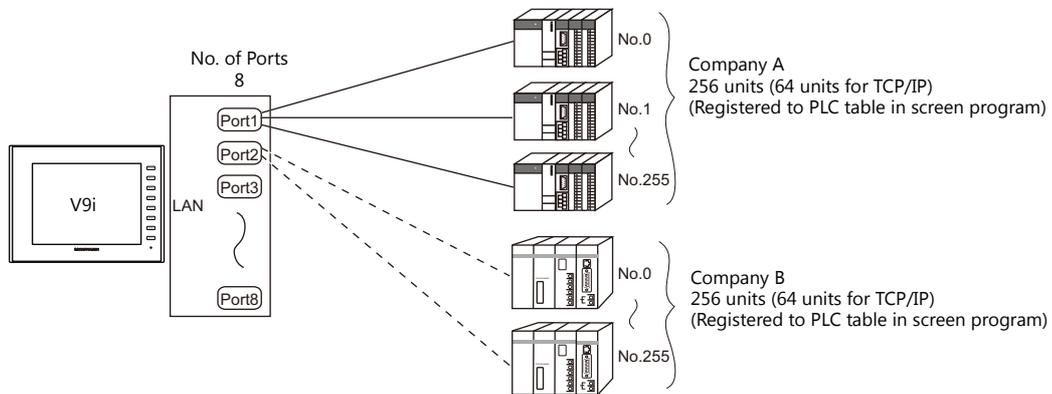

#### Pin Arrangement

LAN/LAN2 RJ-45	No.	Name	Contents
	1	TX+	Send signal +
	2	TX-	Send signal -
	3	RX+	Receive signal +
	4	NC	Not used
	5		
	6	RX-	Receive signal -
	7	NC	Not used
	8		

#### Applicable Devices

Applicable Devices
PLC, slave communication (Modbus TCP/IP), computer (screen program transfer, VNC connection, etc.)

## 1.2.4 WLAN

### WLAN Port Specifications

Item	Specification
Complying Antennas	<ul style="list-style-type: none"> <li>Built-in antenna of the V9 series unit</li> <li>V9-ANT (optional): External dipole antenna for wireless LAN</li> </ul>
Wireless LAN Standards	IEEE802.11b, IEEE802.11g, IEEE802.11n
Communication Frequency *1	2.4 GHz band (2.412 GHz to 2.462 GHz)
Channels *2	1 to 11 ch (for all countries) (Channel spacing: 5 MHz)
Transmission Mode	<ul style="list-style-type: none"> <li>11b: Direct-sequence spread spectrum (DS-SS)</li> <li>11g: Orthogonal frequency-division multiplexing (OFDM)</li> <li>11n: Orthogonal frequency-division multiplexing (OFDM)</li> </ul>
Transmission Rate	<ul style="list-style-type: none"> <li>11b: 1, 2, 5.5, 11 Mbps</li> <li>11g: 6, 9, 12, 18, 24, 36, 48, 54 Mbps</li> <li>11n, HT20 (GI: 800 ns) 1 stream: 6.5, 13, 19.5, 26, 39, 52, 58.5, 65 Mbps</li> <li>11n, HT20 (GI: 400 ns) 1 stream: 7.2, 14.4, 21.7, 29.9, 43.3, 57.8, 65, 72.2 Mbps</li> </ul>
Antenna Power (Output Power)	Max. 10 mW/MHz
Polarization	Vertical polarization
Horizontal radiation pattern	<ul style="list-style-type: none"> <li>Built-in antenna of V9 series unit: Directional</li> <li>V9-ANT (optional): Omnidirectional</li> </ul>
Operation Mode	<ul style="list-style-type: none"> <li>Infrastructure mode (access point, station)</li> <li>Ad-hoc mode</li> </ul> <p>* Selected in Local mode.</p>
Authentication	OPEN SYSTEM, WPA-PSK, WPA2-PSK
Encryption Method	NONE, WEP, TKIP, AES
Clients	Max. 6 (when the V9 series unit is in access point mode)
Conformance Standards *3 *4	<ul style="list-style-type: none"> <li>TELEC (Japanese Radio Law: Technical Regulations Conformity Certification, Article 2, clause 1-19)</li> <li>FCC Part15 SubPart C</li> <li>IC RSS-210, RSS-Gen</li> <li>R&amp;TTE: EN300328, EN301489-1, EN301489-17, EN62311, EN60950-1</li> <li>KC</li> </ul>

\*1 According to wireless LAN standards, the 2.4 GHz communication frequency band can be used indoors and outdoors. However, if UL standard certification is required, installation conditions must conform to those designated by the UL standard.

\*2 Channels 1 to 11 which can be used in all countries are enabled. Channels 12 to 14 cannot be used.

\*3 The V9 series unit will not conform to the above laws if using any antenna other than the built-in antenna or the optional V9-ANT for wireless LAN connection.


\*4 V9150iXRD, V9120iSRD, V9100iSRD and V9080iSRD conform with only the Japanese Radio Law.

### Applicable Devices

Connected Device
Computer (screen program transfer, VNC connection, etc.)

## Notes on Wireless LAN

- An antenna is built into the V9 series unit for use as a wireless communication antenna. Consider your usage environment, and if necessary, use Hakko Electronics' "V9-ANT" external dipole antenna (optional).  
(The built-in antenna of the V9 series unit can be used for wireless LAN communication within 10 meters from the front side of the V9 series unit. For wireless LAN communication around the V9 series unit (360°) or more than 10 meters away from the V9 series unit, use of the "V9-ANT" is recommended.)
- Radio waves used by wireless LAN pass through wood and glass, and therefore communication is possible even if floors and walls are made of wooden or glass material. However, radio waves cannot penetrate reinforcing rods, metal, or concrete, so if these materials are used communication is not possible.  
Signal intensity can be checked using the Received Signal Strength Indication (RSSI) as a guideline. Placing the V9 series unit (access point) so that the RSSI value is higher will attain a more stable communication status.  
A low RSSI value, which does not improve by moving the position of the V9 series unit (access point) or antenna, indicates that the radio wave intensity is weakened due to a long communication distance or physical obstructions.
- The radio waves used for wireless LAN communication are divided into frequency bands called channels (ch). The V9 series spaces the 2.4 GHz band into 11 channels (1 to 11 ch) at 5 MHz intervals. However, if the same channel is used or neighboring channels interfere with each other, communication speed may be reduced.  
We recommend selecting channels for access points so that the frequencies do not overlap, such as 1 ch, 5 ch and 9 ch (when using MONITOUCH as an access point).

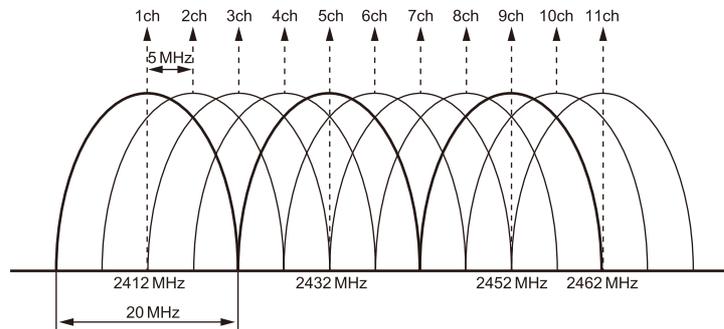

## Notes on radio waves

- The wireless LAN function of the V9 series corresponds to "radio equipment for radio stations (antenna power: 10 mW/MHz or less) of low-power data communication systems" defined by radio law, and therefore does not require a radio license.
- Depending on the peripheral environment or installation conditions, data transmission via wireless LAN may be unstable compared to wired connections and result in packet loss.  
Be sure to check the connection before actual use.
- Do not use the wireless LAN function in the following situations.
  - 1) Near a person who uses a cardiac pacemaker: The function may cause electromagnetic interference in cardiac pacemakers, leading to malfunctions.
  - 2) Near medical devices: The function may cause electromagnetic interference in medical devices, leading to malfunctions.
  - 3) Near microwaves: Microwaves may cause electromagnetic interference in wireless communications of the V9 series unit.
- Radio equipment which use the 2.4 GHz frequency band  
Models that support wireless LAN use the 2.4 GHz frequency band. This frequency band is used for industrial, scientific, and medical equipment; on-site radio stations (requiring a radio license) and certain low-power radio stations (no radio license required) for identifying moving objects in production lines; and amateur radio stations (requiring a radio license).
  - 1) Before using the wireless LAN function, check that there are no on-site radio stations and certain low-power radio stations for identifying moving objects or amateur radio stations in use nearby.
  - 2) If ever the V9 series unit causes wave interference to an on-site radio station for identifying moving objects, immediately stop wireless LAN communication and ensure that waves are no longer emitted. Then take necessary actions to resolve the interference (e.g. changing frequencies, relocating, installing partitions).
  - 3) If the V9 series unit causes wave interference to a certain low-power radio station for identifying moving objects, or if any other problem occurs, contact your distributor.
- The product will not conform to radio laws if using any antenna other than the built-in antenna of the V9 series unit or the external dipole antenna "V9-ANT" (optional).
- The wireless LAN function conforms to the radio standards in the following countries \*.  
Never use the V9 series unit outside of these countries.  
Australia, Belgium, Canada, Czech, Denmark, Finland, France, Germany, Great Britain, Greek, Hungary, Ireland, Italia, Japan, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, South Korea, Spain, Sweden, Switzerland, United States of America
 

\* V9150iXRD, V9120iSRD, V9100iSRD, and V9080iSRD are available for use in Japan only.

### Notes on security

A wireless LAN transmits data between a computer and a wireless LAN access point without using a LAN cable. Therefore, as long as radio waves are transmitted, LAN connection can be established whenever desired.

On the other hand, within a certain range, radio waves will pass through all obstructions (such as walls) and reaches the entire area. If security settings are not made, the following problems may occur.

Transmission contents can be eavesdropped on

- A malicious third party can eavesdrop on communication contents and steal identity such as your ID, password, and credit card numbers, or eavesdrop on email contents.

Unauthorized intrusions

- A malicious third party may access personal or corporate networks without authorization and steal identity or confidential information (information leakage).
- An attacker can impersonate you and send out false information (impersonation).
- Communication contents can be intercepted and then manipulated before sending (manipulation).
- Data and systems can be destroyed using a computer virus (destruction).

Principally, models that support wireless LAN have security functions. If such functions are properly configured before use, any risks of sustaining the above attacks can be reduced.

We recommend configuring security functions before use at your own judgment and responsibility, and fully understand the problems that may occur if the V9 series unit is used without configuring security functions.

## 1.2.5 EXT1 (Connection Port for Network Communication Unit/Optional Unit)


This communication port is used by connecting an optional communication interface unit "CUR-xx" or "DUR-00" (only for V907W and V906).

For more information on network communication, refer to the specifications for each unit.

Unit Model	Network	Unit Model	Network
CUR-00	OPCN-1	CUR-06	SX BUS
CUR-01	T-Link	CUR-07	DeviceNet
CUR-02	CC-Link Ver. 2.00/1.10/1.00	CUR-08	FL-net
CUR-03	Ethernet (UDP/IP) * TCP/IP communication not possible	DUR-00	Serial (CN1: RS-232C, RS-422/485) * Available only with V907W and V906.
CUR-04	PROFIBUS-DP		

## 1.2.6 USB

### USB Port Specifications

Item	Specifications
USB-A 	Applicable standards USB versions 2.0
USB mini-B 	Baud Rate High-speed 480 Mbps


### Applicable Devices

Port	Applicable Devices
USB-A	Printer (EPSON ESC/P-R compatible), barcode reader, USB flash drive, numeric keypad, keyboard, mouse, USB hub
USB mini-B	Printer (PictBridge), computer (screen program transfer)


## 1.2.7 DIP Switch (DIPSW) Settings

The V9 series is equipped with DIP switches 1 to 8. When setting the DIP switch, turn the power off.

- V910W/V915/V912/V910/V908

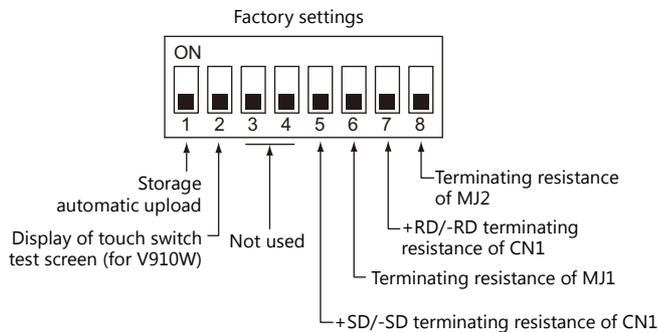

- V907W/V906

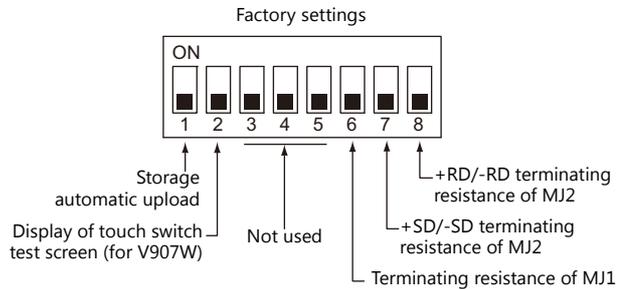

### DIPSW1\* (Storage Automatic Upload)

Set the DIPSW1 to ON when automatically uploading screen programs from storage such as an SD card or USB flash drive. For details, refer to the separate V9 Series Hardware Specifications manual.

\* Be sure to set the DIPSW1 to OFF when automatic upload is not performed.

### DIPSW2 (Display of Touch Switch Test Screen) For V910W and V907W Only

Set DIPSW2 to ON to check if touch switches are functioning properly.

### DIPSW5, 6, 7, 8 (Terminating Resistance Setting)

#### V910W/V915/V912/V910/V908

- When connecting a controller to CN1 via RS-422/485 (2-wire connection), set the DIPSW7 to ON.
- When connecting a controller to CN1 via RS-422/485 (4-wire connection), set the DIPSW5 and DIPSW7 to ON.
- When connecting a controller at MJ1 via RS-422/485 (2-wire connection), set the DIPSW6 to ON.
- When connecting a controller at MJ2 via RS-422/485 (2-wire connection), set the DIPSW8 to ON.



**CAUTION** When executing communication via RS-232C at CN1, set the DIP switches 5 and 7 to OFF.

#### V907W/V906


- When connecting a controller at MJ1 via RS-422/485 (2-wire connection), set the DIPSW6 to ON.
- When connecting a controller at MJ2 via RS-422/485 (2-wire connection), set the DIPSW8 to ON.
- When connecting a controller at MJ2 via RS-422/485 (4-wire connection), set the DIPSW7 and DIPSW8 to ON.

#### V907W/V906 with DUR-00

- When connecting a controller at CN1 via RS-422/485 (2-wire connection), set DIPSW1 on the DUR-00 to the ON position.
- When connecting a controller at CN1 via RS-422/485 (4-wire connection), set DIPSW1 and DIPSW2 on the DUR-00 to the ON position.

- DUR-00 DIP switches

Factory settings

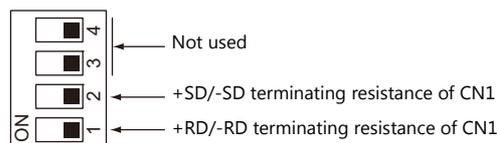

## 1.3 Connection Methods

### 1.3.1 Serial Communication

#### 1 : 1 Connection

##### Overview


- One set of the V9 is connected to one PLC (1 : 1 connection).
- You can make settings for 1 : 1 communication in [Communication Setting] for the logical ports PLC1 - PLC8. A communication port is selectable from CN1, MJ1, and MJ2.



RS-232C or RS-422 (RS-485) connection  
 Maximum length of wiring  
 RS-232C connection: 15 m  
 RS-422/RS-485 connection: 500 m

\* The maximum length of wiring varies depending on the connected device.  
 Check the specifications for each device.

- The V9 (master station) communicates with a PLC under the PLC's protocol. Therefore, there is no need to prepare a communication program for the PLC (slave station).
- The V9 reads from the PLC device memory for screen display. It is also possible to write switch data or numerical data entered through the keypad directly to the PLC device memory.

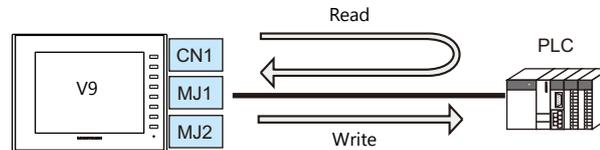


#### V-SFT Ver. 6 Settings

##### Hardware Settings


##### Selecting a device to be connected

Select the device for connection from [System Setting] → [Hardware Setting].

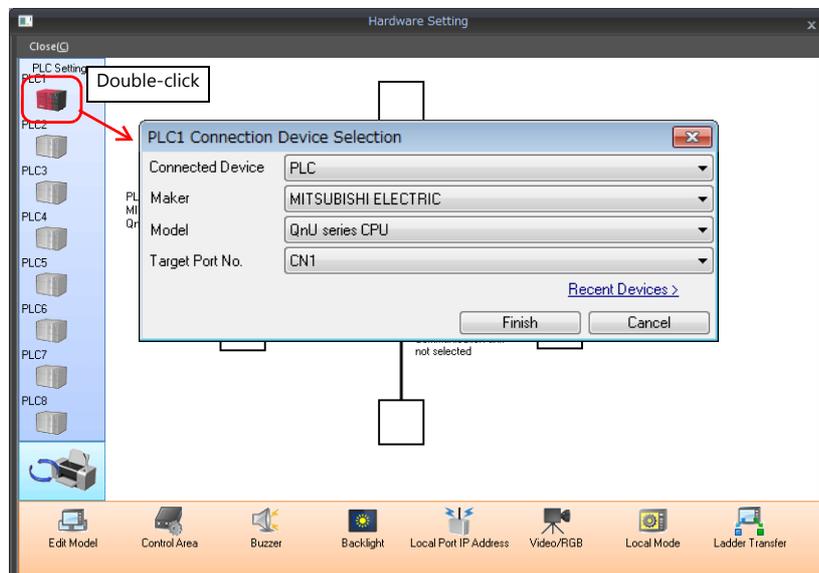

## PLC properties

Configure [Communication Setting] on the [PLC Properties] window.

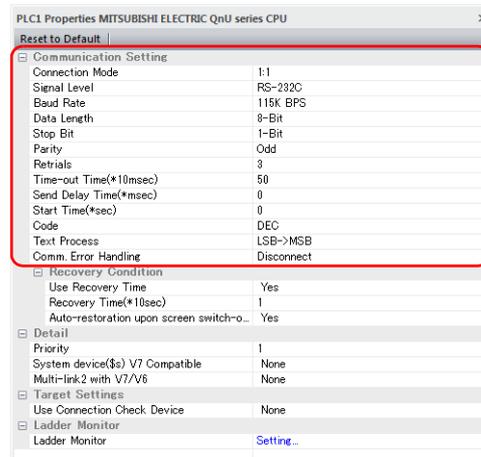

Item	Contents
Connection Mode	1 : 1
Signal Level	Configure according to the connected device.
Baud Rate	
Data Length	
Stop Bit	
Parity	
Target Port No.	
Transmission Mode	

For settings other than the above, see "1.4 Hardware Settings" (page 1-50).

## Settings of a Connected Device

Refer to the chapter of the respective manufacturer.

For descriptions of connecting PLCs, refer to the manual for each PLC.

## Wiring




### DANGER

Be sure to turn off the power before connecting cables. Otherwise, electrical shock or damage may occur.


## CN1

### RS-232C connection

- Prepare a communication cable on your side. Twisted pairs of 0.3 mm sq. or above are recommended.
- The maximum length for wiring is 15 m.
  - \* The maximum length varies depending on the connected device. Check the specifications for each device.
- Connect a shielded cable to either the V9 series or the connected device. The connection diagram shows the case where the shielded cable is connected on the V9 series side. Connect the cable to the FG terminal on the backside of MONITOUCH.

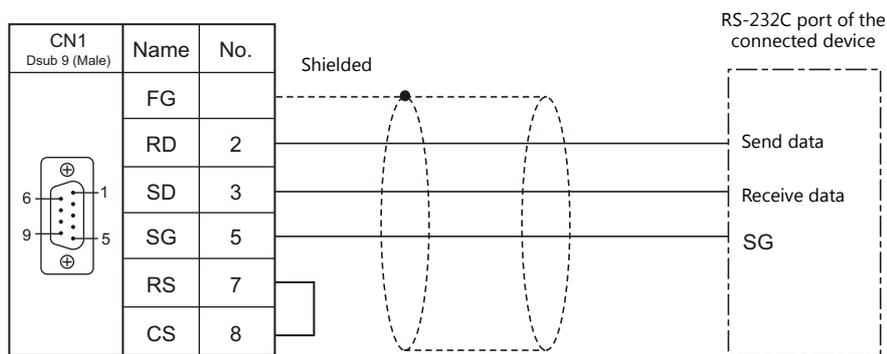


- If noise disturbs communications, establish connections between SD and SG and between RD and SG as pairs respectively, and connect a shielded cable to both the V9 series and the connected device.

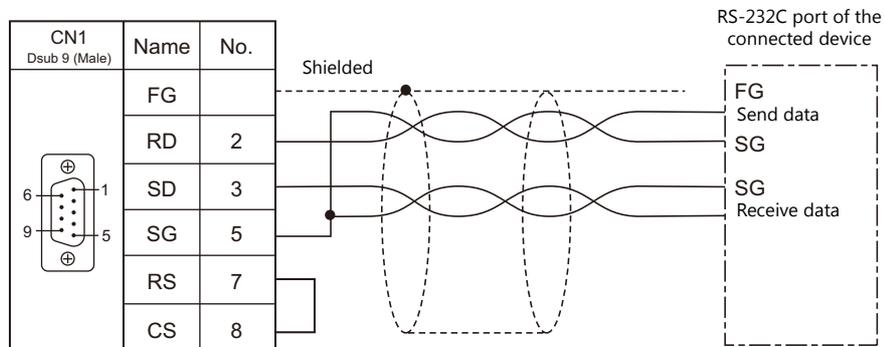


**RS-422/RS-485 connection**

- Prepare a communication cable on your side. Twisted pairs of 0.3 mm sq. or above are recommended.
- The maximum length of wiring is 500 m.
  - \* The maximum length varies depending on the connected device. Check the specifications for each device.
- Connect twisted pairs between +SD and –SD, and between +RD and –RD.
- If the PLC has a signal ground (SG) terminal, connect it.
- To use a terminal block for connection, use Hakko Electronics’ optionally available “TC-D9”.
- The DIP switch on the back of the V9 unit is used to set the terminating resistance. For more information on DIP switches, refer to “1.2.7 DIP Switch (DIPSW) Settings” (page 1-12).
- Connect a shielded cable to either the V9 series or the connected device. The connection diagram shows the case where the shielded cable is connected on the V9 series side. Connect the cable to the FG terminal on the backside of MONITOUCH.

- RS-422 (4-wire system)

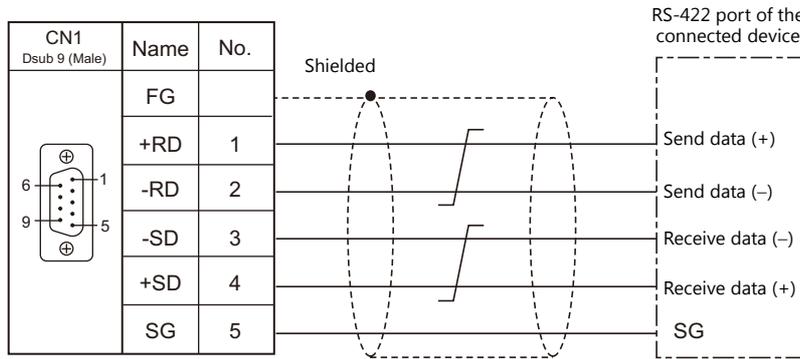


- RS-485 (2-wire system)

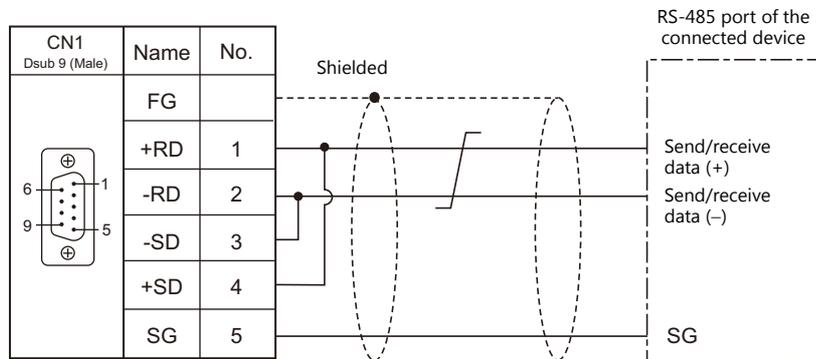


- If noise disturbs communications, connect a shielded cable to both the V9 series and the connected device.

- RS-422 (4-wire system)

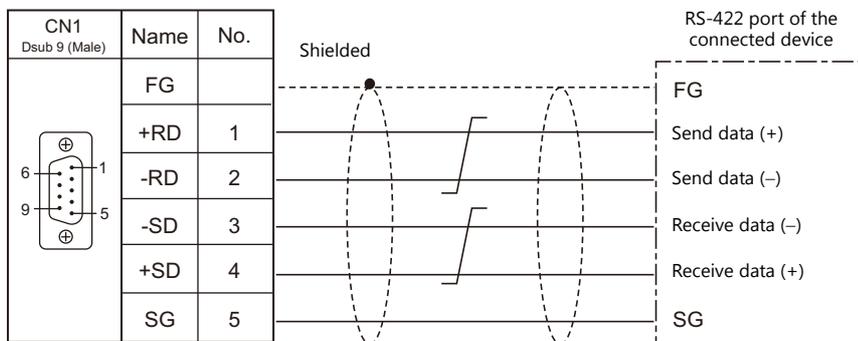

- RS-485 (2-wire system)

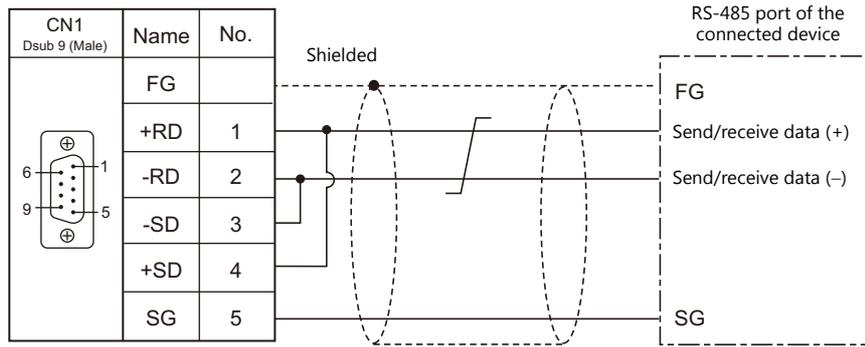


**MJ1/MJ2**


**RS-232C connection**

**CAUTION** Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.

- Use Hakko Electronics' cable "V6-TMP" (3, 5, 10 m) as a communication cable.
- The maximum length of wiring is 15 m.
  - \* The maximum length varies depending on the connected device. Check the specifications for each device.
- Connect a shielded cable to either the V9 series or the connected device. Connect the cable to the FG terminal on the backside of MONITOUCH.

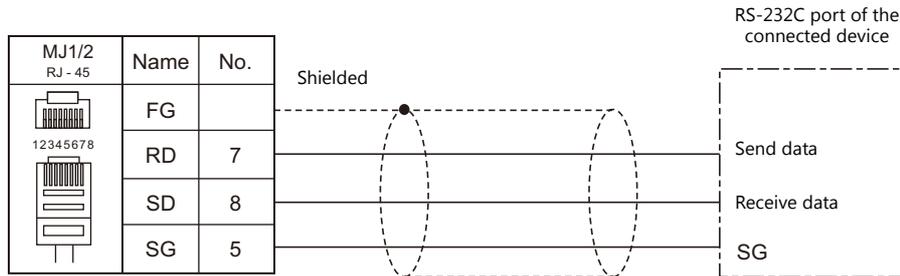

- If noise disturbs communications, connect a shielded cable to both the V9 series and the connected device.

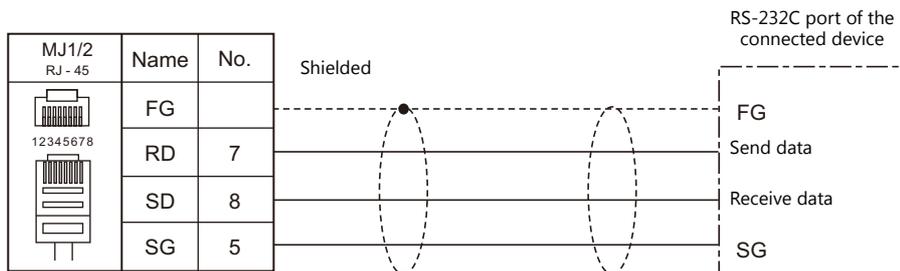


## RS-485 (2-wire system) connection




**CAUTION**

Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.

- Use Hakko Electronics' cable "V6-TMP" (3, 5, 10 m) as a communication cable.
- The maximum length of wiring is 500 m.
  - \* The maximum length varies depending on the connected device. Check the specifications for each device.
- If the PLC has a signal ground (SG) terminal, connect it.
- The DIP switch on the back of the V9 unit is used to set the terminating resistance. For more information, see "1.2.7 DIP Switch (DIPSW) Settings" (page 1-12).
- Connect a shielded cable to either the V9 series or the connected device. Connect the cable to the FG terminal on the backside of MONITOUCH.

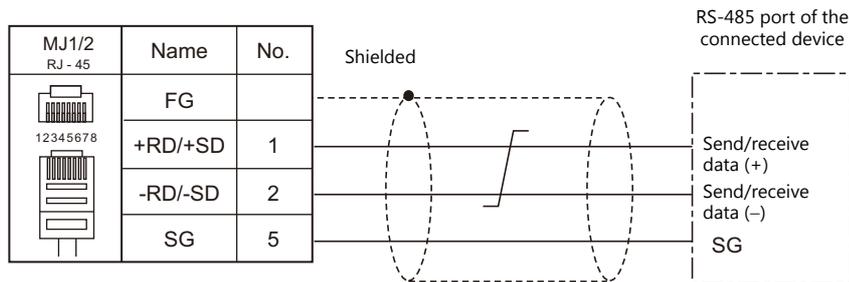

- If noise disturbs communications, connect a shielded cable to both the V9 series and the connected device.

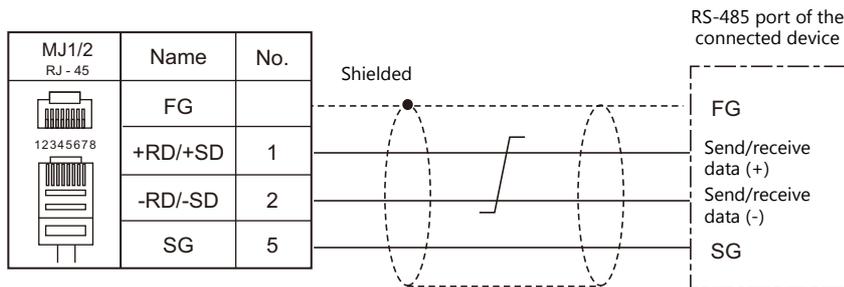


### RS-422 (4-wire system) connection




#### CAUTION

RS-422 (4-wire system) is supported by the MJ2 port of V907W and V906 only. Set the slide switch for signal level selection to RS-422 position (lower). The MJ1/MJ2 ports except these units are not usable for connection via RS-422 (4-wire system).

- Use Hakko Electronics' cable "V6-TMP" (3, 5, 10 m) as a communication cable.
- The maximum length of wiring is 500 m.
  - \* The maximum length varies depending on the connected device. Check the specifications for each device.
- If the PLC has a signal ground (SG) terminal, connect it.
- The DIP switch on the back of the V9 unit is used to set the terminating resistance. For more information, see "1.2.7 DIP Switch (DIPSW) Settings" (page 1-12).
- Connect a shielded cable to either the V9 series or the connected device. Connect the cable to the FG terminal on the backside of MONITOUCH.

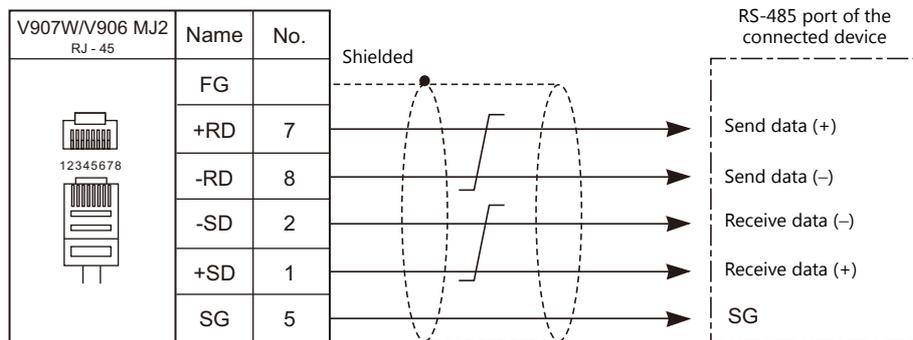


- If noise disturbs communications, connect a shielded cable to both the V9 series and the connected device.

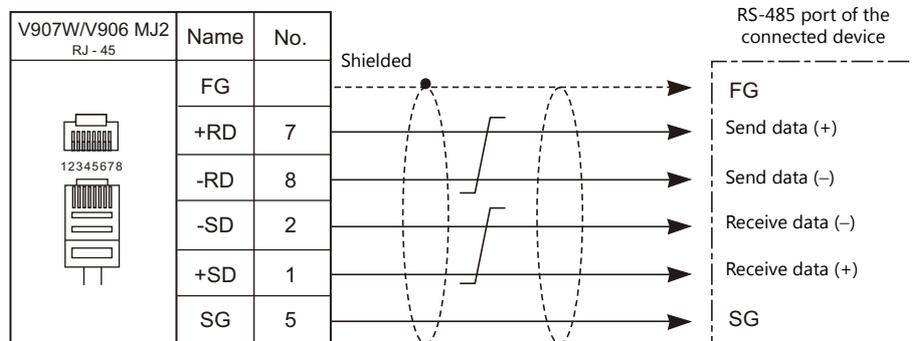

## 1 : n Connection (Multi-drop)

### Overview

- Multi-drop connection connects one V9 unit to multiple PLCs of the same model as a 1 : n connection. (Maximum connectable units: 31)
- You can make settings for 1 : n communication in [Communication Setting] for the logical ports PLC1 - PLC8. A communication port is selectable from CN1, MJ1, and MJ2.

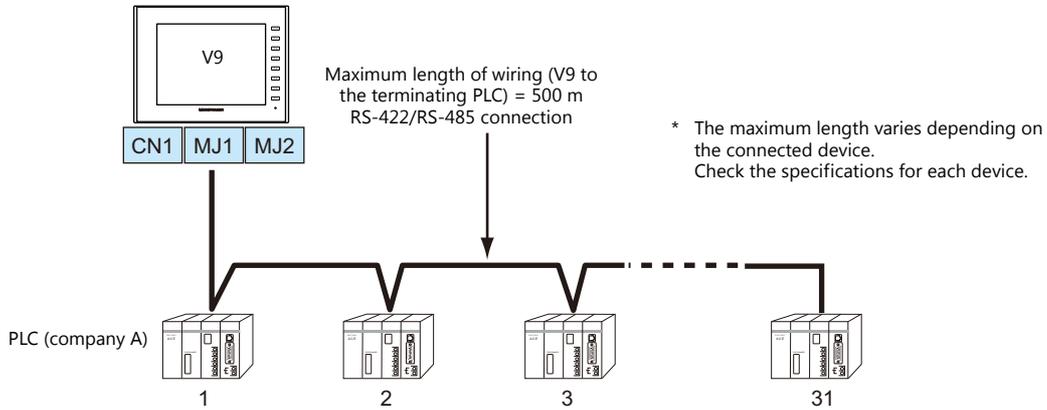


- The ladder transfer function is not available for a 1 : n connection.
- For models that support multi-drop connection, refer to the Connection Compatibility List provided at the end of this manual or the chapters on individual manufacturers.

### V-SFT Ver. 6 Settings

#### Hardware Settings


##### Selecting a device to be connected

Select the device for connection from [System Setting] → [Hardware Setting].

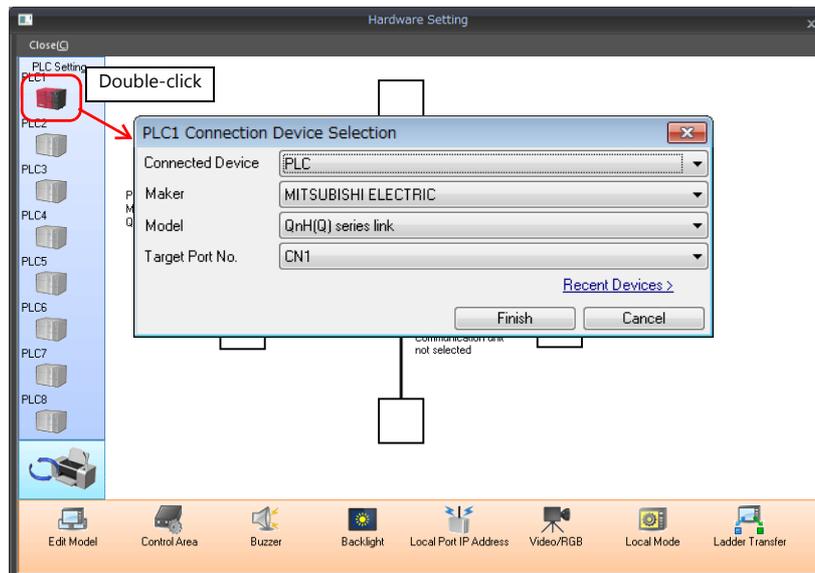

### PLC properties

Configure [Communication Setting] on the [PLC Properties] window.

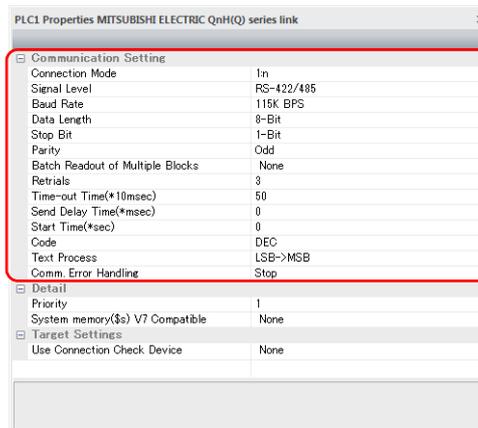

Item	Contents
Connection Mode	1 : n
Signal Level	RS-422/485
Baud Rate	Configure according to the connected device.
Data Length	
Stop Bit	
Parity	
Target Port No.	
Transmission Mode	

For settings other than the above, see "1.4 Hardware Settings" (page 1-50).

### Settings of a Connected Device

Refer to the chapter of the respective manufacturer.  
For descriptions of connecting PLCs, refer to the manual for each PLC.

### Wiring


**DANGER** Be sure to turn off the power before connecting cables. Otherwise, electrical shock or damage may occur.

### CN1

The wiring between a V9 and a connected device is the same as that for 1 : 1 communication. For description of wiring between connected devices, refer to the manuals issued by the manufacturers.

#### RS-422 (4-wire system) connection

- Connection example

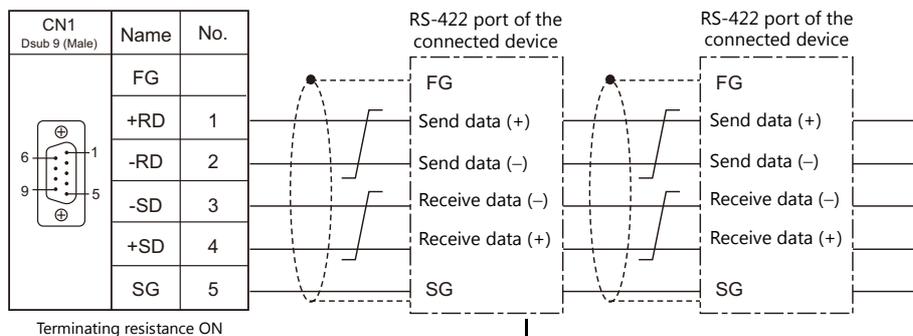


Terminating resistance ON

For wiring between connected devices, refer to the manuals issued by the manufacturers.

### RS-485 (2-wire system) connection

- Connection example

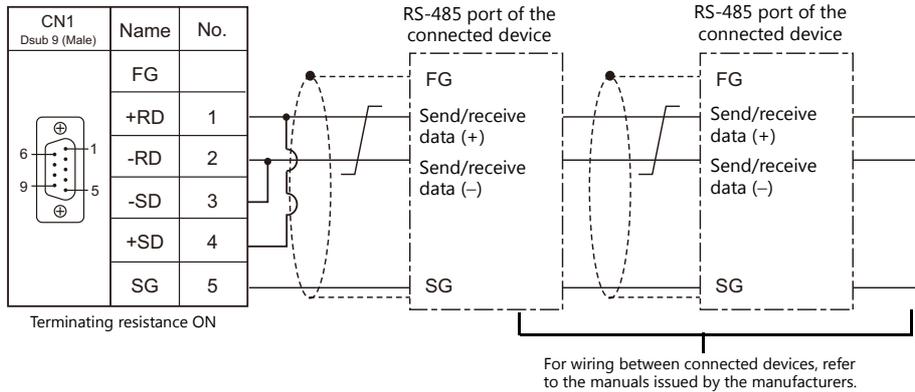


### MJ1/MJ2

The wiring between a V9 and a connected device is the same as that for 1 : 1 communication. For description of wiring between connected devices, refer to the manuals issued by the manufacturers.

### RS-485 (2-wire system) connection

- Connection example

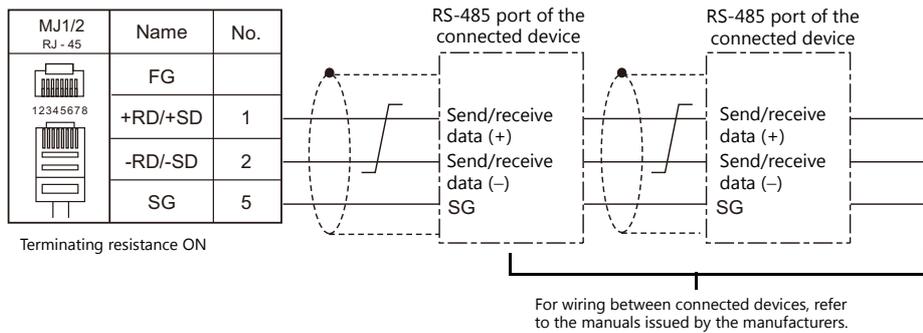


\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.


## n : 1 Connection (Multi-link2)

### Overview

- One PLC is connected to a maximum of four V9 units. The V8 series can be used together.
- Multi-link2 enables you to establish an original network consisting of a master V9 of local port No. 1 and slave V9 units of local port Nos. 2, 3, and 4. The master V9 communicates with the PLC directly, and the slave V9 units communicate with the PLC through the master.
  - Connection example 1:

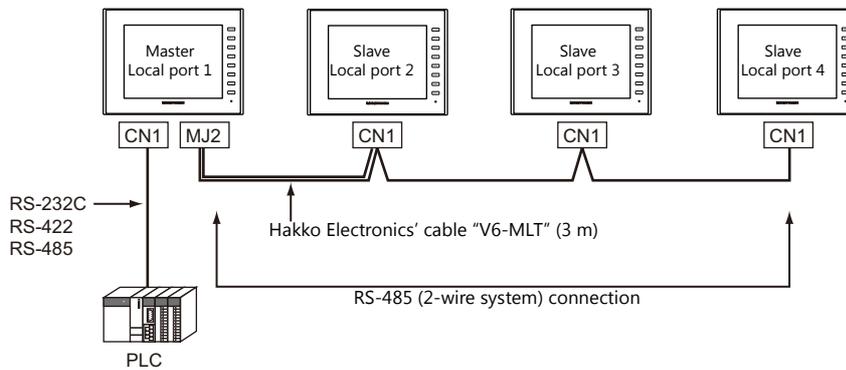

- Connection example 2:

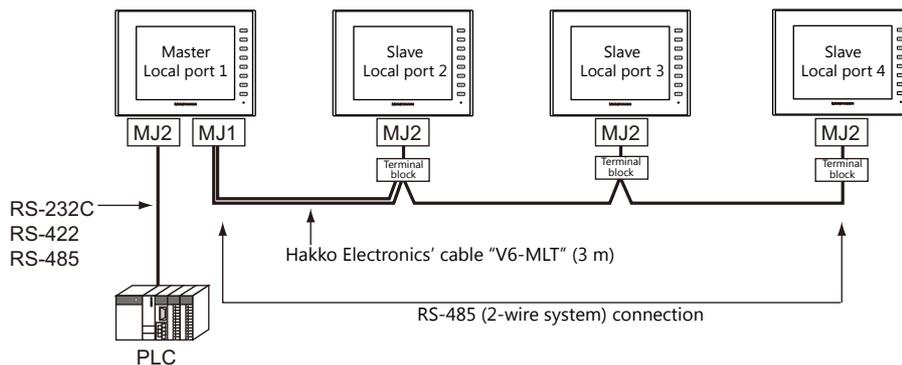


- You can make settings for multi-link2 in [Communication Setting] for PLC1. Therefore, multi-link2 connection is not possible concurrently with a network connection that uses a "CUR-xx" communication interface unit (under development).
- Multi-link2 enables sharing of data stored in PLC1 device memory among the V9 units. However, sharing data in PLC2 - PLC8 is not possible.
- The V7 and V6 series cannot be used together.
- The communication speed between the master and the PLC depends on the setting made on the PLC. The maximum communication speed between V9 units is 115 kbps, which is higher than the one available with multi-link connection described in "n : 1 Connection (Multi-link)".
- For PLCs that support multi-link2 connection, see Connection Compatibility List provided at the end of this manual. The connection between the master and the PLC is the same as the one for 1 : 1 connection. RS-485 (2-wire system) connection is adopted to connect a master with slaves. At this time, use Hakko Electronics' cable "V6-MLT" for the multi-link2 master.
- If the master station becomes faulty (communication error), the master and slave stations do not work, and as a result, "Communication Error Time-Out" is displayed. If a slave station becomes faulty, a communication error is occurred only on the faulty station.
- The ladder transfer function is not available for a multi-link2 connection.
- The setting is needed to use multi-link2 with V9 on the V8 screen data when the using V9 and V8 series together. Location of setting: [Hardware Setting] → [PLC Properties] → [Detail] → [Multi-link 2 with V9]

### V-SFT Ver. 6 Settings

Make settings on [System Setting] → [Hardware Setting] → [PLC Properties]. The differences with respect to a 1 : 1 connection and the points where caution is required are explained here.  
 For details on other settings, refer to Hardware Settings in "1 : 1 Connection" (page 1-13).

### PLC Properties

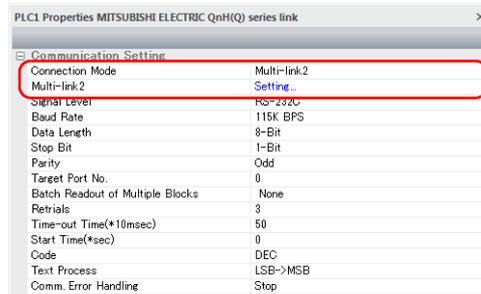


Item		Contents
Communication Setting	Connection Mode	Multi-link2
	Multi-link2	Click [Setting] to display the [Multi-link] dialog, then make the necessary settings in this dialog. For more information on settings, see "Multi-link2" (page 1-24).


### Multi-link2


For a master, set all of the items. For a slave, set only those items marked "◆".

- Master

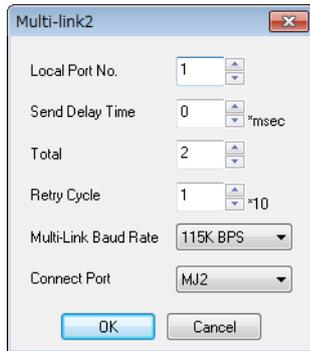

- Slave

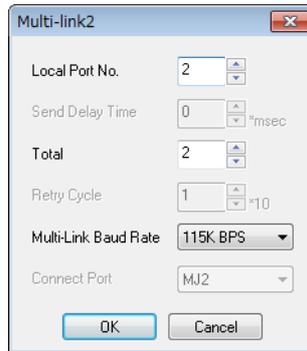

Local Port No.◆	1 to 4 Specify a port number of the V9. For the master set "1", and for the slaves set "2" to "4". Note that if the port number specified is the same as that already set for another V9 unit, the system will not operate correctly.
Send Delay Time	Specify a delay time that elapses before V9 sends the next command after receiving data from the PLC. Normally use the default setting (0). 
Total◆	2 to 4 Set the total number of V9 units connected in the multi-link2 connection. The setting must be the same as other V9 series on the same communication line.
Retry Cycle	Set the number of cycles before the master sends an inquiry for restoration to a slave that has a communication problem (= system down). When a slave has a problem, it is temporarily removed from the communication targets, and the master sends an inquiry for restoration every number of cycles specified for [Retry Cycle]. This setting does not affect the communication speed if no problem is occurring on the slave; however, if there is any problem, it does affect the communication speed. When the setting value is small: Restoration will not take long. When the setting value is large: Restoration will take a longer time.
Multi-Link Baud Rate◆	4800/9600/19200/38400/57600/115K bps Set the baud rate for between V9 series units. The setting must be the same as other V9 series on the same communication line.
Connect Port	CN1/MJ1/MJ2 Set the port to be connected to slaves.

---

## Settings on MONITOUCH


The settings for multi-link2 communication can also be changed on the V9 series unit in Local mode. After transferring the screen program to the V9 series unit, switch to Local mode and select the [Comm. Setting] → [Multi-link2] tab. Then change the settings as necessary.

- \* For more information, refer to the V9 Series Troubleshooting/Maintenance Manual.

## System Configurations and Wiring Diagrams

### Connection Method 1


Connecting the MJ1/MJ2 of the master to CN1 connectors of the slaves

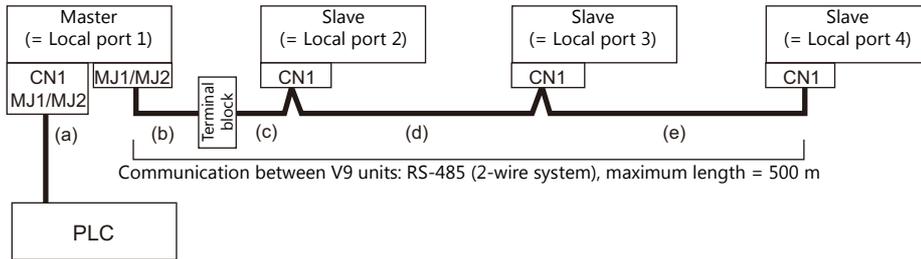

- (a) Connection between master and PLC  
Select the port for connection from among CN1, MJ1 and MJ2.  
The communication settings and connection method are the same as those for 1 : 1 connection.
- (b), (c) Connection between master and slave  
Choose the connecting port of the master between MJ1 and MJ2.  
The connecting port of the slave should be CN1. It is convenient to install the optional terminal converter "TC-D9".  
Use the "V6-MLT" cable (3 m). If the distance is greater than 3 meters the customer should prepare a terminal block and extension cable (c), and should make the connection through that terminal block.
- (d), (e) Connection between slaves  
Use the RS-485 (2-wire system) connection. It is convenient to install the optional terminal converter "TC-D9". Use twisted-pair cables of 0.3 mm sq or greater.
- (b), (c), (d), (e) The maximum length of the wiring among the master and slave is 500 m.


### Wiring diagrams

- When a TC-D9 is used:  
Set the slide switch of "TC-D9" to ON (2-wire system).

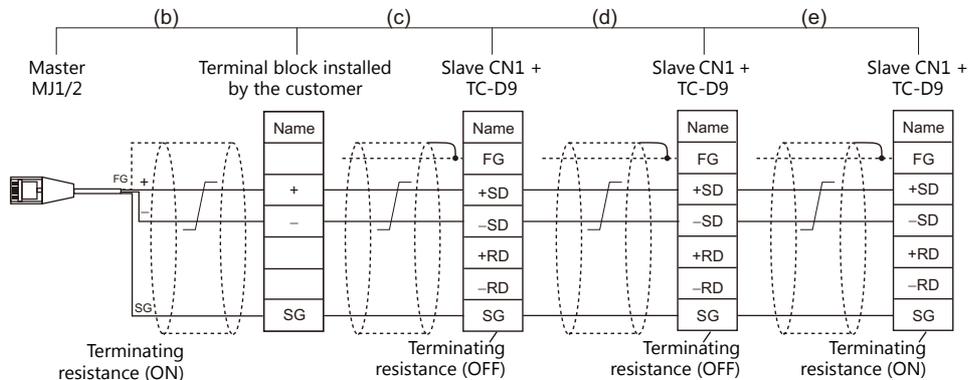

- \* As a measure against noise, connect the frame ground terminal of each V9 series at one side only. The frame ground of V6-MLT must be connected to the V9 series.
- \* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.


- When no TC-D9 is used:  
Install jumpers between +SD and +RD as well as -SD and -RD.

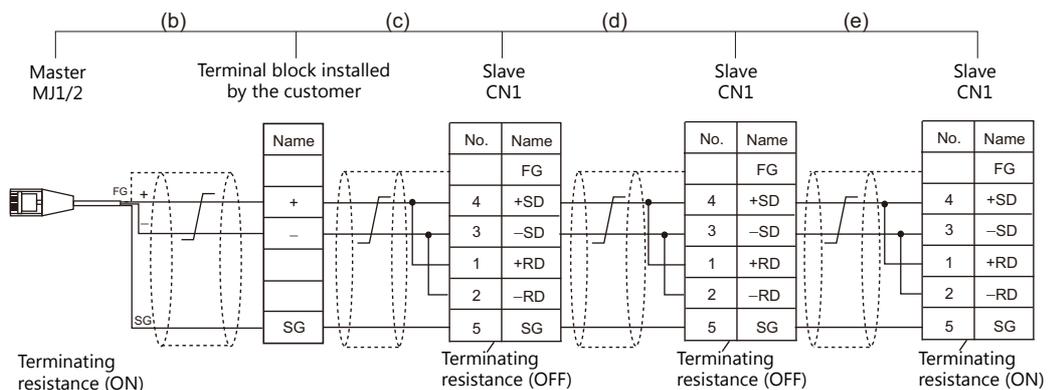

- \* As a measure against noise, connect the frame ground terminal of each V9 series at one side only. The frame ground of V6-MLT must be connected to the V9 series.
- \* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.

### Connection Method 2


Connecting the CN1 of the master to the CN1s of the slaves

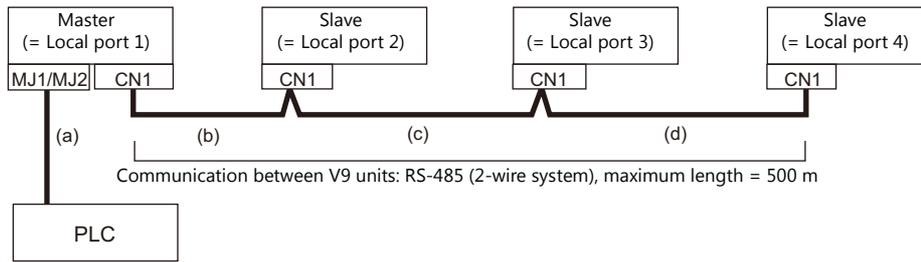

- (a) Connection between master and PLC  
Choose the connection port between MJ1 and MJ2.  
The communication settings and connection method are the same as those for 1 : 1 connection.
- (b), (c), (d) Connection between master and slave  
Use the RS-485 (2-wire system) connection. It is convenient to install the optional terminal converter "TC-D9". Use twisted-pair cables of 0.3 mm sq or greater. The maximum length of the wiring is 500 m.


### Wiring diagrams

- When a TC-D9 is used:  
Set the slide switch of "TC-D9" to ON (2-wire system).

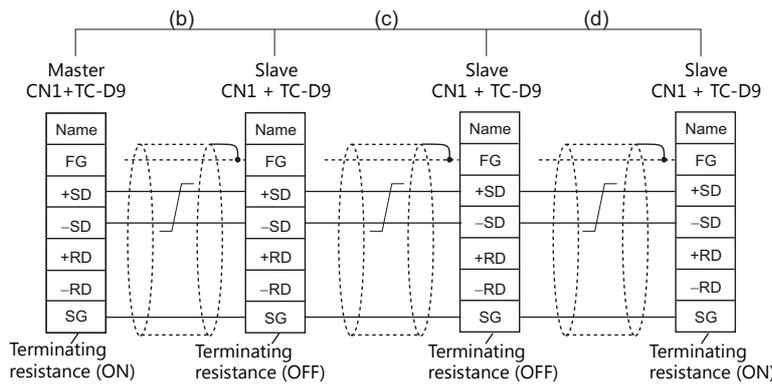

\* As a measure against noise, connect the frame ground terminal of each V9 series at one side only.


- When no TC-D9 is used:  
Install jumpers between +SD and +RD as well as -SD and -RD.

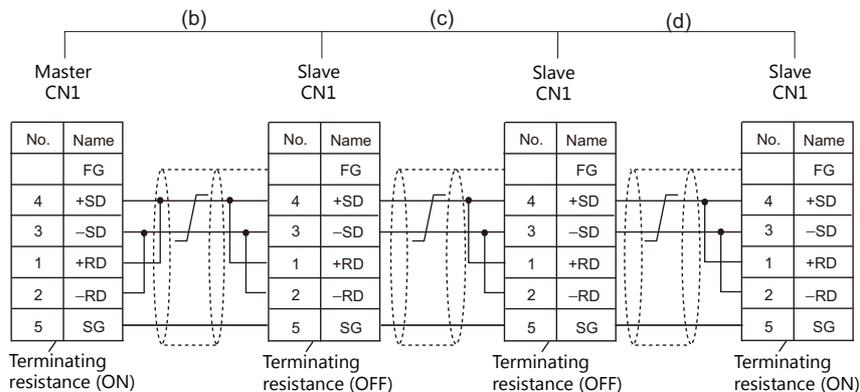

\* As a measure against noise, connect the frame ground terminal of each V9 series at one side only.

### Connection Method 3

Connecting the MJ1/MJ2 of the master to the MJ1/MJ2 ports of the slaves

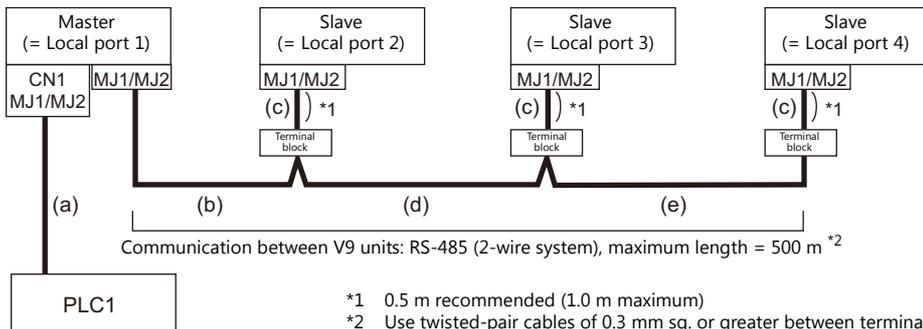


\*1 0.5 m recommended (1.0 m maximum)

\*2 Use twisted-pair cables of 0.3 mm sq. or greater between terminal blocks.

- (a) Connection between master and PLC  
Select the port for connection from among CN1, MJ1 and MJ2.  
The communication settings and connection method are the same as those for 1 : 1 connection.
  - (b) Connection between master and terminal block  
Choose the connecting port of the master between MJ1 and MJ2.  
For the cable, use "V6-MLT" (3 m). Connect the terminals of this cable to a terminal block prepared by the customer.
  - (c) Connection between terminal block and slave  
Choose the connecting port of the slave between MJ1 and MJ2.  
Use the "V6-MLT" cable (3 m).
  - (d) Connection between terminal blocks  
Use the RS-485 (2-wire system) connection. Use twisted-pair cables of 0.3 mm sq or greater.
- (b), (c), (d) The maximum length of the wiring among the master and slave is 500 m.


### Wiring diagrams

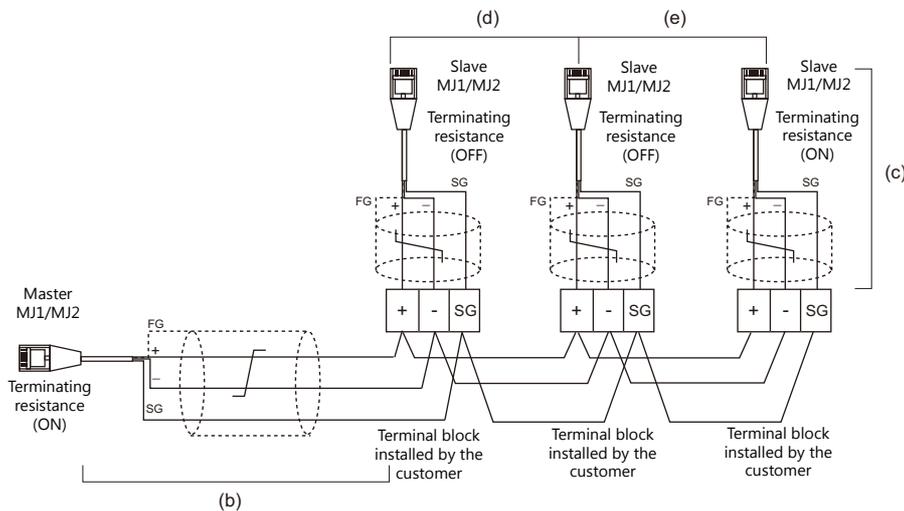

\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.

## Connection Method 4


Connecting the CN1 of the master to the MJ1/MJ2 of the slaves

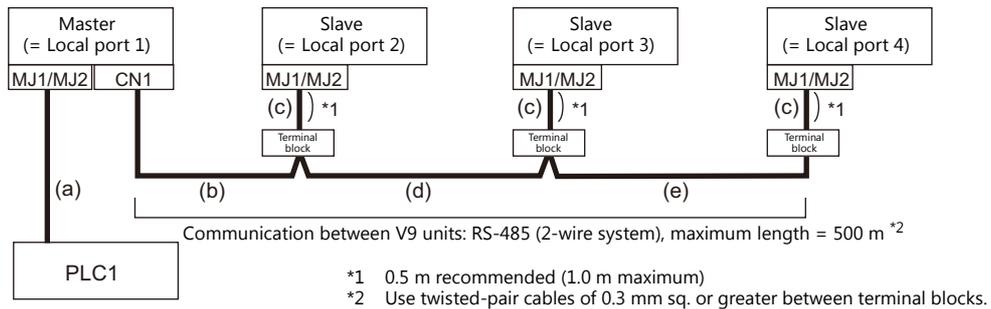

- (a) Connection between master and PLC  
Choose the connection port between MJ1 and MJ2.  
The communication settings and connection method are the same as those for 1 : 1 connection.
- (b), (d), (e) Connection between master and terminal block  
For the connecting port of the master, choose CN1. For the slave, choose between MJ1 and MJ2.  
Use the RS-485 (2-wire system) connection. Use twisted-pair cables of 0.3 mm sq or greater. The maximum length of the wiring is 500 m.
- (c) Connection between terminal block and slave  
The connecting port of the slave should be MJ1 or MJ2.  
Use the "V6-MLT" cable (3 m).


### Wiring diagrams

- When a TC-D9 is used:  
Set the slide switch of "TC-D9" to ON (2-wire system).

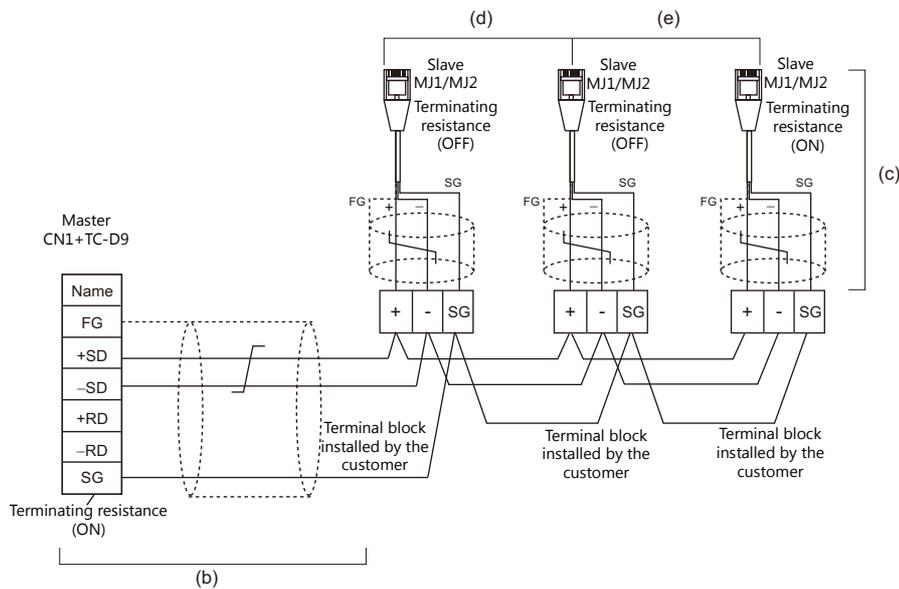

- \* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.

- When no TC-D9 is used:  
Install jumpers between +SD and +RD as well as -SD and -RD.

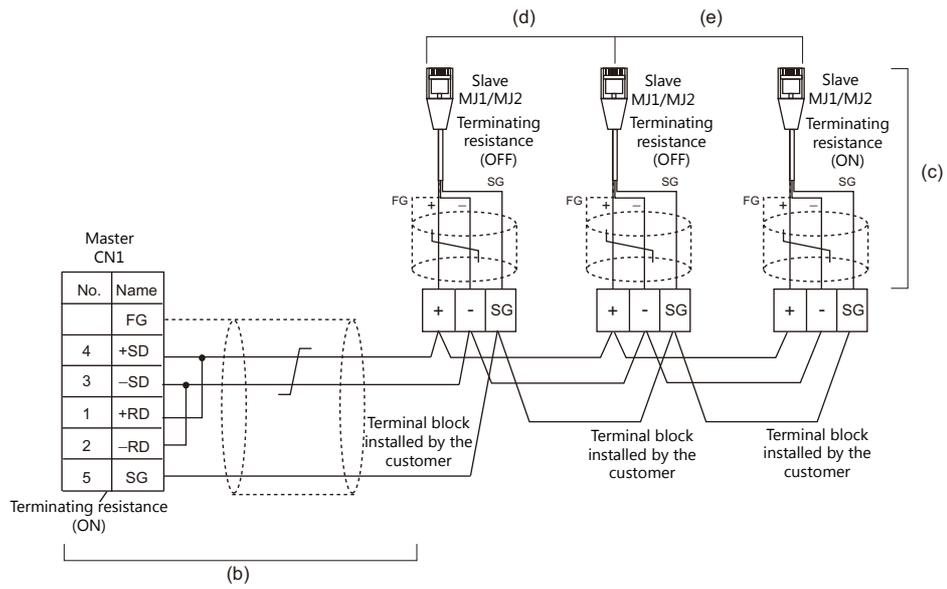


\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.


### Terminating Resistance Setting

The terminating resistance should be set on the DIP switch.

- V910W/V915/V912/V910/V908

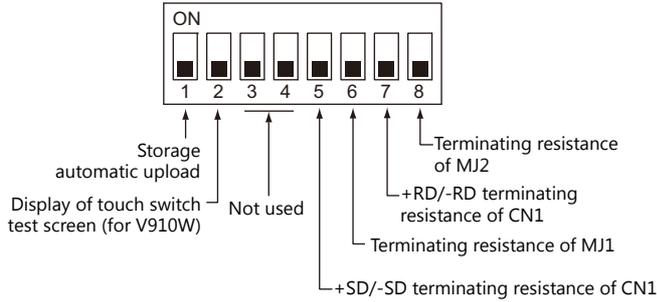


- V907W/V906

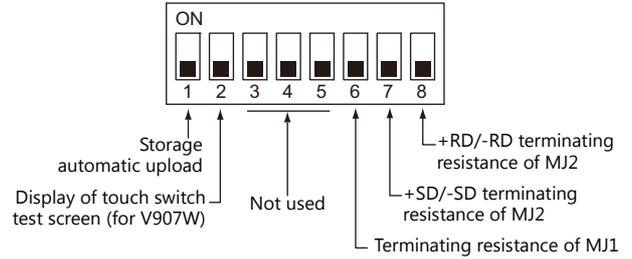


### When the PLC is connected to the master via RS-232C:

There is no terminating resistance setting for communications between the master and the PLC. Set terminating resistances for connections between V9 units.

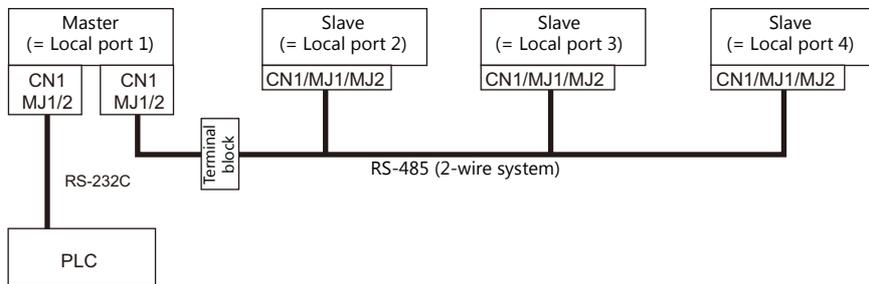


CN1: slave connection




MJ1: slave connection




MJ2: slave connection




When CN1 is used:



When MJ1 is used:




When MJ2 is used:



### When the PLC is connected to the master via RS-485:

Make terminating resistance settings for communications between the master and PLC, and between V9 units.

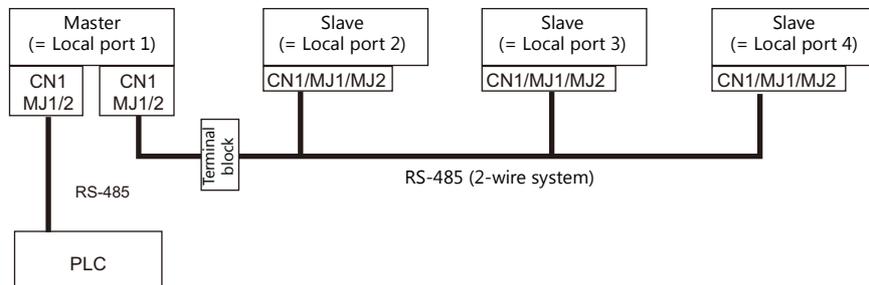


CN1: PLC, MJ1: slave connection




CN1: PLC, MJ2: slave connection




MJ1: PLC, MJ2: slave connection




When CN1 is used:



When MJ1 is used:




When MJ2 is used:



## n : 1 Connection (Multi-link2 (Ethernet))

### Overview

- One PLC is connected to a maximum of 32 V9 units. The V8 series can be used together.
- Multi-link2 (Ethernet) enables you to establish an original network consisting of a master V9 of local port No. 1 and slave V9 units of local port Nos. 2 to 32. The master V9 communicates with the PLC directly, and the slave V9 units communicate with the PLC through the master.
  - Connection example

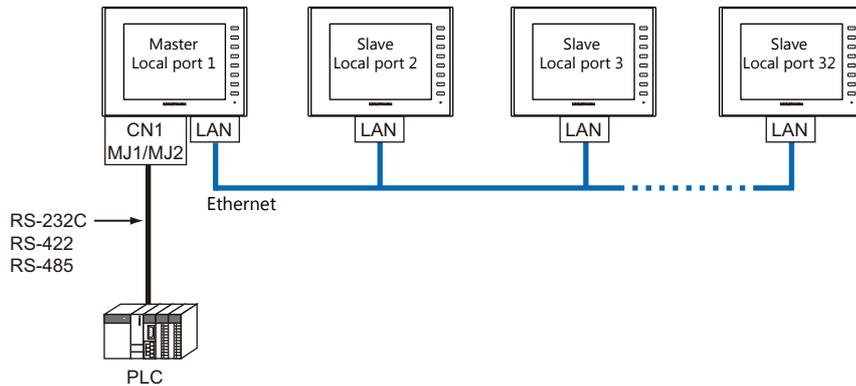

- You can make settings for multi-link2 (Ethernet) in [Communication Setting] for PLC1. Therefore, multi-link2 connection is not possible concurrently with a network connection that uses a "CUR-xx" communication interface unit.
- Multi-link2 (Ethernet) enables sharing of data stored in PLC1 device memory among the V9 units. However, sharing data in PLC2 - PLC8 is not possible.
- The V7 and V6 series cannot be used together.
- The communication speed between the master station and the PLC depends on the setting made on the PLC; however, communication among V9 units is performed via Ethernet, thus, high-speed communication is possible among them.
- For PLCs that support multi-link2 (Ethernet) connection, see Connection Compatibility List provided at the end of this manual.
 


The connection between the master and the PLC is the same as the one for 1 : 1 connection. Ethernet connection is adopted to connect a master with slaves.
- If the master station becomes faulty (communication error), the master and slave stations do not work, and as a result, "Communication Error Time-Out" is displayed. If a slave station becomes faulty, a communication error is occurred only on the faulty station.
- The ladder transfer function is not available for a multi-link2 (Ethernet) connection.


## V-SFT Ver. 6 Settings

Make settings on [System Setting] → [Hardware Setting] → [PLC Properties]. The differences with respect to a 1 : 1 connection and the points where caution is required are explained here.

For details on other settings, refer to Hardware Settings in "1 : 1 Connection" (page 1-13).


### PLC Properties

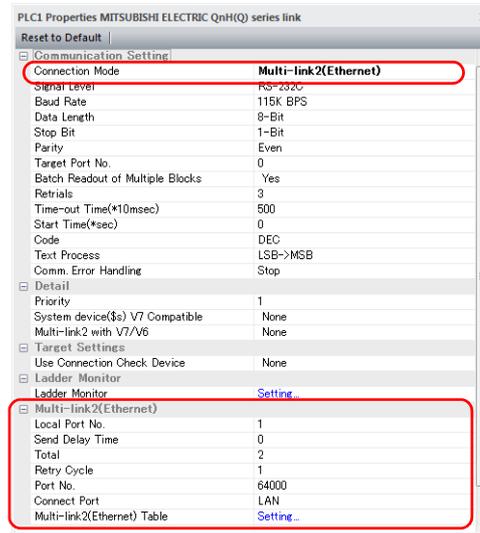


Item		Contents
Communication Setting	Connection Mode	Multi-link2 (Ethernet)
Multi-link2 (Ethernet)	Local Port No.	1: Master 2 to 32: Slave  * Note that if the port number specified is the same as that already set for another V9 unit, the system will not operate correctly.
	Send Delay Time	Specify a delay time that elapses before V9 sends the next command after receiving data from the PLC. Normally use the default setting (0).  
	Total	2 to 32 Set the total number of V9 units connected in the multi-link2 (Ethernet) connection. The setting must be the same as other V9 series on the same communication line.
	Retry Cycle	Valid only when the local port is "1" (master). Set the number of cycles before the master sends an inquiry for restoration to a slave that has a communication problem (= system down). When a slave has a problem, it is temporarily removed from the communication targets, and the master sends an inquiry for restoration every number of cycles specified for [Retry Cycle]. This setting does not affect the communication speed if no problem is occurring on the slave; however, if there is any problem, it does affect the communication speed. When the setting value is small: Restoration will not take long. When the setting value is large: Restoration will take a longer time.
	LAN Port No.	Set a value in the range from 1024 to 65535 (excluding 8001 and 8020). Default: 64000 * Set the same port number for all master and slave stations.
	Connection Port	LAN/LAN2 Set a local port number for master or slave connection.
	Multi-link2 (Ethernet) Table	Click [Setting] to display the [Multi-link2 (Ethernet) Table] window. For details on settings, refer to the next section.

**Multi-link2 (Ethernet) table**

• Master

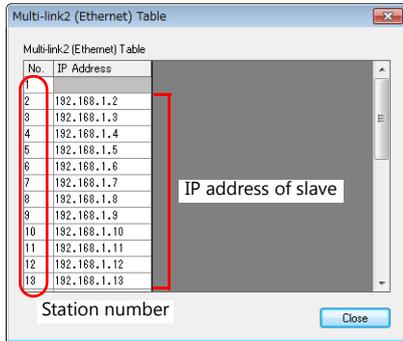

• Slave

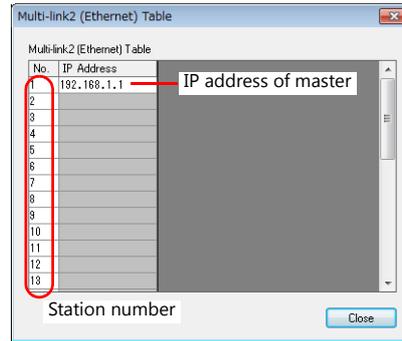

Item	Contents
Multi-link2 (Ethernet) Table	<ul style="list-style-type: none"> <li>For local port 1 (master) Set the IP addresses of all V9 units used as slave to respective local port numbers.</li> <li>For local port 2 to 32 (slave) Set the IP address of the master V9 for No. 1.</li> </ul>

**Settings on MONITOUCH**

The settings for multi-link2 (Ethernet) communication and the multi-link2 (Ethernet) table can also be changed on the V9 series unit in Local mode.

After transferring the screen program to the V9 series unit, switch to Local mode and select the [Comm. Setting] → [Multi-link2] tab. Then change the settings as necessary.

\* For more information, refer to the V9 Series Troubleshooting/Maintenance Manual.

**Wiring**


The connection between the master and the PLC is the same as the one for 1 : 1 connection. Refer to "Wiring" (page 1-15) in "1 : 1 Connection".

Use a LAN cable to connect a master with slaves.

## n : n Connection (1 : n Multi-link2 (Ethernet))

### Overview

- A maximum of 32 units of V9 series can be connected to a maximum of 31 units of PLCs. The V8 series can be used together.
- Multi-link2 (Ethernet) enables you to establish an original network consisting of a master V9 of local port No. 1 and slave V9 units of local port Nos. 2 to 32. The master V9 communicates with the PLC directly, and the slave V9 units communicate with the PLC through the master.

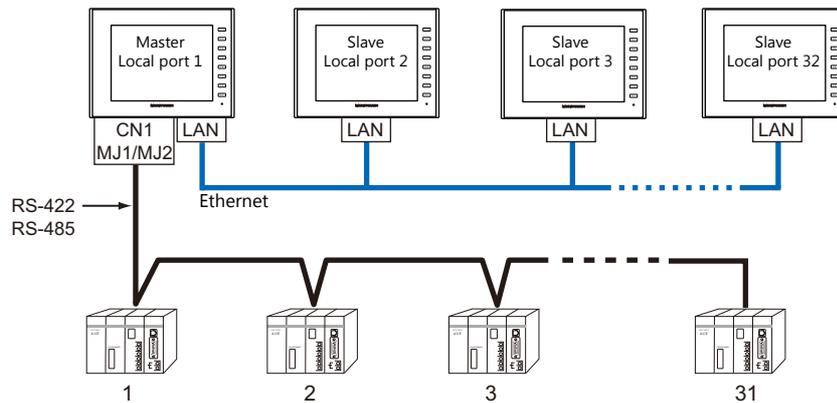


- You can make settings for 1 : n multi-link2 (Ethernet) in [Communication Setting] for PLC1. Therefore, multi-link2 connection is not possible concurrently with a network connection that uses a "CUR-xx" communication interface unit.
- 1 : n multi-link2 (Ethernet) enables sharing of data stored in PLC1 device memory among the V9 units. However, sharing data in PLC2 - PLC8 is not possible.
- The V7 and V6 series cannot be used together.
- The communication speed between the master station and the PLC depends on the setting made on the PLC; however, communication among V9 units is performed via Ethernet, thus, high-speed communication is possible among them.
- For PLCs that support 1 : n multi-link2 (Ethernet) connection, see Connection Compatibility List provided at the end of this manual.  
The connection between the master and the PLC is the same as the one for 1 : n connection.  
Ethernet connection is adopted to connect a master with slaves.
- If the master station becomes faulty (communication error), the master and slave stations do not work, and as a result, "Communication Error Time-Out" is displayed. If a slave station becomes faulty, a communication error is occurred only on the faulty station.
- The ladder transfer function is not available for a 1 : n multi-link2 (Ethernet) connection.

### V-SFT Ver. 6 Settings

Make settings on [System Setting] → [Hardware Setting] → [PLC Properties]. The differences with respect to a 1 : n connection and the points where care is required are explained here.  
 For details on other settings, refer to "Hardware Settings" (page 1-20) in "1 : n Connection (Multi-drop)".

#### PLC Properties

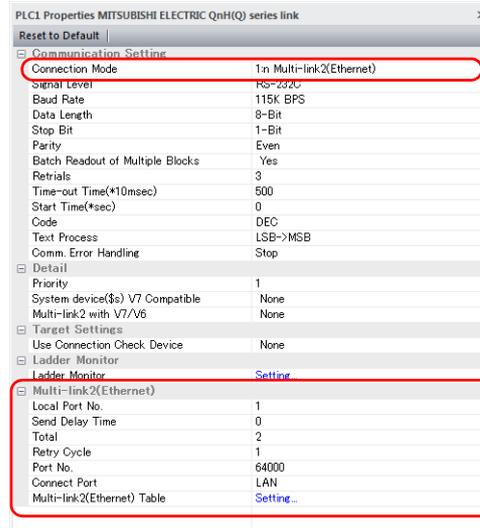

Item		Contents
Communication Setting	Connection Mode	1 : n Multi-link2 (Ethernet)
Multi-link2 (Ethernet)	Local Port No.	1: Master 2 to 32: Slave  * Note that if the port number specified is the same as that already set for another V9 unit, the system will not operate correctly.
	Send Delay Time	Specify a delay time that elapses before V9 sends the next command after receiving data from the PLC. Normally use the default setting (0).  <div style="text-align: center;"> </div>
	Total	2 to 32 Set the total number of V9 units connected in the multi-link2 (Ethernet) connection. The setting must be the same as other V9 series on the same communication line.
	Retry Cycle	Valid only when the local port is "1" (master). Set the number of cycles before the master sends an inquiry for restoration to a slave that has a communication problem (= system down). When a slave has a problem, it is temporarily removed from the communication targets, and the master sends an inquiry for restoration every number of cycles specified for [Retry Cycle]. This setting does not affect the communication speed if no problem is occurring on the slave; however, if there is any problem, it does affect the communication speed. When the setting value is small: Restoration will not take long. When the setting value is large: Restoration will take a longer time.
	LAN Port No.	Set a value in the range from 1024 to 65535 (excluding 8001 and 8020). Default: 64000  * Set the same port number for all master and slave stations.
	Connection Port	LAN/LAN2 Set a local port number for master or slave connection.
	Multi-link2 (Ethernet) Table	Click [Setting] to display the [Multi-link2 (Ethernet) Table] window. For details on settings, refer to the next section.

## Multi-link2 (Ethernet) table

### • Master

No.	IP Address
1	
2	192.168.1.2
3	192.168.1.3
4	192.168.1.4
5	192.168.1.5
6	192.168.1.6
7	192.168.1.7
8	192.168.1.8
9	192.168.1.9
10	192.168.1.10
11	192.168.1.11
12	192.168.1.12
13	192.168.1.13

Station number

### • Slave

No.	IP Address
1	192.168.1.1
2	
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	
13	

Station number

Item	Contents
Multi-link2 (Ethernet) Table	<ul style="list-style-type: none"> <li>For local port 1 (master) Set the IP addresses of all V9 units used as slave to respective local port numbers.</li> <li>For local port 2 to 32 (slave) Set the IP address of the master V9 for No. 1.</li> </ul>

## Settings on MONITOUCH

The settings for multi-link2 (Ethernet) communication and the multi-link2 (Ethernet) table can also be changed on the V9 series unit in Local mode.

After transferring the screen program to the V9 series unit, switch to Local mode and select the [Comm. Setting] → [Multi-link2] tab. Then change the settings as necessary.

- \* For more information, refer to the V9 Series Troubleshooting/Maintenance Manual.

## Wiring

The connection between the master and the PLC is the same as the one for 1 : n connection. Refer to "Wiring" (page 1-21) in "1 : n Connection (Multi-drop)".


Use a LAN cable to connect a master with slaves.

## n : 1 Connection (Multi-link)


### Overview

- One PLC is connected to a maximum of 31 V9 units.

- Connection example 1:

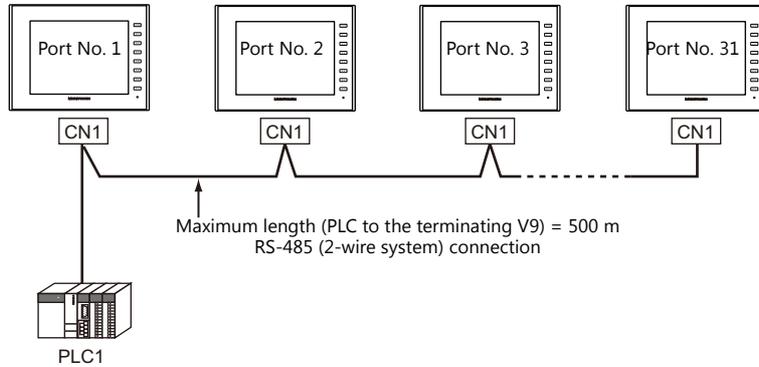

- Connection example 2:

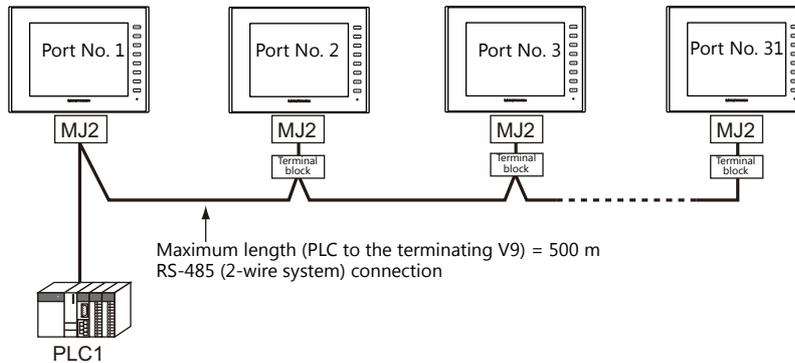


You can make settings for multi-link at the PLC1. Therefore, multi-link connection is not possible concurrently with a network connection that uses a "CUR-xx" communication interface unit. A physical port is selectable from CN1, MJ1, and MJ2.

- Only a PLC [Signal Level: RS422/RS485] and with a port number set. RS-485 (2-wire system) connection is adopted to connect a V-series unit and a PLC. For available models, see Connection Compatibility List provided at the end of this manual.
- The V8, V7 and V6 series cannot be used together.
- Use twisted-pair cables of 0.3 mm sq. or greater between terminal blocks.
- The ladder transfer function is not available for a multi-link connection.

### V-SFT Ver. 6 Settings


Make settings on [System Setting] → [Hardware Setting] → [PLC Properties]. The differences with respect to a 1 : 1 connection and the points where care is required are explained here.  
 For details on other settings, refer to Hardware Settings in “1 : 1 Connection” (page 1-13).


### PLC Properties

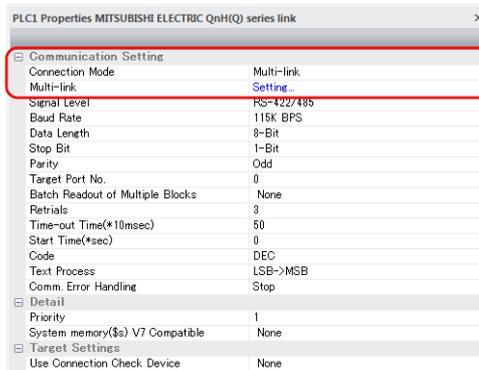

Item		Contents
Communication Setting	Connection Mode	Multi-link
	Multi-link	Display the [Multi-link] dialog by pressing the [Setting] button, then make the necessary settings in this dialog. For more information on settings, see “Multi-link” (page 1-39).

### Multi-link

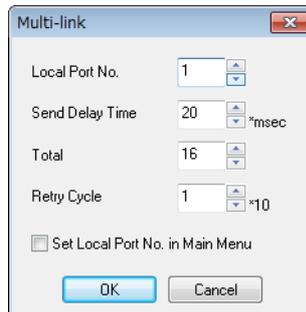

Item	Contents
Local Port No.	1 to 32 Specify a port number of the V9. * Note that if the port number specified is the same as that already set for another V9 unit, the system will not operate correctly.
Send Delay Time <sup>*1</sup>	0 to 255 msec (Default setting: 20 msec) Specify a delay time that elapses before V9 sends the next command after receiving data from the PLC. 
Total <sup>*1</sup>	2 to 32 Set the maximum number of V series units to be connected in multi-link connection. <sup>*2</sup>
Retry Cycle <sup>*1</sup>	1 to 100 (× 10) When the V9 series has a problem, it is temporarily removed from the communication targets, and the master sends an inquiry for restoration every number of cycles specified for [Retry Cycle]. This setting does not affect the communication speed if no problem is occurring; however, if there is any problem, it does affect the communication speed. When the setting value is small: Restoration will not take long. When the setting value is large: Restoration will take a longer time.

<sup>\*1</sup> For [Send Delay Time], [Total] and [Retry Cycle], the same values must be set on all the V9 series that are connected in the same communication line.

<sup>\*2</sup> When connecting three units with the local port numbers 1, 2 and 10, specify “10” for [Total].

## Settings on MONITOUCH

The settings for multi-link communication can also be changed on the V9 series unit in Local mode. After transferring the screen program to the V9 series unit, switch to Local mode and select the [Comm. Setting] → [Multi-link] tab. Then change the settings as necessary.


- \* For more information, refer to the V9 Series Troubleshooting/Maintenance Manual.

## Wiring

### When Connected at CN1

This shows the situation when a multi-link connection is made at CN1. It is convenient to use the Hakko Electronics' optional terminal converter "TC-D9".


- When a TC-D9 is used:  
Set the slide switch of "TC-D9" to ON (2-wire system).

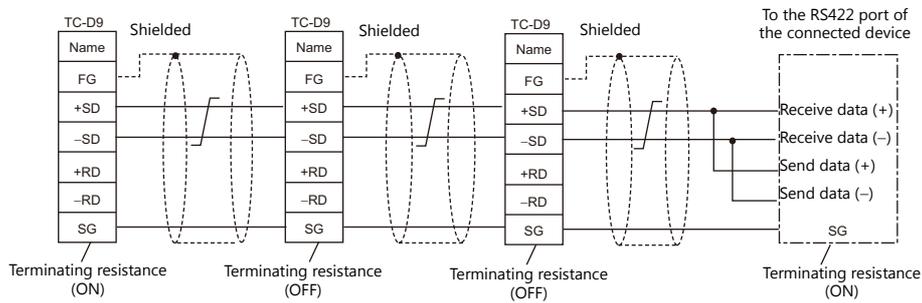

- \* Use shielded twist-pair cables.

- \* Jumpers may not be necessary, depending on the connected device.

- When no TC-D9 is used:  
Install jumpers between +SD and +RD as well as -SD and -RD.

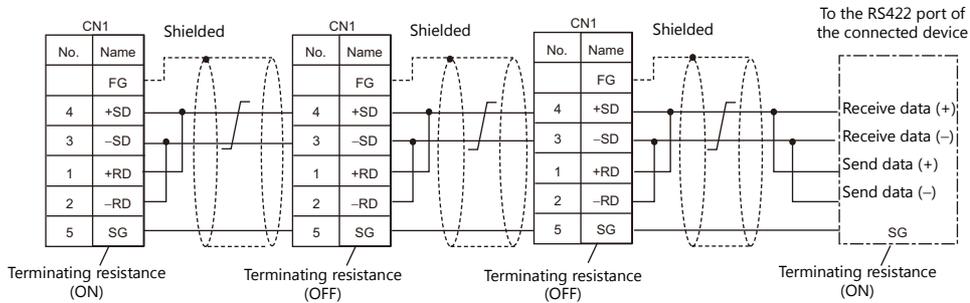


- \* Use shielded twist-pair cables.

- \* Jumpers may not be necessary, depending on the connected device.


**When connecting to Mitsubishi Electric's QnA CPU:**

Use the GD port of Hakko Electronics' optional dual port interface V-MDD for the PLC CPU port.

- When a TC-D9 is used:  
Set the slide switch of "TC-D9" to ON (2-wire system).

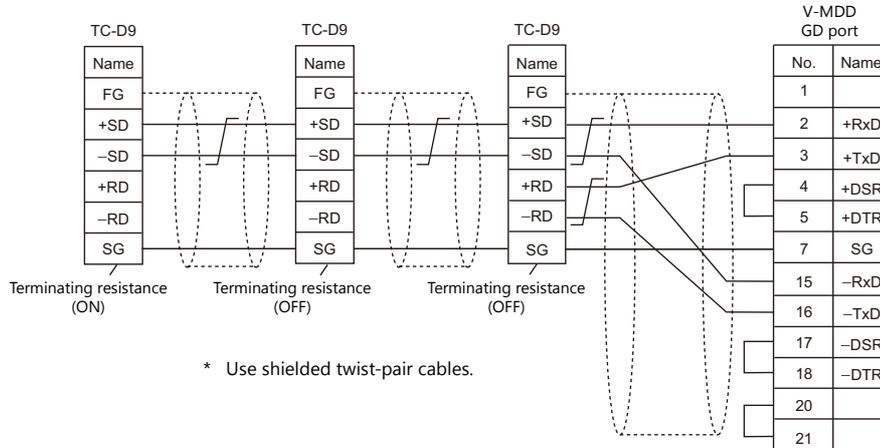


- When no TC-D9 is used:  
Install jumpers between +SD and +RD as well as -SD and -RD.

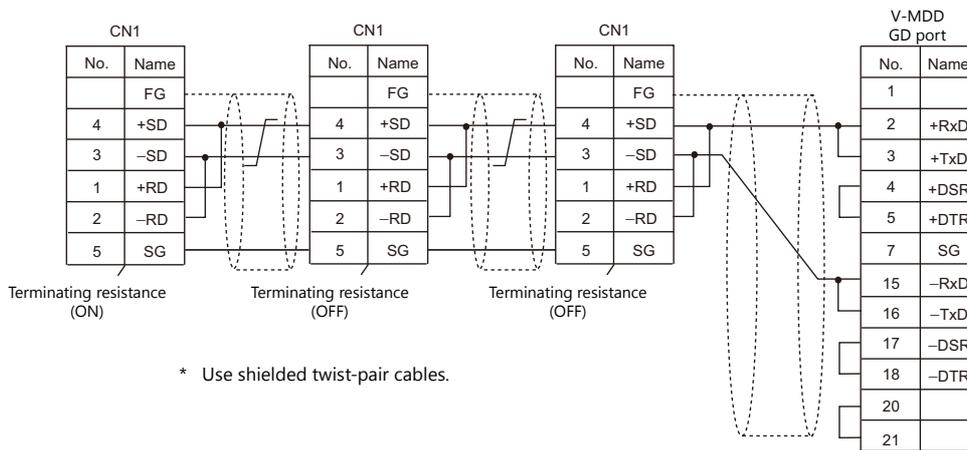

**When Connected at MJ1/MJ2:**


This shows the situation when a multi-link connection is made at MJ1 or MJ2.

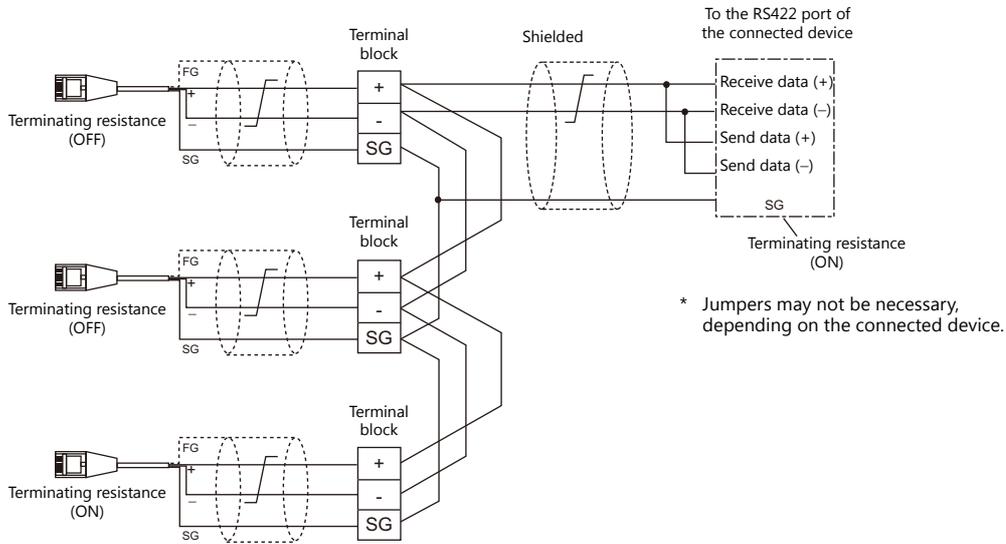

\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.

**When connecting to Mitsubishi Electric's QnA CPU:**

Use the GD port of Hakko Electronics' optional dual port interface V-MDD for the PLC CPU port.

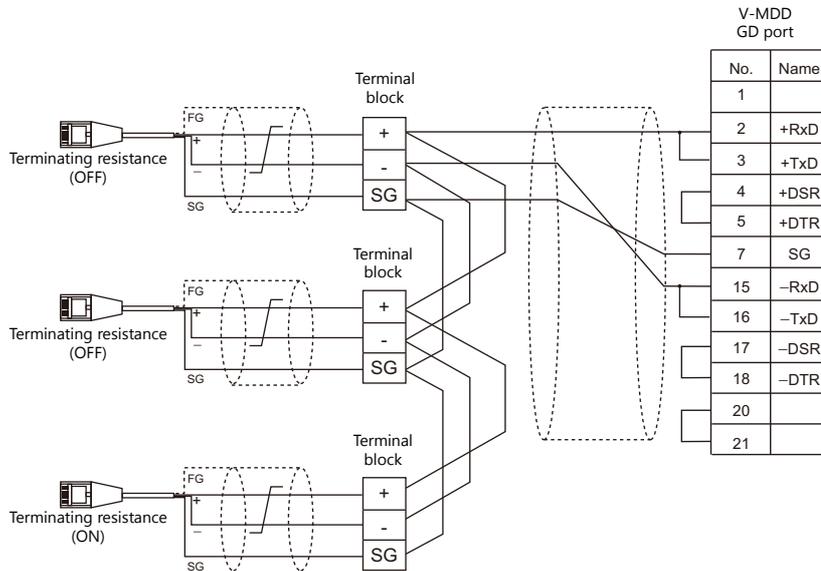


\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906.


## 1.3.2 Ethernet Communication

### Overview


- Because eight communication ports can be opened, the V9 series is allowed to communicate with eight models of PLCs at the same time.

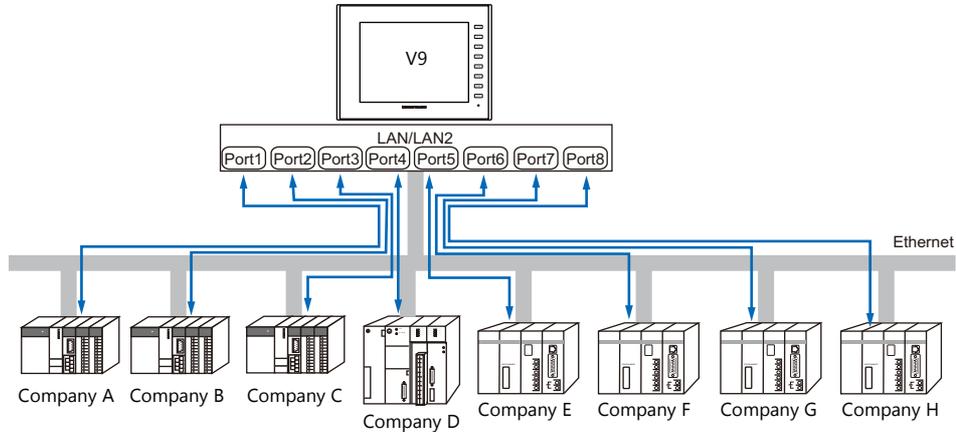

- When there are two or more PLCs of the same model, the V9 series is allowed to carry out 1 : n communication via one single port.

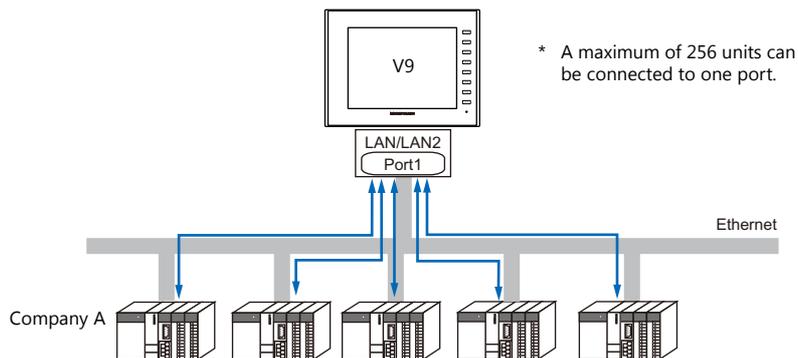

- If multiple V9 units are connected to one single PLC, the maximum permissible number of these units depends on the PLC specifications. Refer to the PLC manual issued by the manufacturer.

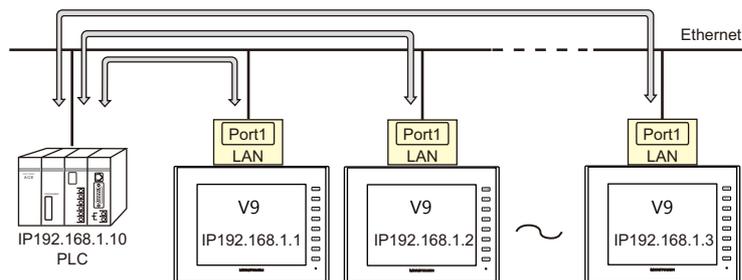


- You can make settings for Ethernet communication in [Communication Setting] for the logical ports PLC1 - PLC8.

## V-SFT Ver. 6 Settings

### Hardware Settings


#### Selecting a device to be connected

Select the device for connection from [System Setting] → [Hardware Setting].



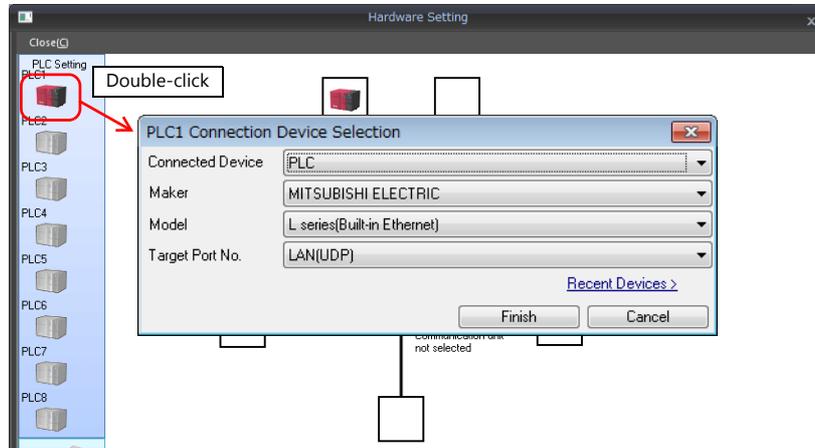


#### PLC properties

Configure the [PLC Properties].

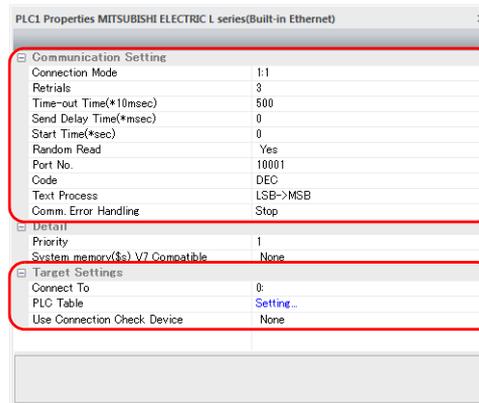

Item		Contents
Communication Setting	Connection Mode	1:1/1:n Set the number of PLCs that are to be communicated with.
	Port No.	Set the port number of the V9 series to be used for communications with the PLCs.
	KeepAlive	<p>This setting is used when using the "KeepAlive" function. The "KeepAlive" function is used for periodically checking the connection with devices on the network. This function enables a prompt detection of a communication error, thus, significantly shortens the time to wait until a "disconnect" process takes place after an occurrence of the time-out error.</p> <p>* When using this function, select [Disconnect] for [Comm. Error Handling].</p> <ul style="list-style-type: none"> <li>[Use KeepAlive] Select [Yes] when using the "KeepAlive" function. The following settings will take effect. <ul style="list-style-type: none"> <li>[Retrials] Specify the number of retries. If a timeout persists even after as many retries as specified, an error handling routine will take place. 0 to 255 Default: 0</li> <li>[Time-out Time] Specify a period of time allowed for V9 to monitor a response from its connected device. If no response is given within the specified time, retry will be made. 1 to 999 (× 10 msec) Default: 30 (× 10 msec)</li> <li>[Checking Cycle] Set the cycle time of "KeepAlive" communication. 1 to 999 (× 10 msec) Default: 10 (× 10 msec)</li> </ul> </li> </ul>

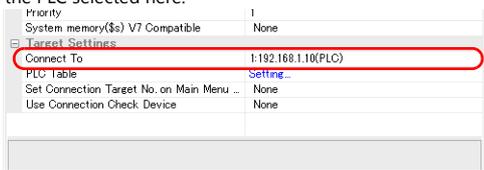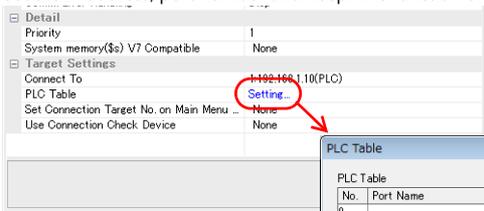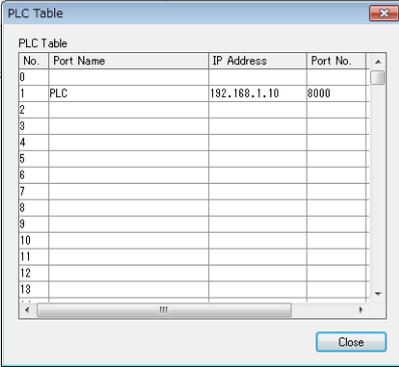Item	Contents
	<p>These settings are valid when [1 : 1] is selected for [Connection Mode]. Select the IP address of the PLC registered in the PLC table. 1 : 1 communications are executed with the PLC selected here.</p> 
Target Settings	<p>Click [Setting] to display the [PLC Table] window. Set the IP address, port number and KeepAlive function of the PLC.</p> 
	<p>PLC Table</p> 

\* For settings other than the above, see "1.4 Hardware Settings" (page 1-50).


### IP Address Setting of the V9 Series

An IP address must be set for the V9 to connect to devices via Ethernet. Set the IP address either on the V9 unit or for the screen program using the V-SFT editor.

#### Setting Using the V-SFT Editor

Set the IP address at [System Setting] → [Hardware Setting] → [Local Port IP Address].

#### Local port IP address setting

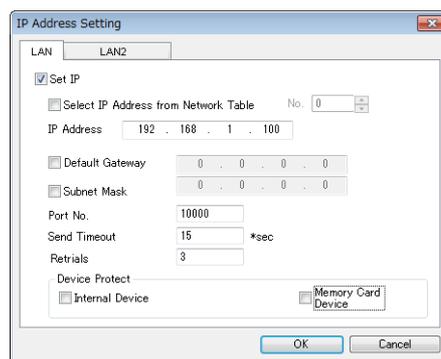

Item	Contents
Select IP Address from Network Table	<p>This is valid when the IP address of the V9 has been registered in the network table. Select a network table number from 0 to 255 to set the IP address.</p> <p>* For more information on the network table, refer to "Network table" (page 1-57).</p>
IP Address *1	Set the IP address for the V9.
Default Gateway *1	Set the default gateway.
Subnet Mask *1	<p>Set the subnet mask. When this box is not checked, the subnet mask is automatically assigned based on the byte at the extreme left of the IP address.</p> <p>Example:                      When IP address is "172.16.200.185", "255.255.0.0" is set.                      When IP address is "192.168.1.185", "255.255.255.0" is set.</p>
Port No. *1	Set a port number from 1024 to 65535. (Excluding 8001 and 8020)
Send Timeout	Specify the timeout time to send the EREAD/EWRITE/SEND/MES command.

Item	Contents
Retrials	0 to 255 Set the number of retrials to be performed when a time-out occurs.
Device Protect Internal Device Memory Card Device	Check either check box to write-protect the device memory from computers or other stations.


\*1 For more information on each setting item, see "Basics of ethernet settings" (page 1-58).

### Settings in Local Mode on the V9 Unit

Set the IP address in Local mode on the V9 unit.

If IP address setting has been performed on the V-SFT editor, this setting will be taken as the valid one.


- Press the [SYSTEM] switch on MONITOUCH to display the system menu.
  - \* When using V910W or V907W, press any of the four corners of the screen for more than two seconds and then press any of the remaining corners for more than two seconds to display the system menu.
- Press the [Local] switch. The display switches to Local mode.
- Press the [LAN Setting] switch and display the LAN Setting screen.
  - \* When using LAN2: [LAN2 Setting] switch
  - When using CUR-03 Ethernet unit: [LAN Unit Setting] switch

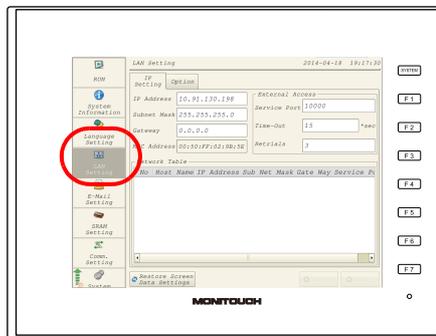

- Set each item.




- Press the [Apply] switch to determine the setting.

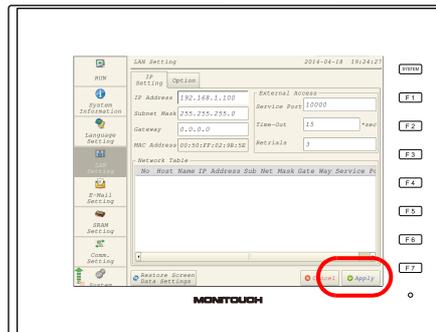


\* Press the [Return to Screen Data Setting] to return to the settings made on the V-SFT editor.

### Connection Example

With hub

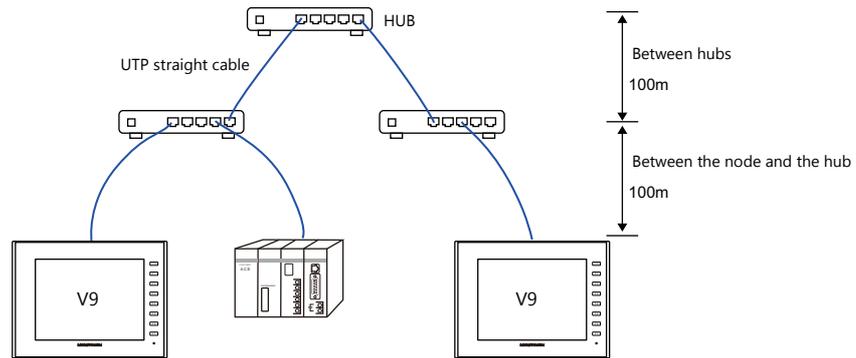

Without hub

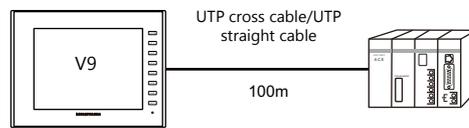


### Wiring




- Use a commercially available cable. Using a self-made cable may cause an error in network connection.
- If the use of a cross cable cannot stabilize communication, use a hub.

- Straight cable

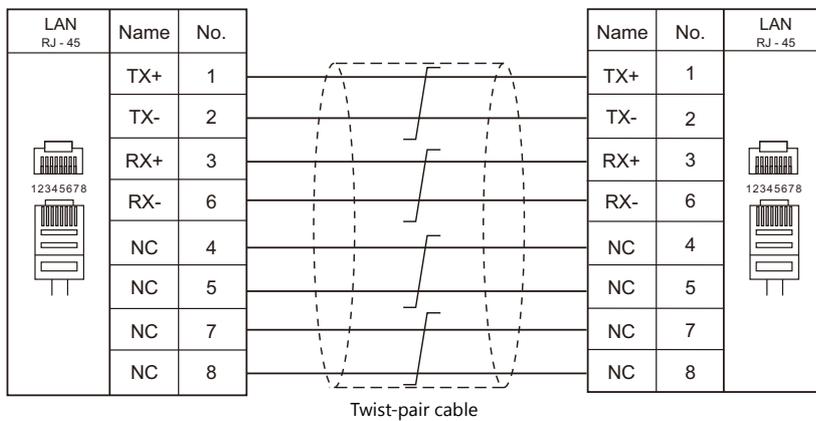

- Cross cable

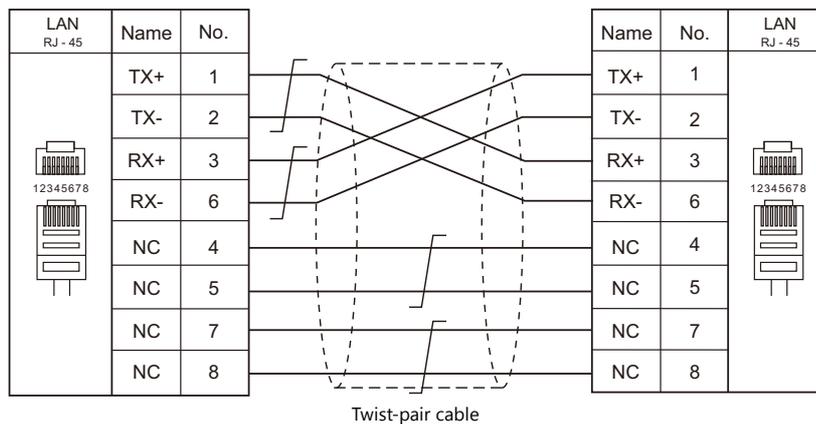

### 1.3.3 Network Communication

#### Overview

- The optional communication interface unit "CUR-xx" is required to enable a network communication listed below.

Communication Interface Unit	Network	Available Models	
CUR-00	OPCN-1	Mitsubishi Electric OMRON Fuji Electric	A series (OPCN-1) SYSMAC C (OPCN-1) MICREX-SX (OPCN-1)
CUR-01	T-Link	Fuji Electric Fuji Electric	MICREX-F (T-LINK) MICREX SX (T-LINK)
CUR-02	CC-LINK Ver. 2.00/1.10/1.00	Mitsubishi Electric Mitsubishi Electric Mitsubishi Electric	A series (CC-LINK) QnA series (CC-LINK) QnH (Q) series (CC-LINK)
CUR-03	Ethernet *1	Various PLCs	Ethernet UDP/IP communication * TCP/IP communication is not supported.
CUR-04	PROFIBUS-DP	Siemens Universal PROFIBUS-DP	S7 PROFIBUS-DP
CUR-06	SX BUS	Fuji Electric	MICREX-SX (SX BUS)
CUR-07	DeviceNet	Universal DeviceNet	
CUR-08	FL-Net	Universal FL-Net	

\*1 In addition to UDP/IP communication with a PLC, screen program transfer, the MES interface function, and TELLUS & V-Server connection can be enabled by connecting a PC. Use the built-in LAN port for TCP/IP communication.

- You can make settings for network communication in [Communication Setting] for the logical port PLC1. Thus, devices available with only PLC1, as those used for multi-link or multi-link2, cannot be connected concurrently for network communication.
- The "CUR-xx" cannot be used for a V907W/V906 that is already connected the "DUR-00".

#### V-SFT Ver. 6 Settings

For more information, refer to the communication unit specifications provided for each network.

#### Wiring


For more information, refer to the communication unit specifications provided for each network.

### 1.3.4 Slave Communication

Connecting via V-Link, Modbus RTU, or Modbus TCP/IP is applicable to slave communication using the V9. V-Link and Modbus RTU are used for serial communication, and Modbus TCP/IP is used for Ethernet (TCP/IP) communication.

#### V-Link

- "V-Link" is the network where the PC reads from and writes to the internal device memory of the V9 series, memory card device memory, or PLC1 to 8 device memory using a dedicated protocol.

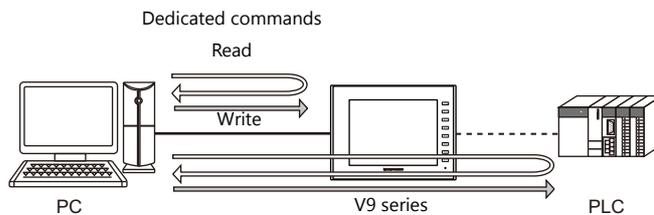

- You can make settings for V-Link communication in [Communication Setting] for the logical ports PLC2 - PLC8. A communication port is selectable from CN1, MJ1, and MJ2.
- For more information, refer to "V-Link" in book 3 of the V9 Series Connection Manual.

#### MODBUS RTU

- The V9 series is connected to a Modbus RTU master via serial connection.
- The device memory table for Modbus slave communication is prepared for the V9. The master is allowed to gain access to the device memory table and read/write the PLC data.
- For more information, refer to the Modbus Slave Communication Specifications manual separately provided.

#### MODBUS TCP/IP


- The V9 is connected to a Modbus TCP/IP master via Ethernet communication.
- The device memory table for Modbus slave communication is prepared for the V9. The master is allowed to gain access to the device memory table and read/write the PLC data.
- For more information, refer to the Modbus Slave Communication Specifications manual separately provided.

### 1.3.5 Other Connections

For connection to a serial printer that is not in 8-way communication, serial ports of MJ1 and MJ2 are used.

## 1.4 Hardware Settings

Select and set the devices to connect to the V9 series on the Hardware Setting screen.

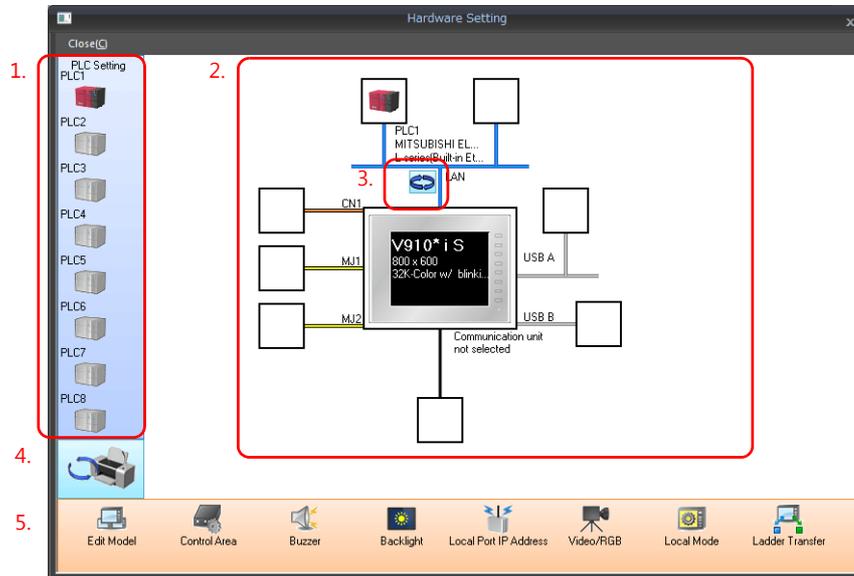


	Item	Contents
1.	PLC Setting	Set the devices (PLC, temperature controller, servo, inverter, barcode reader etc.) to connect to PLC1 to PLC8.
2.	Connection Diagram	The devices which are set for connection are displayed. Devices as well as communication settings can be changed.
3.	Built-in LAN / Ethernet unit switch	Select the Ethernet connection port on the V9 series from the internal LAN communication unit. The icon changes each time it is clicked.
4.	PLC Setting / Other Setting switch	Switch between PLC settings and other settings. The icon changes each time it is clicked.
5.	MONITOUCH Settings	Make MONITOUCH settings on the V9 series.

### 1.4.1 PLC Settings


To enable communication with a PLC, a temperature controller, an inverter, etc., the following settings are required to be set on the editor. You can see the contents of these settings in the V9 Local mode.

For information on Local mode, refer to the V9 Series Troubleshooting/Maintenance Manual.

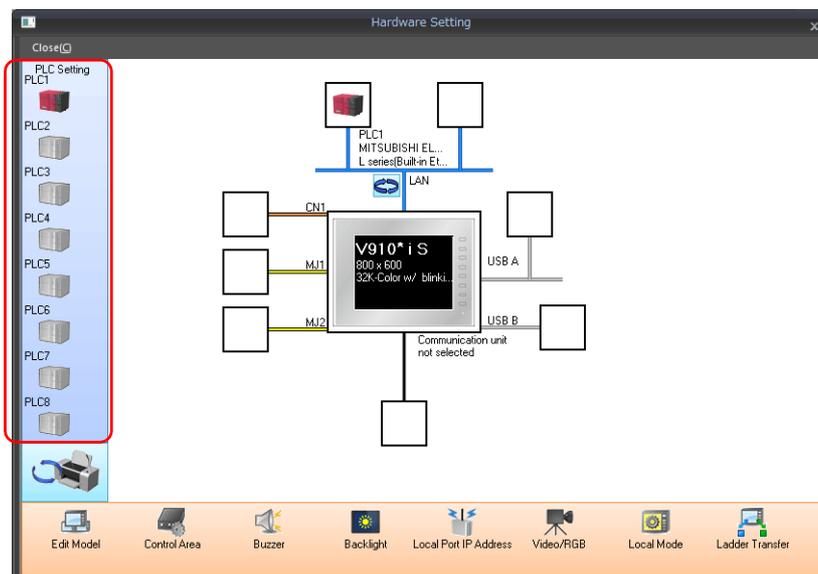

## Selecting a Device to be Connected


Double-click on a PLC icon in the [Hardware Setting] window to display the window shown below.

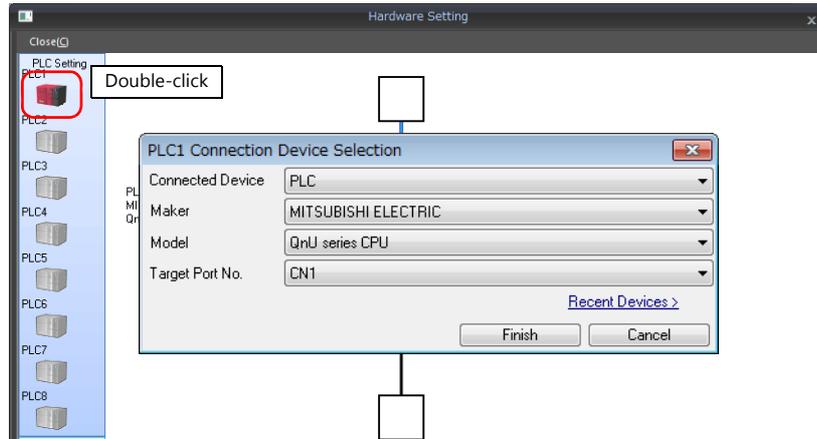



Item	Contents
Connected Device	Select the device to connect.
Maker	Select the maker of the device.
Model	Select the model of the device to connect. Refer to the respective chapter of each maker and select the appropriate model.
Target Port No.	Select the port to which the device connects to on the V9 series.

## PLC Properties

Click on the PLC icon in [Hardware Setting] to display the window shown below.

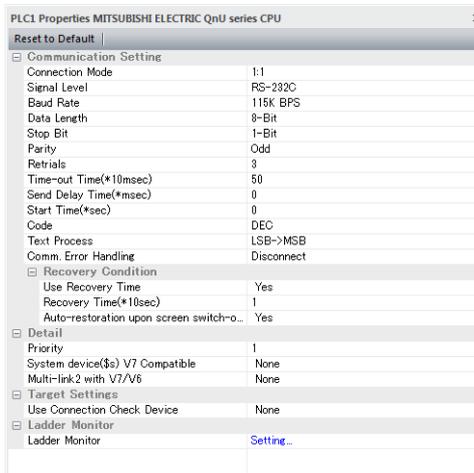


Item	Contents	
Communication Setting	Connection Mode	Select a connection mode. 1 : 1 / 1 : n / Multi-link / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet) Available options vary, depending on which device is connected. For details, see Connection Compatibility List provided at the end of this manual.
	Signal Level <sup>*1</sup>	Select a signal level. RS-232C/RS-422/485
	Baud Rate <sup>*1</sup>	Select a baud rate. 4800/9600/19200/38400/57600/76800/115K/187.5K <sup>*</sup> bps <sup>*</sup> Available only when connecting via Siemens S7-200PPI or S7-300/400MPI and CN1.
	Data Length <sup>*1</sup>	Select a data length. 7 / 8 bits
	Stop Bit <sup>*1</sup>	Select a stop bit. 1 / 2 bits
	Parity <sup>*1</sup>	Select an option for parity bit. None / Odd / Even
	Target Port No. <sup>*1</sup>	Specify a port number of the connected device. 0 to 31 (Modbus RTU: 1 to 255)

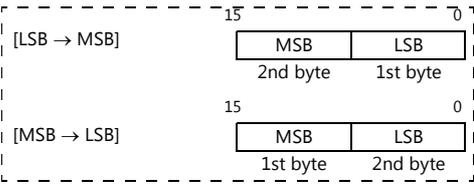Item		Contents	
Communication Setting	Transmission Mode <sup>*1</sup>	Select a transmission mode for the connected device. This setting is required if a device of Mitsubishi, Omron, Hitachi Industrial Equipment Systems, Yokogawa, JTEKT, or Yaskawa is in use.	
	Retrials	Specify the number of retrials to be allowed in the event of a timeout during communication. If a timeout persists even after as many retrials as specified, an error handling routine will take place. 1 to 255	
	Time-out Time	Specify a period of time allowed for V9 to monitor a response from its connected device. If no response is given within the specified time, retrial will be made. 0 to 999 (×10 msec)	
	Send Delay Time	Specify a delay time that elapses before V9 sends the next command after receiving a response from its connected device. Normally use the default setting. 0 to 255 (×1 msec)  	
	Start Time	Specify a delay time that elapses before V9 starts to send commands upon power-up. If V9 and its connected device are turned on at the same time and the device is slower to start up, set [Start Time]. 0 to 255 (×1 sec)	
	Code	Select a code for the connected device. The selected option is reflected through the data displayed on graphs or trending sampling parts. DEC/BCD	
	Text Process	Specify a byte order in text data. This setting is valid for macro commands that handle text. LSB → MSB/MSB → LSB 	
	Comm. Error Handling	Select an action to be taken in the event of a communication error. <ul style="list-style-type: none"> <li>• [Stop] Communication will be stopped entirely and the communication error screen will be displayed. The [RETRY] switch is available for attempting reestablishment of communication.</li> <li>• [Continue] The communication error message will be displayed at the center of the screen. The same communication will continue until restoration, and screen operation is not allowed then. When communication has been returned to a normal state, the message disappears and screen operation is allowed.</li> <li>• [Disconnect] No error message will appear and communication will proceed to the next one. However, communication with the device, in which a timeout was detected, will be disconnected. When a timeout is detected, ⚠ will be displayed for the part that is monitoring the address of the timeout device.</li> </ul> <p>* The communication status is displayed on the status bar. For information, refer to the V9 Series Troubleshooting/Maintenance Manual.</p>	
	Recovery Condition	Use Recovery Time	This setting is valid when [Disconnect] is selected for [Comm. Error Handling].
		Recovery Time	Return Time 1 to 255 (×10 sec) When the specified time has elapsed, V9 checks the recovery of the device which discontinued communicating.
Auto-restoration upon screen switch-over		When the screen is switched, V9 checks the recovery of the device which discontinued communicating.	

Item		Contents
Detail	Priority	[1] (higher priority) - [8] (lower priority) Specify the priority taken during 8-way communication. If interrupts from two or more devices occur at the same time, communication with these devices will take place in order of priority.
	System device (\$) V7 Compatible (PLC1)	This is set to [Yes] if the V7-series screen program (including temperature control network/PLC2Way settings) has been converted to data for the V9 series. System information relevant to 8-way communication will be stored in device memory addresses \$P1 and \$s. * For more information, see "1.5.1 \$Pn (For 8-way Communication)" (page 1-63).
	System device (\$) V7 Compatible (PLC2)	This is set to [Yes] if the V7-series screen program (including temperature control network/PLC2Way settings) has been converted to data for the V9 series. <ul style="list-style-type: none"> <li>[None] \$P2:493/494/495 is used as the transfer table control device memory.</li> <li>[Yes] \$s762/763/764 is used as the transfer table control device memory.</li> </ul> * For more information, see "1.5.1 \$Pn (For 8-way Communication)" (page 1-63).
	Device Memory Map Control Device	Specify the device memory for controlling device memory maps of PLC1 - PLC8. The device memory specified here is the same as [Control Device] in [Device Memory Map Setting] ([System Setting] → [Device Memory Map] → [Device Memory Map Edit] window → [Device Memory Map Setting]). * For more information, refer to the V9 Series Reference Manual 2.
Target Settings	Connect To	Set this for Ethernet communication. For more information, see "1.3.2 Ethernet Communication" (page 1-43).
	PLC Table	
	Use Connection Check Device	Select [Yes] for connection confirmation using a desired device memory address at the start of communication.
	Connection Check Device	Specify a desired device memory address used for connection confirmation.

\*1 Be sure to match the settings to those made on the connected device.


## 1.4.2 MONITOUCH Settings

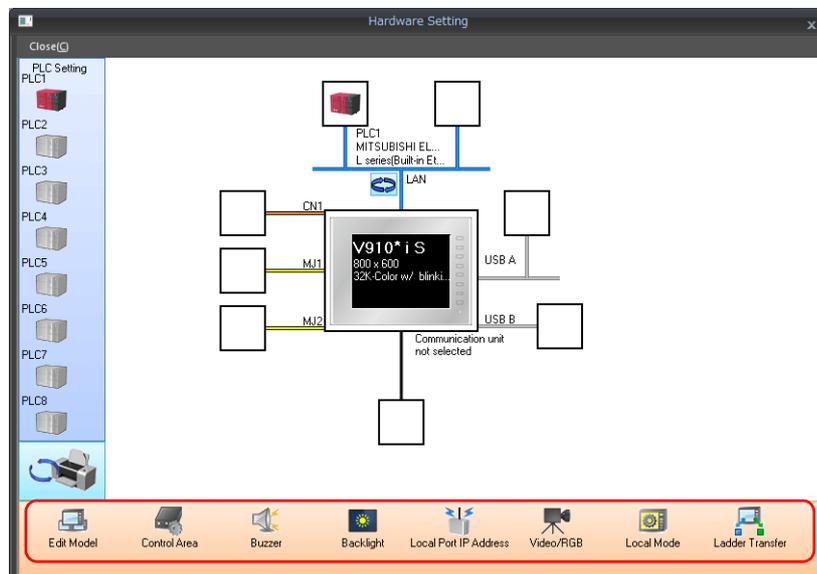

### Select Edit Model

Set the model of the V series to edit.  
For more information, refer to the V9 Series Reference Manual 1.

## Control Area

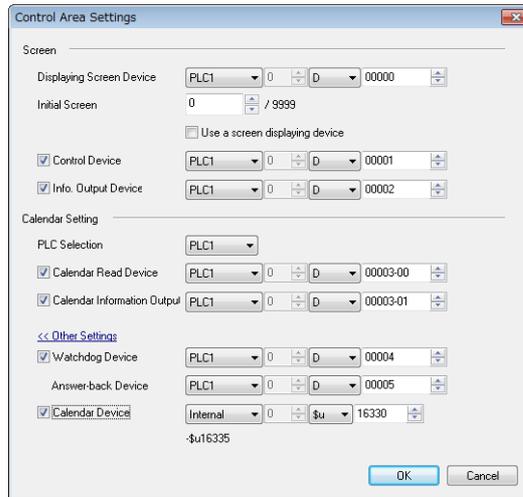

Item		Contents
Screen	Displaying Screen Device	This device memory is used for switching the screen by an external command. When a screen number is specified in a device memory, the screen is displayed. When the screen is switched by an internal switch, the currently displayed screen number is stored in this device memory.
	Initial Screen	Set the number of the screen to be displayed at start up.  * When recovering from a communication error, the screen number which was set for the screen displaying device memory is displayed.
	Use a screen displaying device	When this is checked, the screen number which was set for the screen displaying device memory is displayed as the initial screen.
	Control Device	For more information, refer to the V9 Series Reference Manual 1.
	Info. Output Device	
Calendar Setting	PLC Selection	This setting is valid when the V9 s built-in clock is not used. The setting allows the calendar data to be read from device memory via the selected port at PLC1 - PLC8.
	Calendar Read Device	This setting is valid when the V9 s built-in clock is not used. This bit should be used differently depending on whether the connected PLC is equipped with the calendar function. <ul style="list-style-type: none"> <li>When MONITOUCH is connected to a PLC with calendar function: When calendar data in the PLC is updated, it can forcibly be read by setting this bit (at the leading edge of [0 → 1]). In addition to calendar data update using this bit, calendar data in the PLC is automatically read and updated when:                             <ul style="list-style-type: none"> <li>- The power is turned on.</li> <li>- STOP → RUN</li> <li>- The date changes (AM 00:00:00).</li> </ul> </li> <li>When MONITOUCH is connected to a PLC without calendar function: A virtual calendar area can be provided by setting [Calendar Device] in [Other Settings]. Setting this bit (ON) will set the data stored in the calendar device memory as calendar data for MONITOUCH.</li> </ul>
	Calendar Information Output Device	The status of the calendar read device memory is stored.
Other Settings	Watchdog Device	When data is saved in this area, the same data is written to [Answer-back Device] after the screen has been displayed.
	Answer-back Device	
	Calendar Device	Use this device memory when the connected device is not equipped with the calendar function and the V9 series built-in clock is not used.

**\*1 Watchdog**


When the PLC is communicating with MONITOUCH, there is no means for the PLC to know whether or not MONITOUCH is doing operations correctly.

To solve this one-way communication, forcibly change data in the watchdog device memory and check that the same data is saved in the answer back device memory. This proves that the V series is correctly doing operations through communications with the PLC. This verification is called "watchdog".


Change data in watchdog device memory



Changes data in answer back device memory

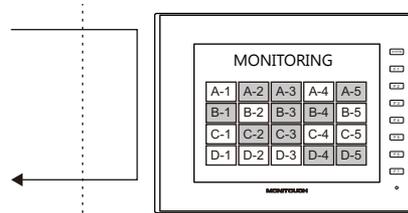

- \*2 Display scanning  
This operation can be utilized for display scanning. Forcibly change data in the watchdog device memory when giving a graphic change command and check that the same data is saved in the answer back device memory. This can prove that the graphic change command is received and executed correctly.

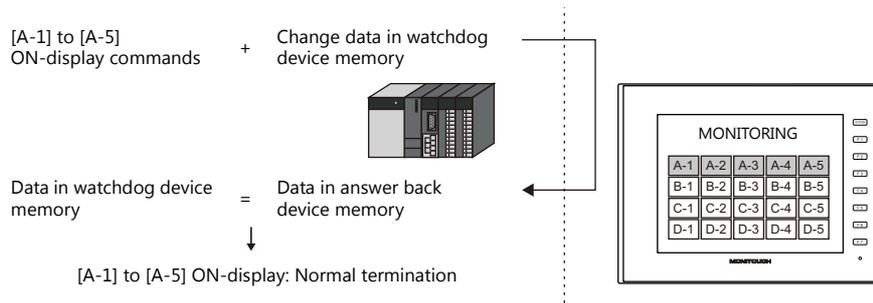

### Calendar device memory

Follow the steps below to set the calendar.

1. Specify the desired device memory address for [Calendar Device]. Six words are occupied consecutively.
2. Save calendar data in the calendar device memory address specified in step 1 in BCD notation. The address allocation of calendar device memory is shown below.

Device Memory	Contents
n	Year (BCD 0 to 99)
n + 1	Month (BCD 1 to 12)
n + 2	Day (BCD 1 to 31)
n + 3	Hour (BCD 0 to 23)
n + 4	Minute(s) (BCD 0 to 59)
n + 5	Second(s) (BCD 0 to 59)

The day of the week is automatically recognized from the above data. It is not necessary to input any data.

3. Set the calendar read device memory to ON. At the leading edge of this bit (0 → 1), data in the calendar device memory is set for calendar data on MONITOUCH.
  - \*1 Calendar data is cleared when the power is turned off. When the power is turned on, set calendar data according to the procedure mentioned above.
  - \*2 When using the calendar device memory, automatic reading of calendar data at the time of PLC connection as well as once-a-day automatic correction is not performed. Consequently, some errors may be introduced. Perform the procedure described above at regular intervals.


## Buzzer

Make settings for the buzzer.  
For more information, refer to the V9 Series Reference Manual 1.

## Backlight

Make settings for the backlight.  
For more information, refer to the V9 Series Reference Manual 1.

## Local IP Address

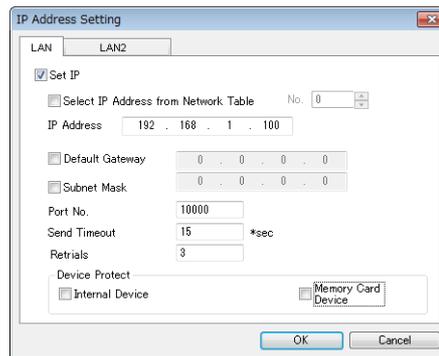

Item	Contents
Select IP Address from Network Table	This is valid when the IP address of the V9 has been registered in the network table. Select a network table number from 0 to 255 to set the IP address. * For more information on the network table, refer to "Network table" (page 1-57).
IP Address <sup>*1</sup>	Set the IP address for the V9.
Default Gateway <sup>*1</sup>	Set the default gateway.
Subnet Mask <sup>*1</sup>	Set the subnet mask. When this box is not checked, the subnet mask is automatically assigned based on the byte at the extreme left of the IP address. Example: When IP address is "172.16.200.185", "255.255.0.0" is set. When IP address is "192.168.1.185", "255.255.255.0" is set.
Port No. <sup>*1</sup>	Set a port number from 1024 to 65535. Other than 8001.
Send Timeout	Specify the timeout time to send the EREAD/EWRITE/SEND/MES command.
Retrials	0 to 255 Set the number of retrials to be performed when a time-out occurs.
Device Protect Internal Device Memory Card Device	Check either check box to write-protect the device memory from computers or other stations.

<sup>\*1</sup> For more information on each setting item, see "Basics of ethernet settings" (page 1-58).


## Network table

This is an area for registering IP addresses of the MONITOUCH, PC and other devices.

Select [System Setting] → [Ethernet Communication] → [Network Table] and register.



Double-click a number in the No. column to display the [Network Table Setting] dialog. An IP address and other items can be registered.

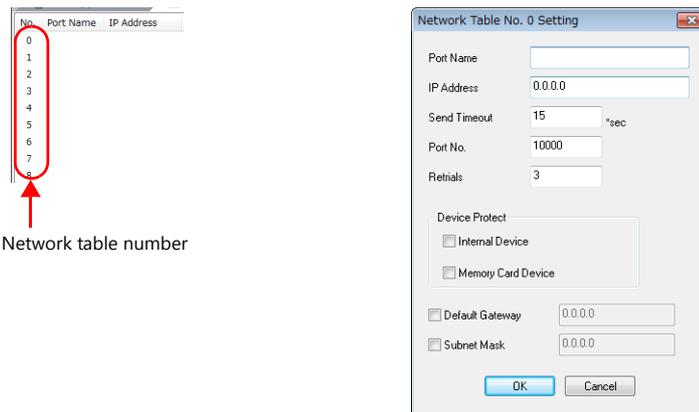

Item	Contents
Port Name	Set the name of the V9 or the computer.
IP Address <sup>*1</sup>	Set the IP address of the V9 or the computer.
Send Timeout <sup>*2</sup>	Specify the timeout time to send the EREAD/EWRITE/SEND/MES command.
Port No. <sup>*1</sup>	Set the port number of the V9 or the computer.
Retrials <sup>*2</sup>	0 to 255 Set the number of retrials to be performed when a time-out occurs.
Device Protect <sup>*2</sup> Internal Device Memory Card Device	Check either check box to write-protect the device memory from computers or other stations.
Default Gateway <sup>*1 *2</sup>	Set the default gateway.
Subnet Mask <sup>*1 *2</sup>	Set the subnet mask.

<sup>\*1</sup> For more information on each setting item, see "Basics of ethernet settings" (page 1-58).

<sup>\*2</sup> Invalid if V9 units or PCs at other ports are registered. Only valid when set as the local port IP of the V9 unit.

## Basics of ethernet settings

IP address				
This is an address that is used for recognizing each node on the Ethernet and should be unique. The IP address is 32-bit data which consists of the network address and the host address and can be classified into classes A to C depending on the network size.				
Class A	<table border="1"> <tr> <td>0</td> <td>Network address (7)</td> <td>Host address (24)</td> </tr> </table>	0	Network address (7)	Host address (24)
0	Network address (7)	Host address (24)		
Class B	<table border="1"> <tr> <td>10</td> <td>Network address (14)</td> <td>Host address (16)</td> </tr> </table>	10	Network address (14)	Host address (16)
10	Network address (14)	Host address (16)		
Class C	<table border="1"> <tr> <td>110</td> <td>Network address (14)</td> <td>Host address (8)</td> </tr> </table>	110	Network address (14)	Host address (8)
110	Network address (14)	Host address (8)		
<p>&lt;Notation&gt; A string of 32-bit data is divided into four, and each segment delimited with a period is in decimal notation. Example: The IP address in class C shown below is represented as "192.128.1.50". 11000000 10000000 00000001 00110010</p> <p>&lt;Unusable IP addresses&gt;</p> <ul style="list-style-type: none"> <li>• "0" is specified for one byte at the extreme left. Example: 0.x.x.x</li> <li>• "127" is specified for one byte at the extreme left (loop back address). Example: 127.x.x.x</li> <li>• "224" or more is specified for one byte at the extreme left (for multi-cast or experiment). Example: 224.x.x.x</li> <li>• The host address consists of only "0" or "255" (broadcast address). Example: 128.0.255.255, 192.168.1.0</li> </ul>				

Port No.
Multiple applications are running on each node, and communications are carried out for each application between the nodes. Consequently, it is necessary to have a means to identify the application that data should be transferred to. The port number works as this identifier. Each port number is 16-bit data (from 0 to 65535). The V9 series uses the port for screen program transfer (8001), PLC communication (as desired), and the simulator (8020). Set a unique number in the range of 1024 to 65535. For a PLC or a computer, set the port number in the range of 256 to 65535. It is recommended to set a greater number.

Default gateway
A gateway and a router are used for communication between different networks. The IP address of the gateway (router) should be set to communicate with the node(s) on other networks.

Subnet mask																			
A subnet mask is used for dividing one network address into multiple networks (subnet). The subnet is assigned by specifying a part of the host address in the IP address as a subnet address.																			
<table border="1"> <tr> <td>Class B</td> <td>10</td> <td>Network address (14)</td> <td>Host address (16)</td> </tr> <tr> <td>Subnet mask</td> <td>255</td> <td>255</td> <td>255</td> <td>0</td> </tr> <tr> <td></td> <td>11111111</td> <td>11111111</td> <td>11111111</td> <td>00000000</td> </tr> <tr> <td></td> <td>Network address</td> <td>Subnet address</td> <td>Host address</td> <td></td> </tr> </table>	Class B	10	Network address (14)	Host address (16)	Subnet mask	255	255	255	0		11111111	11111111	11111111	00000000		Network address	Subnet address	Host address	
Class B	10	Network address (14)	Host address (16)																
Subnet mask	255	255	255	0															
	11111111	11111111	11111111	00000000															
	Network address	Subnet address	Host address																
<p>&lt;Unusable subnet masks&gt;</p> <ul style="list-style-type: none"> <li>• All bits are set to "0".....0.0.0.0</li> <li>• All bits are set to "1".....255.255.255.255</li> </ul>																			


## Video/RGB

Make settings for the Inputting Video/RGB.  
For more information, refer to the V9 Series Reference Manual 2.

## Local Mode Screen


Make prohibition settings for Local mode.  
For more information, refer to the V9 Series Reference Manual 1.

## Ladder Transfer

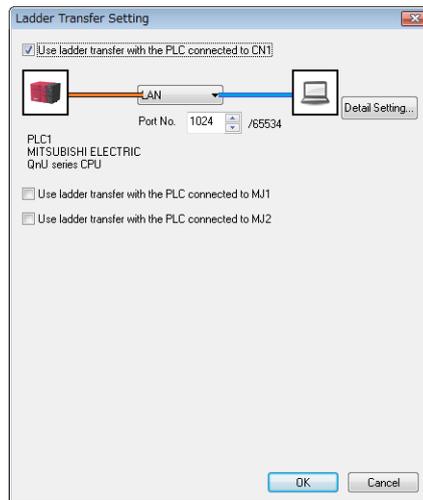

Item	Contents
Use ladder transfer with the PLC connected to CN1	Select the check box and specify the port to connect with PC when using the ladder transfer function. * For more information, refer to the V9 Series Reference Manual 2.
Use ladder transfer with the PLC connected to MJ1	
Use ladder transfer with the PLC connected to MJ2	


### 1.4.3 Other Equipment

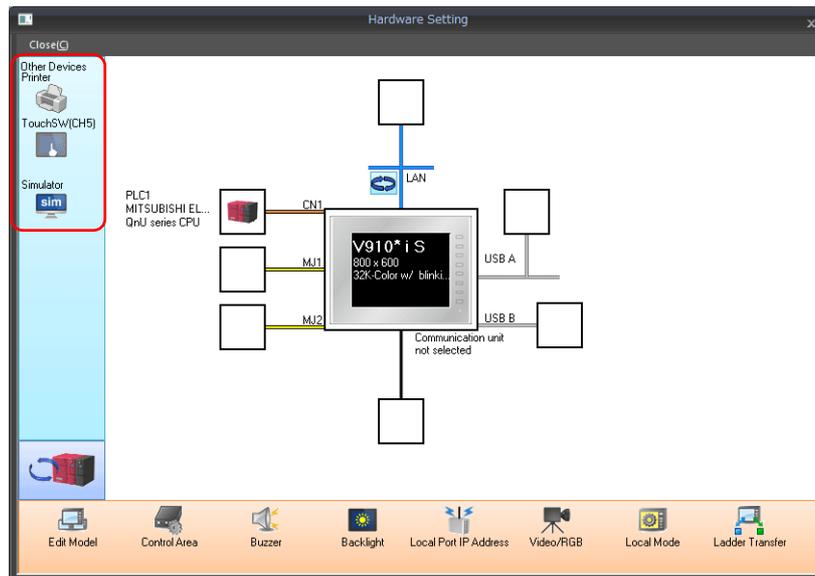

## Printer


Configure these settings when connecting a printer.

### Selecting the printer model

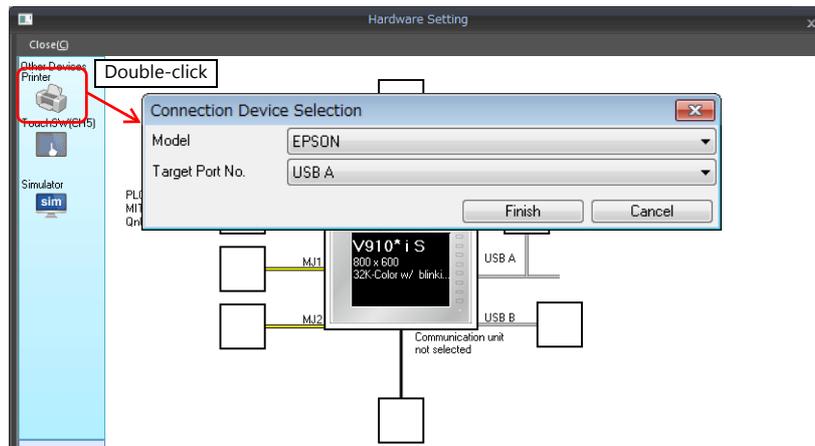

Item	Contents
Model	Select the model of the printer to connect.
Target Port No.	Select the port to connect the printer cable to. USB A: Select when connecting an EPSON, ESC/P-R compatible printer. Also use this setting when connecting a parallel printer using a commercially available parallel-to-USB cable. USB B: Select when connecting a PictBridge-compatible printer. MJ1/MJ2: Select when connecting with the serial interface of a printer. Also select whether to use MJ1 or MJ2 of the V9 series.

Printer properties

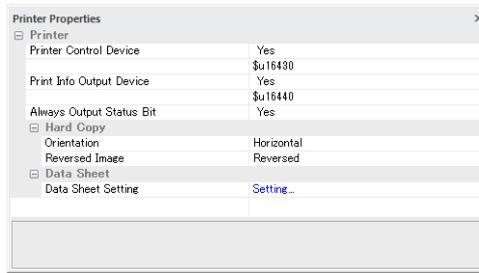

Item	Contents																																
Printer Control Device	<p>When this setting is enabled and the bit is set to ON (0 → 1), screen images and data sheets can be printed out.</p> <p>MSB <span style="float:right">LSB</span></p> <table border="1" style="width:100%; text-align:center;"> <tr><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>09</td><td>08</td><td>07</td><td>06</td><td>05</td><td>04</td><td>03</td><td>02</td><td>01</td><td>00</td></tr> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td></tr> </table> <p style="text-align:right;">0 → 1: Screen image output 0 → 1: Data sheet output</p>	15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00																		
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0																		
Printer Info Output Device	<p>When this setting is enabled, the status of the printer is stored in the specified address.</p> <p>MSB <span style="float:right">LSB</span></p> <table border="1" style="width:100%; text-align:center;"> <tr><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>09</td><td>08</td><td>07</td><td>06</td><td>05</td><td>04</td><td>03</td><td>02</td><td>01</td><td>00</td></tr> <tr><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td></tr> </table> <p style="text-align:right;">0: End (standby) 1: Transferring print data 0: Not busy status 1: Busy status</p>	15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00																		
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0																		
Always Output Status Bit	<p>The V9 series outputs [0 → 1] when starting to transfer data upon receiving a print command, and outputs [1 → 0] upon finishing transfer. However, these signals may not be output if the print data is small. Select [Yes] to output a signal regardless of the data size.</p> <p>The output area is as follows:</p> <ul style="list-style-type: none"> <li>• Bit 1 of the device memory for printer information output</li> <li>• Bit 0 of internal device memory \$s16</li> </ul> <p>\$s16</p> <p>MSB <span style="float:right">LSB</span></p> <table border="1" style="width:100%; text-align:center;"> <tr><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>09</td><td>08</td><td>07</td><td>06</td><td>05</td><td>04</td><td>03</td><td>02</td><td>01</td><td>00</td></tr> <tr><td></td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td></tr> </table> <p style="text-align:right;">0: End (standby) 1: Transferring print data</p>	15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00																		
	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0																		
Hard Copy	<p>Orientation</p> <p>Specify the printing orientation of the screen on paper. In vertical output, the screen is rotated 90° clockwise with respect to the printing paper and printed out.</p> <ul style="list-style-type: none"> <li>• Printing examples of hard copies:</li> </ul> <div style="display: flex; justify-content: space-around; align-items: center;"> <div style="text-align: center;"> <p>Horizontal</p> </div> <div style="text-align: center;"> <p>Vertical</p> </div> </div>																																
	<p>Reversed Image</p> <p>Reversed: Screens are printed with black and white inverted. Normal: Screens are printed as they are displayed on MONITOUCH.</p>																																
Data Sheet	<p>Data Sheet Setting</p> <p>Make settings for printing data sheets. For more information, refer to the V9 Series Reference Manual 1.</p>																																
<p>Use PictBridge only on USB-B port.</p> <p>Make this setting when using a PictBridge-compatible printer. Select [Yes] when starting up the USB-B port as the connection port for a PictBridge printer in the RUN mode. When transferring screen programs via the USB-B port, switch to Local mode.</p>																																	

---

Item		Contents
Serial Port	Baud Rate	Set the communication baud rate. 4800/9600/19200/38400/57600/76800/115K BPS
	Parity	Select an option for parity bit. None / Odd / Even
	Data Length	Select a data length. 7 bits / 8 bits
	Stop Bit	Select a stop bit. 1 bit / 2 bits

\* For details on printing, refer to the V9 Series Reference Manual 1.

## Touch Switch (CH5)

---

Configure this setting when emulating touch switches on the RGB input screen.  
The optional unit "GUR-01" is required for RGB input display.  
For details on touch switch emulation, refer to the V9 Series Reference Manual 2.

## Simulator

---

Configure this setting when saving a simulator communication program to a storage device (SD card or USB flash drive) in addition to screen program data using the storage manager.

## 1.5 System Device Memory for Communication Confirmation

The V9 series has addresses \$s and \$Pn as system device memory.

- \$Pn  
This is the system device memory for 8-way communications, and 512 words are allocated for each logical port. For more information, see "1.5.1 \$Pn (For 8-way Communication)".
- \$s518  
This is the system device memory for confirming the Ethernet status. For more information, see "1.5.2 \$s518 (Ethernet Status Confirmation)".

For the device memory address \$s, \$s0 to 2047 (2 K words) are assigned and data can be read from written to this area. For more information on addresses other than \$s518, refer to the V9 Series Reference Manual 1.

### 1.5.1 \$Pn (For 8-way Communication)

This is the system device memory for 8-way communications, and 512 words are assigned for each logical port. Refer to the next section for more information.

\$P1: 0000 : \$P1: 0511	PLC1 area
\$P2: 0000 : \$P2: 0511	PLC2 area
\$P3: 0000 : \$P3: 0511	PLC3 area
\$P4: 0000 : \$P4: 0511	PLC4 area
\$P5: 0000 : \$P5: 0511	PLC5 area
\$P6: 0000 : \$P6: 0511	PLC6 area
\$P7: 0000 : \$P7: 0511	PLC7 area
\$P8: 0000 : \$P8: 0511	PLC8 area

## \$Pn List

The \$Pn list is presented below. Part of the information of logical ports PLC1/PLC2 can also be stored in \$.<sup>\*1</sup>

\$Pn (n = 1 to 8)	\$. <sup>*1</sup>	Contents	Device Type
000	111 (PLC1)	V9 local port number Stores the local port number of the V9 series. (Universal serial communication, slave communication, etc.)	←V
:	-	:	
004	130 (PLC1) <sup>*2</sup>	Modbus TCP/IP Sub Station communications Relay station No. designated device memory When a relay station number is set with a MOV macro command, the error information of the sub station number that is connected to that relay station is stored in \$Pn010 to 025.	→V
:	-	:	
010	128 (PLC1)	Link down information (station No. 0 - 15) 0: Normal 1: Down	←V
011	129 (PLC1)	Link down information (station No. 16 - 31) 0: Normal 1: Down	
012	114 (PLC1)	Link down information (station No. 32 - 47) 0: Normal 1: Down	
013	115 (PLC1)	Link down information (station No. 48 - 63) 0: Normal 1: Down	
014	116 (PLC1)	Link down information (station No. 64 - 79) 0: Normal 1: Down	
015	117 (PLC1)	Link down information (station No. 80 - 95) 0: Normal 1: Down	
016	118 (PLC1)	Link down information (station No. 96 - 111) 0: Normal 1: Down	
017	119 (PLC1)	Link down information (station No. 112 - 127) 0: Normal 1: Down	
018	120 (PLC1)	Link down information (station No. 128 - 143) 0: Normal 1: Down	
019	121 (PLC1)	Link down information (station No. 144 - 159) 0: Normal 1: Down	
020	122 (PLC1)	Link down information (station No. 160 - 175) 0: Normal 1: Down	
021	123 (PLC1)	Link down information (station No. 176 - 191) 0: Normal 1: Down	
022	124 (PLC1)	Link down information (station No. 192 - 207) 0: Normal 1: Down	
023	125 (PLC1)	Link down information (station No. 208 - 223) 0: Normal 1: Down	
024	126 (PLC1)	Link down information (station No. 224 - 239) 0: Normal 1: Down	
025	127 (PLC1)	Link down information (station No. 240 - 255) 0: Normal 1: Down	
:	-	:	
099	-	Error information hold (page 1-67) Setting for the update timing of the \$Pn: 010 to 025 link down information 0: Always updated with the latest information Other than 0: Only updated when a communication error occurs	→V
100	730 (PLC2)	Error status Station No. 00 status (page 1-68)	←V
101	731 (PLC2)	Error status Station No. 01 status (page 1-68)	
102	732 (PLC2)	Error status Station No. 02 status (page 1-68)	
103	733 (PLC2)	Error status Station No. 03 status (page 1-68)	
104	734 (PLC2)	Error status Station No. 04 status (page 1-68)	
105	735 (PLC2)	Error status Station No. 05 status (page 1-68)	
106	736 (PLC2)	Error status Station No. 06 status (page 1-68)	
107	737 (PLC2)	Error status Station No. 07 status (page 1-68)	
108	738 (PLC2)	Error status Station No. 08 status (page 1-68)	
109	739 (PLC2)	Error status Station No. 09 status (page 1-68)	

\$Pn (n = 1 to 8)	\$s <sup>*1</sup>	Contents	Device Type	
110	740 (PLC2)	Error status Station No. 10 status (page 1-68)	←V	
:	:	:		
120	750 (PLC2)	Error status Station No. 20 status (page 1-68)		
:	:	:		
130	760 (PLC2)	Error status Station No. 30 status (page 1-68)		
131	761 (PLC2)	Error status Station No. 31 status (page 1-68)		
132	820 (PLC2)	Error status Station No. 32 status (page 1-68)		
133	821 (PLC2)	Error status Station No. 33 status (page 1-68)		
:	:	:		
140	828 (PLC2)	Error status Station No. 40 status (page 1-68)		
:	:	:		
150	838 (PLC2)	Error status Station No. 50 status (page 1-68)		
:	:	:		
160	848 (PLC2)	Error status Station No. 60 status (page 1-68)		
:	:	:		
170	858 (PLC2)	Error status Station No. 70 status (page 1-68)		
:	:	:		
180	868 (PLC2)	Error status Station No. 80 status (page 1-68)		
:	:	:		
190	878 (PLC2)	Error status Station No. 90 status (page 1-68)		
:	:	:		
199	887 (PLC2)	Error status Station No. 99 status (page 1-68)		
200	-	Error status Station No. 100 status (page 1-68)		
:	:	:		
350	-	Error status Station No. 250 status (page 1-68)		
:	:	:		
355	-	Error status Station No. 255 status (page 1-68)		
356	-	Device memory map 0 Status		←V
357	-	Device memory map 0 Error code 1		
358	-	Device memory map 0 Error code 2		
359-361	-	Device memory map 1 Status, error code		
362-364	-	Device memory map 2 Status, error code		
365-367	-	Device memory map 3 Status, error code		
368-370	-	Device memory map 4 Status, error code		
371-373	-	Device memory map 5 Status, error code		
374-376	-	Device memory map 6 Status, error code		
377-379	-	Device memory map 7 Status, error code		
380-382	-	Device memory map 8 Status, error code		
383-385	-	Device memory map 9 Status, error code		
386-388	-	Device memory map 10 Status, error code		
389-391	-	Device memory map 11 Status, error code		
392-394	-	Device memory map 12 Status, error code		
395-397	-	Device memory map 13 Status, error code		
398-400	-	Device memory map 14 Status, error code		
401-403	-	Device memory map 15 Status, error code		
404-406	-	Device memory map 16 Status, error code		
407-409	-	Device memory map 17 Status, error code		
410-412	-	Device memory map 18 Status, error code		
413-415	-	Device memory map 19 Status, error code		
416-418	-	Device memory map 20 Status, error code		

\$Pn (n = 1 to 8)	\$s*1	Contents	Device Type
419-421	-	Device memory map 21 Status, error code	←V
422-424	-	Device memory map 22 Status, error code	
425-427	-	Device memory map 23 Status, error code	
428-430	-	Device memory map 24 Status, error code	
431-433	-	Device memory map 25 Status, error code	
434-436	-	Device memory map 26 Status, error code	
437-439	-	Device memory map 27 Status, error code	
440-442	-	Device memory map 28 Status, error code	
443-445	-	Device memory map 29 Status, error code	
446-448	-	Device memory map 30 Status, error code	
449	-	Device memory map 31 Status	
450	-	Device memory map 31 Error code 1	
451	-	Device memory map 31 Error code 2	
:	:	:	
493	762 (PLC2)*3	Device memory map reading prohibited flag (refer to the V9 Series Reference Manual 2). 0: Periodical reading/synchronized reading executed Other than 0: Periodical reading/synchronized reading stopped	→V
494	763 (PLC2)*3	Forced execution of the device memory map TRL_READ/TBL_WRITE macro Setting for macro operation when there is a station with a communication error 0: The macro is not executed in relation to any of the stations. Other than 0: The macro is executed in relation to connected stations.	
495	764 (PLC2)*3	Device memory map writing prohibited flag (refer to the V9 Series Reference Manual 2). 0: Periodical writing/synchronized writing executed Other than 0: Periodical writing/synchronized writing stopped	
:	-	:	
500	800 (PLC3)	Device memory for Modbus slave communications  Used for setting the number of the reference device memory map and the device memory for referring free area 31.Used for setting the number of the reference device memory map and the device memory for referring free area 31. \$Pn500 to 505 are exclusively used for monitoring; \$s800 to 805 are used for writing from the Modbus master.  Refer to the Modbus Slave Communication Specifications.	→V
501	801 (PLC3)		
502	802 (PLC3)		
503	803 (PLC3)		
504	804 (PLC3)		
505	805 (PLC3)		
:	:	:	
508	765 (PLC2)	Error response code (page 1-70) If "800BH" (error code received) is stored for the error status (\$Pn100 to 355), it is possible to check the error code.	←V
509	766 (PLC2)		
510	767 (PLC2)		
511	768 (PLC2)		

\*1 For PLC1, select [Yes] for [System device (\$s) V7 Compatible] under [Detail] on the [PLC Properties] window. The same information is stored in the \$P1 and \$s.

\*2 If designating the relay station number using \$s130, select [Yes] for [System device (\$s) V7 Compatible] under [Detail] on the [PLC Properties] window for PLC1. \$P1: 004 cannot be used in this case.

\*3 If executing device memory map control using \$s762, \$s763 and \$s764, select yes for [System device (\$s) V7 Compatible] under [Detail] on the [PLC Properties] window for PLC2. Note that \$P2: 493/494/495 cannot be used in this case.

## Details

### \$Pn:99

The update timing for the link down information stored in \$Pn:010 to 025 is set here.

- 0: Always updated with the latest information
- Other than 0: Only updated when a communication error occurs

- Example:

An error has occurred at station No. 18. 2nd bit of \$Pn: 011 is set (ON).

	Station No. 31													Station No. 16				
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0		
\$Pn: 011	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0		

↓
↓
Station No. 18 Link down

After resetting communications

- If \$Pn: 99 = 0, the link down information is updated.

	Station No. 31													Station No. 16				
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0		
\$Pn: 011	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

↓
Station No. 18 Normal communication

- If \$Pn: 99 = other than 0, the link down information is not updated.

	Station No. 31													Station No. 16				
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0		
\$Pn: 011	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0		


↓
Station No. 18 Link down

**\$Pn: 100 to 355**

The results of communication with each station are stored here. The status codes are shown below.

Code (HEX)	Contents
0000H	Normal
FFFFH	Time-out
8001H	Check code error
8002H	Data error
800BH	Receives the error code from the connected device

Errors other than the above are stored as shown below.

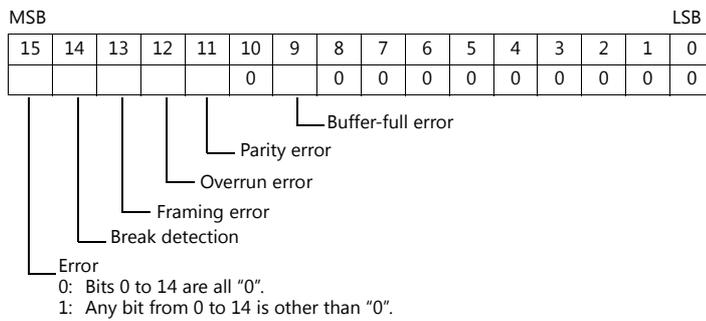

Error	Details	Solution
Time-out	Although a request to send is given, no answer is returned within the specified time.	Implement solutions 1, 2, and 3.
Check code	The check code of the response is incorrect.	Implement solutions 1 and 3.
Data error	The code of the received data is invalid.	Implement solutions 1, 2, and 3.
Error code received	An error occurred on the connected device.	Refer to the instruction manual for the PLC.
Buffer full	The V9 buffer is full.	Contact your local distributor.
Parity	An error occurred in parity check.	Implement solutions 2 and 3.
Overrun	After receiving one character, the next character was received before internal processing was completed.	Implement solutions 1 and 3.
Framing	Although the stop bit must be "1", it was detected as "0".	Implement solutions 1, 2, and 3.
Break detection	The connected device's SD is remaining at the low level.	Examine the connection with the connected device's SD and RD.

- Solution

- 1) Check if the communication settings of the V9 series and the connected device are matched.
- 2) Check the cable connection.
- 3) Data may be disrupted because of noise. Fix noise.

If you still cannot solve the error even after following the solutions above, contact your local distributor.

**\$Pn: 356 to 451**


This device memory is valid when an Omron ID controller (V600/620/680) is connected with [Guarantee synchronism of the data] checked on the [Device Memory Map Setting] dialog.

- Status (\$Pn 356, 359, ...)

The execution status of the device memory map is stored here.

The bit is set (ON) when reading or writing of the first data in the device memory map is correctly finished.

When the control device memory (command bit) is set (ON), the bit is reset.

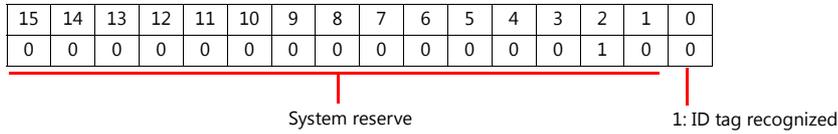

- Error code 1 (\$Pn 357, 360, ...)


An error code is stored when an error occurs in the reading or writing of data in the device memory map.

If multiple errors occur in the device memory map, the last error code is stored.

When the control device memory (command bit) is set (ON), the bit is reset.

Code (HEX)	Contents
FFFFH	Time-out
8001H	Check code error
8002H	Data error
800BH	Receives the error code from the connected device

Errors other than the above are stored as shown below.

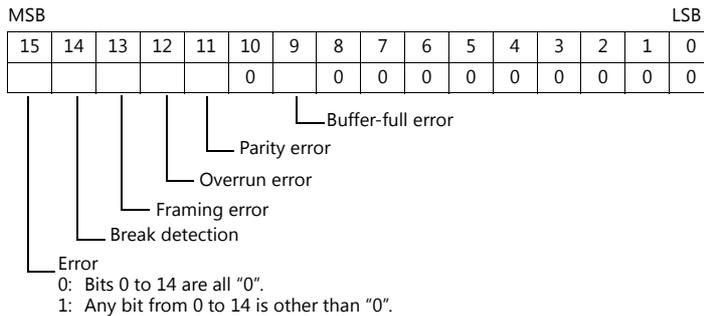

- Error code 2 (\$Pn 358, 361, ...)

The exit code is stored here when "800BH" of error code 1 is stored.

Exit Code (HEX)		Contents
10	Host communication error	Parity error
11		Framing error
12		Overrun error
13		FCS error
14		Format error, execution status error
18		Frame length error
70	Slave communication error	Tag communication error
71		Inconsistency error
72		Tag absence error
76		Copy error
7A		Address error
7C		Antenna disconnection error
7D		Write protect error
75	Tag device memory warning	Data check command Exit code stored when the writing count management command has been successfully processed (without any error)
76		Data check command Exit code stored when the writing count management command has abnormally been processed (comparison error, excessive writing counts)
92	System error	Abnormal mains voltage at antenna
93		Internal device memory error

**\$Pn: 508 to 511**


If "800BH" is stored for the error status information (\$Pn: 100 to 355), on transferring the data of that station number to any internal device memory address, the reception code will be obtained at \$Pn: 508 to 511.

**Notes on use**


- Use \$u/\$T as the target internal device memory.
- Use the macro command MOV (W). MOV (D) cannot be used.
- "0" is stored to device memory addresses that have no expansion error code.

- Example PLC2: Fuji Electric PXR station No. 1


- 1) On receipt of an error code at station No. 1 of PLC2, "800BH" is stored in \$P2:101.

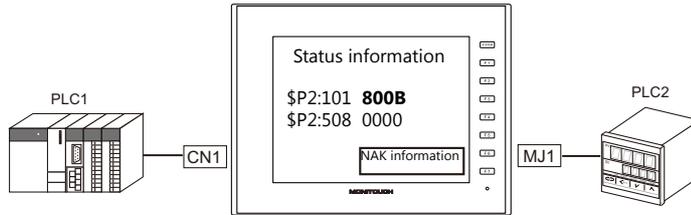

- 2) The data of \$P2: 101 is transferred to \$u1000 by a MOV command.  
\$u1000 = \$P2: 101 (W)

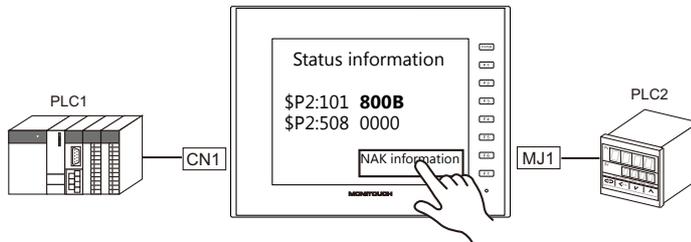

- 3) The reception code is stored in \$P2: 508.  
\$P2:508 = 0002H

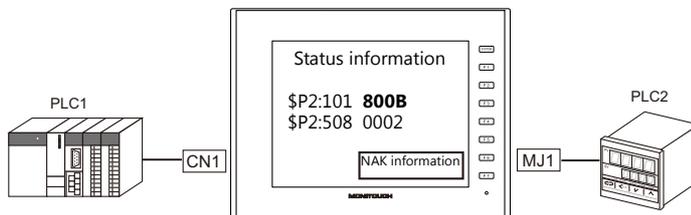

- 4) The PXR manual shows that code 002H means "device memory address range exceeded". Amend the screen program address designation.

## 1.5.2 \$s518 (Ethernet Status Confirmation)

Stores the current status of the Ethernet.


Address	Contents	Stored Value
\$s518	Ethernet status (for built-in LAN port)	<ul style="list-style-type: none"> <li>• [0]: Normal</li> <li>• [Other than 0]: Error</li> </ul> * For details on errors, refer to the next section.

### Error details

No.	Built-in LAN	Contents	Solution
201	○	Send error	Check that the setting on the target station is consistent with the network table setting.
203	○	TCP socket creation error	The TCP socket cannot be created. Turn the power off and back on again, or check the communication line status, e.g., if the port number is duplicated.
204	○	TCP connection over	The number of connections reaches the maximum (256), and no more connection is possible. Check the communication lines.
205	○	TCP connection error	Connection cannot be established. Check the communication lines, or turn the power off and back on again.
207	○	TCP send error	TCP communication has failed. Check the communication lines.
208	○	TCP connection interruption notification from the connected device	Check the connected device and communication lines.
261	○	Send processing full error	Sending process is disabled. Check the communication lines.
350	○	Send buffer full	The line is busy. Consult the network administrator of your company. The communication unit is of an old version or is faulty.
801	○	Link down error	Check the HUB or the link confirmation LED on the communication unit. If the LED is not on, check cable connection and the port setting on the network table.
1202	○	MAC address error	The MAC address is not registered. Repair is necessary.
2001	○	Undefined error	Turn the power off and back on again. If the problem persists, the unit may be faulty. Contact your local distributor.

# MEMO

**MONITOUCH**



## **2. SAIA**

---

### 2.1 PLC Connection

## 2.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU	Unit/Port	Signal Level	Connection			Ladder Transfer <sup>*2</sup>
				CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906	
PCD	PCD1.M120 PCD1.M130	PGU port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
	PCD2.M120 PCD2.M130	PCD7.F120	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		
	PCD2.M170 PCD2.M480	PCD7.F110	RS-422	Wiring diagram 1 - C4	Wiring diagram 1 - M4		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

### Ethernet Connection

PLC Selection on the Editor	CPU	Unit	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>
PCD S-BUS (Ethernet)	PCD.M3120 PCD.M3330 PCD.M5340 PCD.M5540 PCD.M6340 PCD.M6540	CPU with built-in Ethernet	×	○	5050 fixed	○	×

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

## 2.1.1 PCD

### Communication Setting

#### Editor


#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1</u> :1 / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	9600 / <u>19200</u> / 38400 / 57600 / 115K bps	
Data Length	8 bits	
Stop Bit	1 bits	
Target Port No.	1	

#### PLC

#### PCD

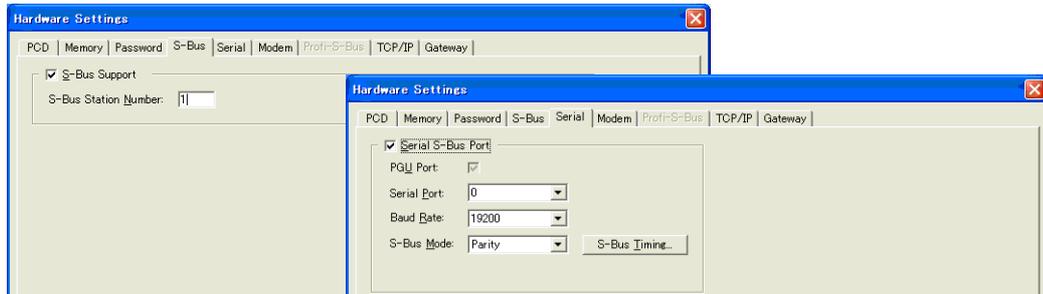

Item	Setting	Remarks
S-Bus Station Number	1	
Serial Port	0: PGU Port 1: PCD7.F120 / F110	
Baud Rate	19200 bps	
S-Bus Mode	Parity	

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (register)	00H	Double-word
Rfp (register/floating point)	01H	Double-word
T (timer)	02H	Double-word
C (counter)	03H	Double-word
I (input)	04H	Read only
O (output)	05H	
F (flag)	06H	

## 2.1.2 PCD S-BUS (Ethernet)

### Communication Setting


#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

##### PCD S-BUS (Ethernet)

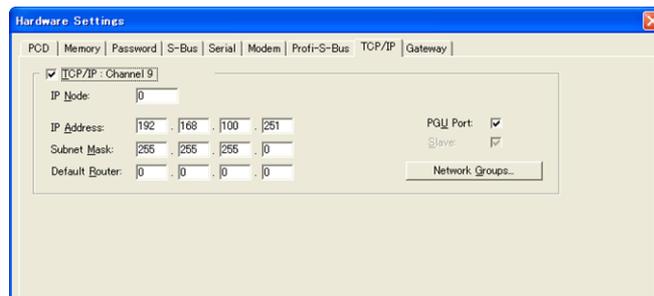

Item	Setting	Remarks
IP Node	Make settings in accordance with the network environment.	For more information, refer to the manual of the PLC.
IP Address	PLC's IP address	
Subnet Mask	PLC's subnet mask	
Default Router	Make settings in accordance with the network environment.	

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
R (register)	00H	Double-word
Rfp (register/floating point)	01H	Double-word
T (timer)	02H	Double-word
C (counter)	03H	Double-word
I (input)	04H	Read only
O (output)	05H	
F (flag)	06H	

### 2.1.3 Wiring Diagrams


#### When Connected at CN1:

#### RS-232C

Wiring diagram 1 - C2

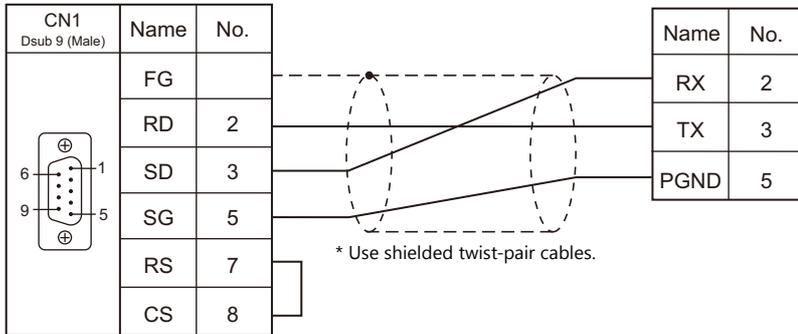


Wiring diagram 2 - C2

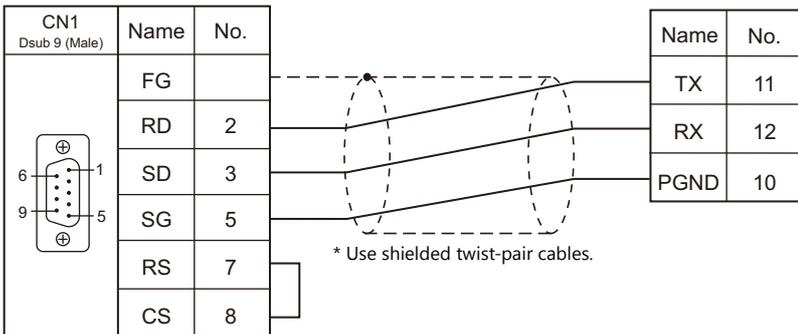

#### RS-422/RS-485


Wiring diagram 1 - C4

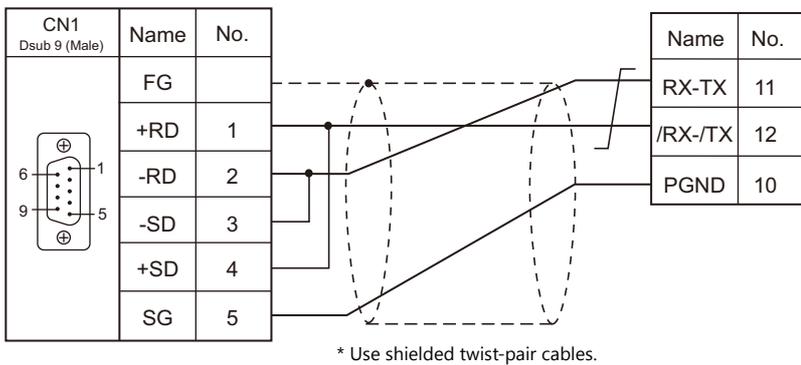

## When Connected at MJ1/MJ2:


### RS-232C

#### Wiring diagram 1 - M2

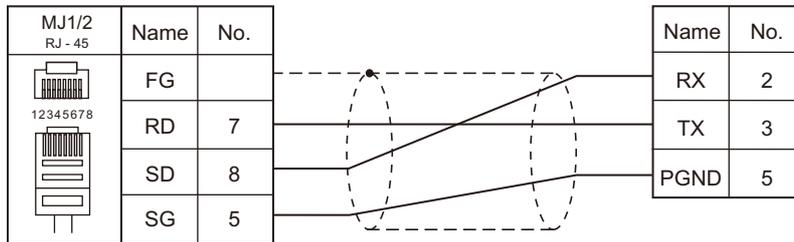

\* Use shielded twist-pair cables.


#### Wiring diagram 2 - M2

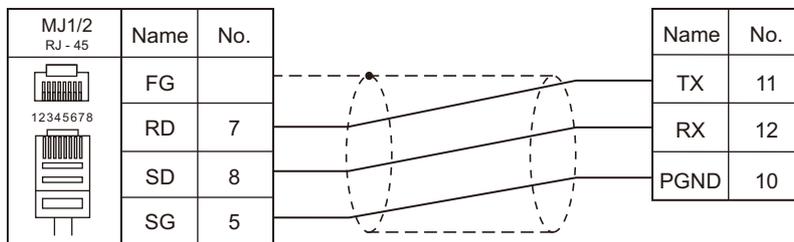

\* Use shielded twist-pair cables.


### RS-422/RS-485

#### Wiring diagram 1 - M4

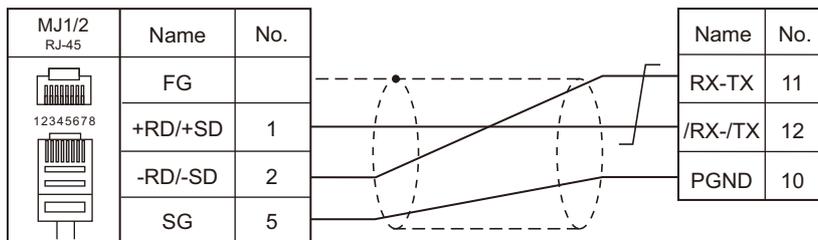

\* Use shielded twist-pair cables.

# MEMO



# 3. SAMSUNG

---

## 3.1 PLC Connection

## 3.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU		Unit/Port	Signal Level	Connection			Ladder Transfer <sup>*3</sup>
					CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>	
SPC series	SPC-10	SPC-10ADT	RS-232C communication port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
	SPC-100	CPU-10AR						
	SPC-300	CPU-300 CPU-300A CPU-300B CPU-300C	RS-485 communication port	RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		
N_plus	N70 plus	CPL9215A CPL9216A	COM1/ COM2	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
	N700 plus	CPL7215A						
	NX70 plus	NX70-CPU 70p1	COM port					
			NX70-CCU+ (CCU)					
	NX70 plus	NX70-CPU 70p2	COM1/ COM2	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		
			NX70-CCU+ (CCU)					
	NX700 plus	NX-CPU 700p	COM1/ COM2					
			NX-CCU+ (CCU)					

PLC Selection on the Editor	CPU		Unit/Port	Signal Level	Connection			Ladder Transfer *3
					CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
SECNET	N70	CPL9211A	COM port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		×
				RS-422	Wiring diagram 2 - C4	×	Wiring diagram 2 - M4	○
			CPL9462 (CCU)	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		×
	N70α	CPL9210A	COM port	RS-232C	Wiring diagram 4 - C2	Wiring diagram 4 - M2		○
			CPL9462 (CCU)	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		×
	N700	CPL7210A CPL7211A	COM port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		×
				RS-422	Wiring diagram 2 - C4	×	Wiring diagram 2 - M4	○
			CPL7462 (CCU)	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		×
	N700α	CPL6210A CPL6210B	TOOL port	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		○
			COM port	RS-232C	Wiring diagram 5 - C2	Wiring diagram 5 - M2		×
			CPL7462 (CCU)	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		×
	N7000	CPL5221B CPL5231	COM port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		×
				RS-422	Wiring diagram 2 - C4	×	Wiring diagram 2 - M4	○
			CPL5462 (CCU)	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		×
	N7000α	CPL4210 CPL4211	COM1	RS-422	Wiring diagram 2 - C4	×	Wiring diagram 2 - M4	○
			COM2	RS-232C	Wiring diagram 5 - C2	Wiring diagram 5 - M2		×
			CPL5462 (CCU)	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		×
	NX70	NX70-CPU70	TOOL port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		○
			NX70-CCU (CCU)	RS-232C	Wiring diagram 6 - C2	Wiring diagram 6 - M2		×
		NX70-CPU750	TOOL port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		○
			COM port	RS-232C	Wiring diagram 6 - C2	Wiring diagram 6 - M2		×
			NX70-CCU (CCU)	RS-232C	Wiring diagram 6 - C2	Wiring diagram 6 - M2		×
	NX700	NX-CPU750A NX-CPU750B NX-CPU750C NX-CPU750D	TOOL port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		○
			COM port	RS-232C	Wiring diagram 6 - C2	Wiring diagram 6 - M2		×
			NX-CCU (CCU)	RS-232C	Wiring diagram 6 - C2	Wiring diagram 6 - M2		×
		NX-CPU700	TOOL port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		○
	NX-CCU (CCU)		RS-232C	Wiring diagram 6 - C2	Wiring diagram 6 - M2		×	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*3 For the ladder transfer function, see the V9 Series Reference Manual 2.

### 3.1.1 SPC Series

#### Communication Setting

##### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	<b>9600 bps</b>	
Data Length	<b>8 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>None</b>	
Target Port No.	<u>0</u> to 255	

##### PLC

##### Communication setting

Baud rate: 9600 bps, data length: 8 bits, stop bit: 1 bit, without parity (fixed)

##### Calendar

This model is not equipped with the calendar function. Use the built-in clock of the V series.

#### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (input/output)	00H	
L (link relay)	01H	
M (internal relay)	02H	
K (keep relay)	03H	
F (special relay)	04H	
W (word register)	05H	

### 3.1.2 N\_plus

## Communication Setting

### Editor

#### Communication setting

(Underlined setting: default)


Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	For RS-485 connection, set the transmission delay time to 3 msec or longer.
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 bps	
Data Length	<b>8 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>None</b>	
Target Port No.	<u>0</u> to 31	

### PLC

Be sure to match the settings to those made under [Communication Setting] of the editor.

#### System information

Set a station number for the PLC using the PLC software "WINGPC". For more information, refer to the PLC manual issued by the manufacturer.

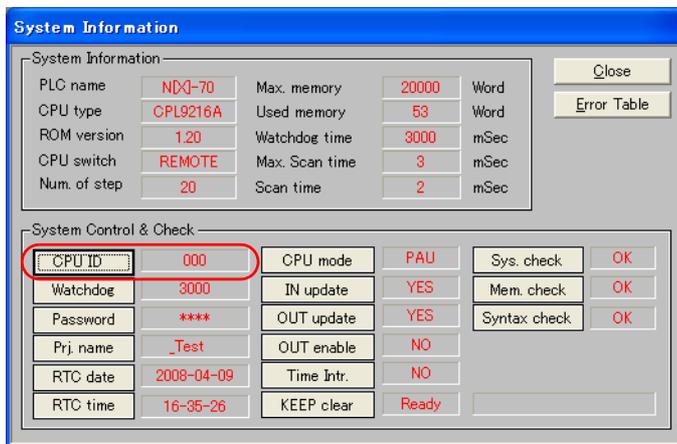


Setting Item	Setting	Remarks
CPU ID	0 to 223, 255	

### CPL9215A


#### DIP switches 1

DIPSW1	Contents	Setting																
	SW1	Program write target ON: EEPROM OFF: RAM																
	SW2	RS-232C / RS-485 selection ON: RS-485 OFF: RS-232C																
	SW3	Baud rate selection	<table border="1"> <thead> <tr> <th>SW3</th> <th>SW4</th> <th>Baud Rate</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>9600bps</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>38400bps</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>19200bps</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>4800bps</td> </tr> </tbody> </table>	SW3	SW4	Baud Rate	OFF	OFF	9600bps	ON	OFF	38400bps	OFF	ON	19200bps	ON	ON	4800bps
	SW3		SW4	Baud Rate														
OFF	OFF	9600bps																
ON	OFF	38400bps																
OFF	ON	19200bps																
ON	ON	4800bps																
SW4																		

**CPL9216A****DIP switches 1**

DIPSW1	Contents		Setting															
	SW1	Baud rate selection (COM1)	<table border="1"> <thead> <tr> <th>SW1</th> <th>SW2</th> <th>Baud Rate</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>9600bps</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>19200bps</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>38400bps</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>4800bps</td> </tr> </tbody> </table>	SW1	SW2	Baud Rate	OFF	OFF	9600bps	ON	OFF	19200bps	OFF	ON	38400bps	ON	ON	4800bps
	SW1		SW2	Baud Rate														
	OFF		OFF	9600bps														
	ON		OFF	19200bps														
	OFF	ON	38400bps															
	ON	ON	4800bps															
	SW2																	
	SW3	Baud rate selection (COM2)	<table border="1"> <thead> <tr> <th>SW3</th> <th>SW4</th> <th>Baud Rate</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>9600bps</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>19200bps</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>38400bps</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>4800bps</td> </tr> </tbody> </table>	SW3	SW4	Baud Rate	OFF	OFF	9600bps	ON	OFF	19200bps	OFF	ON	38400bps	ON	ON	4800bps
SW3	SW4		Baud Rate															
OFF	OFF	9600bps																
ON	OFF	19200bps																
OFF	ON	38400bps																
ON	ON	4800bps																
SW4																		
SW5	RS-232C / RS-485 selection (COM1)	ON: RS-485 OFF: RS-232C																
SW6	RS-232C / RS-485 selection (COM2)	ON: RS-485 OFF: RS-232C																
SW7	Not used	OFF																
SW8	Program write target	ON: EEPROM OFF: RAM																


**DIP switches 2**

DIPSW2	Contents		Setting									
	SW1	COM1 terminating resistance (for RS-485 connection)	<table border="1"> <thead> <tr> <th>SW1</th> <th>SW2</th> <th>Terminating Resistance</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>Invalid</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>Valid</td> </tr> </tbody> </table>	SW1	SW2	Terminating Resistance	OFF	OFF	Invalid	ON	ON	Valid
	SW1		SW2	Terminating Resistance								
	OFF	OFF	Invalid									
	ON	ON	Valid									
SW2												
SW3	COM2 terminating resistance (for RS-485 connection)	<table border="1"> <thead> <tr> <th>SW3</th> <th>SW4</th> <th>Terminating Resistance</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>Invalid</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>Valid</td> </tr> </tbody> </table>	SW3	SW4	Terminating Resistance	OFF	OFF	Invalid	ON	ON	Valid	
SW3		SW4	Terminating Resistance									
OFF	OFF	Invalid										
ON	ON	Valid										
SW4												


**CPL7215A****DIP switches 1**

DIPSW1	Contents		Setting															
	SW1	Baud rate selection (COM1)	ON: 19200bps OFF: 9600bps															
	SW2	Baud rate selection (COM2)	<table border="1"> <thead> <tr> <th>SW2</th> <th>SW3</th> <th>Baud Rate</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>9600bps</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>19200bps</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>38400bps</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>4800bps</td> </tr> </tbody> </table>	SW2	SW3	Baud Rate	OFF	OFF	9600bps	ON	OFF	19200bps	OFF	ON	38400bps	ON	ON	4800bps
	SW2		SW3	Baud Rate														
	OFF		OFF	9600bps														
	ON	OFF	19200bps															
	OFF	ON	38400bps															
ON	ON	4800bps																
SW3																		
SW4	Program write target	ON: EEPROM OFF: RAM																
SW5	COM2 terminating resistance (for RS-485 connection)	<table border="1"> <thead> <tr> <th>SW5</th> <th>SW6</th> <th>Terminating Resistance</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>Invalid</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>Valid</td> </tr> </tbody> </table>	SW5	SW6	Terminating Resistance	OFF	OFF	Invalid	ON	ON	Valid							
SW5		SW6	Terminating Resistance															
OFF	OFF	Invalid																
ON	ON	Valid																
SW6																		


**NX70-CPU70p1 (COM Port)****DIP switches**

DIPSW	Contents		Setting		
	SW1	Terminating resistance (for RS-485 connection)	SW1	SW2	Terminating Resistance
	SW2		OFF	OFF	Invalid
			ON	ON	Valid
	SW3	Program write target	ON: EEPROM OFF: RAM		
	SW4	RS-232C / RS-485 selection	ON: RS-485 OFF: RS-232C		
	SW5	Baud rate selection	SW5	SW6	Baud Rate
	OFF		OFF	9600bps	
	ON		OFF	38400bps	
		OFF	ON	19200bps	
		ON	ON	4800bps	

**NX70-CPU70p2 (COM Port) / NX-CPU700p (COM Port)****DIP switches 1**


DIPSW1	Contents		Setting		
	SW1	COM1 terminating resistance (for RS-485 connection)	SW1	SW2	Terminating Resistance
	SW2		OFF	OFF	Invalid
			ON	ON	Valid
	SW3	COM2 terminating resistance (for RS-485 connection)	SW3	SW4	Terminating Resistance
SW4	OFF		OFF	Invalid	
		ON	ON	Valid	

**DIP switches 2**

DIPSW2	Contents		Setting		
	SW1	Program write target	ON: EEPROM OFF: RAM		
	SW2	Not used	OFF		
	SW3	RS-232C / RS-485 selection (COM2)	ON: RS-485 OFF: RS-232C		
	SW4	RS-232C / RS-485 selection (COM1)	ON: RS-485 OFF: RS-232C		
	SW5	Baud rate selection (COM1)	SW5	SW6	Baud Rate
			OFF	OFF	9600bps
			ON	OFF	38400bps
			OFF	ON	19200bps
		ON	ON	4800bps	
SW7	Baud rate selection (COM2)	SW7	SW8	Baud Rate	
		OFF	OFF	9600bps	
		ON	OFF	38400bps	
		OFF	ON	19200bps	
		ON	ON	4800bps	

## NX-CCU+(CCU) / NX70-CCU+(CCU)

### DIP switches

DIPSW	Contents		Setting			
	SW1	Baud rate selection	SW1	SW2	SW3	Baud Rate
	SW2		OFF	OFF	OFF	38400bps
	SW3		ON	OFF	OFF	19200bps
	SW4	Data length	<b>ON: 8 bits</b>			
	SW5	Parity check	<b>OFF: None</b>			
	SW6					
	SW7	Stop bit	<b>OFF: 1 bit</b>			
	SW8	Reserved	<b>OFF</b>			

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (input/output)	00H	
L (link relay)	01H	
M (internal relay)	02H	
K (keep relay)	03H	
F (special relay)	04H	
W (word register)	05H	

### 3.1.3 SECRET

## Communication Setting

### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 / 76800 / 115K bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 31	Only port No. 31 is valid, depending on the CPU model. For connection with a CCU module, select port No. 1.
Header	<u>% (Header)</u> / < (Extension Header)	Models on which "< (Expansion Header)" is available: NX-CPU750A / NX-CPU750B / NX-CPU750C / NX-CPU750D / NX70-CPU750
Monitor Registration	Unchecked / <u>Checked</u>	One V9 unit can be registered as a monitor for one PLC. When multi-link connection (n : 1) is selected, do not check this box for multiple V9 units.

### PLC

Be sure to match the settings to those made under [Communication Setting] of the editor.

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
DT (data register)	00H	
X (external input)	01H	WX as word device, read only
Y (external output)	02H	WY as word device
R (internal relay)	03H	WR as word device
L (link relay)	04H	WL as word device
LD (link register)	05H	
FL (file register)	06H	
SV (timer, counter/set value)	07H	
EV (timer, counter/elapsed time)	08H	
T (timer/contact)	09H	Read only
C (counter/contact)	0AH	Read only

### 3.1.4 Wiring Diagrams


#### When Connected at CN1:

#### RS-232C


Wiring diagram 1 - C2

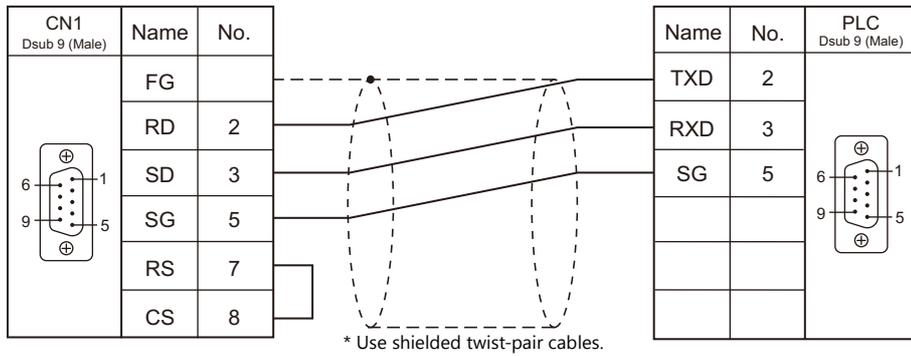


Wiring diagram 2 - C2

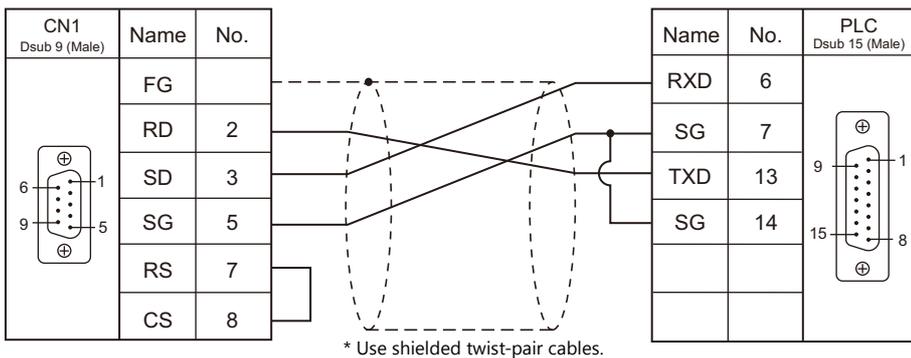


Wiring diagram 3 - C2

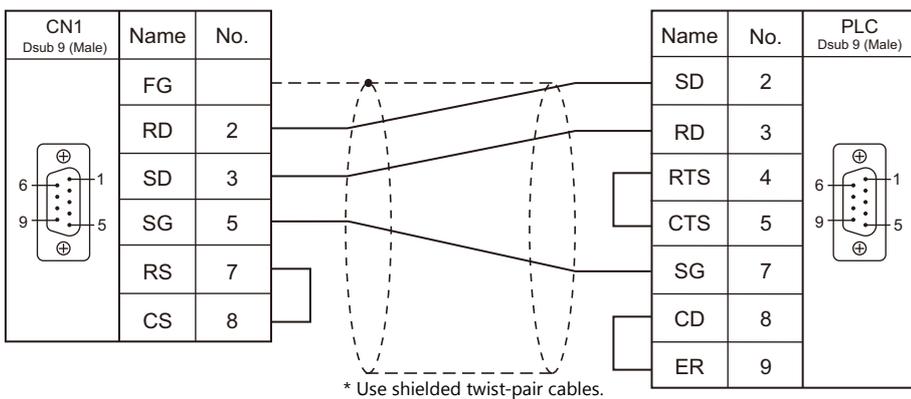


**Wiring diagram 4 - C2**

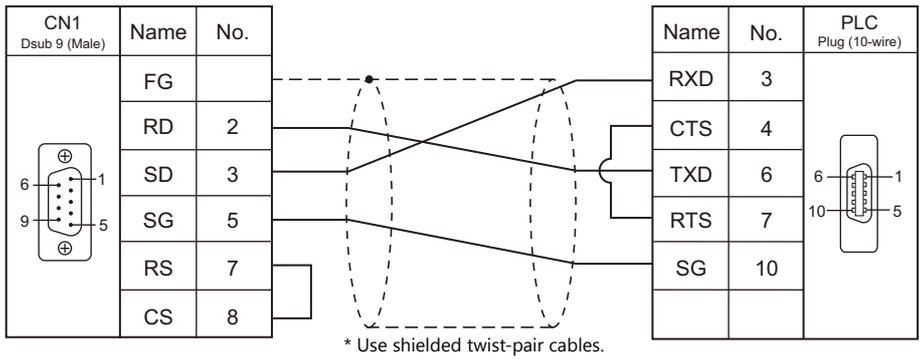

**Wiring diagram 5 - C2**

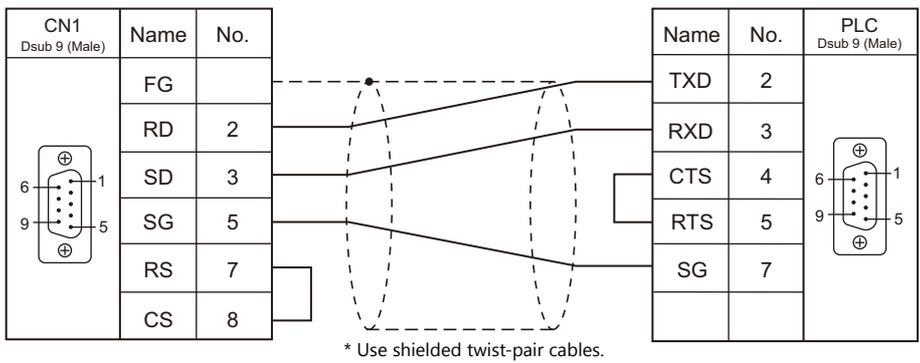


**Wiring diagram 6 - C2**

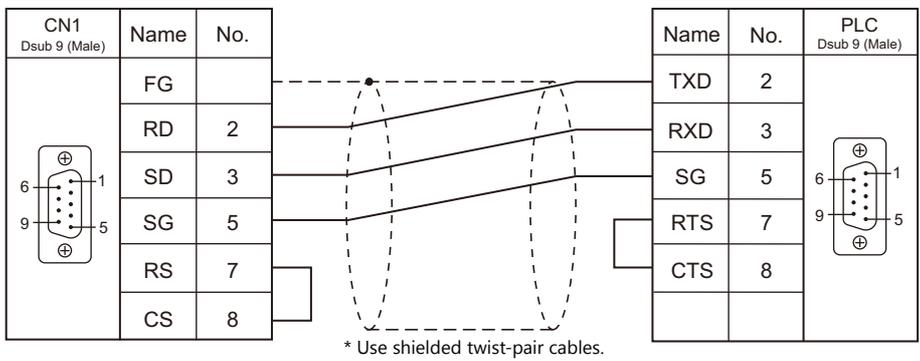


RS-422/RS-485


Wiring diagram 1 - C4

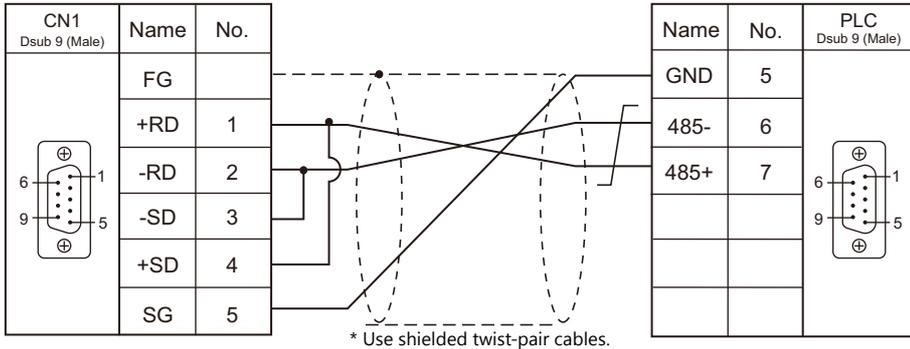

Wiring diagram 2 - C4

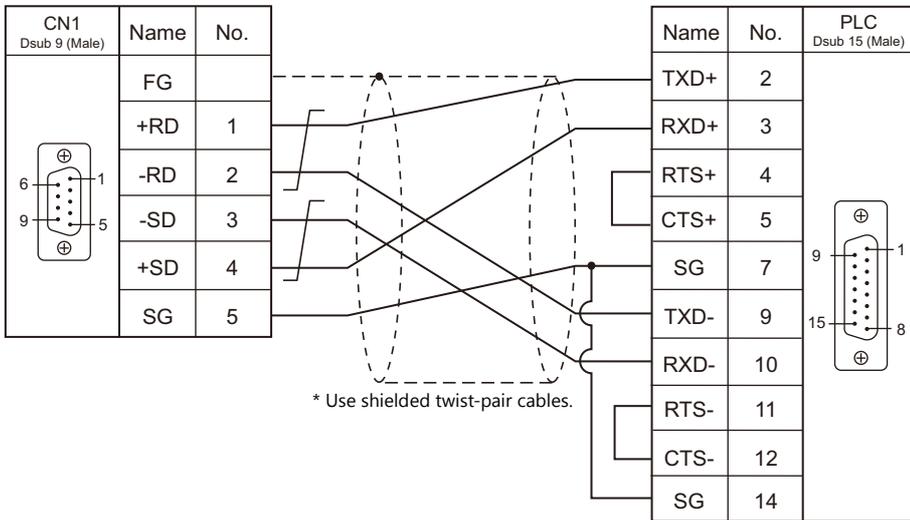


Wiring diagram 3 - C4

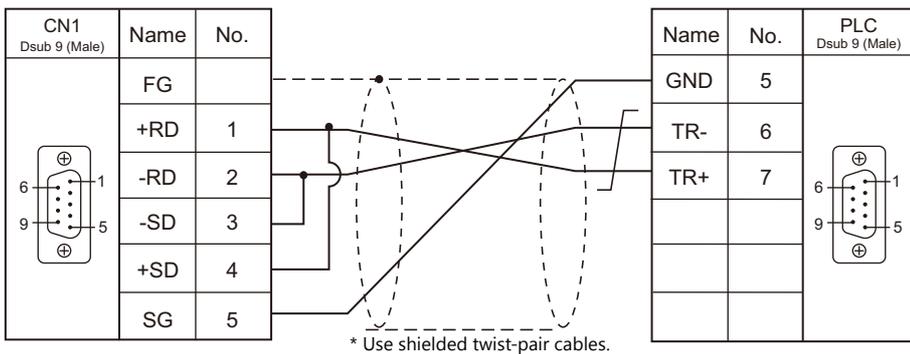


**When Connected at MJ1/MJ2:**

**RS-232C**


**Wiring diagram 1 - M2**

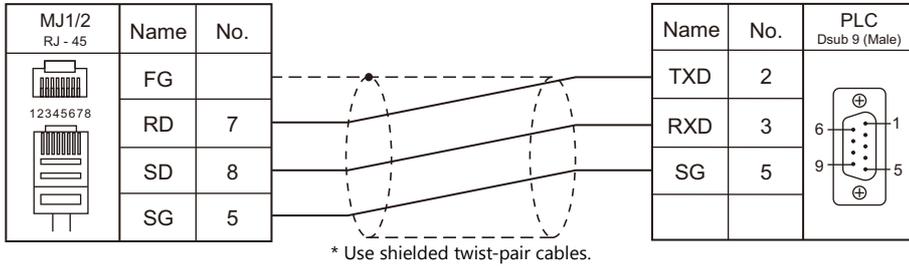


**Wiring diagram 2 - M2**

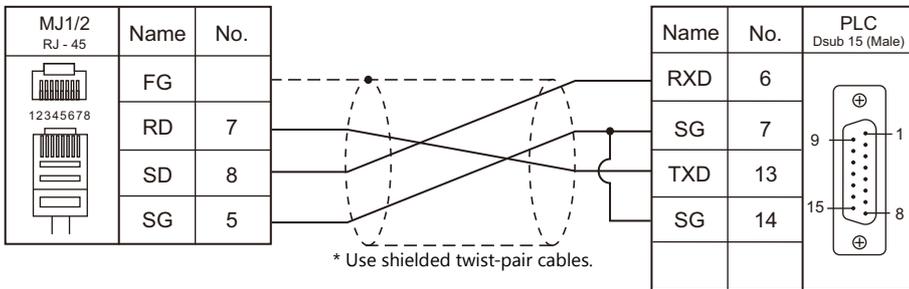


**Wiring diagram 3 - M2**

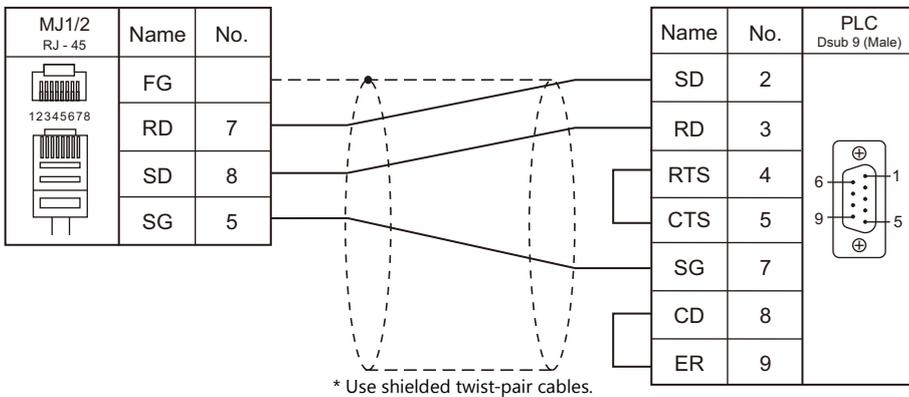


**Wiring diagram 4 - M2**

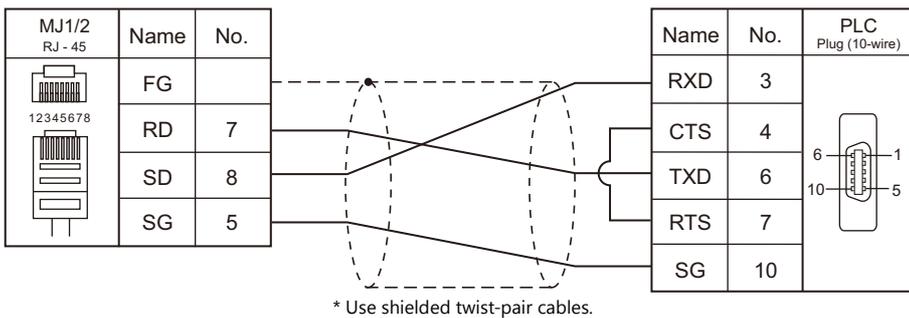

**Wiring diagram 5 - M2**

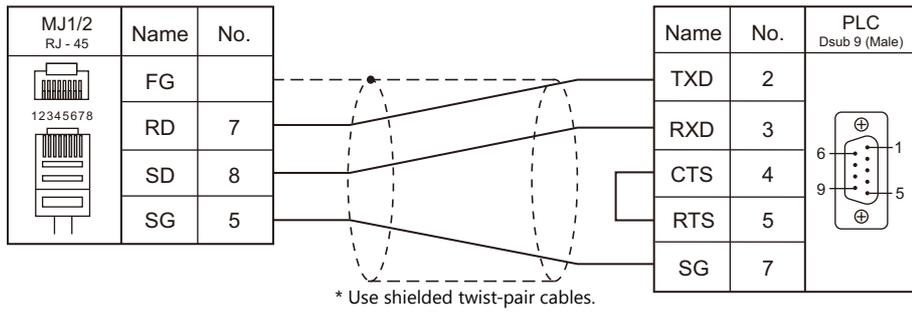


**Wiring diagram 6 - M2**

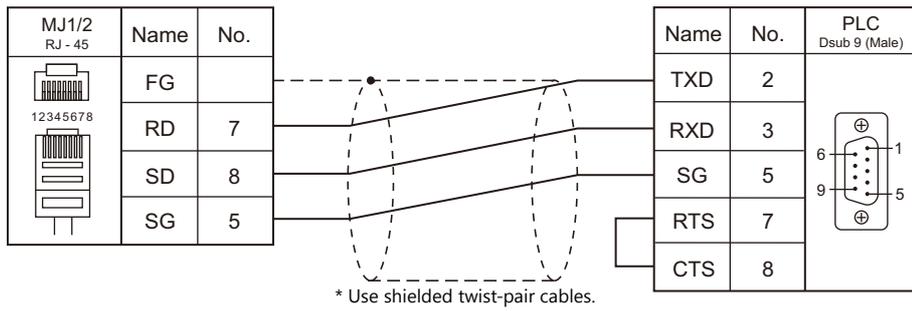


**RS-422/RS-485**


**Wiring diagram 1 - M4**

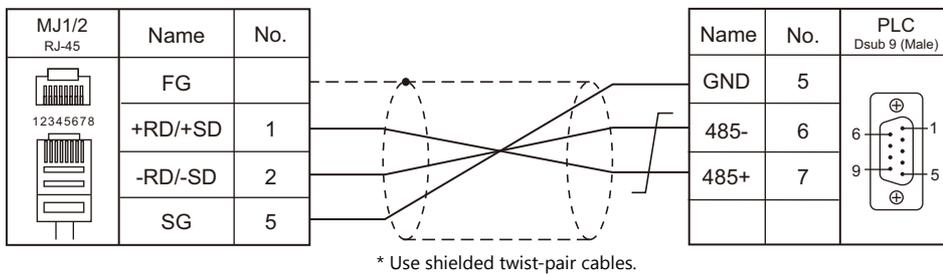

**Wiring diagram 2 - M4**

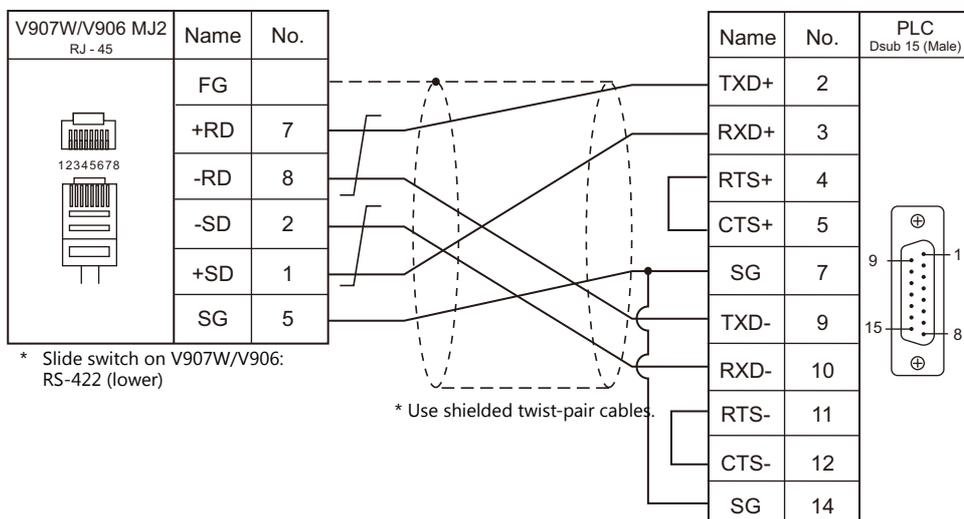

**Wiring diagram 3 - M4**

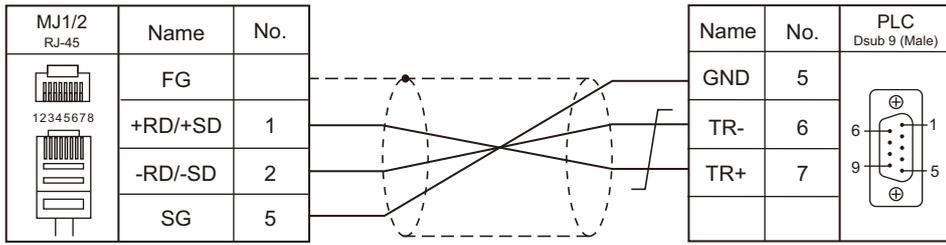

\* Use shielded twist-pair cables.

# 4. SanRex

---

4.1 Temperature Controller / Servo / Inverter Connection

## 4.1 Temperature Controller / Servo / Inverter Connection

### Serial Connection

#### DC Power Supply Unit

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
DC AUTO (HKD type)	Type HKD B	Terminal block	RS-422	Wiring diagram 1 - C4	×	Wiring diagram 1 - M4	HKD.Lst

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 4.1.1 DC AUTO (HKD type)

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1 : 1 / 1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	<u>9600 bps</u>	
Parity	<u>Even</u>	
Data Length	<u>8 bits</u>	
Stop Bit	<u>1 bit</u>	
Target Port No.	<u>1</u> to 31	

#### DC AUTO (Type HKD B)

Item	Setting	Remarks
Communication address	1 to 31	
Baud rate	<u>9600 BPS</u>	
Transmission mode	<u>8E1</u>	
REMOTE/PANEL key	<u>REMOTE</u>	Remote control mode <sup>*1</sup>

\*1 This setting is not provided, depending on the model.

### Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
M (monitor data)	00H	Read only
MD (monitor data (4 bytes))	01H	Double-word, read only
S (setting data)	02H	*1
SD (setting data (4 bytes))	03H	Double-word


\*1 When changing the data setting, press the REMOTE/PANEL key to select the remote mode.

## 4.1.2 Wiring Diagrams

### When Connected at CN1:

#### RS-422/RS-485


Wiring diagram 1 - C4

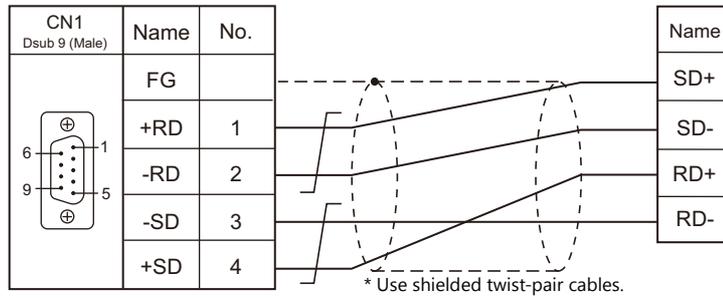

### When Connected at MJ1/MJ2:


#### RS-422/RS-485

Wiring diagram 1 - M4

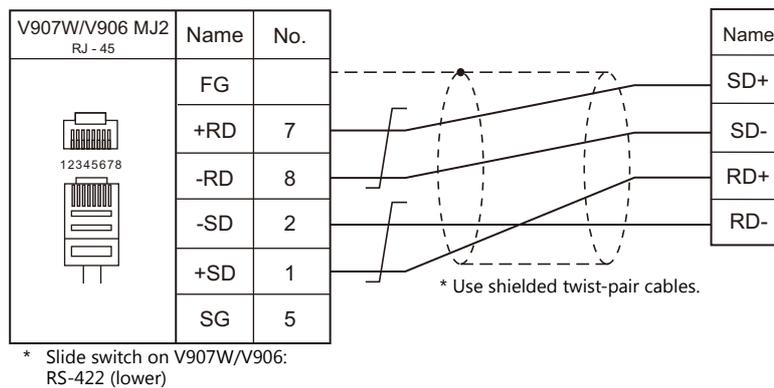

# MEMO

**MONITOUCH**



# 5. SANMEI

---

## 5.1 Temperature Controller/Servo/Inverter Connection

## 5.1 Temperature Controller/Servo/Inverter Connection

### AC Servo Driver

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>	
Cuty Axis	QT-0xxAX	CN4	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		SanQT.Lst
			RS-422	Wiring diagram 1 - C4	×	Wiring diagram 1 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 5.1.1 Cuty Axis

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	<b>9600 bps (fixed)</b>	
Data Length	<b>8 bits (fixed)</b>	
Stop Bit	<b>1 bit (fixed)</b>	
Parity	<b>Even (fixed)</b>	
Target Port No.	<u>0</u> to 9	Set the same number as the axis number of the AC servo driver.

#### AC Servo Driver

The communication parameters can be set using the MODE key on the built-in digital operator attached to the front of the AC servo driver.

They can also be set by using the software "Cuty Wave" or the ladder program.

For settings using the software or ladder program, refer to the AC servo driver manual issued by the manufacturer.

(Underlined setting: default)

Mode	Parameter No.	Item	Setting	Remarks
Parameter mode (P-)	27	Axis number	<u>0</u> to 9	Invalid during RS-232C communication

The following settings are fixed; baud rate: 9600 bps, data length: 8 bits, stop bit: 1 bit, and parity: even.

### Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
PRM (parameter) *1	00H	Double-word
TBL (point table) *2	01H	Double-word
OPE (basic operation)	02H	Double-word
MON (value monitor) *1	03H	Double-word, read only
IO (I/O monitor) *1	04H	Double-word, read only
ALM (alarm status) *1	05H	Double-word, read only
S (servo status)	06H	Double-word, read only
VV (internal monitor)	07H	Double-word, read only

\*1 When using the parameter, value monitor, I/O monitor or alarm status device memory, set the address with the number of digits shown below. For other types of device memory, see "Device Memory Types" described later.

- Parameter, value monitor, I/O monitor: 8 digits
- Alarm status: 4 digits

\*2 Address denotations  
On the signal name reference list, every point number is designated as "00". To access any point number other than "00", manually input the desired number.

aabb



## Device Memory Types

Type	Address	Name	Digits	Type	Address	Name	Digits
TBL (Point table)	0	Absolute/relative value	2	S (Servo status)	0	Servo status	8
	1	Distance of movement	8		1	Command point	2
	2	Speed	4		2	Motor type	2
	3	Acceleration/deceleration time constant	4		3	ROM version	4
	4	Wait time	4		4	System data 1	4
	5	Continuous motion	2		5	System data 2	4
	6	Branch target point number	2		6	System data 3	2
	7	Acceleration/deceleration ON/OFF at S	2		7	System data 4	2
	8	Expansion (1)	2	Internal monitor (VV)	0	System data 1	2
	9	Expansion (2)	4		1	System data 2	2
OPE (Basic operation)	0	Write into EEPROM	1		2	System data 3	2
	1	Servo ON	1		3	System data 4	2
	2	Servo OFF	1		4	System data 5	2
	3	Emergency stop ON	1		5	System data 6	2
	4	Emergency stop OFF	1		6	System data 7	2
	5	Alarm reset	1		7	System data 8	2
	6	Start ON	1		8	Speed [rpm]	8
	7	Start OFF	1		9	Torque [%]	8
	8	Zero start ON	1		A	Torque (+-) peak [%]	8
	9	Zero start OFF	1		B	Current position [pulse]	8
	A	Zero deceleration ON	1		C	Position command [pulse]	8
	B	Zero deceleration OFF	1	D	Position deviation [pulse]	8	
	C	Pause ON	1	E	Servo status	8	
	D	Pause OFF	1	F	I/O status	8	
	E	Single block ON	1	10	System data 9	4	
	F	Single block OFF	1	11	System data 10	4	
	10	Point No. designation	2	12	System data 11	4	
	11	Log clear	1	13	Point being executed	2	
	12	Torque peak reset	1				
	13	Machine zero point change	8				
14	Reset	1					
15	Normal JOG	1					
16	Reverse JOG	1					
17	JOG stop	1					
18	General-purpose output setting	2					
19	General-purpose output	2					
1A	Smoothing setting	8					

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Data write of all axes (PRM, OPE)	1 - 8 (PLC1 - 8)	n	Command: 7FH <sup>*1</sup>	5
		n + 1	Device number 00H: Parameter (PRM) 02H: Basic operation (OPE)	
		n + 2	Address	
		n + 3	Data (lower)	
		n + 4	Data (higher)	
Data write of all axes <sup>*2</sup> (TBL)	1 - 8 (PLC1 - 8)	n	Command: 7FH <sup>*1</sup>	23 <sup>*3</sup>
		n + 1	Device number 01H: Point table (TBL)	
		n + 2	Point number: 0000H to 0007H	
		n + 3 to n + 4	Absolute/relative value: 0 to 1	
		n + 5 to n + 6	Distance of movement: -9999999 to 9999999	
		n + 7 to n + 8	Speed: 1 to 5000	
		n + 9 to n + 10	Acceleration/deceleration time constant: 1 to 9999	
		n + 11 to n + 12	Wait time: 0 to 9999	
		n + 13 to n + 14	Continuous motion: 0 to 1	
		n + 15 to n + 16	Branch target point number: 0 to 107	
		n + 17 to n + 18	S-shaped motion ON/OFF: 0 to 1	
		n + 19 to n + 20	Expansion 1 <sup>*3</sup>	
n + 21 to n + 22	Expansion 2 <sup>*3</sup>			
Data write of each axis (PRM, OPE)	1 - 8 (PLC1 - 8)	n	Station number: 0100H to 0109H	5
		n + 1	Device number 00H: Parameter (PRM) 02H: Basic operation (OPE)	
		n + 2	Address	
		n + 3	Data (lower)	
		n + 4	Data (higher)	
Data write of each axis (TBL)	1 - 8 (PLC1 - 8)	n	Station number: 0100H to 0109H	23 <sup>*3</sup>
		n + 1	Device number 01H: Point table (TBL)	
		n + 2	Point number: 0000H to 0007H	
		n + 3 to n + 4	Absolute/relative value: 0 to 1	
		n + 5 to n + 6	Distance of movement: -9999999 to 9999999	
		n + 7 to n + 8	Speed: 1 to 5000	
		n + 9 to n + 10	Acceleration/deceleration time constant: 1 to 9999	
		n + 11 to n + 12	Wait time: 0 to 9999	
		n + 13 to n + 14	Continuous motion: 0 to 1	
		n + 15 to n + 16	Branch target point number: 0 to 107	
		n + 17 to n + 18	S-shaped motion ON/OFF: 0 to 1	
		n + 19 to n + 20	Expansion 1 <sup>*3</sup>	
n + 21 to n + 22	Expansion 2 <sup>*3</sup>			
Teaching	1 - 8 (PLC1 - 8)	n	Station number: 00H to 09H	2
		n + 1	Command: 0000H	
		n + 2	Data (lower)	
		n + 3	Data (higher)	

Contents	F0	F1 (= \$u n)	F2										
T waveform monitor sampling	1 - 8 (PLC1 - 8)	n	Station number: 00H to 09H	5									
		n + 1	Command: 0001H										
		n + 2	Control code Bit <table border="1" style="display: inline-table; vertical-align: middle;"> <tr><td>-</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td></tr> </table> <ul style="list-style-type: none"> <li>Trigger target                             <ul style="list-style-type: none"> <li>0: Speed</li> <li>1: Torque</li> <li>2: Servo status</li> <li>3: Manual</li> </ul> </li> <li>Trigger edge                             <ul style="list-style-type: none"> <li>0: Leading edge in normal turn</li> <li>1: Trailing edge in normal turn</li> <li>2: Leading edge in reverse turn</li> <li>3: Trailing edge in reverse turn</li> </ul> </li> <li>Sampling interval                             <ul style="list-style-type: none"> <li>0: 2 ms (50 ms/div)</li> <li>1: 4 ms (100 ms/div)</li> <li>2: 8 ms (200 ms/div)</li> <li>3: 20 ms (500 ms/div)</li> </ul> </li> <li>Operation command                             <ul style="list-style-type: none"> <li>0: Stop</li> <li>1: Run</li> </ul> </li> </ul>		-	7	6	5	4	3	2	1	0
		-	7		6	5	4	3	2	1	0		
		n + 3	Trigger position 00H to 1EH (0FH: Center)										
		n + 4	Servo status bit Bit <table border="1" style="display: inline-table; vertical-align: middle;"> <tr><td>-</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td></tr> </table> <ul style="list-style-type: none"> <li>Positioning</li> </ul>		-	7	6	5	4	3	2	1	0
		-	7		6	5	4	3	2	1	0		
		n + 5	Servo status										
		n + 6	Torque										
		n + 7	Speed										
		n + 8	Servo status										
		:	:										
		n + 51	Torque										
n + 52	Speed												
Servo status acquisition	1 - 8 (PLC1 - 8)	n	Station number: 00H to 09H	2									
		n + 1	Command: 0002H										
		n + 2 to n + 3	Servo status										
		n + 4 to n + 5	Command point										
		n + 6 to n + 7	Motor type										
		n + 8 to n + 9	ROM version										
		n + 10 to n + 11	System data										
		n + 12 to n + 13	System data										
		n + 14 to n + 15	System data										
		n + 16 to n + 17	System data										

Contents	F0	F1 (= \$u n)		F2
Internal monitor	1 - 8 (PLC1 - 8)	n	Station number: 00H to 09H	2
		n + 1	Command: 0003H	
		n + 2 to n + 3	System data	
		n + 4 to n + 5	System data	
		n + 6 to n + 7	System data	
		n + 8 to n + 9	System data	
		n + 10 to n + 11	System data	
		n + 12 to n + 13	System data	
		n + 14 to n + 15	System data	
		n + 16 to n + 17	System data	
		n + 18 to n + 19	Speed [rpm]	
		n + 20 to n + 21	Torque [%]	
		n + 22 to n + 23	Torque (+) peak [%]	
		n + 24 to n + 25	Current position [pulse]	
		n + 26 to n + 27	Position command [pulse]	
		n + 28 to n + 29	Position deviation [pulse]	
		n + 30 to n + 31	Servo status	
		n + 32 to n + 33	I/O status	
		n + 34 to n + 35	System data	
		n + 36 to n + 37	System data	
n + 38 to n + 39	System data			
n + 40 to n + 41	Point being executed			

 Return data: Data stored from AC servo to V series

- \*1 "FFH" can be set for the command (n) when Cuty Axis of version 2.50 and later is used.
- \*2 When "01H: point table" is set for the device number (n + 1) of the "data write of all axes" command, the version of all connected Cuty Axis units must be unified into earlier than 2.50 or 2.50 and later.
- \*3 "Expansion 1" and "expansion 2" settings are valid when Cuty Axis of version 2.50 and later is used.


Function	Expansion 1	Expansion 2
None	00	0000
Jump setting for input condition	01	Jump destination Point number: 0000 to 0007 Operation end: 0063
Loop setting	Number of loops: 02 to 64	Point number (single block function): 0064 to 0071
Torque setting	FF	Torque setting value [%]: 0001 to 0120
Loop counter clear	7F	Counter number to be cleared: 0000 to 0007

## 5.1.2 Wiring Diagrams

### When Connected at CN1:


#### RS-232C

Wiring diagram 1 - C2

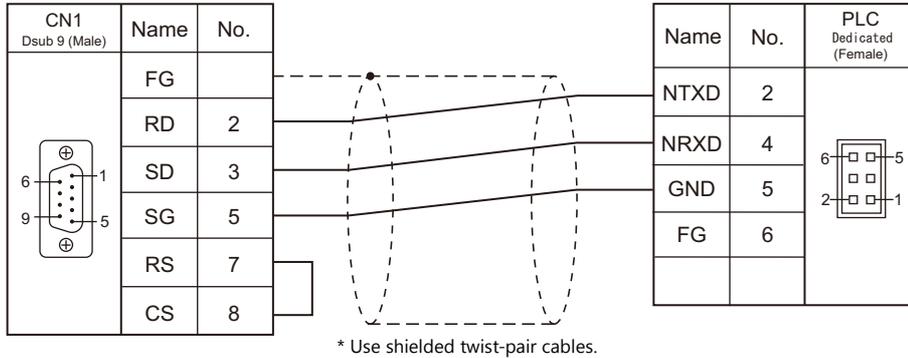

#### RS-422/RS-485


Wiring diagram 1 - C4

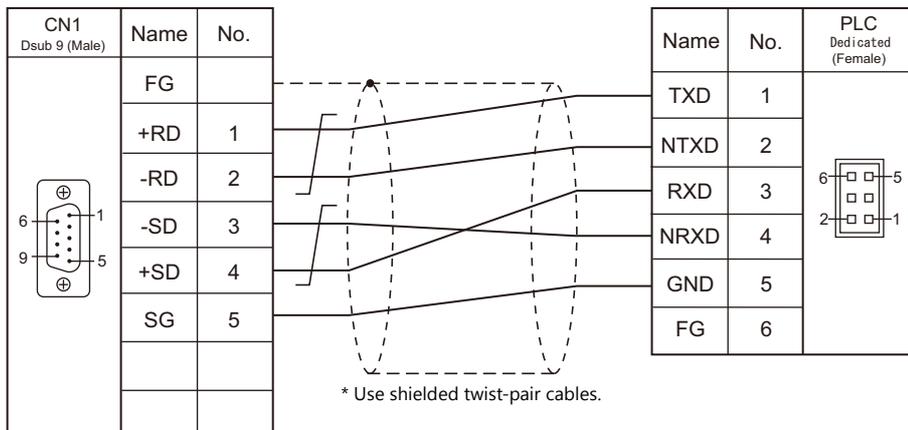

**When Connected at MJ1/MJ2:**


**RS-232C**

**Wiring diagram 1 - M2**

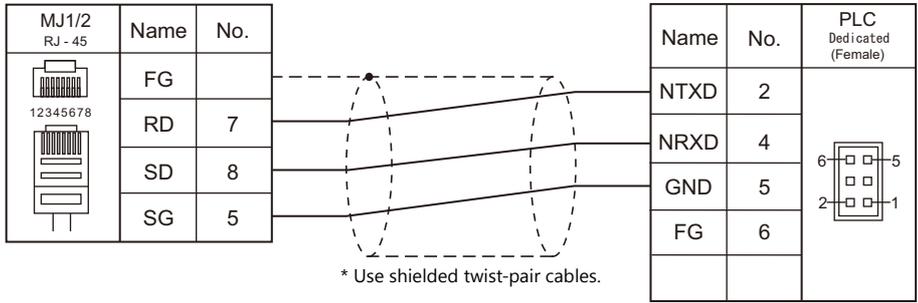

**RS-422/RS-485**

**Wiring diagram 1 - M4**

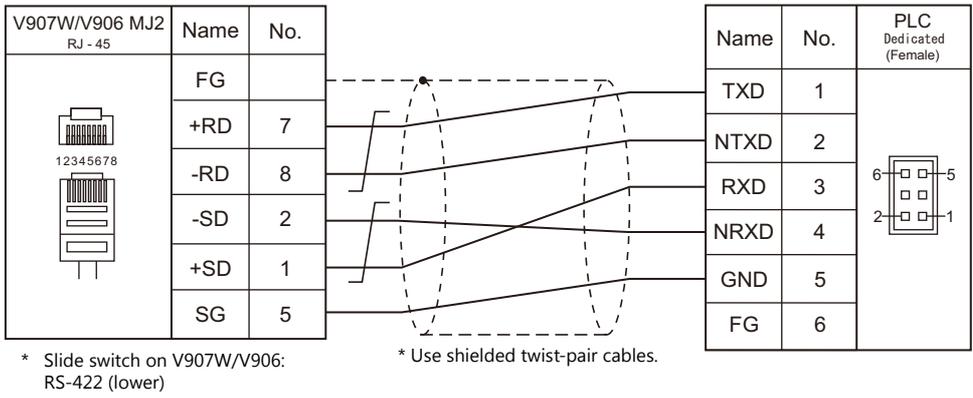

# 6. SHARP

---

6.1 PLC Connection

6.2 Temperature Controller/Servo/Inverter Connection

## 6.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU		Unit/Port	Signal Level	Connection			Ladder Transfer <sup>*3</sup>	
					CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>		
JW series	W70H, W100H JW50, JW70, JW100 JW50H, JW70H, JW100H JW-50CU		JW-10CM ZW-10CM	RS-422	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4		
	JW20, JW20H, JW30H		JW-21CM	RS-422	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4		
	JW10	JW-1324K JW-1342K JW-1424K JW-1442K JW-1624K JW-1642K		MMI port	RS-422	Wiring diagram 2 - C4	×		Wiring diagram 3 - M4
				Communication port	RS-422	Wiring diagram 3 - C4	Wiring diagram 1 - M4		
	JW30H	JW-32CUH JW-32CUH1 JW-32CUM1 JW-33CUH JW-33CUH1 JW-33CUH2 JW-33CUH3		PG/COMM1 port	RS-422	Wiring diagram 4 - C4	×		Wiring diagram 4 - M4
				PG/COMM2 port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
J-board		Z-331J Z-332J	Host communication port T1	RS-422	Wiring diagram 3 - C4	Wiring diagram 1 - M4			
JW100/70H COM port	JW70	JW-70CU	Communication port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2			
	JW100	JW-100CU		RS-422	Wiring diagram 5 - C4	×	Wiring diagram 5 - M4		
	JW70H	JW-70CUH	Communication port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2			
	JW100 H	JW-100CUH		RS-422	Wiring diagram 6 - C4	×	Wiring diagram 6 - M4		
JW20 COM port	JW20H	JW-22CU	Communication port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2	×		
				RS-422	Wiring diagram 5 - C4	×		Wiring diagram 5 - M4	
	J-board	Z-311J Z-312J		Host communication port CN3	RS-232C	Wiring diagram 3 - C2		Wiring diagram 3 - M2	
				Host communication port TC1	RS-422	Wiring diagram 7 - C4		×	Wiring diagram 7 - M4
		Z-511J		PG/COMM1 port PG/COMM2 port	RS-422	Wiring diagram 4 - C4		×	Wiring diagram 4 - M4
Z-512J		PG/COMM1 port PG/COMM2 port							
JW300 series	JW300	JW-311CU JW-312CU		RS-232C	Wiring diagram 4 - C2	Wiring diagram 4 - M2			
				RS-422	Wiring diagram 4 - C4	×	Wiring diagram 4 - M4		
		JW-21CM <sup>*4</sup>		RS-422	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4		
				RS-232C	Wiring diagram 4 - C2	Wiring diagram 4 - M2			
		JW-321CU JW-322CU JW-331CU JW-332CU JW-341CU JW-342CU JW-352CU JW-362CU		PG/COMM1 port	RS-422	Wiring diagram 4 - C4	×	Wiring diagram 4 - M4	
				PG/COMM2 port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
				RS-422	Wiring diagram 4 - C4	×	Wiring diagram 4 - M4		
				JW-21CM <sup>*4</sup>	RS-422	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*3 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*4 When using this unit with JW300, be sure to use one of the JW300-compatible type. The JW300-compatible unit has a 300 mark on its front.

## Ethernet Connection

PLC Selection on the Editor	CPU		Unit	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>
JW series (Ethernet)	JW20H JW30H		JW-255CM					
			JW-25TCM					
	JW50H JW70H JW100H		JW-50CM JW-51CM					
	J-board		Z-339J					
JW311/312/321/322 series (Ethernet)	JW300	JW-311CU JW-312CU JW-321CU JW-322CU	JW-255CM <sup>*3</sup> JW-25TCM <sup>*3</sup>	×	○	1001 to 65534	○	×
JW331/332/341/342/352/362 series (Ethernet)	JW300	JW-331CU JW-332CU JW-341CU JW-342CU JW-352CU JW-362CU	JW-255CM <sup>*3</sup> JW-25TCM <sup>*3</sup>					

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*3 When using with JW300, be sure to use a JW300-compatible type. A JW300-compatible unit has a 300 mark on its front.

## 6.1.1 JW Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1</u> : 1 / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / 9600 / <u>19200</u> / 38400 / 57600 / 115K bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	0 to 31	

\* For JW10 series with MMI port or communication port, turn off the terminating resistances of the V series.

The following switches must be turned off.

CN1: DIP switches 5 and 7

MJ1: DIP switch 6

MJ2: DIP switch 8

#### PLC

Be sure to match the settings to those made under [Communication Setting] of the editor.

#### JW-10CM, ZW-10CM, JW-21CM Unit

#### Switch setting

Switch	Contents	Setting
SW0	Computer link (command mode)	<b>4</b>
SW1	Station address Set the number from 01 to 37 in octal notation.	1
SW2	SW1 denotes the lower-order digit, and SW2 denotes the higher-order digit.* * Do not set 00, 08, 09, 18, 19, 28, 29 and 40 or greater. When any of these numbers is set, an error will occur.	0
SW3	1 Not used	<b>OFF</b>
	2 Communication system (ON: 4-wire system, OFF: 2-wire system)	ON
	3 Not used	<b>OFF</b>
	4 Parity (ON: even, OFF: odd)	ON
SW4	Baud rate 0:19200, 1: 9600, 2: 4800	0
SW7	Terminating resistance (ON: provided, OFF: not provided)	<b>ON</b>

\* The following settings are fixed; data length: 7 bits, and stop bit: 2 bits.

#### Z-331J, Z-332J

Switch	Contents	Setting
SW0	Command mode	<b>4</b>
SW1	Station address Set the number from 01 to 37 in octal notation.	1
SW2	SW1 denotes the lower-order digit, and SW2 denotes the higher-order digit.* * Do not set 00, 08, 09, 18, 19, 28, 29 and 40 or greater. When any of these numbers is set, an error will occur.	0
SW3	1 Not used	<b>OFF</b>
	2 Communication system (ON: 4-wire system, OFF: 2-wire system)	OFF
	3 Not used	<b>OFF</b>
	4 Parity (ON: even, OFF: odd)	ON
SW4	Baud rate 0: 19200, 1: 9600, 2: 4800	0
SW7	Terminating resistance (ON: provided, OFF: not provided)	<b>ON</b>

\* The following settings are fixed; data length: 7 bits, and stop bit: 2 bits.

**JW-10**

The settings for communications with the V9 series should be made at the system memory as shown below.

**MMI port**

System Memory	Contents	Setting Example																
#226	Transmission specification <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td>D7</td><td>D6</td><td>D5</td><td>D4</td><td>D3</td><td>D2</td><td>D1</td><td>D0</td> </tr> <tr> <td>0</td><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td> </tr> </table> <div style="display: flex; justify-content: space-around;"> <div style="text-align: left;"> <p>→ Data length 0: 7 bits 1: 8 bits</p> </div> <div style="text-align: left;"> <p>→ Stop bit 0: 1 bit 1: 2 bits</p> </div> <div style="text-align: left;"> <p>→ Parity 00: None 01: Odd 10: Even</p> </div> <div style="text-align: left;"> <p>→ Baud rate 111: 38400 bps 000: 19200 bps 001: 9600 bps 010: 4800 bps</p> </div> </div>	D7	D6	D5	D4	D3	D2	D1	D0	0	0	1	1	0	0	0	0	30H  Data length: 7 bits Stop bit: 2 bits Parity: even Baud rate: 19200 bps
D7	D6	D5	D4	D3	D2	D1	D0											
0	0	1	1	0	0	0	0											
#227	Port number: 001 to 037 (OCT)	01H																

\* With the MMI port, only 1 : 1 or multi-link2 communication is available.

**Communication port**


System Memory	Contents	Setting Example																
#234	Communication mode: computer link mode	00H																
#236	Transmission specification <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td>D7</td><td>D6</td><td>D5</td><td>D4</td><td>D3</td><td>D2</td><td>D1</td><td>D0</td> </tr> <tr> <td>0</td><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td> </tr> </table> <div style="display: flex; justify-content: space-around;"> <div style="text-align: left;"> <p>→ Data length 0: 7 bits 1: 8 bits</p> </div> <div style="text-align: left;"> <p>→ Stop bit 0: 1 bit 1: 2 bits</p> </div> <div style="text-align: left;"> <p>→ Parity 00: None 01: Odd 10: Even</p> </div> <div style="text-align: left;"> <p>→ Baud rate 111: 38400 bps 000: 19200 bps 001: 9600 bps 010: 4800 bps</p> </div> </div>	D7	D6	D5	D4	D3	D2	D1	D0	0	0	1	1	0	0	0	0	30H  Data length: 7 bits Stop bit: 2 bits Parity: even Baud rate: 19200 bps
D7	D6	D5	D4	D3	D2	D1	D0											
0	0	1	1	0	0	0	0											
#237	Port number: 001 to 037 (OCT)	01H																

**JW-30H****PG/COMM1 port**

System Memory	Contents	Setting Example																
#234	Transmission specification <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td>D7</td><td>D6</td><td>D5</td><td>D4</td><td>D3</td><td>D2</td><td>D1</td><td>D0</td> </tr> <tr> <td>0</td><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td> </tr> </table> <div style="display: flex; justify-content: space-around;"> <div style="text-align: left;"> <p>→ Stop bit 0: 1 bit 1: 2 bits</p> </div> <div style="text-align: left;"> <p>→ Parity 00: None 01: Odd 10: Even</p> </div> <div style="text-align: left;"> <p>→ Baud rate 101: 115 kbps*1 110: 57600 bps*1 111: 38400 bps*1 000: 19200 bps 001: 9600 bps 010: 4800 bps</p> </div> </div>	D7	D6	D5	D4	D3	D2	D1	D0	0	0	1	1	0	0	0	0	30H  Data length: 7 bits (fixed) Stop bit: 2 bits Parity: even Baud rate: 19200 bps
D7	D6	D5	D4	D3	D2	D1	D0											
0	0	1	1	0	0	0	0											
#235	Port number: 001 to 037 (OCT)	01H																

\*1 Not available for JW-32CUH and JW-33CUH

## PG/COMM2 port

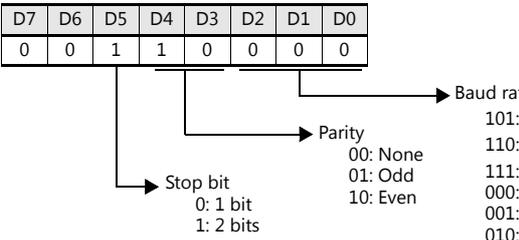System Memory	Contents	Setting Example
#236	Transmission specification 	30H Data length: 7 bits (fixed) Stop bit: 2 bits Parity: even Baud rate: 19200 bps
#237	Port number: 001 to 037 (OCT)	01H

\*1 Not available for JW-32CUH and JW-33CUH


## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
R (register)	00H	*1, *2
Relay (relay)	01H	<input type="checkbox"/> for word device *1
E (self diagnosis)	02H	*1
b (timer, counter/current value)	03H	*1
Fn (file register)	07H	*1, *3

\*1 The addresses are expressed in "bytes". For word designation, specify an even-numbered address.

\*2 The assigned device memory is expressed as shown on the right when editing the screen.

Example: x9yyy  


\*3 The file number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.

Example: F1:00002  


## Indirect Device Memory Designation

- For R device memory "x9yyy":  
Specify the value "x" (0 to 9: decimal) for higher bytes (bit 15 to 8).  
Specify a value obtained by dividing "yyy" (000 to 777: octal) by 2 for lower bytes (bit 7 to 0).

Example: With indirect device memory designation, "086D" (H) is assigned for "R89332".  
 89 (ignoring the lower digit of "9") → 8 (DEC) → 08 (HEX)  
 332 (OCT) → 218 (DEC) / 2 = 109 (DEC) → 6D (HEX)

- For Fn device memory :  
Specify the file number in the expansion code.
- For a device memory other than "R" or "Fn":  
Example: With indirect device memory designation, "01BF" (H) is assigned for " 1576".  
1576 (OCT) → 894 (DEC) / 2 = 447 (DEC) → 01BF (HEX)

## 6.1.2 JW100/70H COM Port

### Communication Setting

#### Editor

##### Communication setting

Item	Setting	Remarks
Connection Mode	1 : 1 / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / RS-422/485	
Baud Rate	4800 / 9600 / 19200 bps	
Data Length	7 bits	
Stop Bit	1 / 2 bits	
Parity	None / Odd / Even	
Target Port No.	0 to 31	

#### PLC

Be sure to match the settings to those made under [Communication Setting] of the editor.

##### JW-70CU/JW-100CU, JW-70CUH/JW-100CUH

The settings for communications with the V9 series should be made at the system memory as shown below.

System Memory	Contents	Setting Example																
#236	<p>Transmission specification</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td>D7</td><td>D6</td><td>D5</td><td>D4</td><td>D3</td><td>D2</td><td>D1</td><td>D0</td> </tr> <tr> <td>0</td><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td> </tr> </table> <p>                     Stop bit                      0: 1 bit                      1: 2 bits                 </p> <p>                     Parity                      00: None                      01: Odd                      10: Even                 </p> <p>                     Baud rate                      000: 19200 bps                      001: 9600 bps                      010: 4800 bps                 </p>	D7	D6	D5	D4	D3	D2	D1	D0	0	0	1	1	0	0	0	0	<p>30H</p> <p>                     Data length: 7 bits (fixed)                      Stop bit: 2 bits                      Parity: even                      Baud rate: 19200 bps                 </p>
D7	D6	D5	D4	D3	D2	D1	D0											
0	0	1	1	0	0	0	0											
#237	Port number: 001 to 037 (OCT)	01H																


## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
R (register)	00H	*1, *2
Relay (relay)	01H	$\square$ for word device *1
E (self diagnosis)	02H	*1
b (timer, counter/current value)	03H	*1
Fn (file register)	07H	*1, *3

\*1 The addresses are expressed in "bytes". For word designation, specify an even-numbered address.

\*2 The assigned device memory is expressed as shown on the right when editing the screen.

Example: x9yyy  


\*3 The file number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.

Example: F1 : 00002  


### Indirect Device Memory Designation

- For R device memory "x9yyy":  
Specify the value "x" (0 to 9: decimal) for higher bytes (bit 15 to 8).  
Specify a value obtained by dividing "yyy" (000 to 777: octal) by 2 for lower bytes (bit 7 to 0).

Example: With indirect device memory designation, "086D" is assigned for "R89332".  
 89 (ignoring the lower digit of "9") → 8 (DEC) → 08 (HEX)  
 332 (OCT) → 218 (DEC) / 2 = 109 (DEC) → 6D (HEX)

- For Fn device memory :  
Specify the file number in the expansion code.
- For a device memory other than "R" or "Fn":  
Example: With indirect device memory designation, "01BF" is assigned for " $\square$  1576".  
 1576 (OCT) → 894 (DEC) / 2 = 447 (DEC) → 01BF (HEX)

### 6.1.3 JW20 COM Port

#### Communication Setting

##### Editor

##### Communication setting


Item	Setting	Remarks
Connection Mode	1 : 1 / 1:n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / RS-422/485	
Baud Rate	4800 / 9600 / 19200 bps	
Data Length	7 bits	
Stop Bit	1 / 2 bits	
Parity	None / Odd / Even	
Target Port No.	0 to 31	

##### PLC

Be sure to match the settings to those made under [Communication Setting] of the editor.

##### JW-22CU, Z-311J, Z-312J


The settings for communications with the V9 series should be made at the system memory as shown below.

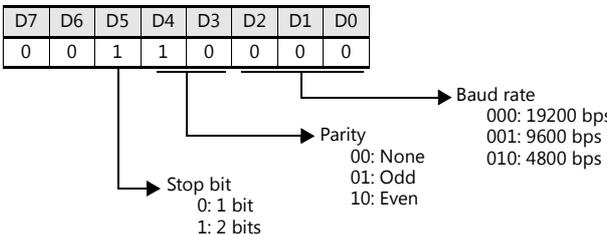System Memory	Contents	Setting Example
#236	Transmission specification 	30H Data length: 7 bits (fixed) Stop bit: 2 bits Parity: even Baud rate: 19200 bps
#237	Port number: 001 to 037 (OCT)	01H

\* The terminating resistance switch (SW1) is provided at the back of the JW-22CU board. Turn this switch off for RS-232C connection.

##### Z-511J, Z-512J

##### PG/COMM1 port

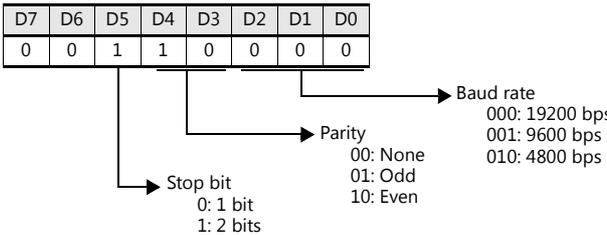System Memory	Contents	Setting Example
#234	Transmission specification 	30H Data length: 7 bits (fixed) Stop bit: 2 bits Parity: even Baud rate: 19200 bps
#235	Port number: 001 to 037 (OCT)	01H

## PG/COMM2 port

System Memory	Contents	Setting Example																
#236	Transmission specification <table border="1" style="margin-left: 20px;"> <tr> <td>D7</td><td>D6</td><td>D5</td><td>D4</td><td>D3</td><td>D2</td><td>D1</td><td>D0</td> </tr> <tr> <td>0</td><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td> </tr> </table> <p>Stop bit 0: 1 bit 1: 2 bits</p> <p>Parity 00: None 01: Odd 10: Even</p> <p>Baud rate 000: 19200 bps 001: 9600 bps 010: 4800 bps</p>	D7	D6	D5	D4	D3	D2	D1	D0	0	0	1	1	0	0	0	0	30H Data length: 7 bits (fixed) Stop bit: 2 bits Parity: even Baud rate: 19200 bps
D7	D6	D5	D4	D3	D2	D1	D0											
0	0	1	1	0	0	0	0											
#237	Port number: 001 to 037 (OCT)	01H																


## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
R (register)	00H	*1, *2
Relay (relay)	01H	<input type="checkbox"/> for word device *1
E (self diagnosis)	02H	*1
b (timer, counter/current value)	03H	*1
Fn (file register)	07H	*1, *3

\*1 The addresses are expressed in "bytes". For word designation, specify an even-numbered address.

\*2 The assigned device memory is expressed as shown on the right when editing the screen.



\*3 The file number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.



## Indirect Device Memory Designation

- For R device memory "x9yyy":  
Specify the value "x" (0 to 9: decimal) for higher bytes (bit 15 to 8).  
Specify a value obtained by dividing "yyy" (000 to 777: octal) by 2 for lower bytes (bit 7 to 0).

Example: With indirect device memory designation, "086D" is assigned for "R89332".  
89 (ignoring the lower digit of "9") → 8 (DEC) → 08 (HEX)  
332 (OCT) → 218 (DEC) / 2 = 109 (DEC) → 6D (HEX)

- For Fn device memory:  
Specify the file number in the expansion code.
- For a device memory other than "R" or "Fn":  
Example: With indirect device memory designation, "01BF" is assigned for " 1576".  
1576 (OCT) → 894 (DEC) / 2 = 447 (DEC) → 01BF (HEX)

## 6.1.4 JW300 Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / 9600 / 19200 / 38400 / <u>115K</u> bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	1 / <u>2</u> bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 31	
Transmission Mode	<u>2-wire</u> / 4-wire	Multi-link connection is not available in the 4-wire mode.

#### PLC

Be sure to match the settings to those made under [Communication Setting] of the editor.

#### PG/COMM 1 Port, PG/COMM 2 Port

Make PLC communication settings by using the application software "JW300SP" or writing the setting values directly into the system memory. For more information, refer to the PLC manual issued by the manufacturer.

#### JW300SP

Item	Setting	Remarks
Port 1 Port 2	Baud Rate	115200 / 38400 / 19200 / 9600 / 4800
	Parity	None / Odd / Even
	Stop Bit	1 / 2
	Station number	0 to 37 (OCT)
	Data Length	7 bits / 8 bits

#### System memory

#### PG/COMM 1 port

System Memory	Contents	Setting Example																
#234	Transmission specification <table border="1" style="margin-left: 20px;"> <tr> <td>D7</td><td>D6</td><td>D5</td><td>D4</td><td>D3</td><td>D2</td><td>D1</td><td>D0</td> </tr> <tr> <td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td> </tr> </table> Data length 0: 7 bits 1: 8 bits  Stop bit 0: 1 bit 1: 2 bits  Parity 00: None 01: Odd 10: Even  Baud rate 100: 115 kbps 010: 38400 bps 001: 19200 bps 000: 9600 bps	D7	D6	D5	D4	D3	D2	D1	D0	0	0	0	0	1	1	0	0	0CH Data length: 7 bits Stop bit: 1 bit Parity: Odd Baud rate: 115 kbps
D7	D6	D5	D4	D3	D2	D1	D0											
0	0	0	0	1	1	0	0											
#235	Station number: 001 to 037 (OCT)	01H																

## PG/COMM 2 port

System Memory	Contents	Setting Example																
#236	Transmission specification <table border="1" style="margin-left: 20px;"> <tr> <td>D7</td><td>D6</td><td>D5</td><td>D4</td><td>D3</td><td>D2</td><td>D1</td><td>D0</td> </tr> <tr> <td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td> </tr> </table> <div style="margin-left: 20px;">             Data length              0: 7 bits              1: 8 bits           </div> <div style="margin-left: 20px;">             Stop bit              0: 1 bit              1: 2 bits           </div> <div style="margin-left: 20px;">             Parity              00: None              01: Odd              10: Even           </div> <div style="margin-left: 20px;">             Baud rate              100: 115 kbps              010: 38400 bps              001: 19200 bps              000: 9600 bps           </div>	D7	D6	D5	D4	D3	D2	D1	D0	0	0	0	0	1	1	0	0	0CH Data length: 7 bits Stop bit: 1 bit Parity: Odd Baud rate: 115 kbps
D7	D6	D5	D4	D3	D2	D1	D0											
0	0	0	0	1	1	0	0											
#237	Station number: 001 to 037 (OCT)	01H																

## JW-21CM Unit

## Switch setting

Switch	Contents	Setting
SW0	Computer link (command mode)	<b>4</b>
SW1	Station address	1
SW2	Set the number from 01 to 37 in octal notation. SW1 denotes the lower-order digit, and SW2 denotes the higher-order digit. <b>Do not set 00, 08, 09, 18, 19, 28, 29 and 40 or greater. When any of these number is set, an error occurs.</b>	0
SW3	1 Not used	<b>OFF</b>
	2 Communication system (ON: 4-wire / OFF: 2-wire)	ON
	3 Not used	<b>OFF</b>
	4 Parity (ON: Even / OFF: Odd)	ON
SW4	Baud rate 0: 19200, 1: 9600, 2: 4800	0
SW7	Terminating resistance (ON: Provided / OFF: Not provided)	<b>ON</b>

\* The following settings are fixed; data length: 7 bits, and stop bit: 2 bits.

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (register)	00H	*1, *2
Relay (relay)	01H	□ for word device *1
E (self diagnosis)	02H	*1
b (timer, counter/current value)	03H	*1
Fn (file register)	07H	*1, *3

\*1 The addresses are expressed in "bytes". For word designation, specify an even-numbered address.

\*2 The assigned device memory is expressed as shown on the right when editing the screen.

Example: xx9yyy  
 ↑ ↑  
 0 to 777 (octal)  
 0 to 38 (decimal)

\*3 The file number is required in addition to the device type and address.  
 The assigned device memory is expressed as shown on the right when editing the screen.

Example: F1 : 00002  
 ↑ ↑ ↑  
 Address number  
 Colon  
 File number

## Indirect Device Memory Designation

- For R device memory "xx9yyy":  
Specify the value "xx" (00 to 38: decimal) for higher bytes (bit 15 to 8).  
Specify a value obtained by dividing "yyy" (000 to 777: octal) by 2 for lower bytes (bit 7 to 0).  
  
Example: With indirect device memory designation, "086D" is assigned for "R89332".  
089 (ignoring the lower digit of "9") → 08 (DEC) → 08 (HEX)  
332 (OCT) → 218 (DEC) / 2 = 109 (DEC) → 6D (HEX)
- For Fn device memory:  
Specify the file number in the expansion code.
- For a device memory other than "R" or "Fn":  
Example: With indirect device memory designation, "01BF" is assigned for "□ 1576".  
1576 (OCT) → 894 (DEC) / 2 = 447 (DEC) → 01BF (HEX)

## 6.1.5 JW Series (Ethernet)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

##### JW-255CM, JW-25TCM

Make PLC communication settings by using the application software or entering the setting values directly into the network parameter.

For more information, refer to the PLC manual issued by the manufacturer.

##### JW300SP (JW25TCM/255CM parameter settings)

Item	Setting	Remarks
IP Address Setting	IP Address	Set the IP address of the PLC.
	Subnet Mask	Set the subnet mask of the PLC.
Connection Setting	Open Method	<b>UDP</b>
	Local Port No.	Set the port number of the PLC.

#### Network parameter

Parameter Address	Contents	Setting Example
0000 to 0003	IP address at local port (DEC)	IP address: 192.168.1.1 0000: 192 0001: 168 0002: 1 0003: 1
0004 to 0007	Subnet mask (DEC)	Subnet mask: 255.255.255.0 0004: 255 0005: 255 0006: 255 0007: 0
0100 to 0103	Connection 0 setting 0100: Open method <b>01: UDP</b> 0101: Fixed to 0 0102: Local port number (lower byte (HEX)) 0103: Local port number (higher byte (HEX))	UDP connection, port number 3000 (= BB8H) 0100: 01H 0101: 00H 0102: B8H 0103: 0BH
0104 to 0107	Connection 1 setting (same as connection 0)	
0110 to 0113	Connection 2 setting (same as connection 0)	
0114 to 0117	Connection 3 setting (same as connection 0)	
0120 to 0123	Connection 4 setting (same as connection 0)	
0124 to 0127	Connection 5 setting (same as connection 0)	
0130 to 0133	Connection 6 setting (same as connection 0)	
0134 to 0137	Connection 7 setting (same as connection 0)	
3777 *	Communication start switch 00H: Communication stop 01H: Parameter check, BCC check, communication start 81H: Parameter check, BCC creation, writing into EEPROM, communication start (changed to 01H after the start of communication)	

\* Communication must be stopped before entering values into the network parameter to make the communication setting. Specify 00H at parameter address 3777 at first, and set the IP address, etc. After settings are made, specify 81H at parameter address 3777. Then settings will be written into EEPROM and communication will start.

## JW-50CM, JW-51CM

Make PLC communication settings by using the application software or entering the setting values directly into the network parameter.

For more information, refer to the PLC manual issued by the manufacturer.

### JW300SP (parameter settings)

Item	Setting	Remarks
IP Address Setting	IP Address	Set the IP address of the PLC.
	Subnet Mask	Set the subnet mask of the PLC.
Connection Setting	Open Method	<b>UDP</b>
	Local Port No.	Set the port number of the PLC.

### Network parameter

Parameter Address	Contents	Setting Example
0000 to 0003	IP address at local port (DEC)	IP address: 192.168.1.1 0000: 192 0001: 168 0002: 1 0003: 1
0004 to 0007	Subnet mask (DEC)	Subnet mask: 255.255.255.0 0004: 255 0005: 255 0006: 255 0007: 0
0100 to 0103	Connection 0 setting 0100: Open method <b>01: UDP</b> 0101: Fixed to 0 0102: Local port number (lower byte (HEX)) 0103: Local port number (higher byte (HEX))	UDP connection, port number 3000 (= BB8H) 0100: 01H 0101: 00H 0102: B8H 0103: 0BH
0104 to 0107	Connection 1 setting (same as connection 0)	
0110 to 0113	Connection 2 setting (same as connection 0)	
0114 to 0117	Connection 3 setting (same as connection 0)	
0120 to 0123	Connection 4 setting (same as connection 0)	
0124 to 0127	Connection 5 setting (same as connection 0)	
0130 to 0133	Connection 6 setting (same as connection 0)	
0134 to 0137	Connection 7 setting (same as connection 0)	
3777 *	Communication start switch 00H: Communication stop 01H: Parameter check, BCC check, communication start 81H: Parameter check, BCC creation, writing into EEPROM, communication start (changed to 01H after the start of communication)	

\* Communication must be stopped before entering values into the network parameter to make the communication setting. Specify 00H at parameter address 3777 at first, and set the IP address, etc. After settings are made, specify 81H at parameter address 3777. Then settings will be written into EEPROM and communication will start.

## Z-339J

### 12-VDC Power Input

10BASE5 or 10BASE-T is selected according to the input status of the 12-VDC power supply.

Item	Contents	
12-VDC power input	Provided	10BASE5 communication
	Not provided	10BASE-T communication

## Network parameter

Parameter Address	Contents	Setting Example
0000 to 0003	IP address at local port (DEC)	IP address: 192.168.1.1 0000: 192 0001: 168 0002: 1 0003: 1
0004 to 0007	Subnet mask (DEC)	Subnet mask: 255.255.255.0 0004: 255 0005: 255 0006: 255 0007: 0
0100 to 0103	Connection 0 setting 0100: Open method <b>01: UDP</b> 0101: Fixed to 0 0102: Local port number (lower byte (HEX)) 0103: Local port number (higher byte (HEX))	UDP connection, port number 3000 (= BB8H) 0100: 01H 0101: 00H 0102: B8H 0103: 0BH
0104 to 0107	Connection 1 setting (same as connection 0)	
0110 to 0113	Connection 2 setting (same as connection 0)	
0114 to 0117	Connection 3 setting (same as connection 0)	
0120 to 0123	Connection 4 setting (same as connection 0)	
0124 to 0127	Connection 5 setting (same as connection 0)	
0130 to 0133	Connection 6 setting (same as connection 0)	
0134 to 0137	Connection 7 setting (same as connection 0)	
3777 *	Communication start switch 00H: Communication stop 01H: Parameter check, BCC check, communication start 81H: Parameter check, BCC creation, writing into EEPROM, communication start (changed to 01H after the start of communication)	

- \* Communication must be stopped before entering values into the network parameter to make the communication setting. Specify 00H at parameter address 3777 at first, and set the IP address, etc. After settings are made, specify 81H at parameter address 3777. Then settings will be written into EEPROM and communication will start.


## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
R (register)	00H	*1, *2
Relay (relay)	01H	<input type="checkbox"/> for word device *1
E (self diagnosis)	02H	*1
b (timer, counter/current value)	03H	*1
Fn (file register)	07H	*1, *3

\*1 The addresses are expressed in "bytes". For word designation, specify an even-numbered address.

\*2 The assigned device memory is expressed as shown on the right when editing the screen.



\*3 The file number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.



## Indirect Device Memory Designation

- For R device memory "x9yyy":  
Specify the value "x" (0 to 9: decimal) for higher bytes (bit 15 to 8).  
Specify a value obtained by dividing "yyy" (000 to 777: octal) by 2 for lower bytes (bit 7 to 0).

Example: With indirect device memory designation, "086D" is assigned for "R89332".  
89 (ignoring the lower digit of "9") → 8 (DEC) → 08 (HEX)  
332 (OCT) → 218 (DEC) / 2 = 109 (DEC) → 6D (HEX)

- For Fn device memory:  
Specify the file number in the expansion code.
- For a device memory other than "R" or "Fn":  
Example: With indirect device memory designation, "01BF" is assigned for "□ 1576".  
1576 (OCT) → 894 (DEC) / 2 = 447 (DEC) → 01BF (HEX)

## 6.1.6 JW311/312/321/322 Series (Ethernet)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

##### JW-255CM, JW-25TCM

Make PLC communication settings by using the application software or entering the setting values directly into the network parameter.

For more information, refer to the PLC manual issued by the manufacturer.

##### JW300SP (JW25TCM/255CM parameter settings)

Item	Setting	Remarks
IP Address Setting	IP Address	Set the IP address of the PLC.
	Subnet Mask	Set the subnet mask of the PLC.
Connection Setting	Open Method	<b>UDP</b>
	Local Port No.	Set the port number of the PLC.

#### Network parameter

Parameter Address	Contents	Setting Example
0000 to 0003	IP address at local port (DEC)	IP address: 192.168.1.1 0000: 192 0001: 168 0002: 1 0003: 1
0004 to 0007	Subnet mask (DEC)	Subnet mask: 255.255.255.0 0004: 255 0005: 255 0006: 255 0007: 0
0100 to 0103	Connection 0 setting 0100: Open method <b>01: UDP</b> 0101: Fixed to 0 0102: Local port number (lower byte (HEX)) 0103: Local port number (higher byte (HEX))	UDP connection, port number 3000 (= BB8H) 0100: 01H 0101: 00H 0102: B8H 0103: 0BH
0104 to 0107	Connection 1 setting (same as connection 0)	
0110 to 0113	Connection 2 setting (same as connection 0)	
0114 to 0117	Connection 3 setting (same as connection 0)	
0120 to 0123	Connection 4 setting (same as connection 0)	
0124 to 0127	Connection 5 setting (same as connection 0)	
0130 to 0133	Connection 6 setting (same as connection 0)	
0134 to 0137	Connection 7 setting (same as connection 0)	
3777 *	Communication start switch 00H: Communication stop 01H: Parameter check, BCC check, communication start 81H: Parameter check, BCC creation, writing into EEPROM, communication start (changed to 01H after the start of communication)	

\* Communication must be stopped before entering values into the network parameter to make the communication setting. Specify 00H at parameter address 3777 at first, and set the IP address, etc. After settings are made, specify 81H at parameter address 3777. Then settings will be written into EEPROM and communication will start.


## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
R (register)	00H	*1, *2
Relay (relay)	01H	□ for word device *1
E (self diagnosis)	02H	*1
b (timer, counter/current value)	03H	*1
Fn (file register)	07H	*1, *3

\*1 The addresses are expressed in "bytes". For word designation, specify an even-numbered address.

\*2 The assigned device memory is expressed as shown on the right when editing the screen.

Example: xx9yyy  


\*3 The file number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.

Example: F1 : 00002  


### Indirect Device Memory Designation

- For R device memory "xx9yyy":  
Specify the value "xx" (0 to 38: decimal) for higher bytes (bit 15 to 8).  
Specify a value obtained by dividing "yyy" (000 to 777: octal) by 2 for lower bytes (bit 7 to 0).

Example: With indirect device memory designation, "086D" is assigned for "R89332".  
 089 (ignoring the lower digit of "9") → 08 (DEC) → 08 (HEX)  
 332 (OCT) → 218 (DEC) / 2 = 109 (DEC) → 6D (HEX)

- For Fn device memory:  
Specify the file number in the expansion code.
- For a device memory other than "R" or "Fn":  
Example: With indirect device memory designation, "01BF" is assigned for "□ 1576".  
1576 (OCT) → 894 (DEC) / 2 = 447 (DEC) → 01BF (HEX)

### 6.1.7 JW331/332/341/342/352/362 Series (Ethernet)


Settings are the same as those described in "6.1.6 JW311/312/321/322 Series (Ethernet)".

## 6.1.8 Wiring Diagrams


### When Connected at CN1:

#### RS-232C


Wiring diagram 1 - C2

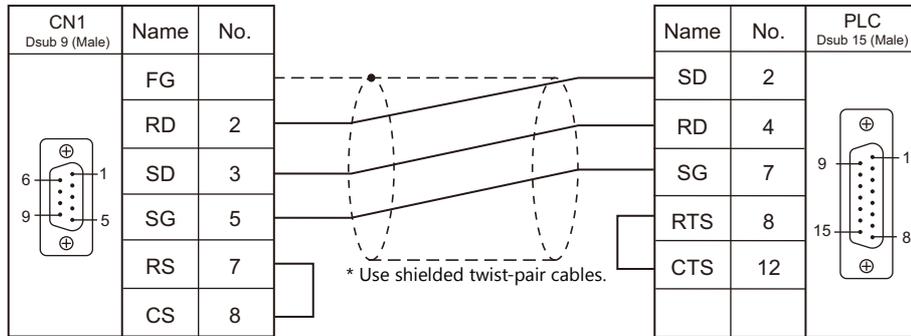


Wiring diagram 2 - C2

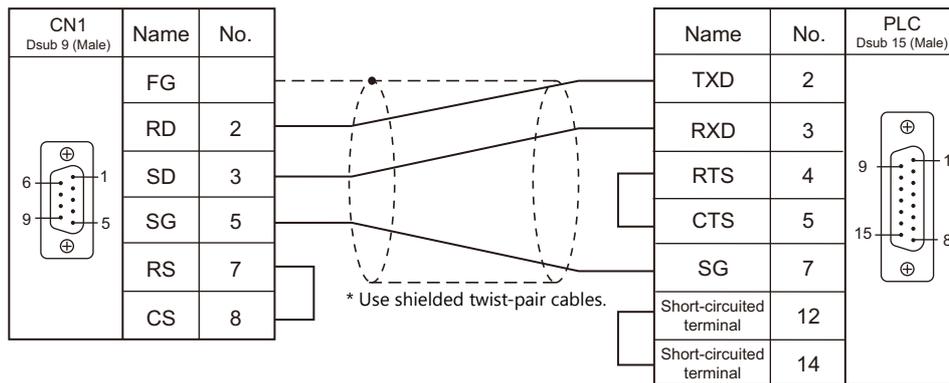

Wiring diagram 3 - C2

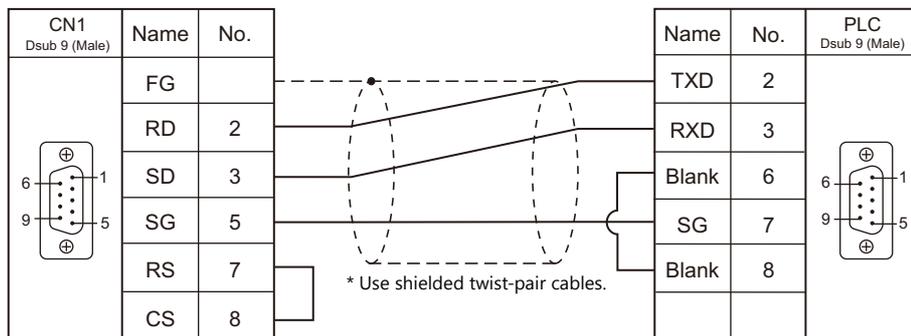


**Wiring diagram 4 - C2**

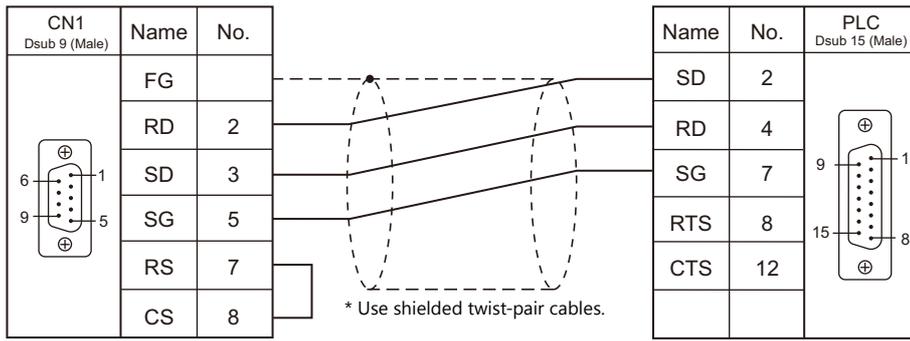


**RS-422/RS-485**


**Wiring diagram 1 - C4**

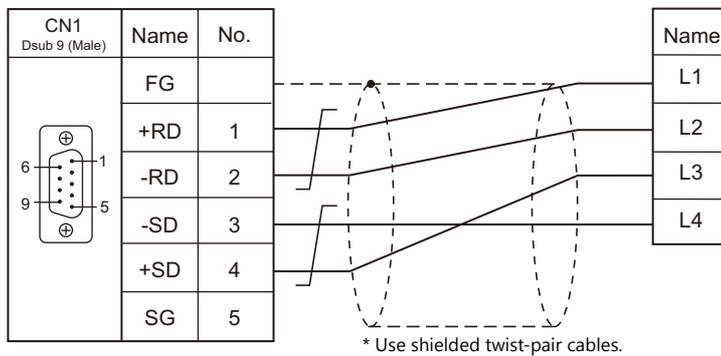


**Wiring diagram 2 - C4**

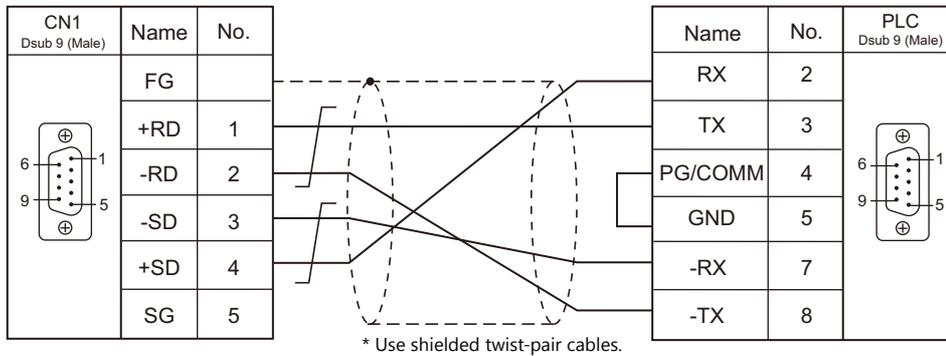


**Wiring diagram 3 - C4**

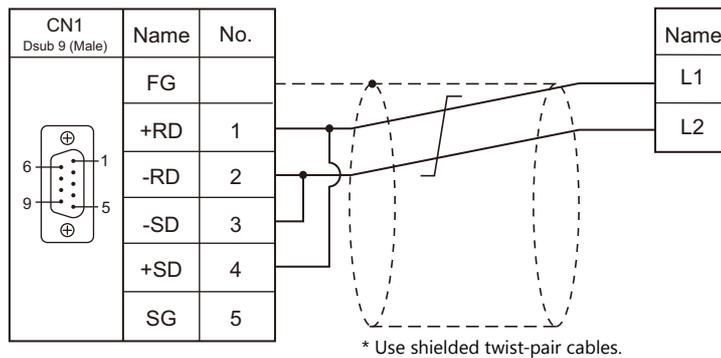


**Wiring diagram 4 - C4**

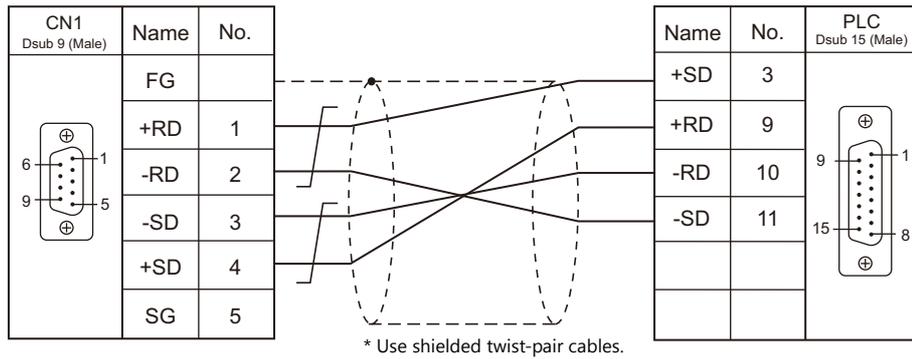


**Wiring diagram 5 - C4**

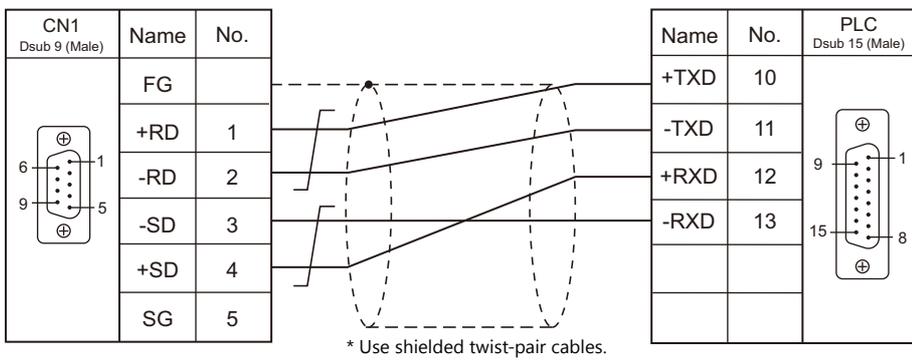

**Wiring diagram 6 - C4**

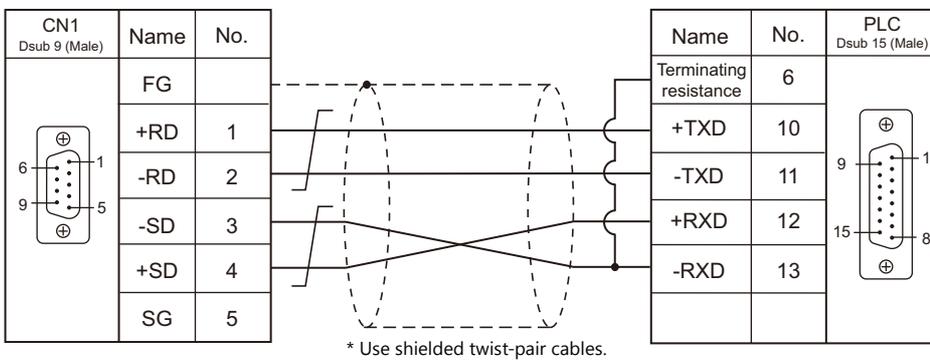


**Wiring diagram 7 - C4**

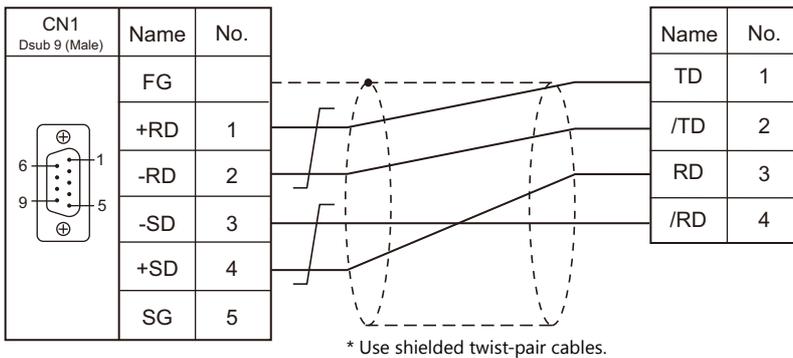


**When Connected at MJ1/MJ2:**

**RS-232C**


**Wiring diagram 1 - M2**

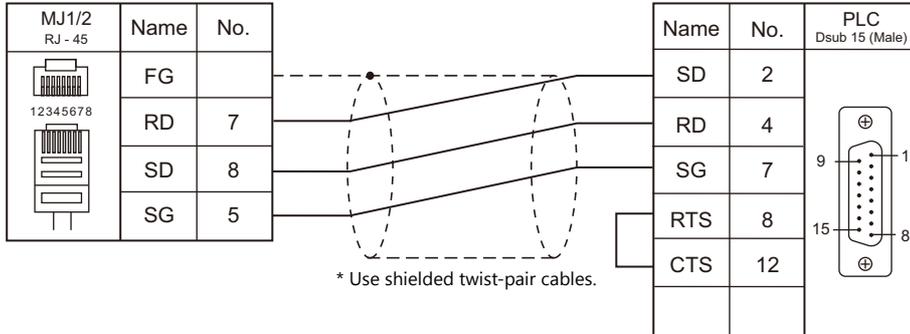


**Wiring diagram 2 - M2**

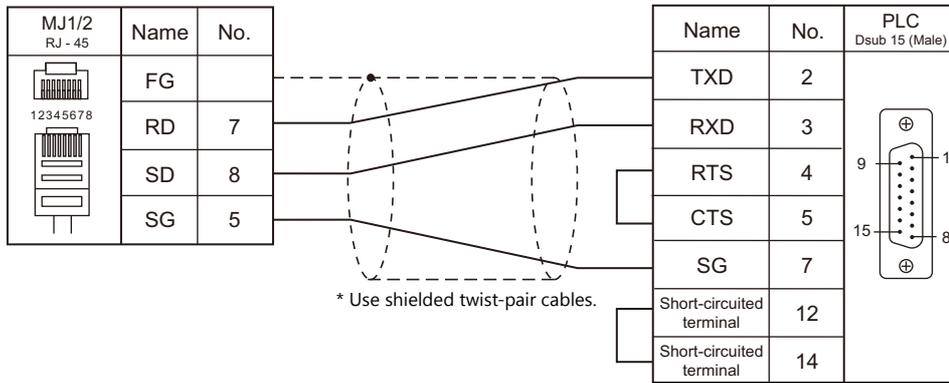

**Wiring diagram 3 - M2**

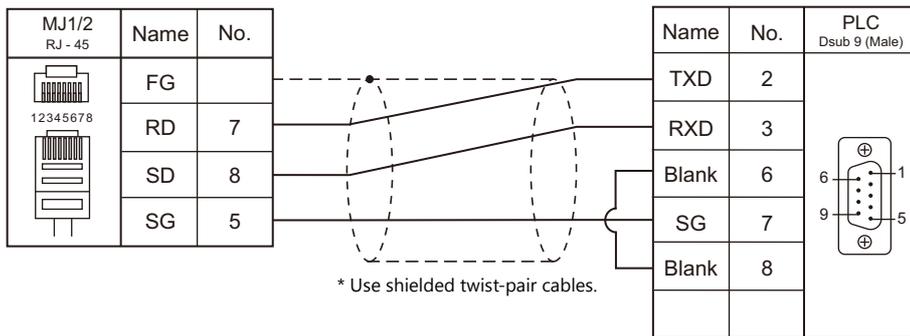


**Wiring diagram 4 - M2**

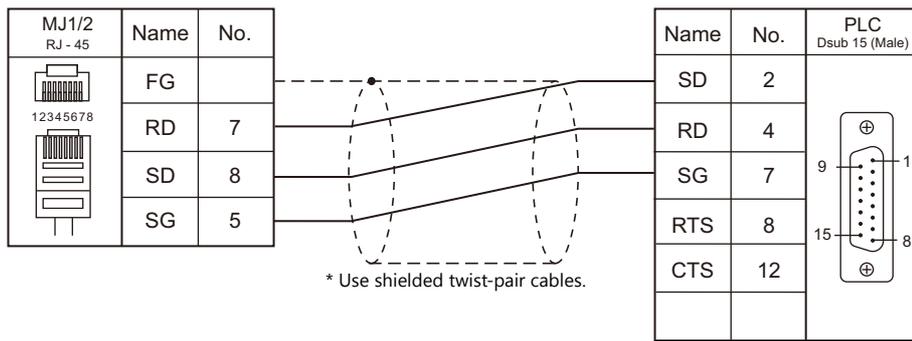


**RS-422/RS-485**


**Wiring diagram 1 - M4**

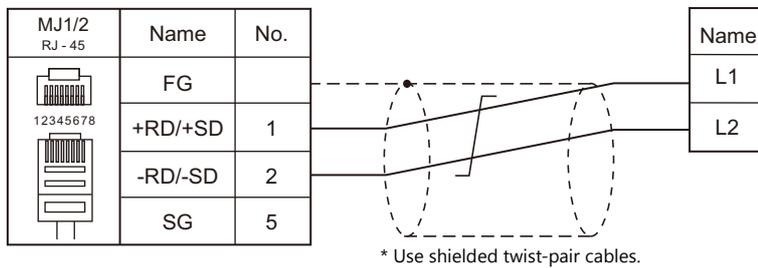

**Wiring diagram 2 - M4**

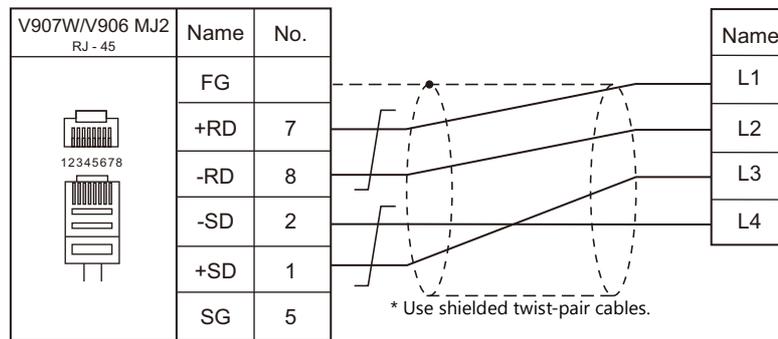


**Wiring diagram 3 - M4**

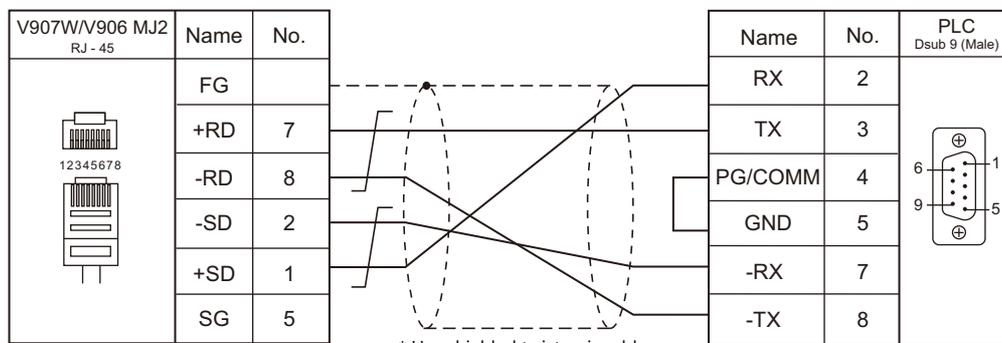


\* Slide switch on V907W/V906:  
RS-422 (lower)

**Wiring diagram 4 - M4**

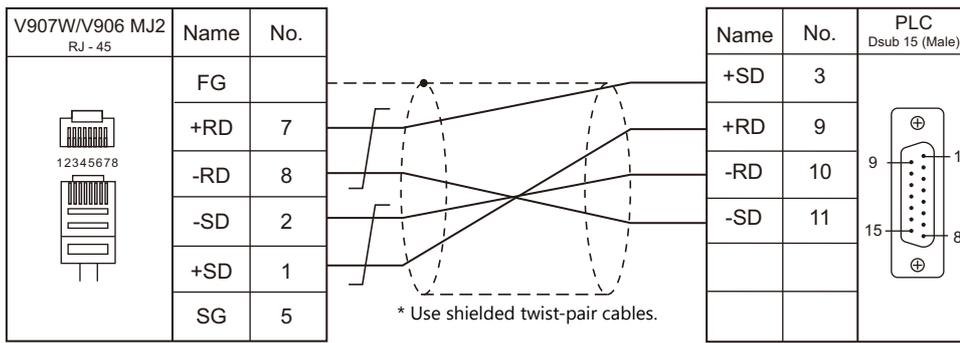


\* Slide switch on V907W/V906:  
RS-422 (lower)

**Wiring diagram 5 - M4**

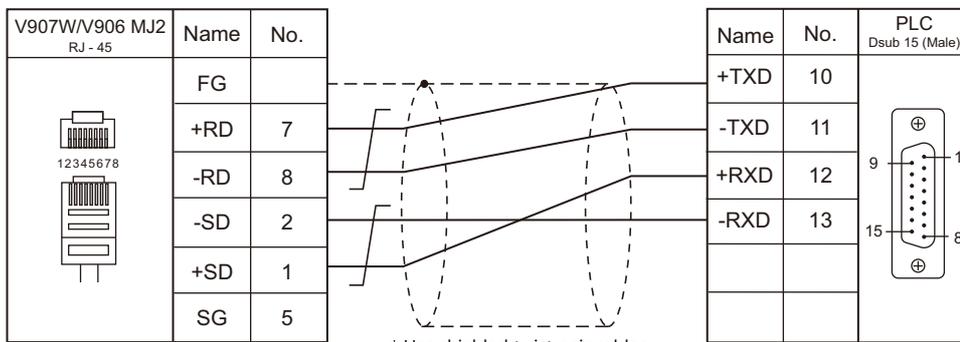


\* Slide switch on V907W/V906:  
RS-422 (lower)

**Wiring diagram 6 - M4**

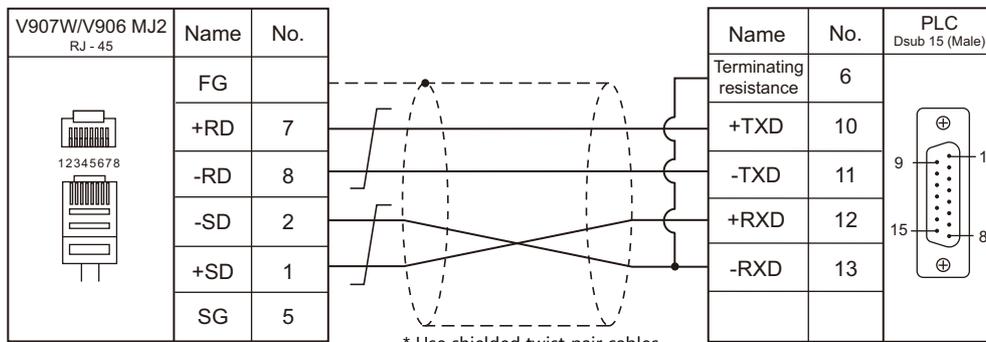

\* Slide switch on V907W/V906:  
RS-422 (lower)

**Wiring diagram 7 - M4**

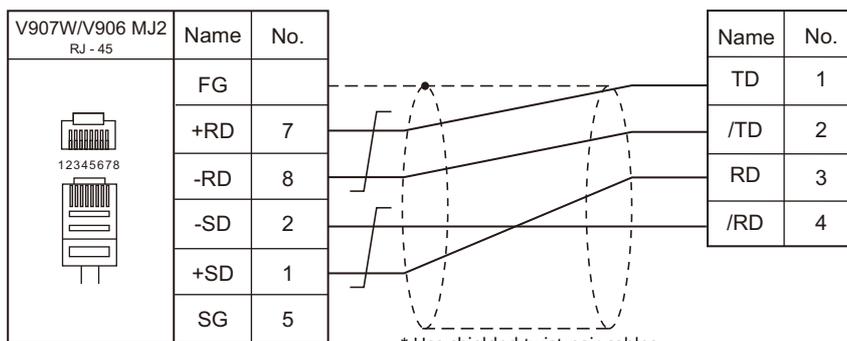

\* Slide switch on V907W/V906:  
RS-422 (lower)

## 6.2 Temperature Controller/Servo/Inverter Connection

### ID Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
DS-30D	DS-30D	Terminal block	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		SH-DS30D. Lst
			RS-422	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4	
		Connector for host/peripheral equipment	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		
			RS-422	Wiring diagram 2 - C4	×	Wiring diagram 3 - M4	
DS-32D	DS-32D	Host communication port 1	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		SH-DS32D. Lst
		Host communication port 2	RS-422	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4	
		MMI port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 6.2.1 DS-30D

### Communication Setting

#### Editor

##### Communication setting

(Underlined setting: default)


Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	<u>0</u> to 15	

#### RFID System

##### Switch Setting

(Underlined setting: default)

##### Communication setting

SW1	Function	OFF	ON	Setting Example									
1	Data length	<u>7</u>	8										
2	Parity	<u>None</u>	Provided										
3		<u>Even</u>	Odd										
4	Stop bit	<u>1</u>	2										
5	Connector type	<u>Using the host only</u>	Using the host and hand-held programmer (e.g. JW-12PG) at one time										
6	Communication system (wiring type)	<table border="1"> <thead> <tr> <th>RS-232C</th> <th>RS-422 (4-wire system)</th> <th>RS-485 (2-wire system)</th> </tr> </thead> <tbody> <tr> <td><u>OFF</u></td> <td>ON</td> <td>OFF</td> </tr> <tr> <td><u>OFF</u></td> <td>OFF</td> <td>ON</td> </tr> </tbody> </table>			RS-232C	RS-422 (4-wire system)	RS-485 (2-wire system)	<u>OFF</u>	ON	OFF	<u>OFF</u>	OFF	ON
RS-232C		RS-422 (4-wire system)	RS-485 (2-wire system)										
<u>OFF</u>	ON	OFF											
<u>OFF</u>	OFF	ON											
7													
8	Mode	<u>High speed</u>	Standard										

##### Station number setting

SW2	Contents	Setting Example
	<u>0</u> to F (H) (0 to 15)	0

##### Baud rate

SW3	Setting	Baud Rate	Setting Example
	4	4800 bps	5
	<u>5</u>	<u>9600 bps</u>	
	6	19200 bps	

##### Terminating resistance

SW4	Contents	Setting Example									
	<table border="1"> <thead> <tr> <th>RS-232C</th> <th>RS-422 (4-wire system)</th> <th>RS-485 (2-wire system)</th> </tr> </thead> <tbody> <tr> <td><u>OFF</u></td> <td>ON</td> <td>OFF</td> </tr> <tr> <td><u>OFF</u></td> <td>OFF</td> <td>ON</td> </tr> </tbody> </table>	RS-232C	RS-422 (4-wire system)	RS-485 (2-wire system)	<u>OFF</u>	ON	OFF	<u>OFF</u>	OFF	ON	1: OFF 2: OFF
RS-232C	RS-422 (4-wire system)	RS-485 (2-wire system)									
<u>OFF</u>	ON	OFF									
<u>OFF</u>	OFF	ON									

## Communication Mode Setting

Set a communication mode at the system memory. The selected mode becomes effective when the power is turned off and on again.

Address	Contents	Setting
A008	Communication start method	0: At any time required
A00A	Response transmission method	0: Automatic

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
CMUC (controller memory 1-byte data)	00H	
CMS (controller memory 2-byte data)	01H	
CMUT (controller memory 3-byte data)	02H	
CML (controller memory 4-byte data)	03H	
IMUC (ID memory 1-byte data)	04H	
IMS (ID memory 2-byte data)	05H	
IMUT (ID memory 3-byte data)	06H	
IML (ID memory 4-byte data)	07H	
ID (ID code)	08H	Double-word
TM (time)	09H	

\*1 The CH number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.

Example: #0: CMUC9000

Address number  
Device type  
CH number

## Indirect Device Memory Designation

Specify the CH number in the expansion code.

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2	
Plate clear	1 - 8 (PLC1 - 8)	n	Station number		7/9
		n + 1	Command: 0		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)	Attribute (1, 2, 4, 5, B, C, E, F)	
		n + 4	Address	Address	
		n + 5	Bytes	Bytes	
		n + 6	Clear data	Designated ID code	
		n + 7	-		
n + 8	-	Clear data			
Plate initialize	1 - 8 (PLC1 - 8)	n	Station number		4/6
		n + 1	Command: 1		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)	Attribute (1, 2, 4, 5, B, C, E, F)	
		n + 4	-	Designated ID code	
n + 5	-				
DS-30D clear	1 - 8 (PLC1 - 8)	n	Station number		6
		n + 1	Command: 2		
		n + 2	CH No.		
		n + 3	Address		
		n + 4	Bytes		
n + 5	Clear data				
DS-30D initialize	1 - 8 (PLC1 - 8)	n	Station number		3
		n + 1	Command: 3		
		n + 2	CH No.		
Log clear (communication time, number of retrials, error log)	1 - 8 (PLC1 - 8)	n	Station number		4
		n + 1	Command: 4		
		n + 2	CH No.		
		n + 3	Area 0: Communication time log 1: Retry count log 2: Error log		
Plate self diagnosis	1 - 8 (PLC1 - 8)	n	Station number		6/8
		n + 1	Command: 5		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)	Attribute (1, 2, 4, 5, B, C, E, F)	
		n + 4	Address	Address	
		n + 5	Bytes	Bytes	
		n + 6	Battery use rate	Designated ID code	
		n + 7	-		
n + 8	-	Battery use rate			
ROM check	1 - 8 (PLC1 - 8)	n	Station number		4/6
		n + 1	Command: 6		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)	Attribute (1, 2, 4, 5, B, C, E, F)	
		n + 4	-	ID code	
n + 5	-				
RAM check	1 - 8 (PLC1 - 8)	n	Station number		6/8
		n + 1	Command: 7		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)	Attribute (1, 2, 4, 5, B, C, E, F)	
		n + 4	Address	Address	
		n + 5	Bytes	Bytes	
		n + 6	-	Designated ID code	
n + 7	-				

Contents	F0	F1 (= \$u n)		F2	
Plate battery service life check	1 - 8 (PLC1 - 8)	n	Station number	4/6	
		n + 1	Command: 8		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)		Attribute (1, 2, 4, 5, B, C, E, F)
		n + 4	Battery use rate		Designated ID code
		n + 5	-		
		n + 6	-		Battery use rate
DS-30D self diagnosis	1 - 8 (PLC1 - 8)	n	Station number	2	
		n + 1	Command: 9		
Block check	1 - 8 (PLC1 - 8)	n	Station number	6/8	
		n + 1	Command: 10		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)		Attribute (1, 2, 4, 5, B, C, E, F)
		n + 4	Address		Address
		n + 5	Bytes		Bytes
		n + 6	-		Designated ID code
n + 7	-				
Reset	1 - 8 (PLC1 - 8)	n	Station number	3	
		n + 1	Command: 11		
		n + 2	CH No. 0: CH No. 0 1: CH No. 1 2: Both		
Output command	1 - 8 (PLC1 - 8)	n	Station number	7	
		n + 1	Command: 12		
		n + 2	CH No.		
		n + 3	Output 0		
		n + 4	Output 1		
		n + 5	Output 2		
Status read out	1 - 8 (PLC1 - 8)	n	Station number	3	
		n + 1	Command: 13		
		n + 2	CH No.		
		n + 3	Status		
DS-30D read out	1 - 8 (PLC1 - 8)	n	Station number	6	
		n + 1	Command: 14		
		n + 2	CH No.		
		n + 3	Address		
		n + 4	Bytes		
DS-30D write	1 - 8 (PLC1 - 8)	n	Station number	6	
		n + 1	Command: 15		
		n + 2	CH No.		
		n + 3	Address		
		n + 4	Bytes		
ID memory read out	1 - 8 (PLC1 - 8)	n	Station number	7/9	
		n + 1	Command: 16		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)		Attribute (1, 2, 4, 5, B, C, E, F)
		n + 4	Address		Address
		n + 5	Bytes		Bytes
		n + 6	Internal device memory address <sup>*1</sup>		Designated ID code
		n + 7	-		
n + 8	-	Internal device memory address <sup>*1</sup>			

Contents	F0	F1 (= \$u n)		F2	
ID memory write	1 - 8 (PLC1 - 8)	n	Station number		7/9
		n + 1	Command: 17		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)	Attribute (1, 2, 4, 5, B, C, E, F)	
		n + 4	Address	Address	
		n + 5	Bytes	Bytes	
		n + 6	Internal device memory address *2	Designated ID code	
		n + 7	-		
n + 8	-	Internal device memory address *2			
ID code read out	1 - 8 (PLC1 - 8)	n	Station number		4/6
		n + 1	Command: 18		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)	Attribute (1, 2, 4, 5, B, C, E, F)	
		n + 4	ID code	Designated ID code	
		n + 5			
		n + 6	-	ID code	
		n + 7	-		
ID code write	1 - 8 (PLC1 - 8)	n	Station number		6/8
		n + 1	Command: 19		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, A, D)	Attribute (1, 2, 4, 5, B, C, E, F)	
		n + 4	ID code	Designated ID code	
		n + 5			
		n + 6	-	ID code	
		n + 7	-		
Time read out	1 - 8 (PLC1 - 8)	n	Station number		3
		n + 1	Command: 20		
		n + 2	CH No.		
		n + 3	Year		
		n + 4	Month		
		n + 5	Day		
		n + 6	Hour		
		n + 7	Minute		
		n + 8	Second		
		n + 9	A day of the week		
Time correction	1 - 8 (PLC1 - 8)	n	Station number		10
		n + 1	Command: 21		
		n + 2	CH No.		
		n + 3	Year		
		n + 4	Month		
		n + 5	Day		
		n + 6	Hour		
		n + 7	Minute		
		n + 8	Second		
		n + 9	A day of the week		

Return data: Data stored from servo to V series

\*1 Specify the top address of the internal device memory (\$u) at which the read data is to be stored.

\*2 Specify the top address of the internal device memory (\$u) at which data to be written is stored.

## 6.2.2 DS-32D

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / 19200 / 38400 / 57600 / 76800 / <u>115K</u> bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 15	

\*1 When RS-422 connection is used via the MMI port, the following settings are fixed; baud rate: 115 kbps, data length: 8 bits, stop bit: 1 bit, and parity: even.

#### RFID System

#### Switch Setting

(Underlined setting: default)


#### Station number setting

SW1	Contents	Setting Example
	<u>0</u> to F (H) (0 to 15)	0

#### Baud rate

SW2	Setting	Baud Rate	Setting Example
	4	4800 bps	9
	5	9600 bps	
	6	19200 bps	
	7	38400 bps	
	8	57600 bps	
	<u>9</u>	<u>115 kbps</u>	

#### Terminating resistance

SW3	Contents			Setting Example
	RS-232C	RS-422 (4-wire system)	RS-485 (2-wire system)	1: OFF 2: OFF
	<u>OFF</u>	ON	OFF	
	<u>OFF</u>	ON	ON	

## Communication setting

SW4	Function	OFF	ON	Setting Example	
1	Data length	7	8		
2	Parity	None	Provided		
3		Even	Odd		
4	Stop bit	1	2		
5	Fixed to OFF				
6	Communication system (wiring type)	RS-232C	RS-422 (4-wire system)		RS-485 (2-wire system)
7		OFF	ON		OFF
		OFF	OFF		ON
8	Fixed to OFF				
9	Fixed to OFF				

## Communication Mode Setting

Set a communication mode at the system memory. The selected mode becomes effective when the power is turned off and on again.

Address	Contents	Setting
A008	Communication start method	0: At any time required
A00A	Response transmission method	0: Automatic
A00F	Trigger setting	0: Triggering invalid

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
CMUC (controller memory 1-byte data)	00H	
CMS (controller memory 2-byte data)	01H	
CMUT (controller memory 3-byte data)	02H	
CML (controller memory 4-byte data)	03H	
IMUC (ID memory 1-byte data)	04H	
IMS (ID memory 2-byte data)	05H	
IMUT (ID memory 3-byte data)	06H	
IML (ID memory 4-byte data)	07H	
ID (ID code)	08H	Double-word
TM (time)	09H	
RWUC (reader/writer memory 1-byte data)	0AH	
RWS (reader/writer memory 2-byte data)	0BH	
RWUT (reader/writer memory 3-byte data)	0CH	
RWL (reader/writer memory 4-byte data)	0DH	

\*1 The CH number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.

Example: #0 : CMUC9000

## Indirect Device Memory Designation

Specify the CH number in the expansion code.

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2	
Tag memory clear	1 - 8 (PLC1 - 8)	n	Station number	7/11	
		n + 1	Command: 0		
		n + 2	CH No.		
		n + 3	Attribute (0, 8)		Attribute (1, 2, 9, A)
		n + 4	Address		Address
		n + 5	Bytes		Bytes
		n + 6	Clear data		UID (lower)
		n + 7	-		
		n + 8	-		UID (higher)
		n + 9	-		
n + 10	-	Clear data			
Controller clear	1 - 8 (PLC1 - 8)	n	Station number	6	
		n + 1	Command: 1		
		n + 2	CH No.		
		n + 3	Address		
		n + 4	Bytes		
n + 5	Clear data				
Controller initialize	1 - 8 (PLC1 - 8)	n	Station number	3	
		n + 1	Command: 2		
		n + 2	CH No.		
Error log clear (communication time, number of retrials)	1 - 8 (PLC1 - 8)	n	Station number	4	
		n + 1	Command: 3		
		n + 2	CH No.		
n + 3	Area 0: Communication time log 1: Retry count log				
Reader/writer memory clear	1 - 8 (PLC1 - 8)	n	Station number	7/9	
		n + 1	Command: 4		
		n + 2	CH No.		
		n + 3	Attribute (0, 8)		Attribute (1, 9)
		n + 4	Address		Address
		n + 5	Bytes		Bytes
		n + 6	Clear data		Identification sign
		n + 7	-		
n + 8	-	Clear data			
Controller self diagnosis	1 - 8 (PLC1 - 8)	n	Station number	3	
		n + 1	Command: 5		
		n + 2	CH No.		
Reader/writer self diagnosis	1 - 8 (PLC1 - 8)	n	Station number	4/6	
		n + 1	Command: 6		
		n + 2	CH No.		
		n + 3	Attribute (0, 8)		Attribute (1, 9)
		n + 4	-		Identification sign
n + 5	-				
Error reset	1 - 8 (PLC1 - 8)	n	Station number	3	
		n + 1	Command: 7		
		n + 2	CH No. 0: CH No. 0 1: CH No. 1		
Output command	1 - 8 (PLC1 - 8)	n	Station number	5	
		n + 1	Command: 8		
		n + 2	CH No.		
		n + 3	OUT0 0: OFF 1: ON		
n + 4	OUT1 0: OFF 1: ON				
Status read out	1 - 8 (PLC1 - 8)	n	Station number	3	
		n + 1	Command: 9		
		n + 2	CH No.		
n + 3	Status				

Contents	F0	F1 (= \$u n)		F2	
Reader/writer reset	1 - 8 (PLC1 - 8)	n	Station number		4/6
		n + 1	Command: 10		
		n + 2	CH No.		
		n + 3	Attribute (0, 8)	Attribute (1, 9)	
		n + 4	-		
		n + 5	-		
Reader/writer radio wave stop	1 - 8 (PLC1 - 8)	n	Station number		4
		n + 1	Command: 11		
		n + 2	CH No.		
		n + 3	Command to reader/writer 0: Radio wave stop 1: Radio wave emit		
Input check	1 - 8 (PLC1 - 8)	n	Station number		3
		n + 1	Command: 12		
		n + 2	CH No.		
		n + 3	IN0		
		n + 4	IN1		
Controller read out	1 - 8 (PLC1 - 8)	n	Station number		6
		n + 1	Command: 13		
		n + 2	CH No.		
		n + 3	Address		
		n + 4	Bytes		
		n + 5	Internal device memory address <sup>*1</sup>		
Controller write	1 - 8 (PLC1 - 8)	n	Station number		6
		n + 1	Command: 14		
		n + 2	CH No.		
		n + 3	Address		
		n + 4	Bytes		
		n + 5	Internal device memory address <sup>*2</sup>		
Tag read out	1 - 8 (PLC1 - 8)	n	Station number		7/11
		n + 1	Command: 15		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, 4, 8, B, C)	Attribute (1, 2, 5, 6, 9, A, D, E)	
		n + 4	Address	Address	
		n + 5	Bytes	Bytes	
		n + 6	Internal device memory address <sup>*1</sup>	UID (lower)	
		n + 7	-		
		n + 8	-	UID (higher)	
		n + 9	-		
n + 10	-	Internal device memory address <sup>*1</sup>			
Tag write	1 - 8 (PLC1 - 8)	n	Station number		7/11
		n + 1	Command: 16		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, 4, 8, B, C)	Attribute (1, 2, 5, 6, 9, A, D, E)	
		n + 4	Address	Address	
		n + 5	Bytes	Bytes	
		n + 6	Internal device memory address <sup>*2</sup>	UID (lower)	
		n + 7	-		
		n + 8	-	UID (higher)	
		n + 9	-		
n + 10	-	Internal device memory address <sup>*2</sup>			
Tag UID code read out	1 - 8 (PLC1 - 8)	n	Station number		5
		n + 1	Command: 17		
		n + 2	CH No.		
		n + 3	Attribute (0, 3, 4, 8, B, C)		
		n + 4	Internal device memory address <sup>*1</sup>		

Contents	F0	F1 (= \$u n)		F2	
Time read out	1 - 8 (PLC1 - 8)	n	Station number		3
		n + 1	Command: 18		
		n + 2	CH No.		
		n + 3	Year		
		n + 4	Month		
		n + 5	Day		
		n + 6	Hour		
		n + 7	Minute		
		n + 8	Second		
		n + 9	A day of the week		
Time setting	1 - 8 (PLC1 - 8)	n	Station number		10
		n + 1	Command: 19		
		n + 2	CH No.		
		n + 3	Year		
		n + 4	Month		
		n + 5	Day		
		n + 6	Hour		
		n + 7	Minute		
		n + 8	Second		
		n + 9	A day of the week		
Reader/writer read out	1 - 8 (PLC1 - 8)	n	Station number		7/9
		n + 1	Command: 20		
		n + 2	CH No.		
		n + 3	Attribute (0, 8)	Attribute (1, 9)	
		n + 4	Address	Address	
		n + 5	Bytes	Bytes	
		n + 6	Internal device memory address <sup>*1</sup>	Identification sign	
		n + 7	-		
		n + 8	-	Internal device memory address <sup>*1</sup>	
Reader/writer write	1 - 8 (PLC1 - 8)	n	Station number		7/9
		n + 1	Command: 21		
		n + 2	CH No.		
		n + 3	Attribute (0, 8)	Attribute (1, 9)	
		n + 4	Address	Address	
		n + 5	Bytes	Bytes	
		n + 6	Internal device memory address <sup>*2</sup>	Identification sign	
		n + 7	-		
		n + 8	-	Internal device memory address <sup>*2</sup>	

Return data: Data stored from servo to V series

\*1 Specify the top address of the internal device memory (\$u) at which the read data is to be stored.


\*2 Specify the top address of the internal device memory (\$u) at which data to be written is stored.

### 6.2.3 Wiring Diagrams


#### When Connected at CN1:

#### RS-232C

Wiring diagram 1 - C2

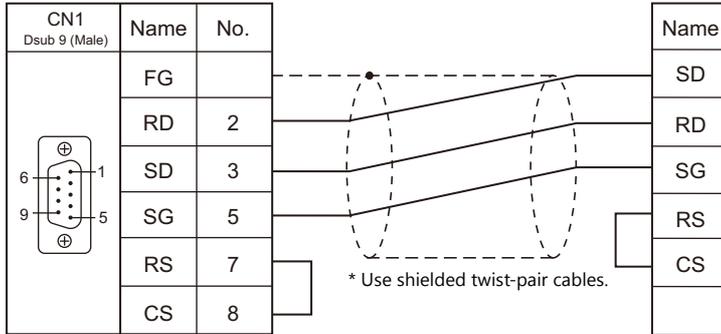






Wiring diagram 2 - C2

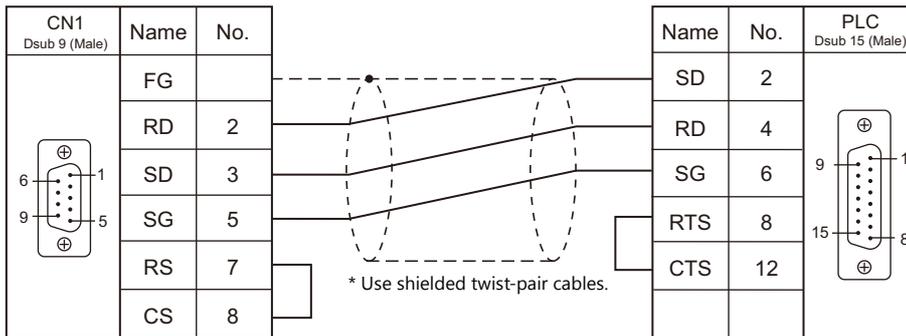


#### RS-422/RS-485

Wiring diagram 1 - C4

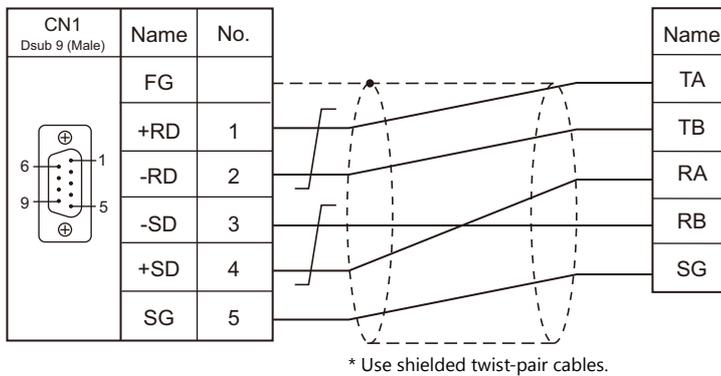

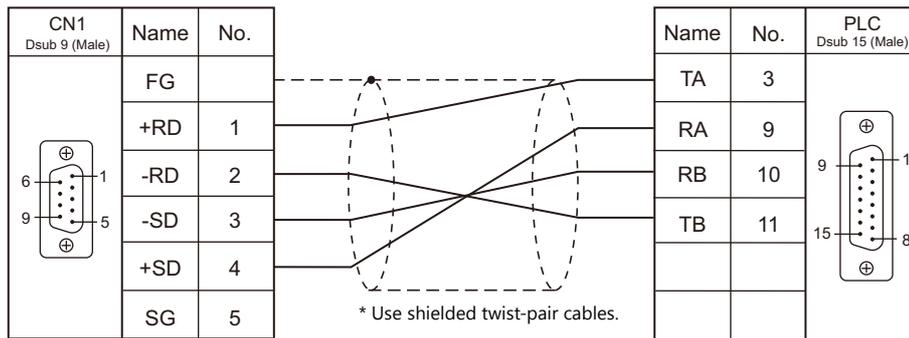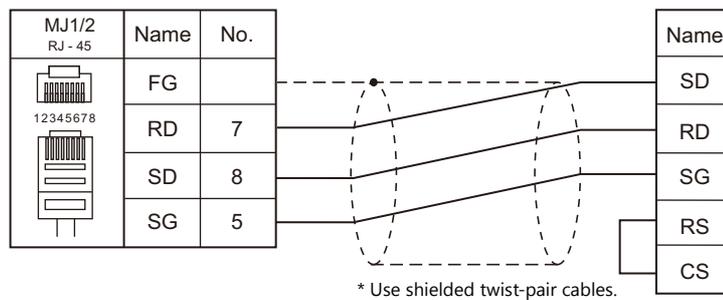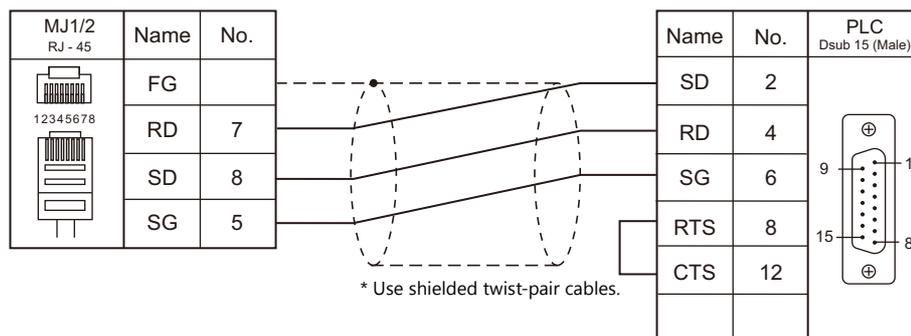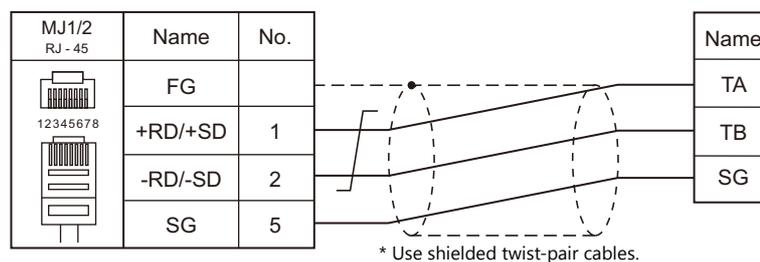**Wiring diagram 2 - C4****When Connected at MJ1/MJ2:****RS-232C****Wiring diagram 1 - M2****Wiring diagram 2 - M2****RS-422/RS-485****Wiring diagram 1 - M4**


**Wiring diagram 2 - M4**

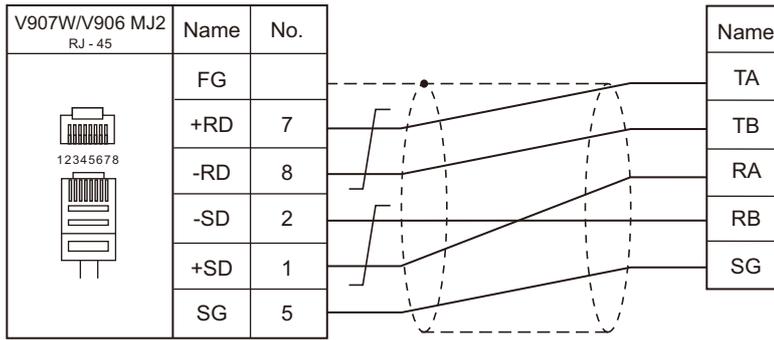

\* Slide switch on V907W/V906:  
RS-422 (lower)

\* Use shielded twist-pair cables.

**Wiring diagram 3 - M4**

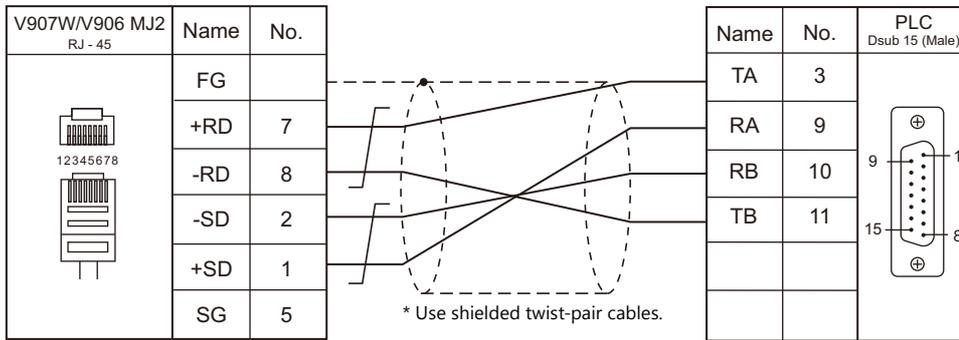

\* Slide switch on V907W/V906:  
RS-422 (lower)

\* Use shielded twist-pair cables.

# 7. SHIMADEN

---

7.1 Temperature Controller / Servo / Inverter Connection

## 7.1 Temperature Controller / Servo / Inverter Connection

### Controller / Indicator / Servo Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
SHIMADEN standard protocol	SR82-xx-N-xx-xxxx5xx SR83-xx-x-xx-xxxx5xx SR84-xx-x-xx-xxxx5xx SR91-xx-xx-x5x SR92-xx-x-xx-xx5x SR93-xx-x-xx-x05x SR94-xx-x-xx-x05x SR23-xxxx-xxxxx5x FP93-xx-xx-xx5x MR13-xx1-xxxx15x SD16-xxx-xx5x EM70-xx-xxx5x	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		Shimaden.List
	SR82-xx-N-xx-xxxx7xx SR83-xx-x-xx-xxxx7xx SR84-xx-x-xx-xxxx7xx SR92-xx-x-xx-xx7x SR93-xx-x-xx-x07x SR94-xx-x-xx-x07x SR23-xxxx-xxxxx7x FP93-xx-xx-xx7x MR13-xx1-xxxx17x SD16-xxx-xx7x EM70-xx-xxx7x	Terminal block	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
	SR253-xx-x-xxxxx5x	Communication port	RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4		
	SR253-xx-x-xxxxx6x	Communication port	RS-422	Wiring diagram 3 - C4	×	Wiring diagram 3 - M4	
	SR253-xx-x-xxxxx7x	Communication port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		
	FP23-xxxx-xxxxx5x	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		
	FP23-xxxx-xxxxx7x	Terminal block	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
						ShimadenFP23.List	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 7.1.1 SHIMADEN Standard Protocol

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / <u>19200</u> bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>1</u> to 31	
Sum Check	<u>Add</u> / Complement for Adding 2 / Exclusive OR / None	
CR/LF	<u>CR</u> / CR/LF	Only CR supported by the SR90/FP93/SD16 series
Write Data Count Setting	<u>1</u> to 10	

#### Controller / Indicator / Servo Controller

Communication parameters can be set by operating the keys on the front of the controller. Be sure to match the settings to those made under [Communication Setting] of the editor.

#### SR80 Series / EM70 Series

(Underlined setting: default)

Parameter Display	Item	Setting	Example
Comm	Communication mode *1	<u>LOC</u> : Read only COM: Read/write	COM
AdrS	Communication address	<u>1</u> to 99	1
bPS	Baud rate	4800 / 9600 / 19200 bps	19200
dAtA	Communication data format	<u>7E1</u> : 7 bits / even parity / 1 bit 7E2: 7 bits / even parity / 2 bits 7N1: 7 bits / none / 1 bit 7N2: 7 bits / none / 2 bits 8E1: 8 bits / even parity / 1 bit 8E2: 8 bits / even parity / 2 bits 8N1: 8 bits / none / 1 bit <u>8N2</u> : 8 bits / none / 2 bits	7E1
Ctrl	Communication control code	1: STX_ETX_CR 2: STX_ETX_CRLF	1
bcc	Communication BCC check	<u>1</u> : ADD (addition) 2: ADD_two's cmp (addition + 2's complement number) 3: XOR (exclusive OR) 4: None	1

\*1 The front-mounted key works for switching COM → LOC only.

When writing from the V9, place "1" (= communication mode: COM) at address "018Cxx (H)". (xx: Subaddress)

**SR90 Series**

(Underlined setting: default)

Parameter Display	Item	Setting	Example
Comm	Communication mode *1	<u>LOC</u> : Read only COM: Read/write	COM
Prot	Communication protocol	<u>Shim: SHIMADEN protocol</u>	Shim
bcc	BCC calculation	1: <u>ADD (addition)</u> 2: ADD_two's cmp (addition + 2's complement number) 3: XOR (exclusive OR) 4: None	1
bPS	Baud rate	4800 / 9600 / 19200 bps	19200
Addr	Communication address	<u>1</u> to 255	1
dAtA	Communication data format	<u>7E1: 7 bits / even parity / 1 bit</u> 7E2: 7 bits / even parity / 2 bits 7N1: 7 bits / none / 1 bit 7N2: 7 bits / none / 2 bits 8E1: 8 bits / even parity / 1 bit 8E2: 8 bits / even parity / 2 bits 8N1: 8 bits / none / 1 bit 8N2: 8 bits / none / 2 bits	7E1
SchA	Start character	<u>STX</u>	STX

\*1 The front-mounted key works for switching COM → LOC only.  
When writing from the V9, place "1" (= communication mode: COM) at address "018Cxx (H)". (xx: Subaddress)

**SR253 Series**

(Underlined setting: default)

Group	Display	Item	Setting	Example
Group 1-2	Operation	Communication mode *1	<u>LOCAL</u> : Read only COMM: Read/write	COMM
Group 5-5A	Add	Machine address	<u>01</u> to 99	01
	BPS	Baud rate	4800 / 9600 / 19200 bps	19200
	DATA	Communication data format	<u>7E1: 7 bits / even parity / 1 bit</u> 7E2: 7 bits / even parity / 2 bits 7N1: 7 bits / none / 1 bit 7N2: 7 bits / none / 2 bits 8E1: 8 bits / even parity / 1 bit 8E2: 8 bits / even parity / 2 bits 8N1: 8 bits / none / 1 bit 8N2: 8 bits / none / 2 bits	7E1
	Mode	Communication protocol mode	<u>Standard: Standard protocol</u>	Standard
Group 5-5B	MEM	Communication memory mode	<u>EEP: EEPROM</u> RAM: RAM	EEP
	CTRL	Control code	<u>STX_ETX_CR</u> <u>STX_ETX_CRLF</u>	STX_ETX_CR
	BCC	Checksum	<u>ADD (addition)</u> ADD_two's cmp (addition + 2's complement number) XOR (exclusive OR) None	ADD
	DELY	Delay time	0 to 99 ms	40

\*1 The front-mounted key works for switching COMM → LOCAL only.  
When writing from the V9, place "1" (= communication mode: COM) at address "018Cxx (H)". (xx: Subaddress)

**SR23 Series / FP23 Series**

(Underlined setting: default)

Parameter Display	Item	Setting	Example
COM	Communication mode *1	<u>LOCAL</u> : Read only COM: Read/write	COM
PORT	Communication protocol mode	<b>SHIMADEN: SHIMADEN protocol</b>	SHIMADEN
ADDR	Device address	<u>1</u> to 98	1
BPS	Baud rate	4800 / 9600 / 19200 bps	19200
MEM	Communication memory mode	<u>E</u> EP: EEPROM RAM: RAM R_E: RAM/EEPROM *2	EEP
DATA	Data length	<u>7</u> / 8	7
PARI	Parity	<u>EVEN</u> / ODD / NONE	EVEN
STOP	Stop bit	<u>1</u> / 2	1
DELY	Communication delay time	1 to 50 ms	10
CTRL	Communication control code	STX_ETX_CR STX_ETX_CRLF	STX_ETX_CR
BCC	Communication BCC data calculation	<u>ADD (addition)</u> ADD_two's cmp (addition + 2's complement number) XOR (exclusive OR) None	ADD

\*1 The front-mounted key works for switching COM → LOC only.

When writing from the V9, place "1" (= communication mode: COM) at address "018Cxx (H)". (xx: Subaddress)

\*2 Data in SV, OUT, and COM modes will be written to RAM. Other data will be written to EEPROM.

**FP93 Series**

(Underlined setting: default)

Parameter Display	Item	Setting	Example
Comm	Communication mode *1	<u>LOC</u> : Read only COM: Read/write	COM
Addr	Communication address	<u>1</u> to 255	1
bPS	Baud Rate	4800 / 9600 / 19200 bps	19200
dAtA	Communication data format	<u>7E1</u> : 7 bits / even parity / 1 bit 8N1: 8 bits / none / 1 bit	7E1
Stx	Start character	<b>STX</b>	STX
bCC	Communication calculation	<u>1: Addition</u> 2: Addition + 2's complement number 3: XOR 4: None	1

\*1 The front-mounted key works for switching COM → LOC only.

When writing from the V9, place "1" (= communication mode: COM) at address "018Cxx (H)". (xx: Subaddress)

**MR13 Series**

(Underlined setting: default)

Parameter Display	Item	Setting	Example
Com	Communication mode *1	<u>LOC</u> : Read only COM: Read/write	COM
Addr	Communication address	<u>1</u> to 99	1
bPS	Baud rate	4800 / 9600 / 19200 bps	19200
dAtA	Communication data format	<u>7E1</u> : 7 bits / even parity / 1 bit 7E2: 7 bits / even parity / 2 bits 7N1: 7 bits / none / 1 bit 7N2: 7 bits / none / 2 bits 8E1: 8 bits / even parity / 1 bit 8E2: 8 bits / even parity / 2 bits 8N1: 8 bits / none / 1 bit 8N2: 8 bits / none / 2 bits	7E1
mEm	Communication memory mode	<u>EED</u> : EEPROM RAM: RAM	EED
Ctrl	Communication control code	1: STX_ETX_CR 2: STX_ETX_CRLF	1
bCC	Communication checksum	1: <u>ADD (addition)</u> 2: ADD_two's cmp (addition + 2's complement number) 3: XOR (exclusive OR) 4: None	1

\*1 The front-mounted key works for switching COM → LOC only.  
When writing from the V9, place "1" (= communication mode: COM) at address "018Cxx (H)". (xx: Subaddress)

**SD16 Series**

(Underlined setting: default)

Parameter Display	Item	Setting	Example
Comm	Communication mode *1	<u>LOC</u> : Read only COM: Read/write	COM
Prot	Communication protocol mode	<u>SHIM</u> : SHIMADEN standard protocol	SHIM
Addr	Communication address	<u>1</u> to 100	1
dAtA	Communication data format	<u>7E1</u> : 7 bits / even parity / 1 bit 7E2: 7 bits / even parity / 2 bits 7N1: 7 bits / none / 1 bit 7N2: 7 bits / none / 2 bits 8E1: 8 bits / even parity / 1 bit 8E2: 8 bits / even parity / 2 bits 8N1: 8 bits / none / 1 bit 8N2: 8 bits / none / 2 bits	7E1
SchA	Communication start character	<u>STX</u>	STX
bcc	BCC calculation	1: <u>ADD (addition)</u> 2: ADD_two's cmp (addition + 2's complement number) 3: XOR 4: None	1
bPS	Baud rate	4800 / <u>9600</u> / 19200 bps	19200

\*1 The front-mounted key works for switching COM → LOC only.  
When writing from the V9, place "1" (= communication mode: COM) at address "018Cxx (H)". (xx: Subaddress)


## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
--	00H	

### Address denotations

The assigned device memory is expressed as shown below when editing the screen.



\* Specify a channel as a subaddress.

SR23 series / FP23 series	: 01 to 02
MR13 series	: 01 to 03
Other models	: 01 (fixed)

### Indirect Device Memory Designation

	15	8 7	0
n+0	Model	Device type	
n+1	Address (lower)	Subaddress	
n+2	00	Address (higher)	
n+3	00	Bit designation	
n+4	00	Station number	

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"


Contents	F0	F1 (= \$u n)	F2
Broadcast	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)
		n+1	Address (lower) + subaddress
		n+2	Address (higher)
		n+3	Write data
			4

## 7.1.2 Wiring Diagrams


### When Connected at CN1:

#### RS-232C

Wiring diagram 1 - C2

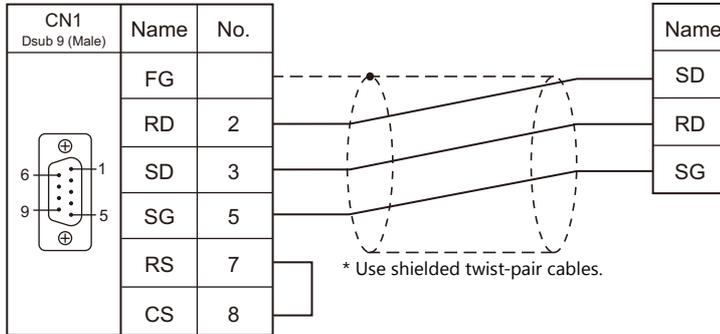


Wiring diagram 2 - C2

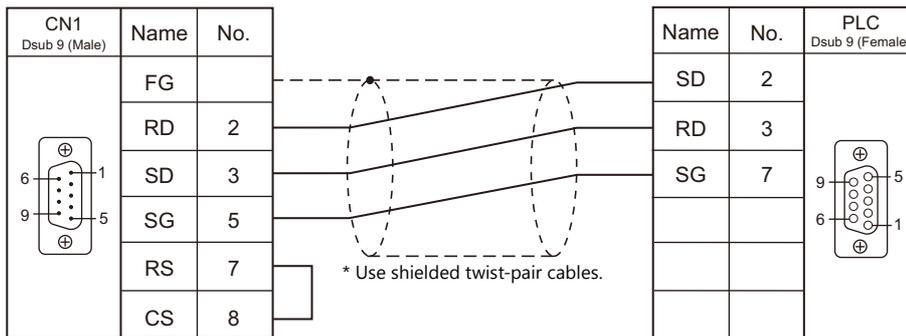


#### RS-422/RS-485


Wiring diagram 1 - C4

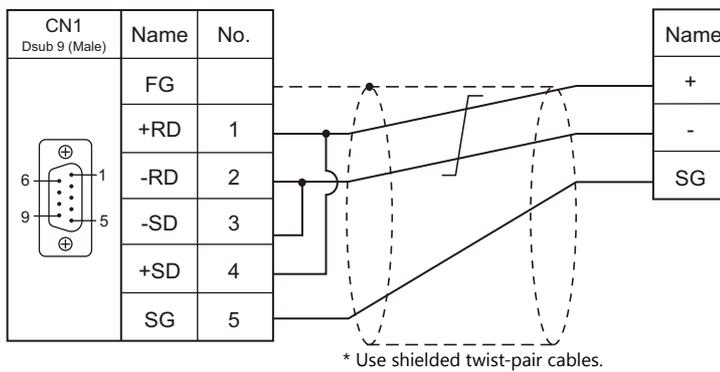

**Wiring diagram 2 - C4**

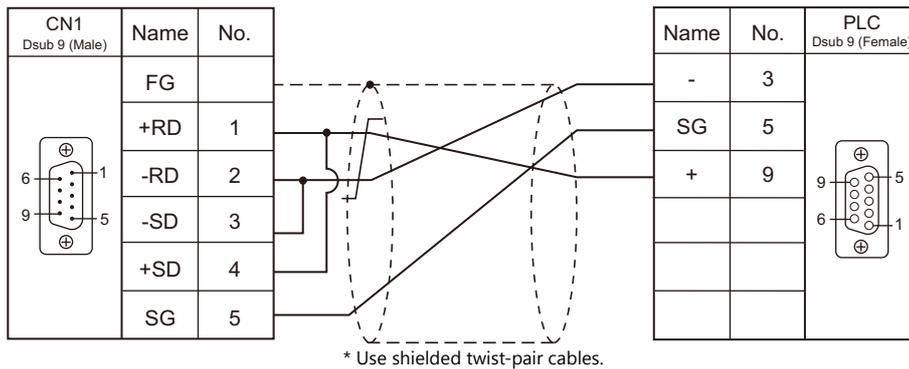


**Wiring diagram 3 - C4**

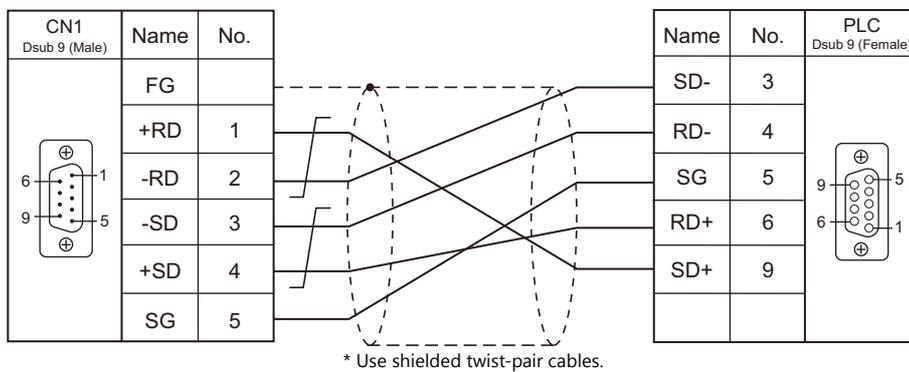


**When Connected at MJ1/MJ2:**

**RS-232C**

**Wiring diagram 1 - M2**

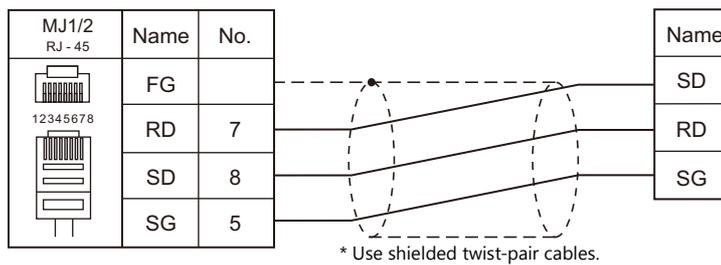


**Wiring diagram 2 - M2**

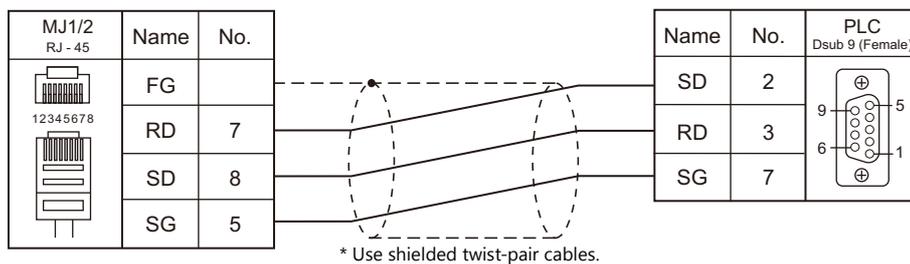


RS-422/RS-485


Wiring diagram 1 - M4

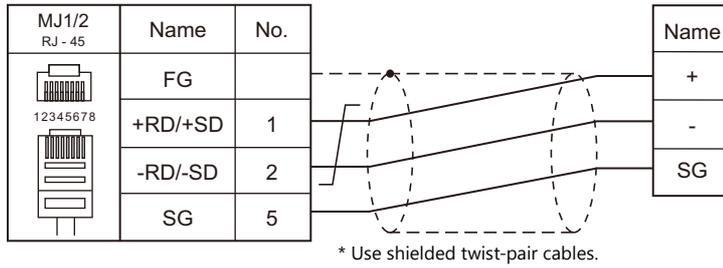

Wiring diagram 2 - M4

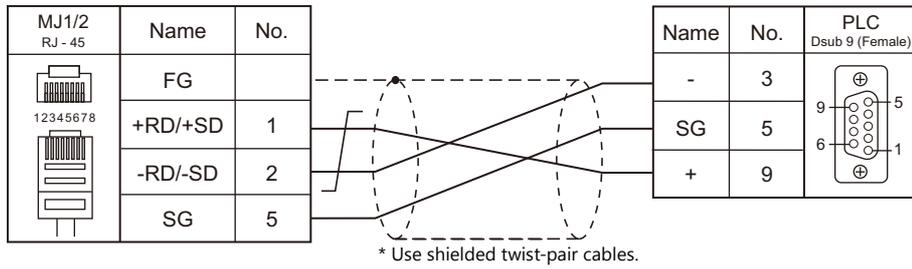


Wiring diagram 3 - M4

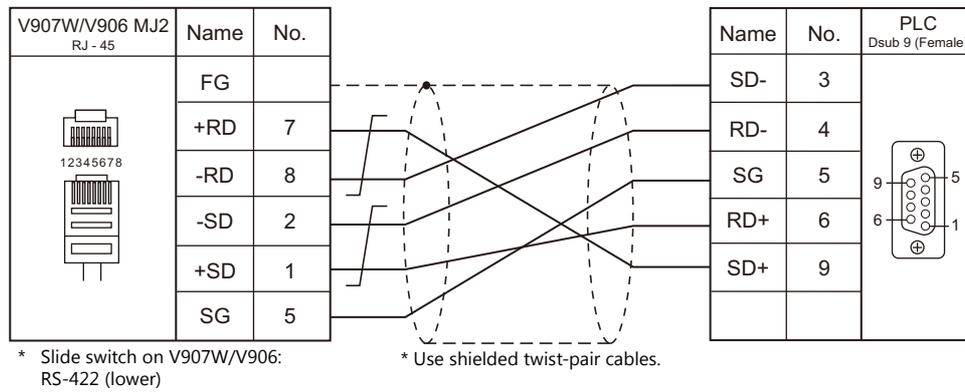

# MEMO

**MONITOUCH**



# 8. SHINKO TECHNOS

---

## 8.1 Temperature Controller/Servo/Inverter Connection

## 8.1 Temperature Controller/Servo/Inverter Connection

### Serial Connection

#### Multi-point Temperature Control System

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
C series	CPT-20A	Power source host link unit	RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4	Wiring diagram 4 - M4	S-C.Lst

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

#### Digital Indicating Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
FC series	FCS-23A (C5, C) <sup>*2</sup>	Terminal block	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		S-FC.Lst
	FCD-13A (C5, C) <sup>*2</sup>						
	FCR-13A (C5, C) <sup>*2</sup>		RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		
	FCR-23A (C5, C) <sup>*2</sup>						
FCR-15A (C5, C) <sup>*2</sup>							
GC series	GCS-33x-x/x, C5	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		S-GC.Lst
JCx-300 series	JCS-33A-x/xx, C5 JCR-33A-x/xx, C5 JCD-33A-x/xx, C5	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		S-JC.Lst
ACS-13A	ACS-13A-x/Mx, C5	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		S-ACS13 A.Lst
ACD/ACR series	ACD-13A-x/Mx, (C5, C) <sup>*2</sup>	Terminal block	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		S-ACDR. Lst
	ACR-13A-x/Mx, (C5, C) <sup>*2</sup>		RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		
WCL-13A	WCL-13A-xx/xxx, C5	RS-485	RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4		S-WCL. Lst

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Select a model with option C5 (serial communication RS-485) or C (serial communication RS-232C).

#### DIN-Rail-Mounted Indicating Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
DCL-33A	DCL-33A-x/xx, C5	RS-485	RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4		S-DCL.Lst

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

#### Program Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
PCD-33A	PCD-33A-x/Mx, C5	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		S-PCD33A.Lst
PC-900	PC-9x5-x/M, (C5, C) <sup>*2</sup>	Terminal block	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		S-PC900.Lst
			RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Select a model with option C5 (serial communication RS-485) or C (serial communication RS-232C).

## 8.1.1 C Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	<u>9600</u> / 19200 bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	0 to 15	


#### C Series

#### Device number setting

STATION No.	Setting	Setting Example
	0 to F (H) (0 to 15)	0

#### Communication setting DIP switch

(Underlined setting: default)

Switch	Contents	OFF	ON	Setting Example															
1	Baud rate	<u>9600 bps</u>	19200 bps																
2	Terminating resistance	<u>Without terminating resistance</u>	With terminating resistance																
3	Communication format	<u>QFE</u> : Shinko standard protocol																	
4																			
5																			
6																			
7	Digital output setting	<table border="1"> <thead> <tr> <th>7</th> <th>8</th> <th>Contents</th> </tr> </thead> <tbody> <tr> <td><u>QFE</u></td> <td><u>QFE</u></td> <td>Turning ON/OFF by communication command <sup>*1</sup></td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>DO1: warning 1, DO2: warning 2, DO3: heater disconnection warning</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>DO1: warning 1, DO2: warning 2, DO3: abnormal loop warning</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>DO1: warning 1, DO2: heater disconnection warning, DO3: abnormal loop warning</td> </tr> </tbody> </table>	7		8	Contents	<u>QFE</u>	<u>QFE</u>	Turning ON/OFF by communication command <sup>*1</sup>	ON	OFF	DO1: warning 1, DO2: warning 2, DO3: heater disconnection warning	OFF	ON	DO1: warning 1, DO2: warning 2, DO3: abnormal loop warning	ON	ON	DO1: warning 1, DO2: heater disconnection warning, DO3: abnormal loop warning	
7		8	Contents																
<u>QFE</u>		<u>QFE</u>	Turning ON/OFF by communication command <sup>*1</sup>																
ON		OFF	DO1: warning 1, DO2: warning 2, DO3: heater disconnection warning																
OFF	ON	DO1: warning 1, DO2: warning 2, DO3: abnormal loop warning																	
ON	ON	DO1: warning 1, DO2: heater disconnection warning, DO3: abnormal loop warning																	
8																			

\*1 Works only when the data is sent to the address (digital output [0041xx]) on CPT-20A. For more information, refer to the instruction manual for the temperature controller issued by the manufacturer.

## Available Device Memory


The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

### Address denotations

- The assigned device memory is expressed as shown below when editing the screen.

Example: XXXXY



- On the signal name reference list, every channel number is designated as "00". To access any channel number other than "00", manually input the desired number.

## 8.1.2 FC Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<b>7 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 95	"95" is used for broadcasting.

#### FC Series

#### Auxiliary function setting mode 1

When the [MODE] key is held down for three seconds together with the [▼] key in the PV/SV display mode, the controller enters in "auxiliary function setting mode 1".

(Underlined setting: default)

Item	Setting	Remarks
Communication protocol selection	<b>Shinko standard</b>	Available only with FCS-23A, FCR-13A, FCR-23A and FCD-13A
Device number setting	<u>0</u> to 94	
Baud rate selection	4800 / <u>9600</u> / 19200 bps	

\* The following settings are fixed; data length 7, stop bit 1 and even parity.

### Available Device Memory


The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

#### Address denotations

- The assigned device memory is expressed as shown below when editing the screen.

Example: XXXXY



- On the signal name reference list, every sub address is designated as "00". To access any sub address other than "00", manually input the desired address.

## 8.1.3 GC Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<b>7 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 95	"95" is used for broadcasting.

#### GC Series

#### Auxiliary function setting mode 1

When the [MODE] key is held down for three seconds together with the [▼] key in the PV/SV display mode, the controller enters in "auxiliary function setting mode 1".

(Underlined setting: default)

Item	Setting	Remarks
Device number setting	<u>0</u> to 94	
Baud rate selection	4800 / <u>9600</u> / 19200 bps	

\* The following settings are fixed; data length 7, stop bit 1, even parity.

### Available Device Memory


The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

#### Address denotations

- The assigned device memory is expressed as shown below when editing the screen.

Example: XXXXY



## 8.1.4 JCx-300 Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<b>7 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 95	"95" is used for broadcasting.

#### JCx-300 Series

#### Auxiliary function setting mode 1

When the [MODE] key is held down for three seconds together with the [▼] key in the PV/SV display mode, the controller enters in "auxiliary function setting mode 1".

(Underlined setting: default)

Item	Setting	Remarks
Communication protocol selection	<b>Shinko standard</b>	
Communication device number setting	0 to 94	
Baud rate selection	4800 / <u>9600</u> / 19200 bps	
Parity selection	<b>Even</b>	Cannot be changed when the Shinko standard protocol is selected.
Stop bit selection	<b>1 bit</b>	

\* The data length setting is fixed to "7".

### Available Device Memory

The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

## 8.1.5 ACS-13A

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<b>7 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 95	"95" is used for broadcasting.

#### ACS-13A

#### Auxiliary function setting mode

When the [MODE] key is held down for three seconds together with the [▼] key in the PV/SV display mode, the controller enters in "auxiliary function setting mode".

(Underlined setting: default)

Item	Setting	Remarks
Communication protocol selection	<b>Shinko standard</b>	
Device number setting	<u>0</u> to 94	
Baud rate selection	4800 / <u>9600</u> / 19200 bps	
Data bit / parity selection	<b>7 bits / even</b>	
Stop bit selection	<b>1 bit</b>	

### Available Device Memory

The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

## 8.1.6 ACD/ACR Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	<u>9600</u> / 19200 / 38400 bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	0 to 95	"95" is used for broadcasting.

#### ACD/ACR Series

#### Communication parameter setting group

When the [SET] key is pressed four times and the [MODE] key is pressed in the PV/SV display mode, the controller enters in "input parameter group".

In this state, press the [SET] key several times again. The controller enters in "communication parameter setting group".

(Underlined setting: default)

Item	Setting	Remarks
Communication protocol selection	<u>Shinko standard</u>	
Device number setting	<u>0</u> to 94	
Baud rate selection	<u>9600</u> / 19200 / 38400 bps	
Data bit / parity selection	8 bits / no parity 7 bits / no parity 8 bits / even <u>7 bits / even</u> 8 bits / odd 7 bits / odd	
Stop bit selection	<u>1 bit</u> 2 bits	

### Available Device Memory

The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

## 8.1.7 WCL-13A

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	<u>9600</u> / 19200 / 38400 bps	
Data Length	<b>7 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 95	"95" is used for broadcasting.

#### WCL-13A

#### Specific function setting group

When the [MODE] key is pressed several times in the PV/SV display mode, the controller enters in "specific function setting group".

(Underlined setting: default)

Item	Setting	Remarks
Communication protocol selection	<b>Shinko standard</b>	
Device number setting	<u>0</u> to 94	
Baud rate selection	<u>9600</u> / 19200 / 38400 bps	
Data bit / parity selection	<u>7 bits / even</u>	
Stop bit selection	<u>1 bit</u>	

### Available Device Memory

The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

## 8.1.8 DCL-33A

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<b>7 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 31	

#### DCL-33A

#### Auxiliary function setting mode 1

When the [MODE] key is held down for three seconds together with the [▼] key in the PV/SV display mode, the controller enters in the "auxiliary function setting" mode.

(Underlined setting: default)

Item	Setting	Remarks
Communication protocol selection	<b>Shinko standard</b>	
Communication device number setting	0 to 31	
Baud rate selection	4800 / <u>9600</u> / 19200 bps	
Parity selection	<b>Even</b>	Cannot be changed when the Shinko standard protocol is selected.
Stop bit selection	<b>1 bit</b>	

\* The data length setting is fixed to "7".

### Available Device Memory

The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

## 8.1.9 PCD-33A

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<b>7 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 95	"95" is used for broadcasting.

#### PCD-33A

#### Auxiliary function setting mode 1

When the [MODE] key is held down for three seconds together with the [▼] key in the PV/SV display mode, the controller enters in "auxiliary function setting mode 1".

(Underlined setting: default)

Item	Setting	Remarks
Communication protocol selection	<b>Shinko standard</b>	
Device number setting	<u>0</u> to 94	
Baud rate selection	<u>9600</u> / 19200 / 38400 bps	
Parity selection	<b>Even</b>	Cannot be changed when the Shinko standard protocol is selected.
Stop bit selection	<b>1 bit</b>	

\* The data length setting is fixed to "7".

### Available Device Memory

The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	00H	

## 8.1.10 PC-900

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<b>7 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 95	"95" is used for broadcasting.

#### PC-900

#### Communication parameter

Press the [SET/RST] key in the standby mode or program control execution mode, press the [STOP/MODE] key four times, and then press the [HOLD/ENT] key to select "auxiliary function setting mode". In this state, press the [STOP/MODE] key five times and then press the [HOLD/ENT] key to select "communication parameter". For more information, refer to the instruction manual for the PC-900.

(Underlined setting: default)

Item	Setting	Remarks
Baud rate selection	4800 / <u>9600</u> / 19200 bps	
Device number setting	<u>0</u> to 94	
Communication mode selection	<b><u>Serial communication</u></b>	

\* The following settings are fixed; data length 7, stop bit 1, even parity.

### Available Device Memory

The available setting range of device memory varies depending on the controller model. Be sure to set within the range available for the controller to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
---	00H	

### 8.1.11 Wiring Diagrams

#### When Connected at CN1:


##### RS-232C

Wiring diagram 1 - C2

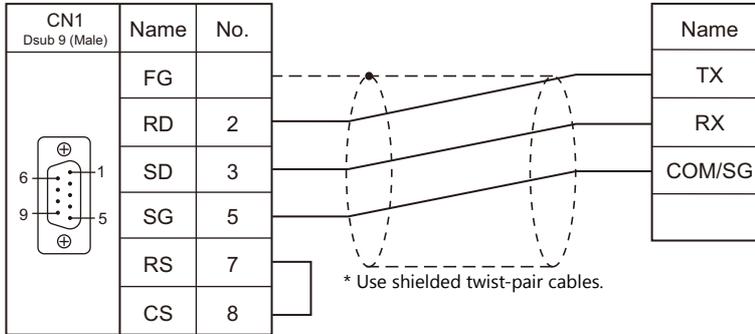


##### RS-422/RS-485


Wiring diagram 1 - C4

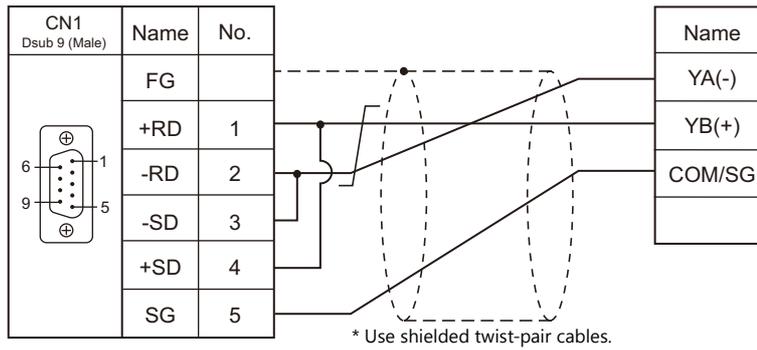

Wiring diagram 2 - C4

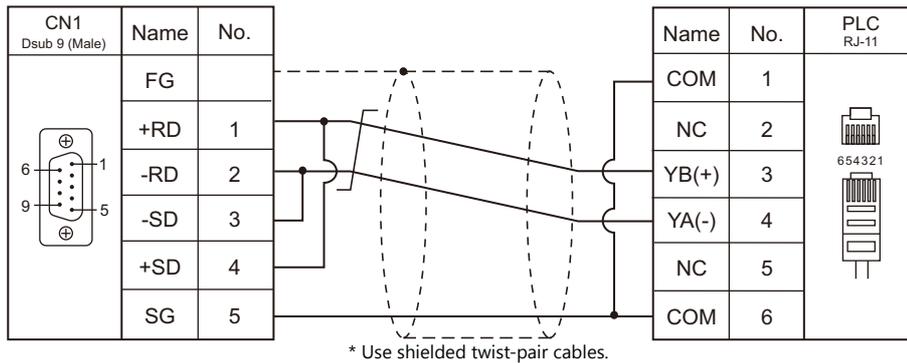


**Wiring diagram 3 - C4**

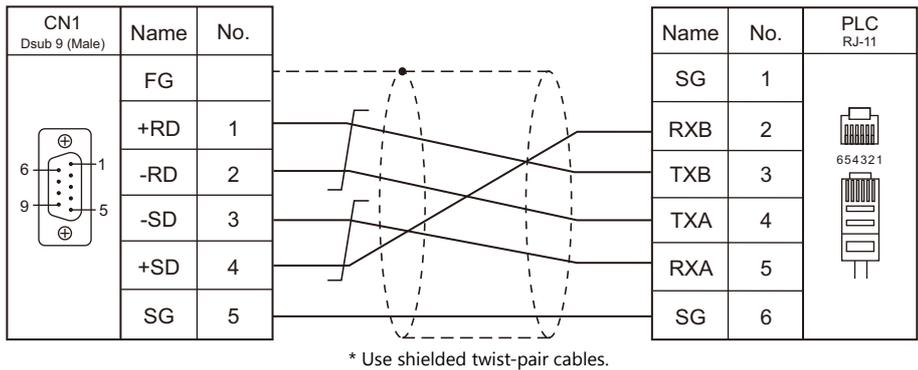

**When Connected at MJ1/MJ2:**


**RS-232C**

**Wiring diagram 1 - M2**

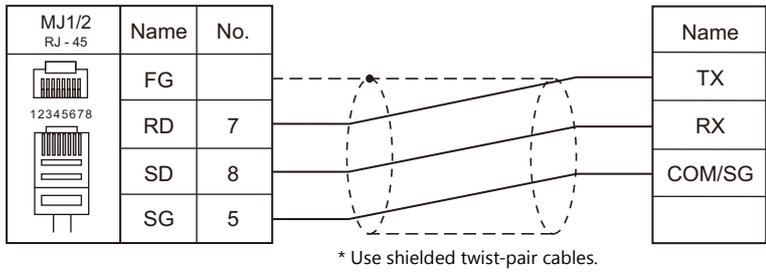


**RS-422/RS-485**


**Wiring diagram 1 - M4**

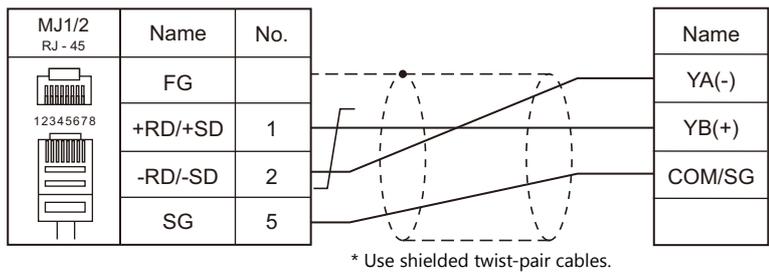


**Wiring diagram 2 - M4**

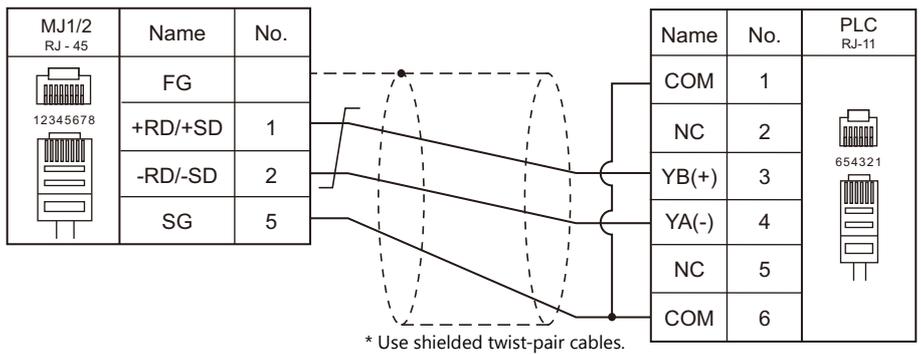

**Wiring diagram 3 - M4**

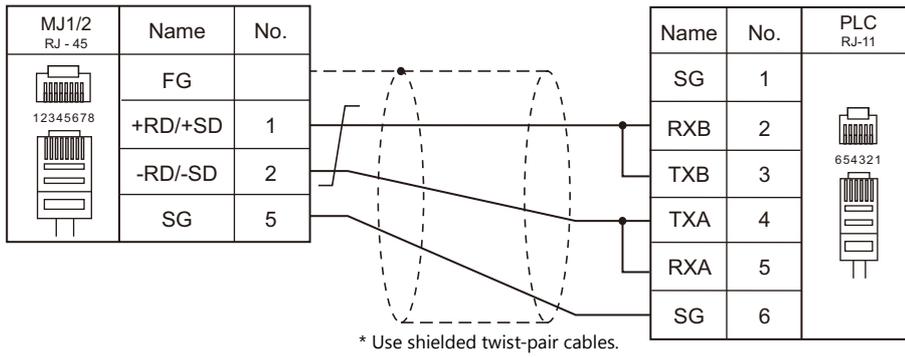


**Wiring diagram 4 - M4**

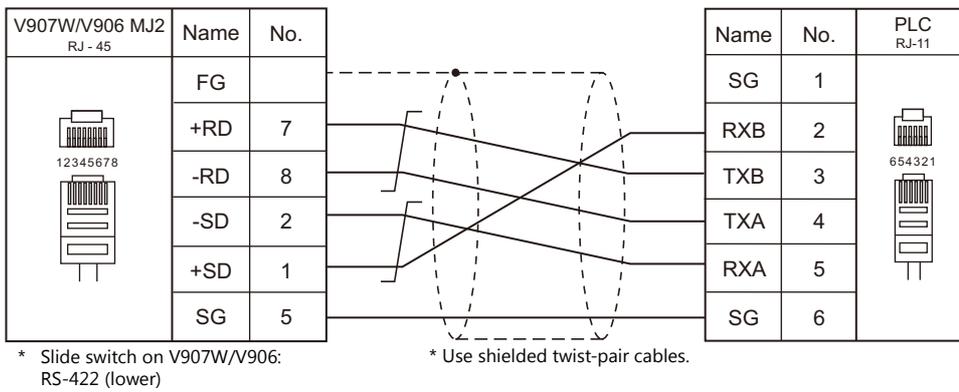

# MEMO

**MONITOUCH**



# 9. Siemens

---

## 9.1 PLC Connection

## 9.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU	Unit/Port	Signal Level	Connection			Ladder Transfer *3
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
S5 (PG port)	S5-90U S5-95U S5-95F S5-100U S5-115U S5-115H S5-115F	Programming port of CPU	RS-232C	Siemens 6ES5 734-1BD20 + Wiring diagram 2 - C2	Siemens 6ES5 734-1BD20 + Wiring diagram 2 - M2		×
S7	S7-300	CP-341 (3964R/RK512)	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
			RS-422	Wiring diagram 1 - C4	×	Wiring diagram 3 - M4	
	S7-400	CP-441 (3964R/RK512)	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			RS-422	Wiring diagram 1 - C4	×	Wiring diagram 3 - M4	
S7-200 PPI	CPU 226 CPU 224 CPU 222 CPU 221 CPU 216 CPU 215 CPU 214 CPU 212	PPI	RS-485	Wiring diagram 2 - C4*4	Wiring diagram 1 - M4*5		×
S7-300/400 MPI	CPU 312 CPU 312C CPU 313C CPU 313C-2 DP CPU 314 CPU 314C-2 DP CPU 315-2 DP CPU 315-2 PN/DP CPU 315F-2 DP CPU 317-2 DP CPU 317-2 PN/DP CPU 317F-2 DP CPU 319-3 PN/DP CPU 412-1 CPU 412-2 CPU 414-2 CPU 414-3 CPU 416-2 CPU 416-3 CPU 417-4	MPI (MPI/DP)	RS-485	Wiring diagram 2 - C4*4	Wiring diagram 1 - M4*5		×
TI500/505 series	TI545-1103	Port2	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		×
	TI545-1101 TI545-1102 TI545-1104 TI545-1111	Port2	RS-232C	Wiring diagram 4 - C2	Wiring diagram 4 - M2		
	TI555-1101 TI555-1102 TI555-1103 TI555-1104 TI555-1105 TI555-1106		RS-422	Wiring diagram 3 - C4	Wiring diagram 2 - M4	Wiring diagram 4 - M4	
	TI575-2104 TI575-2105 TI575-2106		Port1	RS-232C	Wiring diagram 5 - C2	Wiring diagram 5 - M2	
		Port3	RS-422	Wiring diagram 4 - C4	×	Wiring diagram 5 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906.

For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*3 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*4 The CN1 port of the optional unit "DUR-00" is not usable for the connection.

\*5 Only the MJ2 port of V907W and V906 is supported communication. The MJ1/MJ2 ports except these units are not usable for the connection.


## Ethernet Connection

PLC Selection on the Editor	CPU	Unit	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>
S7-200 (Ethernet ISOTCP)	CPU222, CPU224 CPU224XP, CPU226	CP243-1 CP243-1 IT	○	×	102 fixed (Max. 8 units)	○	×
S7-300/400 (Ethernet ISOTCP)	CPU312, CPU312C CPU313, CPU313C-2 DP CPU314, CPU314C-2 DP CPU315-2 DP CPU315-2 PN/DP CPU315F-2 DP CPU317-2 DP CPU317-2 PN/DP CPU317F-2 DP	CP343-1 Lean	○	×	102 (fixed) <sup>*3</sup>	○	×
	CPU315-2 PN/DP CPU317-2 PN/DP CPU319-3 PN/DP	-					
	CPU412-1, CPU412-2 CPU414-2, CPU414-3 CPU416-2, CPU416-3 CPU417-4	CP443-1					
S7-300/400 (Ethernet TCP/IP PG protocol)	CPU312, CPU312C CPU313, CPU313C-2 DP CPU314, CPU314C-2 DP CPU315-2 DP CPU315-2 PN/DP CPU315F-2 DP CPU317-2 DP CPU317-2 PN/DP CPU317F-2 DP	CP343-1 Lean	○	×	102 (fixed) <sup>*3</sup>	○	×
	CPU315-2 PN/DP CPU317-2 PN/DP CPU319-3 PN/DP	-					
	CPU412-1, CPU412-2 CPU414-2, CPU414-3 CPU416-2, CPU416-3 CPU417-4	CP443-1					
S7-1200/1500 (Ethernet ISOTCP)	CPU1211C, CPU1212C CPU1214C, CPU1511, CPU1513, CPU1515, CPU1516, CPU1518	-	○	×	102 (fixed) (Max. 3 units)	○	×

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*3 In n : 1 connection, the connectable number of V9 units varies depending on the system resource capacity of the PLC. Check the capacity on [Communication] which is displayed by selecting [STEP7 HW configuration] → [CPU] → [Object Properties].

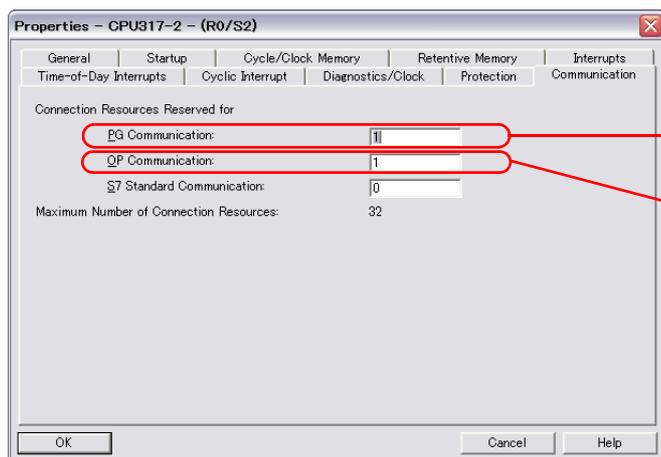

Connectable number of units when the PG protocol is selected (Including connections with STEP 7)

Connectable number of units when ISOTCP is selected (Including the number of OP units of Siemens)

## 9.1.1 S5 (PG Port)

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1 : 1</u> / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u>	
Baud Rate	<u>9600 bps</u>	
Data Length	<u>8 bits</u>	
Stop Bit	<u>1 bit</u>	
Parity	<u>Even</u>	
Target Port No.	0 to 31	

#### S5

No particular setting is necessary on S5.

#### Calendar

This model is not equipped with the calendar function. Use the built-in clock of the V series.

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
DB (Data Block)	00H	*1
I (input)	01H	IW as word device
Q (output)	02H	QW as word device
F (flag/internal relay)	03H	FW as word device
T (timer/current value)	04H	
C (counter/current value)	05H	
AS (absolute address)	06H	

\*1 When these device memory are used, registration is required at the PLC. For more information, refer to the PLC manual issued by the manufacturer. The assigned device memory is expressed as shown on the right when editing the screen. Addresses that can be set on MONITOUCH range from DB000000 to DB255255.

Example: DB001000

↑ Address No. (0 to 255)  
↑ Block No. (0 to 255)

## Indirect Device Memory Designation

	15	8 7	0
n+0	Model		Device type
n+1	Address No. (word designation)		
n+2	00	Bit designation	
n+3	00	Station number	

- Designation of addresses for byte devices (I, Q, F, AS):  
Specify an address number divided by "2" for "n+1".  
  
Example: Indirect device memory designation of "IW00010"  
 $n+1 = 10 \text{ (DEC)} \div 2 = 5 \text{ (DEC)}$
- Bit designation of addresses for byte devices (I, Q, F, AS):
  - An even address number  
Specify a byte address number divided by "2" for "n+1" and specify a bit number for "n+2".  
Example: Indirect device memory designation of "I000105"  
 $n+1 = 10 \div 2 = 5 \text{ (DEC)}$   
 $n+2 = 5 \text{ (DEC)}$
  - An odd address number  
Specify a byte address number minus "1", divided by "2", for "n+1". Specify a bit number plus "8" for "n+2".  
Example: Indirect device memory designation of "I000115"  
 $n+1 = (11 - 1) \div 2 = 5 \text{ (DEC)}$   
 $n+2 = 5 + 8 = 13 \text{ (DEC)}$
- For DB device memory:  
Specify a block number for the higher-order bytes "n + 1". Specify an address number for the lower-order bytes.

## 9.1.2 S7

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)


Item	Setting	Remarks
Connection Mode	<u>1</u> :1 / Multi-link2 / Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 / 76800 / 115K bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bit	
Parity	None / Odd / <u>Even</u>	

#### S7

Make the setting for communication using the ladder tool "SIMATIC Manager". For more information, refer to the PLC manual issued by the manufacturer.


#### Hardware Configuration ([RK 512] tab window)

Open the [Protocol] dialog and specify the baud rate and the parity, etc. in the [RK 512] tab window.

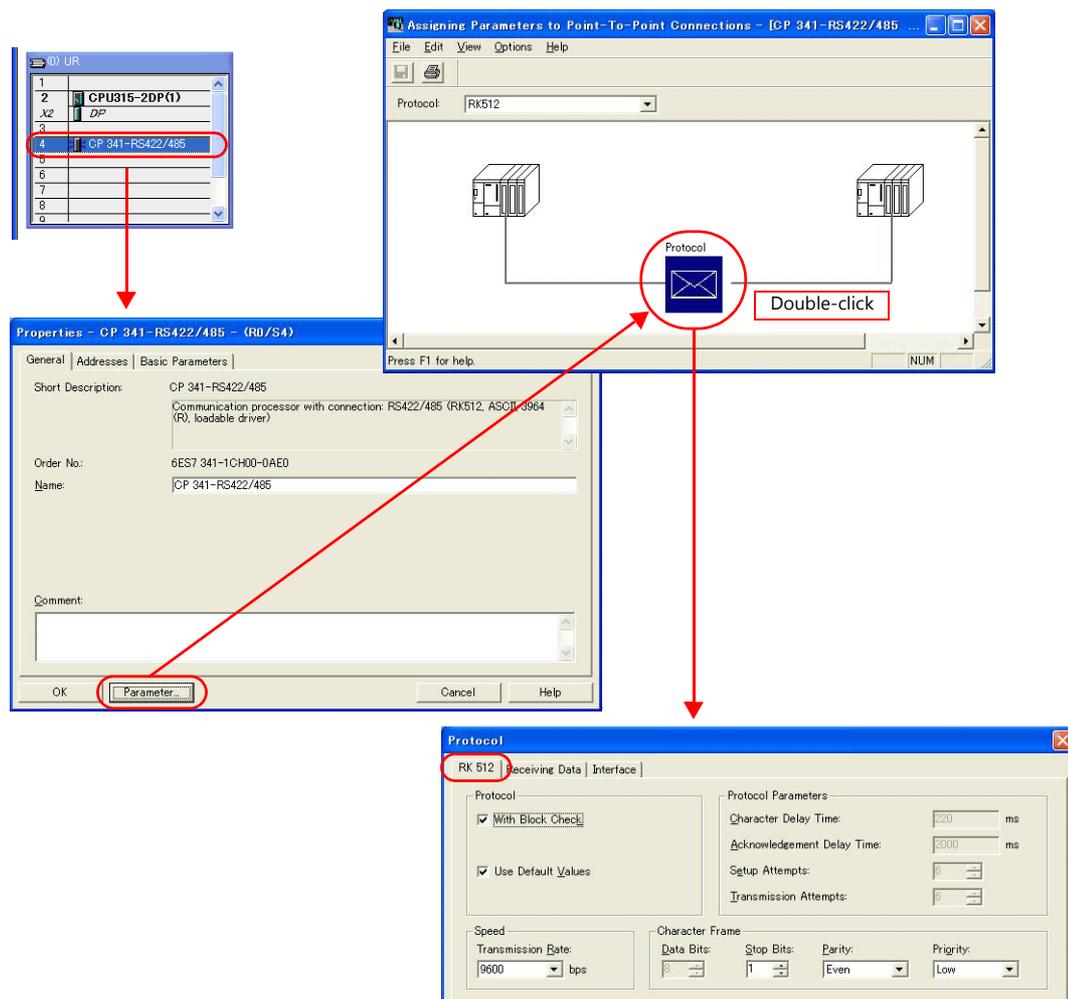

### Hardware Configuration ([Interface] tab window)

Specify "None" for the initial state of the receive line in the [Interface] tab window.

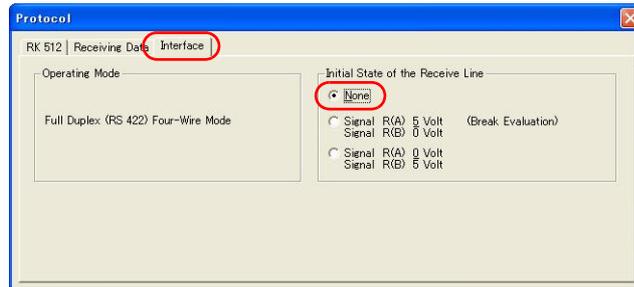


### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
DB (data block)	00H	*1
I (input)	01H	IW as word device
Q (output)	02H	QW as word device
M (memory word)	03H	MW as word device
T (timer/current value)	04H	
C (counter/current value)	05H	

- \*1 When this device memory is used, a registration is required for the PLC. For more information, refer to the PLC manual issued by the manufacturer. The assigned device memory is expressed as shown on the right when editing the screen. The address range available on MONITOUCH is DB255:0000 to DB255:0510.

Example: DB001 : 0000



### 9.1.3 S7-200PPI



#### CAUTION

- Only logical port PLC1 can be selected for S7-200PPI.
- The physical port for each model is fixed as follows:  
V910W / V915 / V912 / V910 / V908: CN1 port  
V907W / V906: MJ2 port (The "DUR-00" unit cannot be connected to CN1.)

## Communication Setting

### Editor

#### Communication setting


(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link2	
Signal Level	RS-422/485	
Baud Rate	<u>9600</u> / 19200 / 187.5k bps	
Data Length	<b>8 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	1 to 31 ( <u>2</u> )	

### S7-200

Make the setting for communication using the ladder tool "STEP 7 MicroWIN".

#### System block

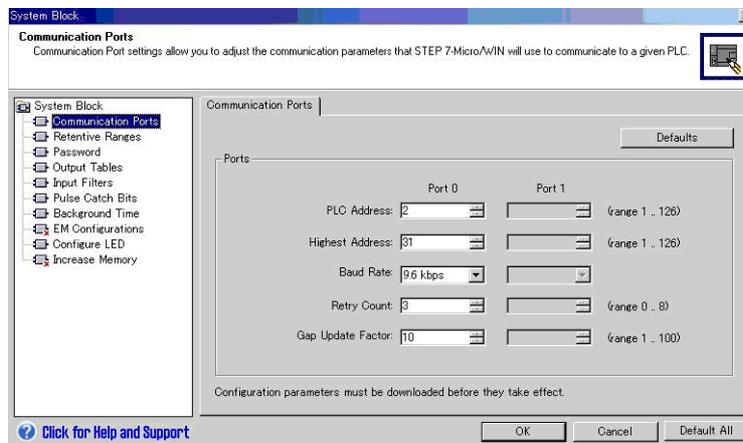

(Underlined setting: default)

Item	Setting	Remarks
PLC Address	1 to 31 ( <u>2</u> )	Numbers from 1 to 126 can be specified, however, communication with V9 cannot be established when a number from 32 to 126 is specified.
Highest Address	1 to <u>31</u>	
Baud Rate	<u>9.6k</u> / 19.2k / 187.5 kbps	

The following settings are fixed; data length: 8 bits, stop bit: 1 bit and parity: even.

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
V (data memory)	00H	VW as word device
I (input)	01H	IW as word device, possible to write to the unused area
Q (output)	02H	QW as word device
M (bit memory/internal relay)	03H	MW as word device
T (timer/current value)	04H	
C (counter/current value)	05H	
HC (high-speed counter/current value)	08H	Double-word usable
AIW (analog input)	09H	
AQW (analog output)	0AH	
SM (special memory/special relay)	0BH	SMW as word device
S (stage)	0CH	SW as word device


## 9.1.4 S7-200(Ethernet ISOTCP)

### Communication Setting


#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number (No. 102) of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

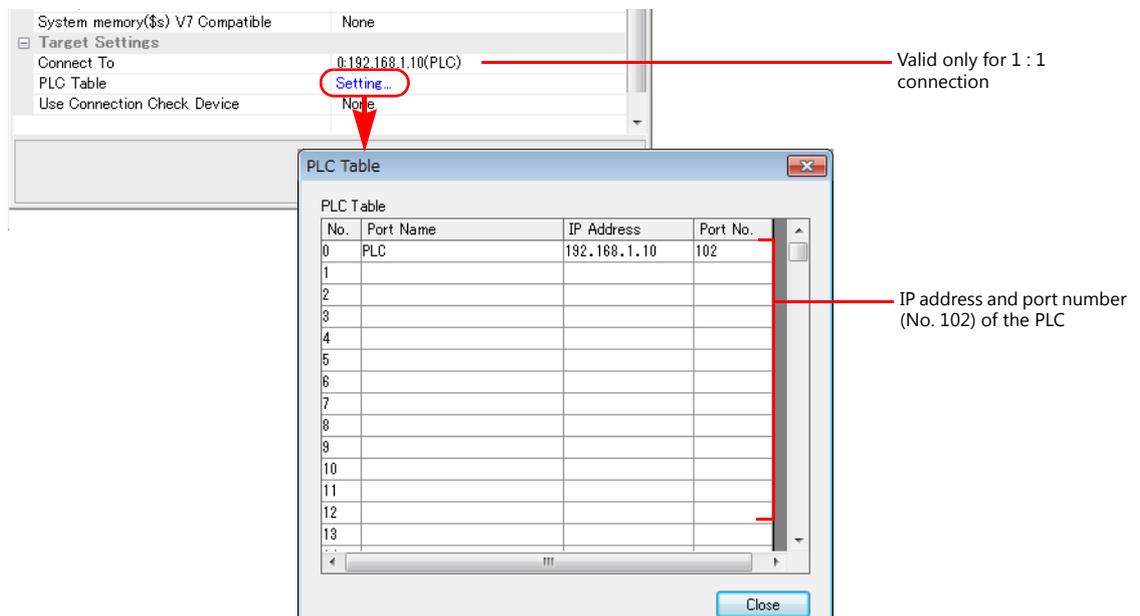

- Others  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting] → [Use Module Position/Connection No.]
  - [Yes] (default)  
Specify the module position and connection number at the [PLC Table] under [Target Settings] on the [PLC Properties] window ([System Setting] → [Hardware Setting]).  
Setting range: [Module Position] 0 to 6, [Connection No.] 0 to 7
  - [None]  
The module position and connection number will automatically be retrieved.

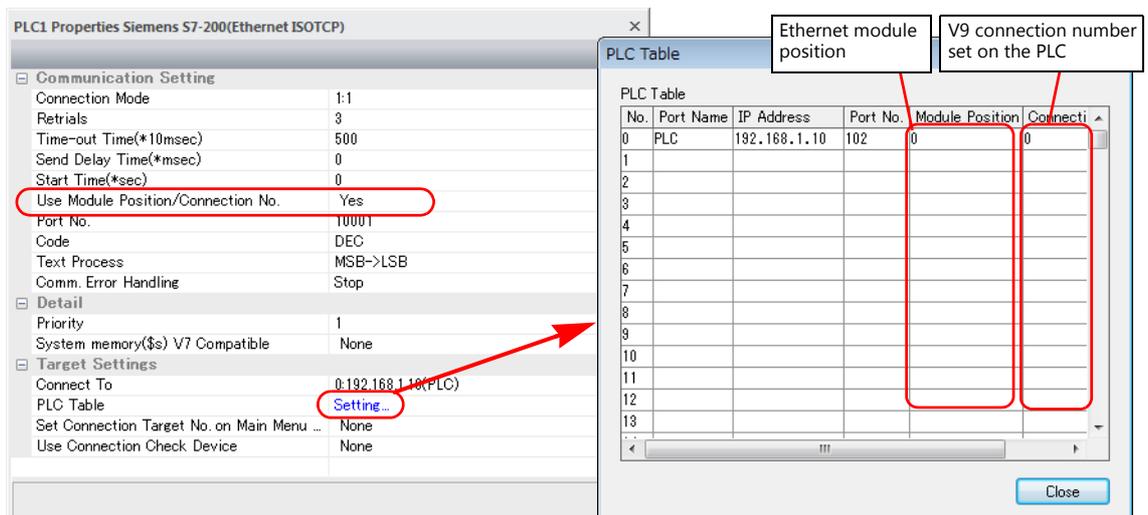


S7-200

Make the following settings in the ladder tool "STEP 7-Micro/WIN".

"ETH0\_CTRL" must be executed in the ladder program at each time of scan. For more information, refer to the PLC manual issued by the manufacturer.

**Ethernet Wizard**

Set the following items including module position, V9 connection number, IP address, and subnet mask according to the instructions in Ethernet Wizard.

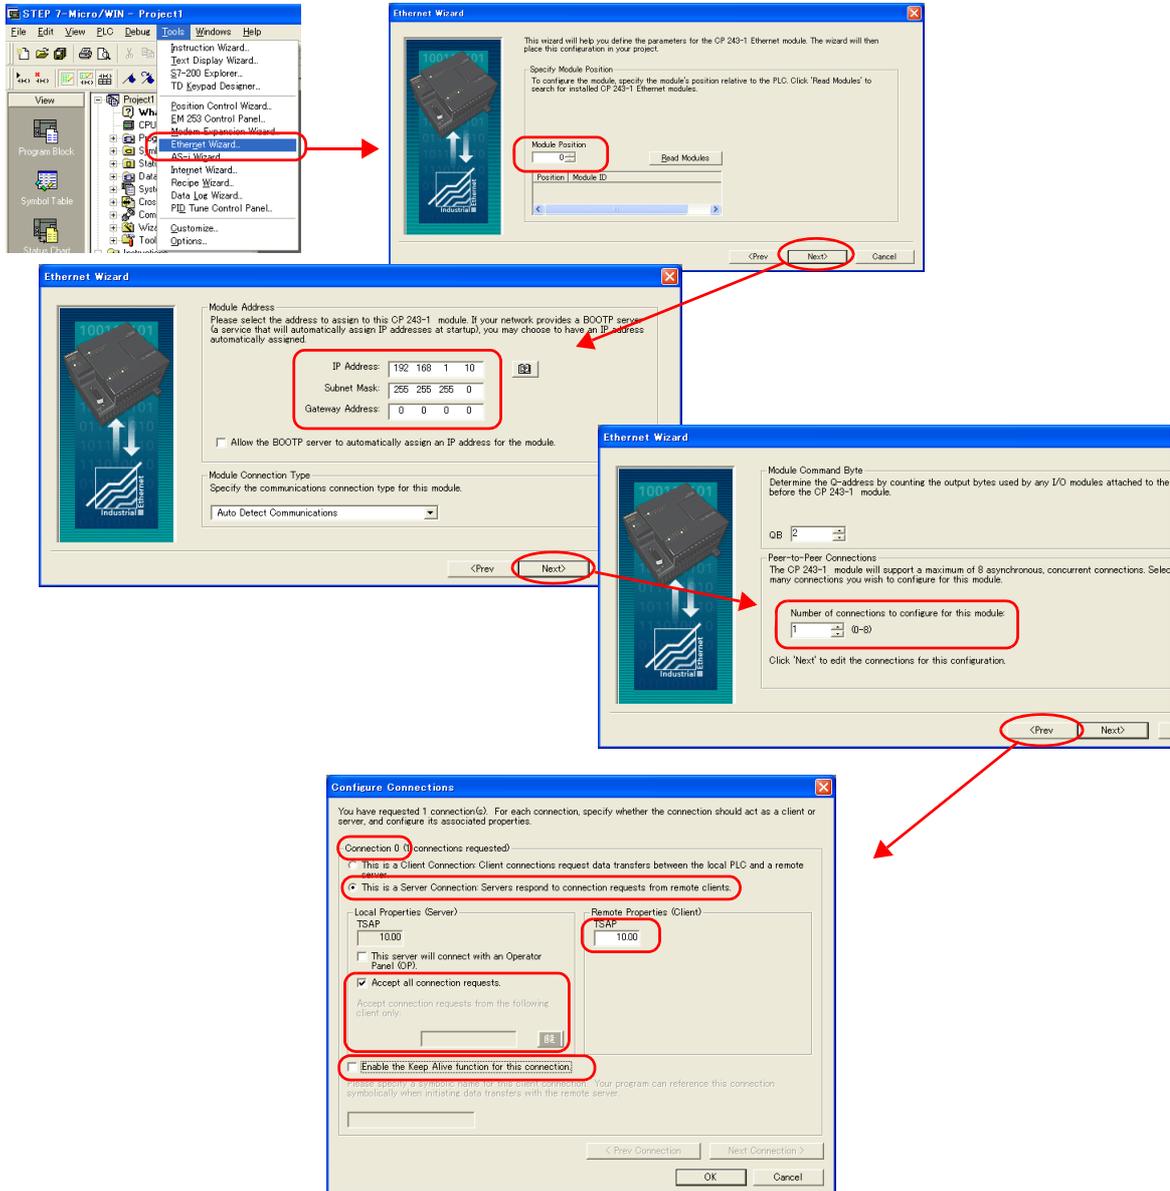

Item	Setting	Remarks	
Module Position	0 to 6	Set this value for [Module Position] in V-SFT.	
IP Address	Set the IP address of the PLC.		
Subnet Mask	Specify according to the environment.		
Gateway Address			
Number of connections to configure for this module	0 to 8	Number of connecting units	
Configure Connections	Connection No.	0 to 7	Automatically displayed according to [Number of connections to configure for this module]. Set this value for [Connection No.] in V-SFT.
	This is a Server Connection	<b>Checked</b>	
	Accept all connection requests	Checked	Unchecked: Specify the IP address of V9 for [Accept connection requests from the following client only].
	Enable the Keep Alive function for this connection.	<b>Unchecked</b>	
Remote Properties (Client) TSAP	<b>10.00</b>		

## Calendar

The V series cannot read the calendar data from this PLC. Use the built-in clock of the V series.

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
V (data memory)	00H	VW as word device
I (input)	01H	IW as word device
Q (output)	02H	QW as word device
M (bit memory/internal relay)	03H	MW as word device
T (timer/current value)	04H	
C (counter/current value)	05H	

### 9.1.5 S7-300/400MPI



- Only logical port PLC1 can be selected for S7-300/400MPI.
- The physical port for each model is fixed as follows:  
 V910W / V915 / V912 / V910 / V908: CN1 port  
 V907W / V906: MJ2 port (The "DUR-00" unit cannot be connected to CN1.)

## Communication Setting

### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1</u> : 1 / 1 : n	A maximum of four MPI-capable units can be connected.
Signal Level	<b>RS-422/485</b>	
Baud Rate	<u>19200</u> / 187.5k bps	
Data Length	<b>8 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>Even</b>	
Target Port No.	0 to 31 (2)	Specify the MPI station number of S7-300/400.

#### MPI setting

(Underlined setting: default)

Item	Setting	Remarks
Highest MPI Address	<u>15</u> / 31 / 63 / 126	Specify the highest address in the MPI network.
Local Port No.	0 to 126 (3)	Specify the port number of V9. It must be a unique number.

### S7-300/400MPI

Specify the MPI address and the baud rate using "SIMATIC Manager". For more information, refer to the PLC manual issued by the manufacturer.


## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
DB (data block)	00H *1	
I (input)	01H	IW as word device
Q (output)	02H	QW as word device
M (memory word)	03H	MW as word device
T (timer/current value)	04H	
C (counter/current value)	05H	

\*1 When this device memory is used, a registration is required for the PLC. For more information, refer to the PLC manual issued by the manufacturer. The assigned device memory is expressed as shown on the right when editing the screen. The address range available on MONITOUCH is DB0001:0000 to DB4095:8190.

Example: DB0001 : 0000



### Indirect Device Memory Designation

- DB device memory

	15	8 7	0
n + 0	9x (x = 1 to 8)		00
n + 1	Block number	Address number (word designation)	
n + 2	00	Block number	
n + 3	Expansion code		Bit designation
n + 4	00		Station number


## 9.1.6 S7-300/400 (Ethernet ISOTCP)

### Communication Setting


#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- Others  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting] → [Use CPU Slot No. Setting]
  - [Yes]  
Set the slot number. Setting range: 2 to 18
  - [None]  
The slot number is automatically retrieved.

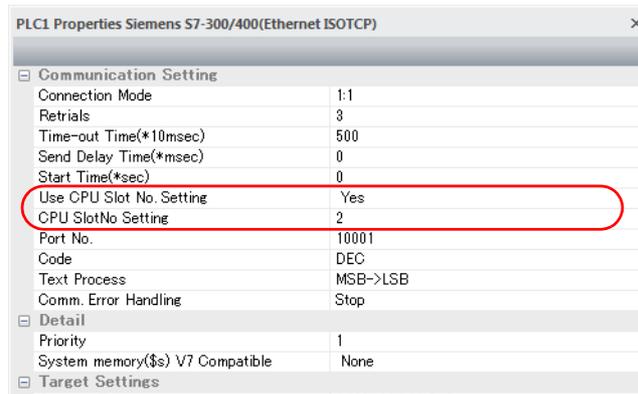

- IP address and port number (No. 102) of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

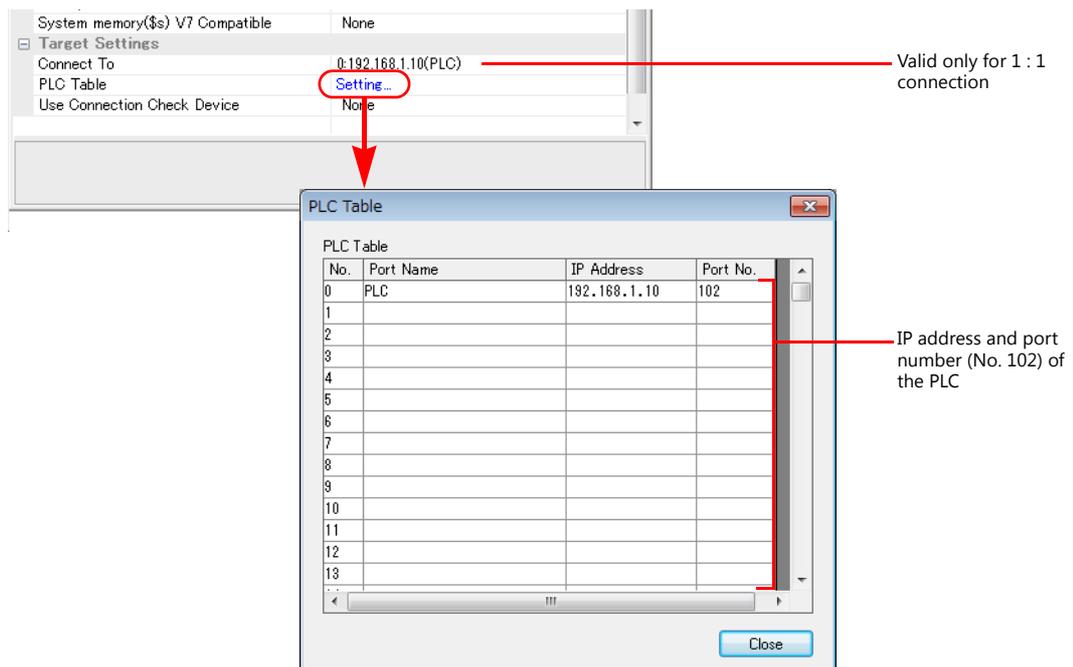

## S7-300/400

Make the communication settings using "SIMATIC Manager". For more information, refer to the PLC manual issued by the manufacturer.

### Hardware configuration

Specify the IP address on the Ethernet interface PN-IO screen.


## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
DB (data block)	00H	*1
I (input)	01H	IW as word device
Q (output)	02H	QW as word device
M (memory word)	03H	MW as word device
T (timer/current value)	04H	
C (counter/current value)	05H	

\*1 When this device memory is used, a registration is required for the PLC. For more information, refer to the PLC manual issued by the manufacturer. The assigned device memory is expressed as shown on the right when editing the screen. The address range available on MONITOUCH is DB0001:0000 to DB4095:8190.

Example: DB0001 : 0000



## Indirect Device Memory Designation

- DB device memory

	15	8 7	0
n + 0	9x (x = 1 to 8)		00
n + 1	Block number (Lower 4 bits)	Address number (word designation)	
n + 2	00	Block number (higher 8 bits)	
n + 3	Expansion code		Bit designation
n + 4	00		Station number


## 9.1.7 S7-300/400 (Ethernet TCP/IP PG Protocol)

### Communication Setting


#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".


- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]

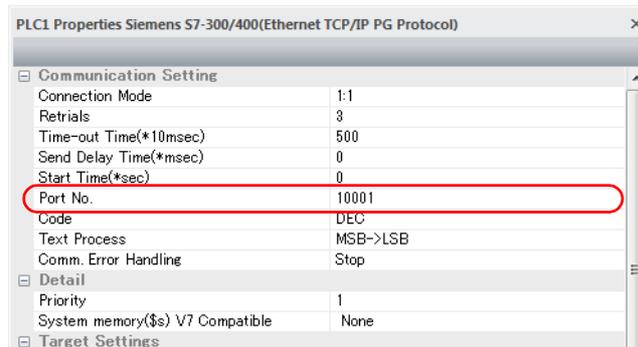

- IP address and port number (No. 102) of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

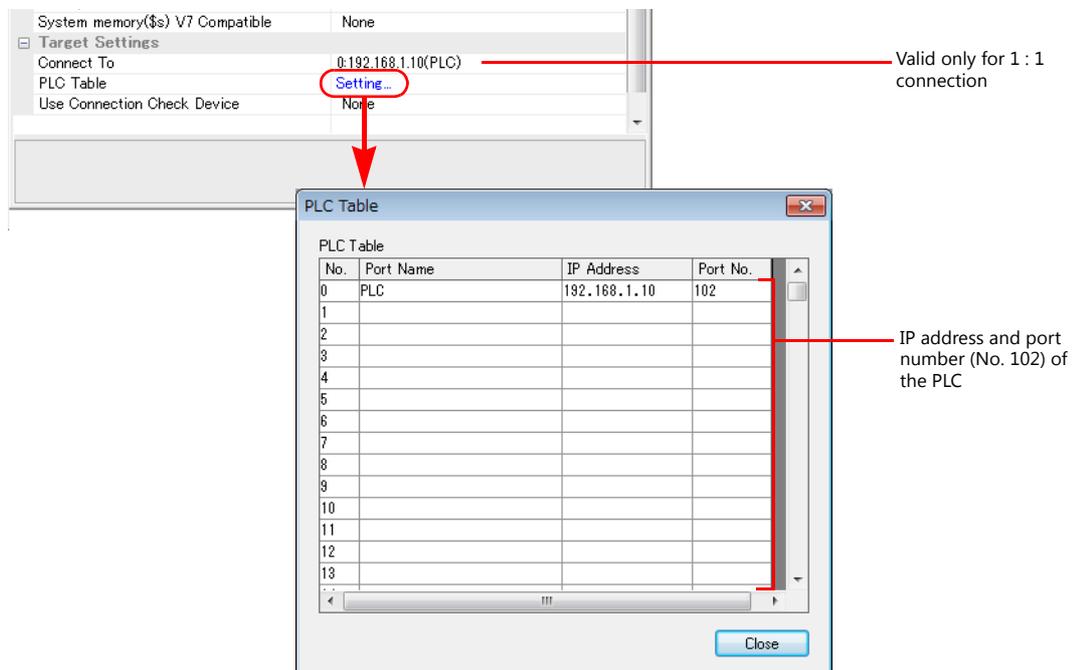

- Others  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting] → [Protection]  
If the protection function is used on STEP7, set a password. Otherwise, a communication error will occur.

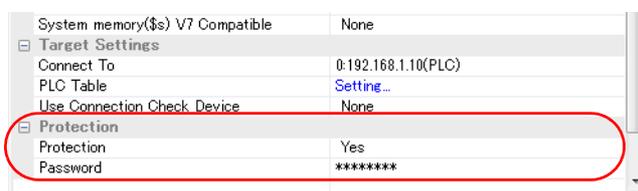

## S7-300/400

Make the communication settings using "SIMATIC Manager". For more information, refer to the PLC manual issued by the manufacturer.

### Hardware configuration

Specify the IP address on the Ethernet interface PN-IO screen.


## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
DB (data block)	00H	*1
I (input)	01H	IW as word device
Q (output)	02H	QW as word device
M (memory word)	03H	MW as word device
T (timer/current value)	04H	
C (counter/current value)	05H	

- \*1 When this device memory is used, a registration is required for the PLC. For more information, refer to the PLC manual issued by the manufacturer. The assigned device memory is expressed as shown on the right when editing the screen.  
The address range available on MONITOUCH is DB0001:0000 to DB4095:8190.

Example: DB0001 : 0000



## Indirect Device Memory Designation

- DB device memory

	15	8 7	0
n + 0	9x (x = 1 to 8)		00
n + 1	Block number (Lower 4 bits)	Address number (word designation)	
n + 2	00		Block number (higher 8 bits)
n + 3	Expansion code		Bit designation
n + 4	00		Station number


## 9.1.8 S7-1200/1500 (Ethernet ISOTCP)

### Communication Setting


#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- Others  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting] → [Use CPU Slot No. Setting]
  - [Yes]  
Set the slot number. Setting range: 2 to 18
  - [None]  
The slot number is automatically retrieved.

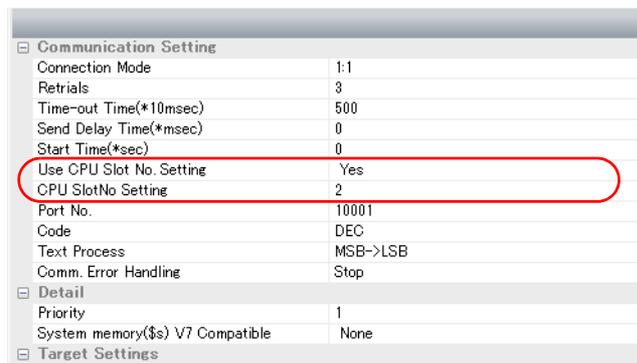

- IP address and port number (No. 102) of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

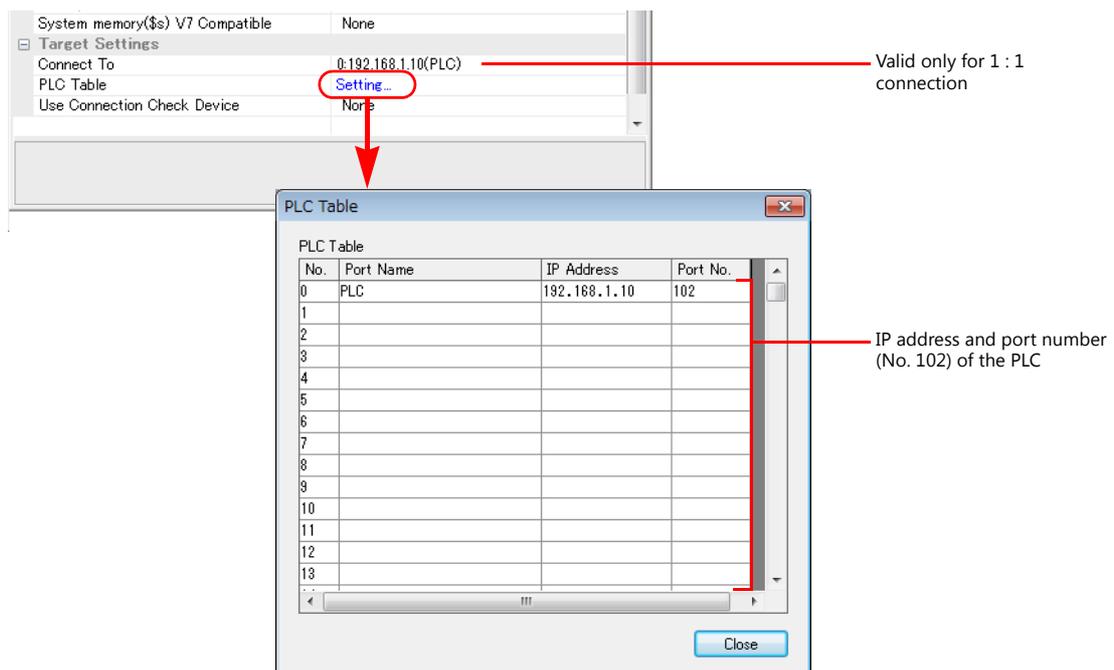

## S7-1200

Make the settings using "Totally Integrated Automation Portal" V10 or later. For more information, refer to the PLC manual issued by the manufacturer.

## IP address setting

1. Select "PLC\_1" in [Network view] or [Device view] in the project.
2. Set the IP address in [Ethernet addresses] ([Properties] → [PROFINET interface]).

The screenshot shows the Siemens TIA Portal interface for configuring a PLC. The 'Project tree' on the left shows the project structure, with 'PLC\_1' selected. The main window displays the 'Device overview' table and the 'Properties' dialog for 'PLC\_1'. The 'PROFINET interface' is expanded, and the 'Ethernet addresses' tab is active. The 'IP protocol' section shows the IP address set to 10.91.131.222 and the subnet mask set to 255.255.255.0. The 'Interface connected with' section shows 'Subnet: Not connected'.


Module	Slot	I address	Q address	Type	Order no.	Firmware	Comment
PLC_1	1			CPU 1214C AC/DC	6ES7 214-1BE30-0XB0	V1.0	
D14/DO10	1.1	0...1	0...1	D14/DO10			
AI2	1.2	64...67		AI2			
	1.3						
HSC_1	1.16			High speed counts			
HSC_2	1.17			High speed counts			

3. From the [Project tree] pane, click [Online & diagnostics] → [Protection]. Check [Permit access with PUT/GET communication from remote partner (PLC, HMI, OPC, ...)] under [Connection mechanisms].


The screenshot shows the Siemens TIA Portal interface for configuring the Protection settings for PLC\_1. The 'Online & diagnostics' pane is active, and the 'Protection' tab is selected. The 'Access level' table shows the 'Full access (no protection)' option selected. The 'Connection mechanisms' section shows the checkbox 'Permit access with PUT/GET communication from remote partner (PLC, HMI, OPC, ...)' checked.

Access level	Access			Access permission
	HMI	Read	Write	
<input checked="" type="radio"/> Full access (no protection)	✓	✓	✓	
<input type="radio"/> Read access		✓		
<input type="radio"/> HMI access	✓			
<input type="radio"/> No access (complete protection)				

- Click [Online] → [Download to device] or [Extended Download to device] to display the [Extended download to device] dialog.

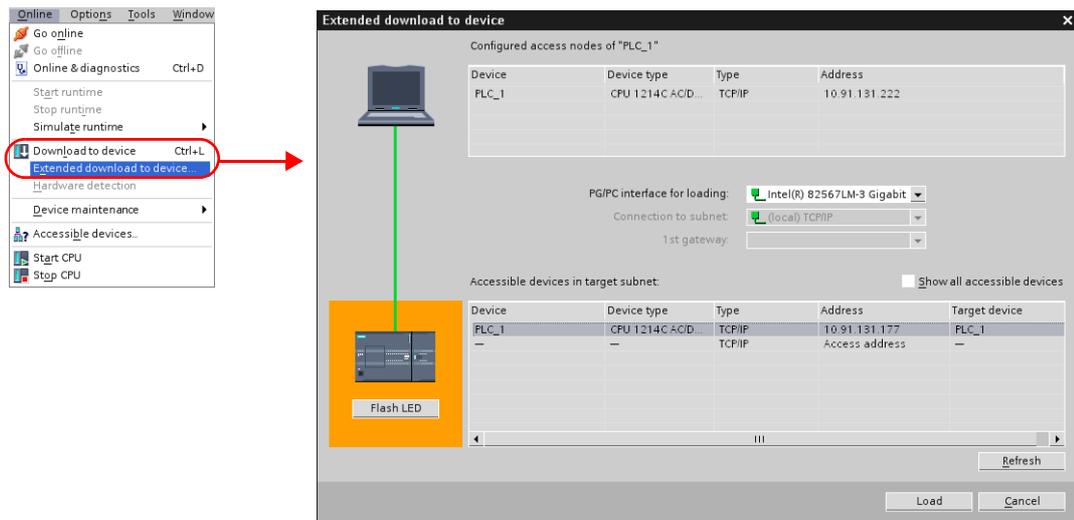

- Select [Access Address] and click [Load].
- The [Load preview] screen is displayed. Click [Load].

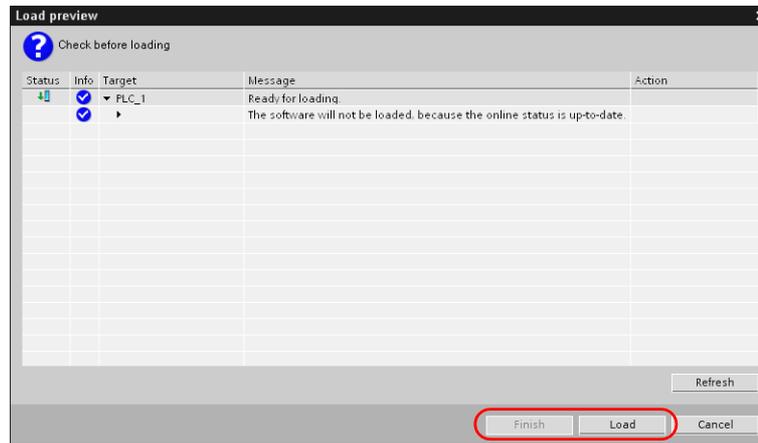


- Click [Finish]. The IP address setting has been completed.

### DB area setting


The following settings are required to use the DB device memory.

1. Select [Program blocks] → [Add new block] in the project, and make the following settings.

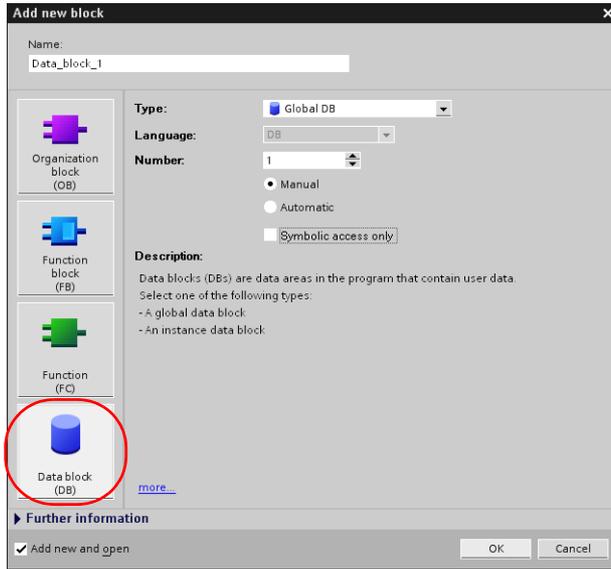


Item		Setting	Remarks
Data block	Number	Set the block number in the range from 1 to 4095.	Block numbers from 4096 cannot be used with the V9.
	Manual / Automatic	Manual	
	Symbolic access only	Unchecked	This setting is not available on "Totally Integrated Automation Portal" V12 and later.

2. The newly created data block is added under [Program blocks] in the project.

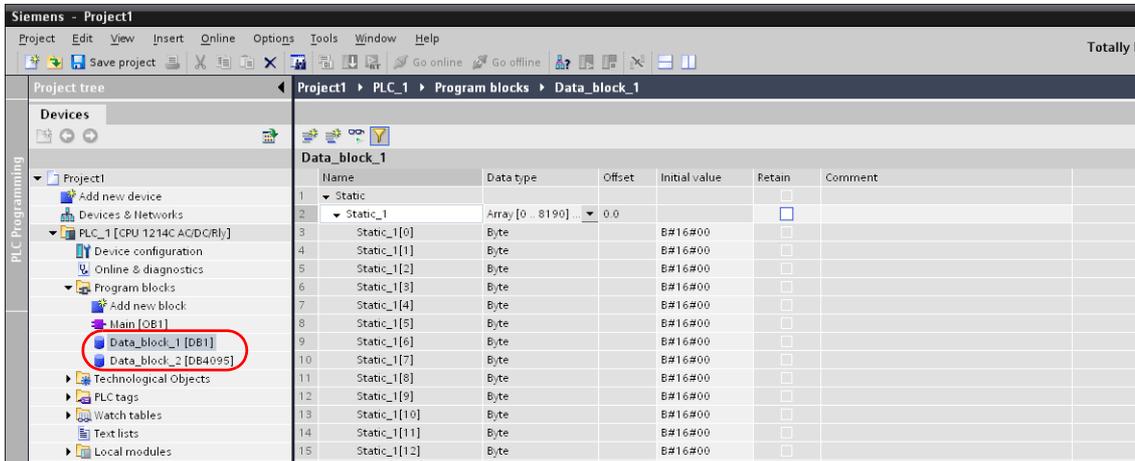

- When specifying the byte address in the array format: Select "Array [lo..hi] of type" for "Data type" and enter "lo", "hi" and "type" (byte).  
Range of "lo" and "hi": 0 to 8190  
  
Example: Array [0..1024] of type

- When using "Totally Integrated Automation Portal" V12 or later, select [Properties] on the right-click menu of the created data block, and deselect [Optimized block access] under [Attributes].

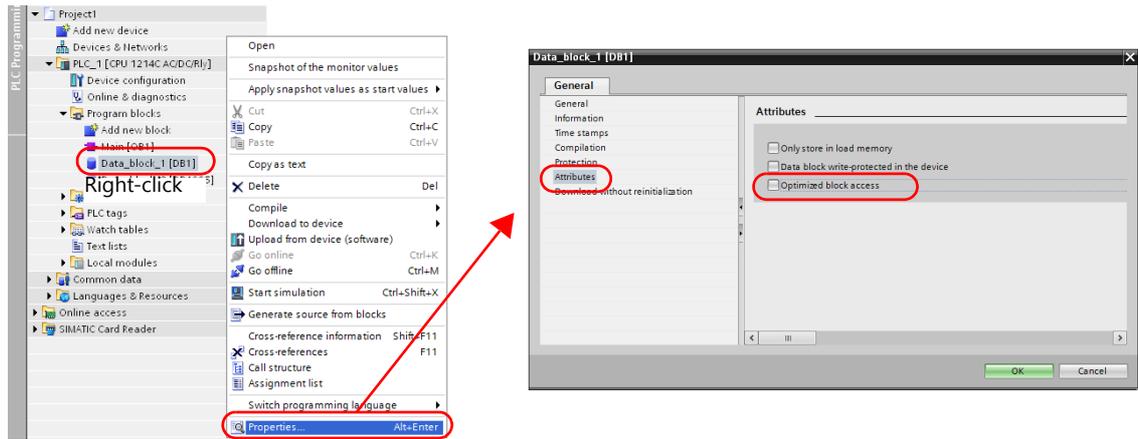


- From the right-click menu of [Project tree], select [Download to device] → [software] to write the settings into the PLC.

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
DB (data block)	00H	*1
I (input)	01H	IW as word device
Q (output)	02H	QW as word device
M (memory word)	03H	MW as word device

\*1 When this device memory is used, a registration is required for the PLC. For more information, refer to the PLC manual issued by the manufacturer. The assigned device memory is expressed as shown on the right when editing the screen. The address range available on MONITOUCH is DB0001:0000 to DB4095:8190.



### Indirect Device Memory Designation

- DB device memory

	15	8	7	0
n + 0	9x (x = 1 to 8)			00
n + 1	Block No. (lower 4 bits)		Address No. (word designation)	
n + 2	00		Block No. (higher 8 bits)	
n + 3	Expansion code		Bit designation	
n + 4	00		Station number	

## 9.1.9 TI500 / 505 Series

### Communication Setting

#### Editor


#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1 : 1</u> / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	9600 / <u>19200</u> / 38400 / 57600 / 115200 bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	0 to 31	

#### PLC

#### TI545/TI555

Item	No.			Remarks																								
	1	Port 2 signal level	ON: RS-232C / RS-422 OFF: RS-485	Only RS-232C supported by 555-1103CPU																								
	6	Port 2 Baud rate	<table border="1"> <thead> <tr> <th>Baud Rate</th> <th>6</th> <th>7</th> <th>8</th> </tr> </thead> <tbody> <tr> <td>115200 *</td> <td>ON</td> <td>ON</td> <td>OFF</td> </tr> <tr> <td>57600 *</td> <td>ON</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>38400</td> <td>ON</td> <td>OFF</td> <td>OFF</td> </tr> <tr> <td>19200</td> <td>ON</td> <td>ON</td> <td>ON</td> </tr> <tr> <td>9600</td> <td>OFF</td> <td>ON</td> <td>ON</td> </tr> </tbody> </table>	Baud Rate	6	7	8	115200 *	ON	ON	OFF	57600 *	ON	OFF	ON	38400	ON	OFF	OFF	19200	ON	ON	ON	9600	OFF	ON	ON	*Supported by 555-1105CPU and 555-1106CPU only
	Baud Rate			6	7	8																						
	115200 *			ON	ON	OFF																						
57600 *	ON	OFF	ON																									
38400	ON	OFF	OFF																									
19200	ON	ON	ON																									
9600	OFF	ON	ON																									
7																												
8																												

#### TI575

Item	Setting	Remarks
Baud rate	9600	
Data length	7 bits	
Parity	Odd	
Stop bit	1 bit	

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
V (variable memory)	00H	
WX (word input)	01H	
WY (word output)	02H	
X (discrete input)	03H	
Y (discrete output)	04H	
CR (control relay)	05H	
TCP (timer, counter/set value)	06H	
TCC (timer, counter/current value)	07H	
DCP (drum count/set value)	08H	
DCC (drum count/current value)	09H	Read only
DSP (drum step/set value)	0AH	
DSC (drum step/current value)	0BH	
K (constant memory)	0CH	
STW (system status)	0DH	

## Indirect Device Memory Designation

	15	8 7	0
n + 0	Model		Device type
n + 1	Address No. (word designation)		
n + 2	Expansion code		Bit designation
n + 3	00		Station number


- For the device memory address number, specify the value obtained by subtracting "1" from the actual address.
- For the designation of a DCC device memory, specify a drum step number minus "1" for the expansion code.

### 9.1.10 Wiring Diagrams


#### When Connected at CN1:

#### RS-232C


**Wiring diagram 1 - C2**

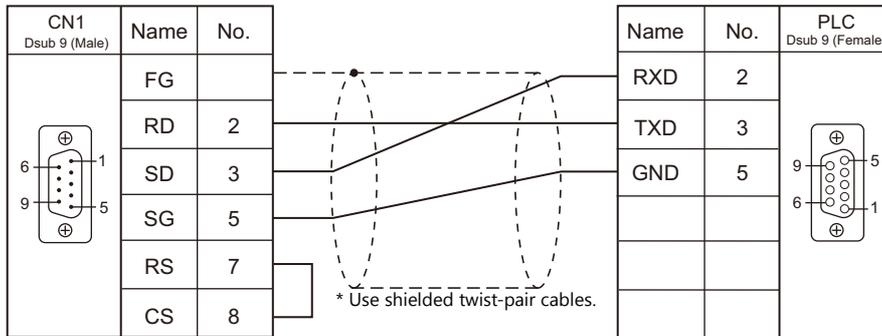


**Wiring diagram 2 - C2**

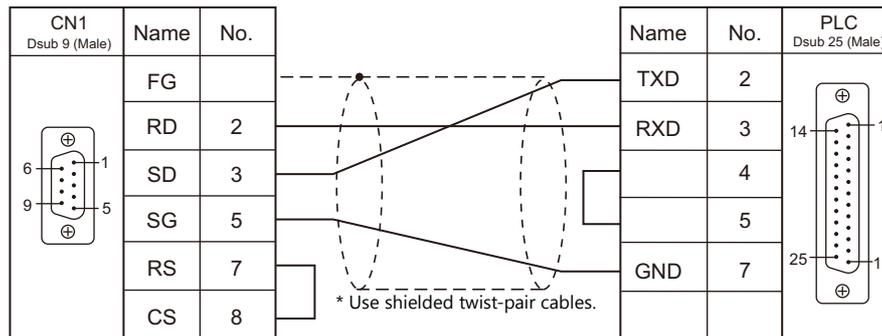


**Wiring diagram 3 - C2**

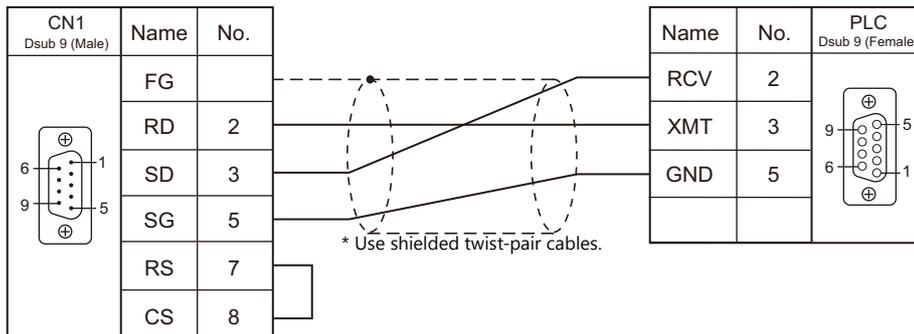

**Wiring diagram 4 - C2**

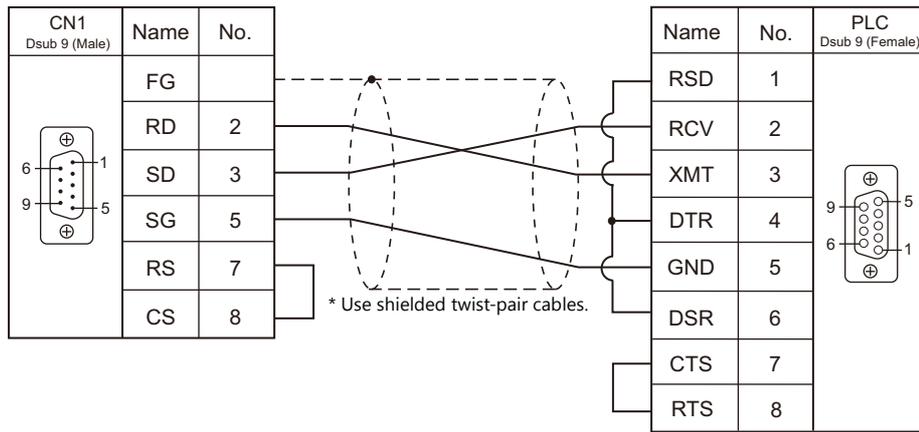


**Wiring diagram 5 - C2**

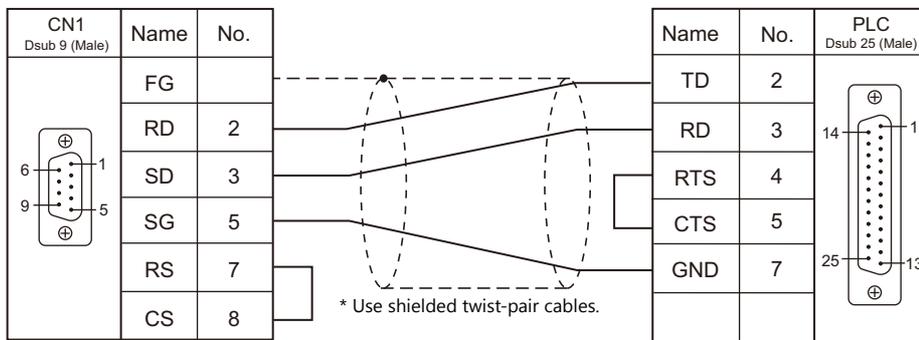

RS-422/RS-485


Wiring diagram 1 - C4

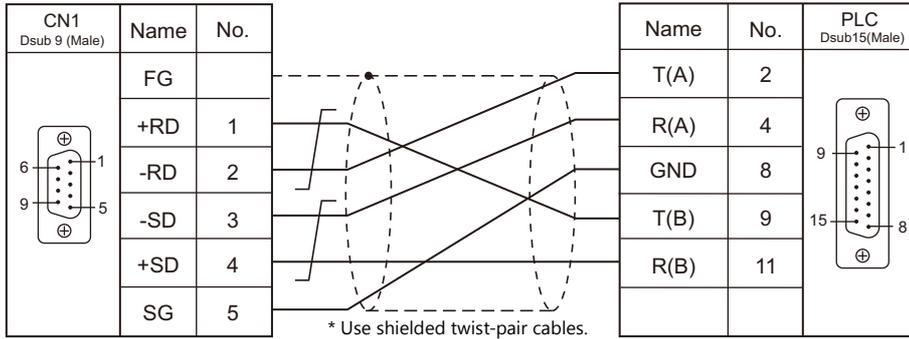

Wiring diagram 2 - C4


**CAUTION**

- When using V907W or V906, the CN1 port of the optional unit "DUR-00" is not usable for the connection. Use the MJ2 port. (Refer to Wiring diagram 1 - M4)
- Terminating resistance  
Set DIP switches 5 and 7 of the V9 unit to the OFF position, and set the terminating resistance by referring to "Terminating resistance setting" described below.

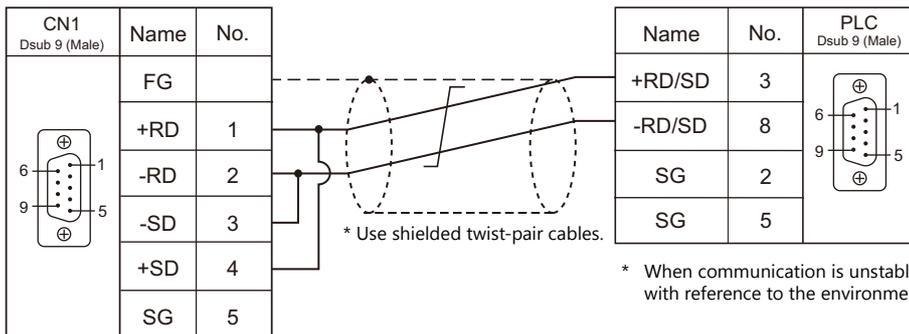


Terminating resistance setting


Set the DIP switch of the V9 unit to the OFF position and connect the terminating resistance to CN1 as shown below. The absence of terminating resistance may result in communication failure.

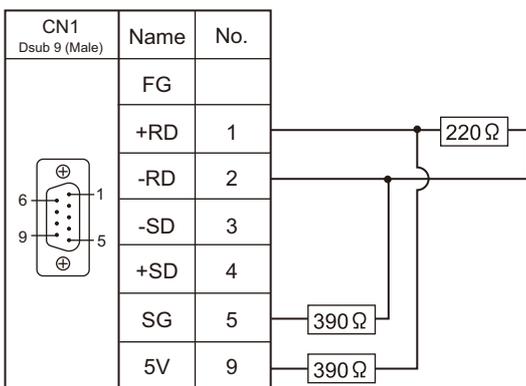

**Wiring diagram 3 - C4**

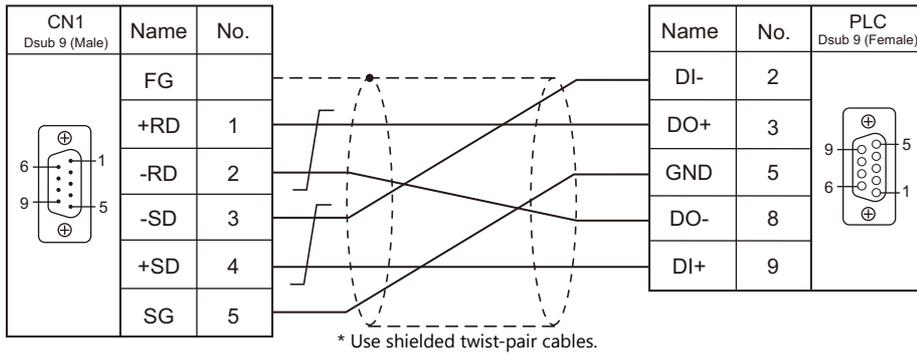


**Wiring diagram 4 - C4**

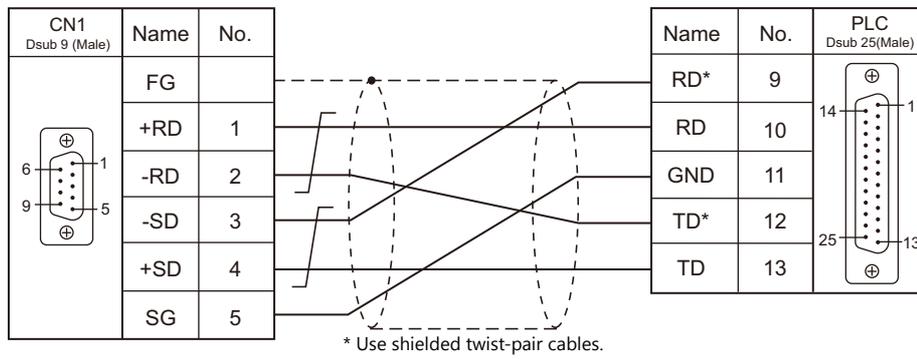


**When Connected at MJ1/MJ2:**

**RS-232C**


**Wiring diagram 1 - M2**

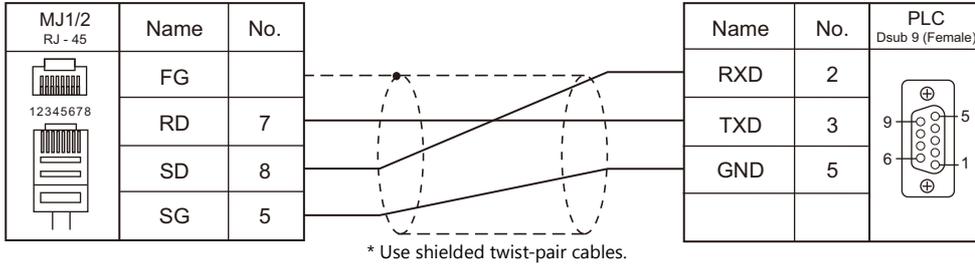


**Wiring diagram 2 - M2**

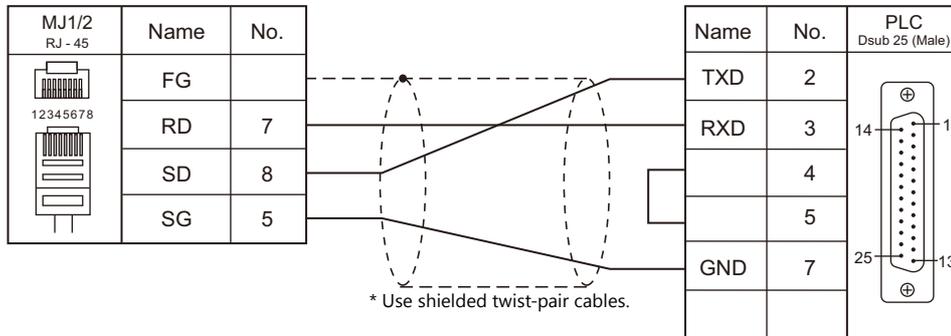


**Wiring diagram 3 - M2**

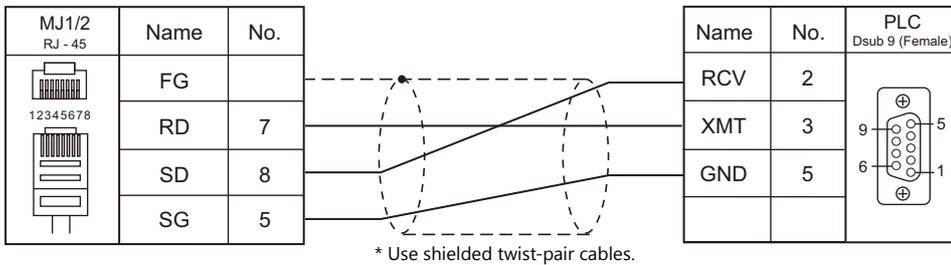

**Wiring diagram 4 - M2**

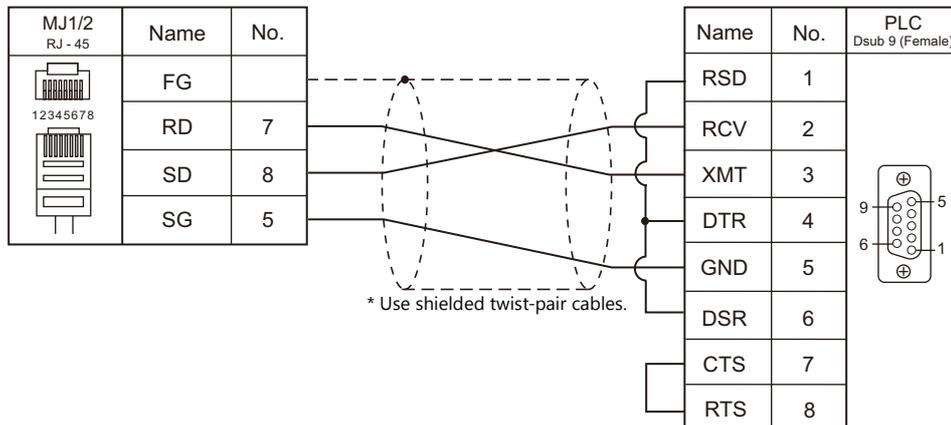

**Wiring diagram 5 - M2**

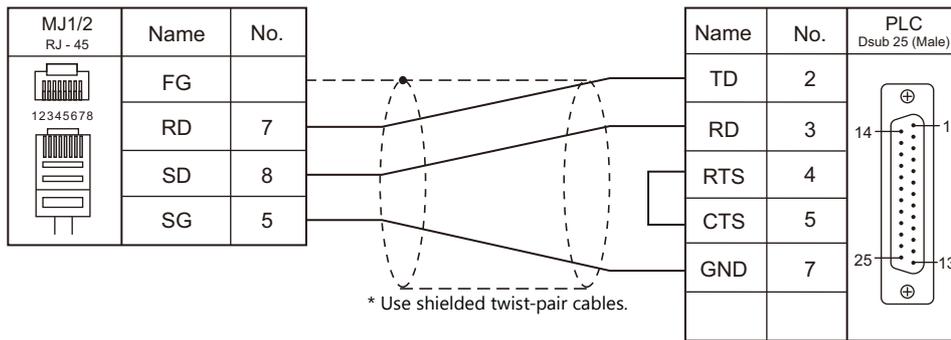


**RS-422/RS-485**

**Wiring diagram 1 - M4**

**CAUTION**

- Only the MJ2 port of V907W and V906 is supported communication. The MJ1/MJ2 ports except these units are not usable for the connection. When using except V907W or V906, use the CN1 port. (Refer to Wiring diagram 2 - C4)
- Terminating resistance  
Set DIP switch 8 of the V9 unit to the OFF position, and set the terminating resistance by referring to "Terminating resistance setting" described below.

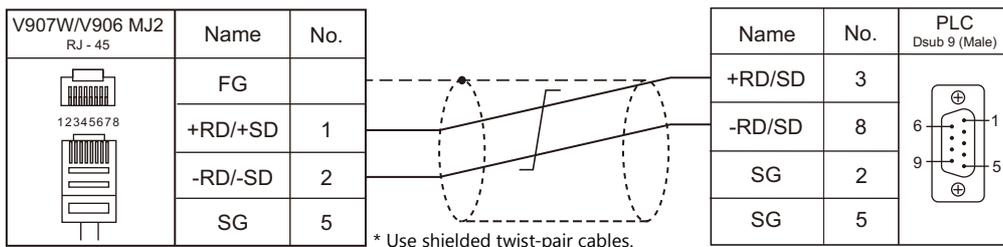


\* Slide switch on V907W/V906: RS-485 (upper)


\* When communication is unstable, connect the SG cable with reference to the environment.

**Terminating resistance setting**


Set the DIP switch of the V-series unit to the OFF position and connect the terminating resistance to MJ as shown below. The absence of terminating resistance may result in communication failure.

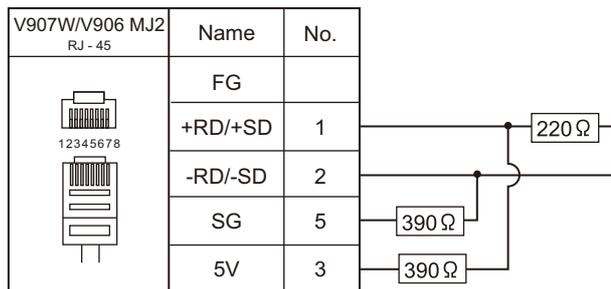


**Wiring diagram 2 - M4**

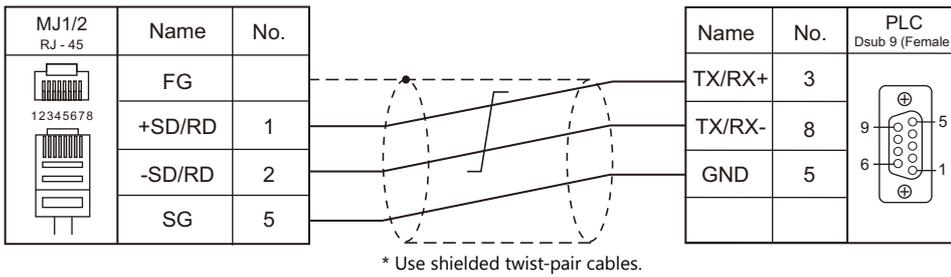


**Wiring diagram 3 - M4**

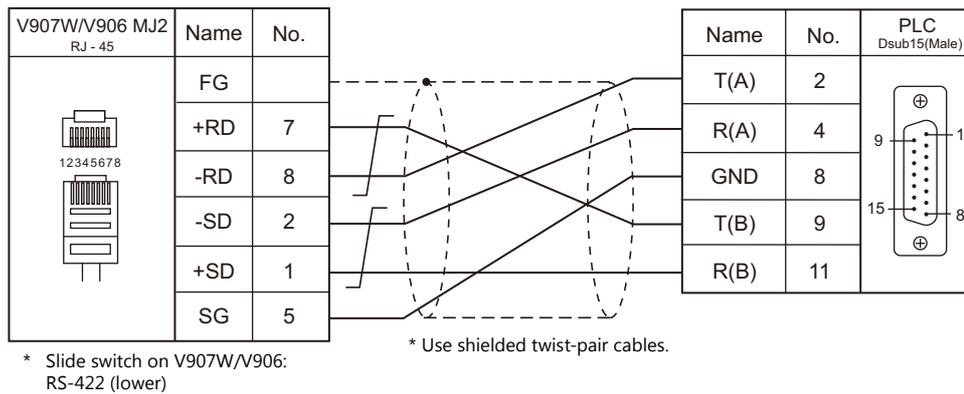

**Wiring diagram 4 - M4**

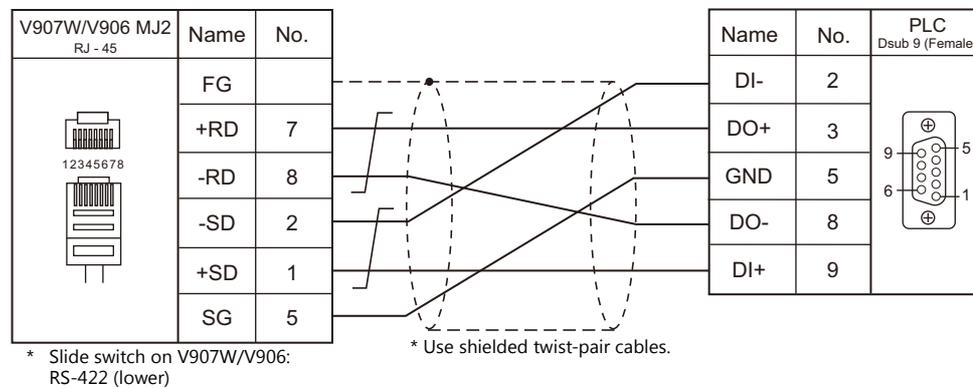

**Wiring diagram 5 - M4**

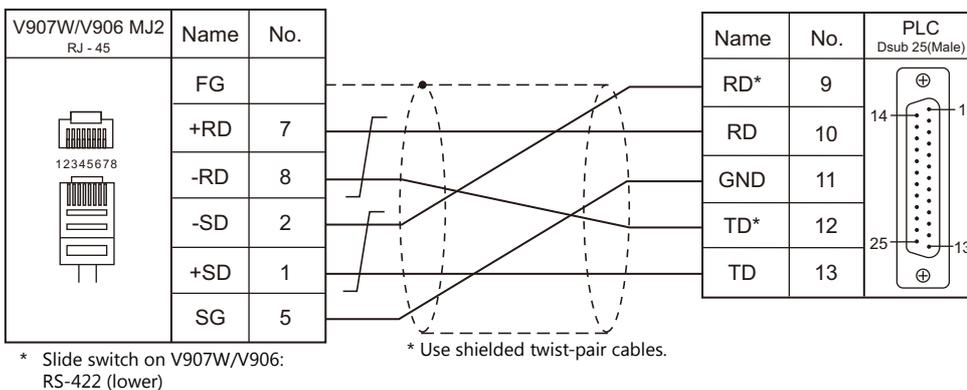

# **10. SINFONIA TECHNOLOGY**

---

## 10.1 PLC Connection

# 10.1 PLC Connection

## Serial Connection

PLC Selection on the Editor	CPU	Unit/Port	Signal Level	Connection			Ladder Transfer <sup>*2</sup>
				CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906	
SELMART	SELMART-100 and later	01M2-UCI-6x 01M2-UCI-Ax	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

## 10.1.1 SELMART

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / <u>19200</u> bps	
Data Length	<u>7</u> bits	
Stop Bit	<u>1</u> bit	
Parity	<u>Even</u>	
Target Port No.	1 to 8	Set the same number as the one set by the DEV. NO. switch on the PLC.

#### PLC

An application program is necessary on the PLC to communicate with the V series. For more information, refer to the specifications sheet of the PLC.


#### 01M2-UCI-6x

#### DEV. NO. switch

SW	Setting	Remarks
DEV. NO.	1 to 8	

#### SELMART SUPPORT SYSTEM

Set desired values for internal addresses in the PLC. For more information, refer to the specifications sheet of the PLC.

Address	Item	Setting	Remarks
C4096 to C4111	Card usage status	X22X (HEX) 	The standard entry table is used. When using an expanded entry table, refer to the specifications sheet of the PLC.
DEV. NO. 1	C4333	Baud rate	4800 / 9600 / 19200
	C4334	Communication mode	<b>0: GD-80</b>
DEV. NO. 2	C4341	Baud rate	4800 / 9600 / 19200
	C4342	Communication mode	<b>0: GD-80</b>
DEV. NO. 3	C4349	Baud rate	4800 / 9600 / 19200
	C4350	Communication mode	<b>0: GD-80</b>
DEV. NO. 4	C4357	Baud rate	4800 / 9600 / 19200
	C4358	Communication mode	<b>0: GD-80</b>
DEV. NO. 5	C4365	Baud rate	4800 / 9600 / 19200
	C4366	Communication mode	<b>0: GD-80</b>
DEV. NO. 6	C4373	Baud rate	4800 / 9600 / 19200
	C4374	Communication mode	<b>0: GD-80</b>
DEV. NO. 7	C4381	Baud rate	4800 / 9600 / 19200
	C4382	Communication mode	<b>0: GD-80</b>
DEV. NO. 8	C4389	Baud rate	4800 / 9600 / 19200
	C4390	Communication mode	<b>0: GD-80</b>

The following settings are fixed; data length: 7 bits, stop bit: 1 bit and parity: even. Changes take effect when the power is turned off and on again.

\* **Be sure to set "mode 0" for the CPU card operation mode.**

#### Calendar

This model is equipped with the calendar function; however, the calendar data cannot be written from the V series. Thus, time correction must be performed on the PLC side.

**01M2-UCI-Ax****DEV. NO. switch (station number)**


SW	Setting	Remarks
DEV. NO.	1 to 8	

**UC1-HL switch (unit communication function setting)**

SW	Setting	Remarks
H	6	UC1-6X (communication for touch panel)
L	0, 1 / 2 / F	

**SELMART SUPPORT SYSTEM**

Set desired values for internal addresses in the PLC. For more information, refer to the specifications sheet of the PLC.

Address		Item	Setting	Remarks
C4096 to C4111		Card usage status	X22X (HEX) 	The standard entry table is used. When using an expanded entry table, refer to the specifications sheet of the PLC.
DEV. NO. 1	C4333	Baud rate	4800 / 9600 / 19200	The standard entry table is used. When using an expanded entry table, refer to the specifications sheet of the PLC. Set the address set by the DEV. NO. switch.
	C4334	Communication mode	<b>0: GD-80</b>	
DEV. NO. 2	C4341	Baud rate	4800 / 9600 / 19200	
	C4342	Communication mode	<b>0: GD-80</b>	
DEV. NO. 3	C4349	Baud rate	4800 / 9600 / 19200	
	C4350	Communication mode	<b>0: GD-80</b>	
DEV. NO. 4	C4357	Baud rate	4800 / 9600 / 19200	
	C4358	Communication mode	<b>0: GD-80</b>	
DEV. NO. 5	C4365	Baud rate	4800 / 9600 / 19200	
	C4366	Communication mode	<b>0: GD-80</b>	
DEV. NO. 6	C4373	Baud rate	4800 / 9600 / 19200	
	C4374	Communication mode	<b>0: GD-80</b>	
DEV. NO. 7	C4381	Baud rate	4800 / 9600 / 19200	
	C4382	Communication mode	<b>0: GD-80</b>	
DEV. NO. 8	C4389	Baud rate	4800 / 9600 / 19200	
	C4390	Communication mode	<b>0: GD-80</b>	

The following settings are fixed; data length: 7 bits, stop bit: 1 bit and parity: even.  
Changes take effect when the power is turned off and on again.

- \* **Be sure to set "mode 0" for the CPU card operation mode.**

**Calendar**

This model is equipped with a calendar function; however, the calendar data cannot be written from the V series. Thus, time correction must be performed on the PLC side.

**Available Device Memory**

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	D0 to D1023


- \* **Addresses other than D0 to D1023 can be set on the editor; however it cannot be used actually. If such a address is set, an error code "06" occurs. Do not specify any addresses other than D0 to D1023.**

### 10.1.2 Wiring Diagrams

#### When Connected at CN1:

**RS-232C**


**Wiring diagram 1 - C2**

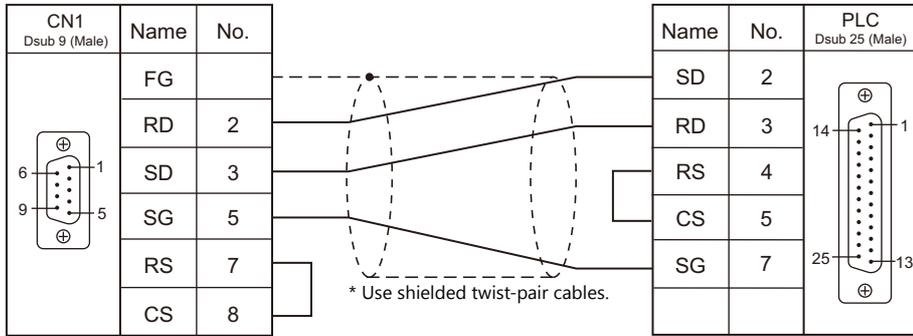

#### When Connected at MJ1/MJ2:

**RS-232C**

**Wiring diagram 1 - M2**

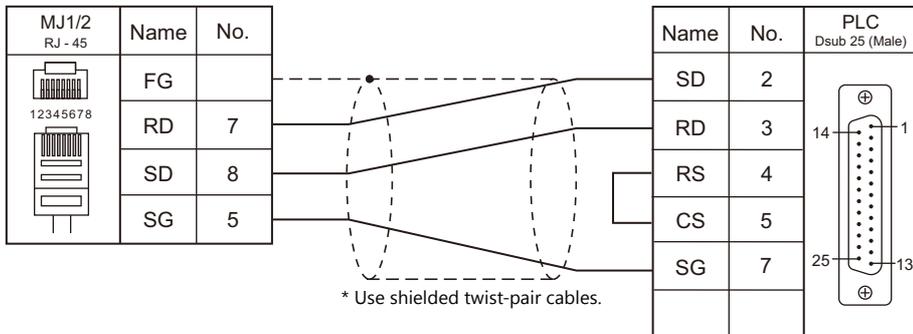

# 11. SUS

---

11.1 Thermo Controller/Servo/Inverter

# 11.1 Thermo Controller/Servo/Inverter

## Electric Actuator

PLC Selection on the Editor	Model		Port	Signal Level	Connection			Lst File
					CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906	
XA-A*	XA-A1 XA-A2 XA-A3 XA-A4	XA-20L XA-28L / XA-28H XA-35L / XA-35H XA-42L / XA-42H XA-42D XA-50L / XA-50H XA-E35L	Jog box connector	RS-232C	Wiring diagram 1 - C2 <sup>*2</sup>	Wiring diagram 1 - M2 <sup>*2</sup>		SUS_XAA.Lst

\*1 Set the slide switch for signal selection to the RS-232C/485 position (upper) when using the V907W or V906.  
For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 When using a self-made cable, use the cable in a noise-free environment and do not make the cable longer than 10 meters.

## 11.1.1 XA-A\*

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / Multi-link2 / Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u>	
Baud Rate	<u>38400 bps</u>	
Data Length	<u>8 bits</u>	
Stop Bit	<u>1 bit</u>	
Parity	<u>None</u>	

### Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available with the device to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
RA (movement completion check)	00H	Read only <sup>*1</sup>
RH (origin return completion check)	01H	Read only <sup>*1</sup>
RC (read current position)	02H	Read only, double-word
RY (input reading)	03H	Read only
RWB (output reading)	04H	

\*1 Check which axis is complete by checking the acquired value.

Axis	Value															
	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Axis 1	○	●	○	●	○	●	○	●	○	●	○	●	○	●	○	●
Axis 2	○	○	●	●	○	○	●	●	○	○	●	●	○	○	●	●
Axis 3	○	○	○	○	●	●	●	●	○	○	○	○	●	●	●	●
Axis 4	○	○	○	○	○	○	○	○	●	●	●	●	●	●	●	●

Not completed: ○ Completed: ●

#### RA (movement completion check)

Address	Name	Remarks
0	Checking movement completion of axes 1, 2, 3, and 4	0: currently moving, 1: movement complete

#### RH (origin return completion check)

Address	Name	Remarks
0	Checking origin return completion of axes 1, 2, 3, and 4	0: not completed, 1: completed

#### RC (read current position)

Address	Name	Remarks
0	Current position of axis 1	Number of pulses (negative values possible if equipped with encoder function)
1	Current position of axis 2	Number of pulses (negative values possible if equipped with encoder function)
2	Current position of axis 3	Number of pulses (negative values possible if equipped with encoder function)
3	Current position of axis 4	Number of pulses (negative values possible if equipped with encoder function)

**RY (input reading)**

Address	Bit Values			
	bit0	bit1	bit2	bit3
0	STB	RES	-	-
1	PRG1	PRG2	PRG4	PRG8
2	IN13	IN14	IN15	IN16
3	IN9	IN10	IN11	IN12
4	IN5	IN6	IN7	IN8
5	IN1	IN2	IN3	IN4
6	LS1	LS2	LS3	LS4

**RWB (output reading)**

Address	Bit Values			
	bit0	bit1	bit2	bit3
0	IN-P	RUN	RDY	ALM
1	OUT13	OUT14	OUT15	OUT16
2	OUT9	OUT10	OUT11	OUT12
3	OUT5	OUT6	OUT7	OUT8
4	OUT1	OUT2	OUT3	OUT4

**PLC\_CTL**

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
OMP: point movement	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	4
		n + 1	Command: 0	
		n + 2	PNO position number: 0 to 3000	
		n + 3	AX No. axis pattern setting: 1 to 15 *1	
OSP: deceleration stop	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	2
		n + 1	Command: 2	
ORP: movement data reading	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	3
		n + 1	Command: 3	
		n + 2	PNO position number: 1 to 3000	
		n + 3	W (axis 1) X axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement	
		n + 4 to n + 5	Pos (axis 1) X axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)	
		n + 6	W (axis 2) Y axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement	
		n + 7 to n + 8	Pos (axis 2) Y axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)	
		n + 9	W (axis 3) Z axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement	
		n + 10 to n + 11	Pos (axis 3) Z axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)	
n + 12	W (axis 4) S axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement			
n + 13 to n + 14	Pos (axis 4) S axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)			

Contents	F0	F1 (= \$u n)	F2				
OMV: Direct movement	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	23			
		n + 1	Command: 1				
		n + 2	VEL (axis 1) X axis speed: 1 to max. speed * <sup>2</sup>				
		n + 3	ACC (axis 1) X axis acceleration/deceleration time (unit: 10 ms): 1 to 200				
		n + 4	W (axis 1) X axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement				
		n + 5 to n + 6	Pos (axis 1) X axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)				
		n + 7	VEL (axis 2) Y axis speed: 1 to max. speed * <sup>2</sup>				
		n + 8	ACC (axis 2) Y axis acceleration/deceleration time (unit: 10 ms): 1 to 200				
		n + 9	W (axis 2) Y axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement				
		n + 10 to n + 11	Pos axis 2) Y axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)				
		n + 12	VEL (axis 3) Z axis speed: 1 to max. speed * <sup>2</sup>				
		n + 13	ACC (axis 3) Z axis acceleration/deceleration time (unit: 10 ms): 1 to 200				
		n + 14	W (axis 3) Z axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement				
		n + 15 to n + 16	Pos (axis 3) Z axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)				
		n + 17	VEL (axis 4) S axis speed: 1 to max. speed * <sup>2</sup>				
		n + 18	ACC (axis 4) S axis acceleration/deceleration time (unit: 10 ms): 1 to 200				
		n + 19	W (axis 4) S axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement				
		n + 20 to n + 21	Pos (axis 4) S axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)				
		n + 22	H interpolation 0: No interpolation 1: With interpolation				
		OWP: movement data writing	1 to 8 (PLC1 to 8)		n	Station number: 0 (fixed)	15
					n + 1	Command: 4	
					n + 2	PNO position number: 1 to 3000	
n + 3	W (axis 1) X axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement						
n + 4 to n + 5	Pos (axis 1) X axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)						
n + 6	W (axis 2) Y axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement						
n + 7 to n + 8	Pos (axis 2) Y axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)						
n + 9	W (axis 3) Z axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement						
n + 10 to n + 11	Pos (axis 3) Z axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)						
n + 12	W (axis 4) S axis movement method 0: No movement 1: Origin as reference 2: Current value as reference, positive movement 3: Current position as reference, negative movement						
n + 13 to n + 14	Pos (axis 4) S axis movement position (number of pulses): 0 to 262143 (3FFFF: HEX)						

Contents	F0	F1 (= \$u n)		F2
0WA: position data memory writing	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	4
		n + 1	Command: 5	
		n + 2	Write starting PNO: 1 to 3000 *3	
		n + 3	Write finishing PNO: 1 to 3000 *3	
0WC: position update	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	4
		n + 1	Command: 6	
		n + 2	PNO position number: 1 to 3000	
		n + 3	AX No. axis pattern setting: 1 to 15 *1	
0RV: version information	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	2
		n + 1	Command: 7	
		n + 2 to n + 3	Ver version (characters)	
		n + 4 to n + 5	CPU CPU model type (characters)	
0DM: program execute	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	3
		n + 1	Command: 8	
		n + 2	PRG program number: 1 to 50	
0CV: speed/acceleration time settings	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	4
		n + 1	Command: 9	
		n + 2	VEL speed: 1 to max. speed *2	
		n + 3	ACC acceleration/deceleration time (10 ms): 1 to 200	
0AR: alarm reset	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	2
		n + 1	Command: 10	

Return data: Data stored from controller to V series

\*1 Axes are validated by the Ax No. setting value according to the following table.

Axis	Value															
	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Axis 1	○	●	○	●	○	●	○	●	○	●	○	●	○	●	○	●
Axis 2	○	○	●	●	○	○	●	●	○	○	●	●	○	○	●	●
Axis 3	○	○	○	○	●	●	●	●	○	○	○	○	●	●	●	●
Axis 4	○	○	○	○	○	○	○	○	○	●	●	●	●	●	●	●

Invalid: ○      Valid: ●

\*2 The setting range varies depending on the actuator type.

Actuator Type	20L / 28L / 35L / 42L / E35L	50L	28H / 35H	42H	50H	42D
Max. speed (mm/sec)	50	100	150	200	300	400


\*3 Do not set a value larger than the write starting PNO for the write finishing PNO. The screen display is not updated during EEPROM writing since MONITOUCH needs to receive the response. It takes about 3 seconds to write position information. Do not turn off the power or pull out the plug of MONITOUCH.

## 11.1.2 Wiring Diagrams

### When Connected at CN1:

#### RS-232C


Wiring diagram 1 - C2

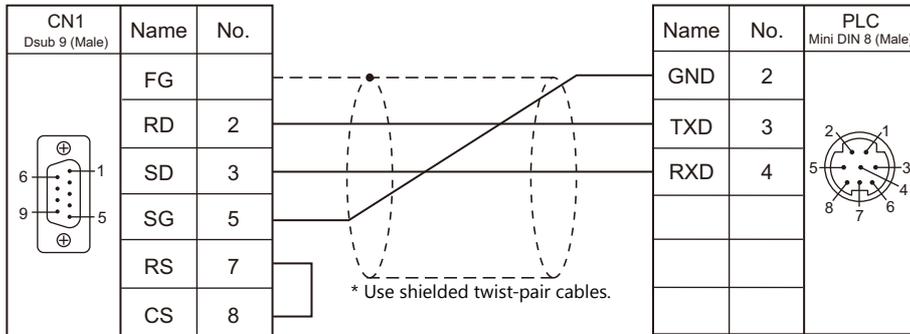

### When Connected at MJ1/MJ2:

#### RS-232C

Wiring diagram 1 - M2

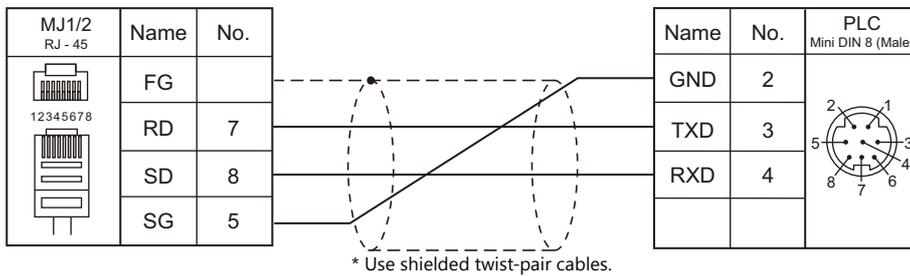

# 12. TECO

---

## 12.1 PLC Connection

# 12.1 PLC Connection

## Serial Connection

PLC Selection on the Editor	CPU	Unit/Port	Signal Level	Connection			Ladder Transfer <sup>*3</sup>
				CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>	
TP03 (MODBUS RTU)	TP03-xxSx-x TP03-xxMx-x	PC / PDA port	RS-232C	TECO TP-302PC + Gender changer <sup>*4</sup>	TECO TP-302PC + Wiring diagram 1 - M2		×
			RS-422	Wiring diagram 2 - C4	×	Wiring diagram 2 - M4	
	Expansion card	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4			
		PC/PDA port	RS-232C	TECO TP-302PC + Gender changer <sup>*4</sup>	TECO TP-302PC + Wiring diagram 1 - M2		
			RS-422	Wiring diagram 2 - C4	×	Wiring diagram 2 - M4	
		RS-485 port Expansion card	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906.

For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*3 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*4 Use a D-sub gender changer (9-pin, female-to-male) commercially available.

Manufacturer	Model
BLACK BOX	FA440-R2
MISUMI	DGC-9PP

## 12.1.1 TP03 (MODBUS RTU)

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / <u>19200</u> / 38400 / 57600 76800 bps	
Data Length	<b>8 bits</b>	
Stop Bit	1 / <u>2</u> bits	
Parity	Odd / Even / <u>None</u>	
Target Port No.	<u>1</u> to 31	

#### PLC

Be sure to match the settings to those made under [Communication Setting] of the editor.  
Set a port number in the communication software. For more information, refer to the PLC manual issued by the manufacturer.

#### PC/PDA Port

Use bits 0 to 7 at D8321 for the following settings.

Device Memory	Setting																																					
D8321	<div style="display: flex; justify-content: space-around; margin-top: 10px;"> <table border="1" style="border-collapse: collapse;"> <thead> <tr> <th>2</th> <th>1</th> <th>Parity</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>None</td> </tr> <tr> <td>0</td> <td>1</td> <td>Odd</td> </tr> <tr> <td>1</td> <td>1</td> <td>Even</td> </tr> </tbody> </table> <table border="1" style="border-collapse: collapse;"> <thead> <tr> <th>7</th> <th>6</th> <th>5</th> <th>4</th> <th>Baud Rate</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>1</td> <td>1</td> <td>1</td> <td>9600 bps</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> <td>0</td> <td>19200 bps</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> <td>1</td> <td>38400 bps</td> </tr> <tr> <td>1</td> <td>0</td> <td>1</td> <td>0</td> <td>57600 bps</td> </tr> </tbody> </table> </div>	2	1	Parity	0	0	None	0	1	Odd	1	1	Even	7	6	5	4	Baud Rate	0	1	1	1	9600 bps	1	0	0	0	19200 bps	1	0	0	1	38400 bps	1	0	1	0	57600 bps
2	1	Parity																																				
0	0	None																																				
0	1	Odd																																				
1	1	Even																																				
7	6	5	4	Baud Rate																																		
0	1	1	1	9600 bps																																		
1	0	0	0	19200 bps																																		
1	0	0	1	38400 bps																																		
1	0	1	0	57600 bps																																		


\* If the value specified for any item is outside the allowable range, the item will be assumed to be: data length: 8 bits, parity: none, stop bit: 2 bits, or baud rate: 19200 bps.

#### Calendar

This model is not equipped with the calendar function. Use the built-in clock of the V series.

### RS-485 Port / Expansion Card

Use D8120 for RS-485 port settings and D8320 for expansion card settings.

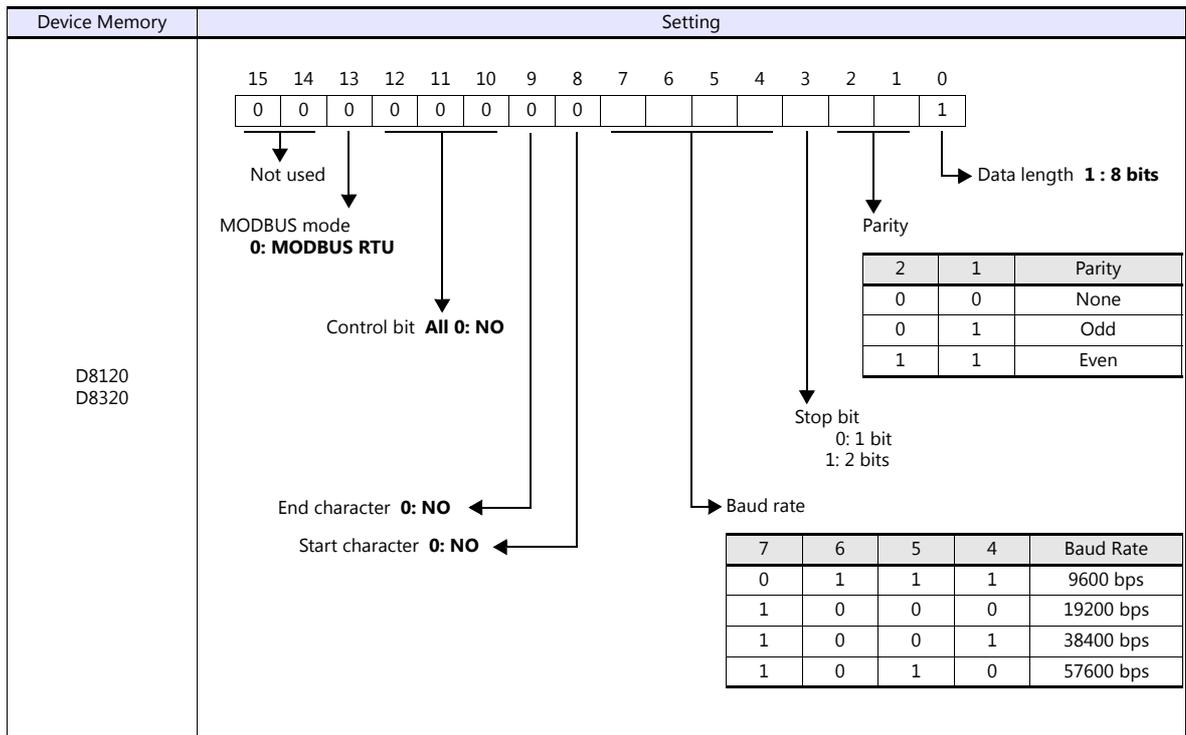

### Calendar

This model is not equipped with the calendar function. Use the built-in clock of the V series.

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (Data register)	00H	
X (Digital I relay)	01H	
Y (Digital O relay)	02H	
M (Auxiliary relay)	03H	
CC (Counter [Coil])	04H	
TC (Timer [Coil])	05H	
C (Counter [Current value])	06H	
T (Timer [Current value])	07H	
CP (Counter [Preset value])	08H	
TP (Timer [Preset value])	09H	

### Indirect Device Memory Designation

	15	8 7	0
n+0	Model		Device type
n+1	Address No.		
n+2	Expansion code		Bit designation
n+3	00		Station number


- For X/Y device memory  
Assign an actual address number (OCT) converted to HEX as the address number.

## 12.1.2 Wiring Diagrams


### When Connected at CN1:

#### RS-422/RS-485

Wiring diagram 1 - C4

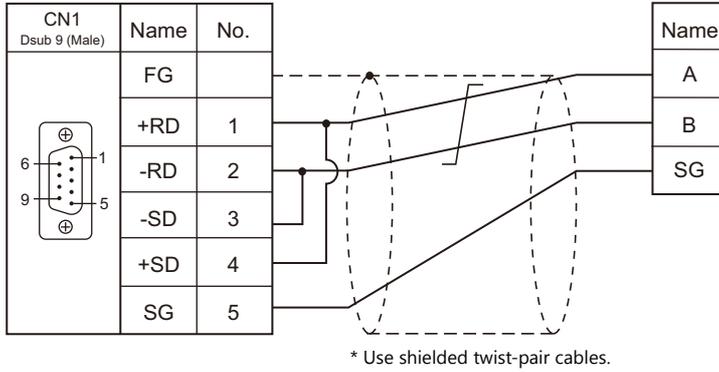


Wiring diagram 2 - C4

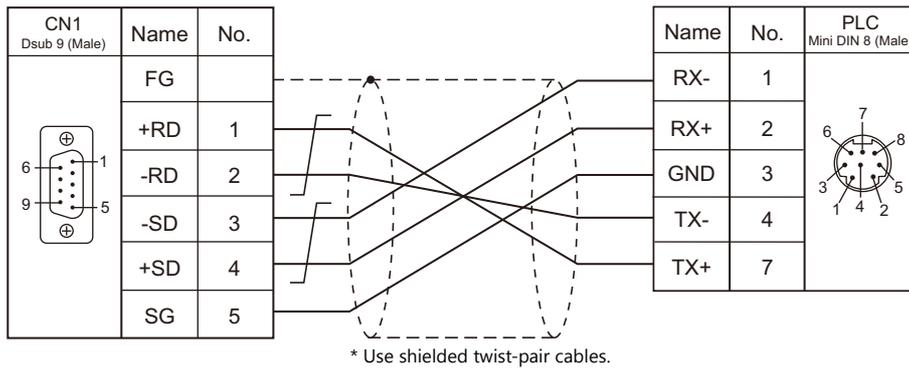

**When Connected at MJ1/MJ2:**


**RS-232C**

**Wiring diagram 1 - M2**

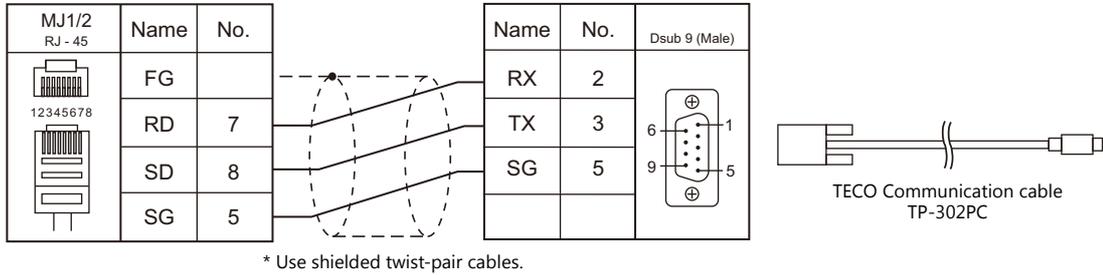


**RS-422/RS-485**

**Wiring diagram 1 - M4**

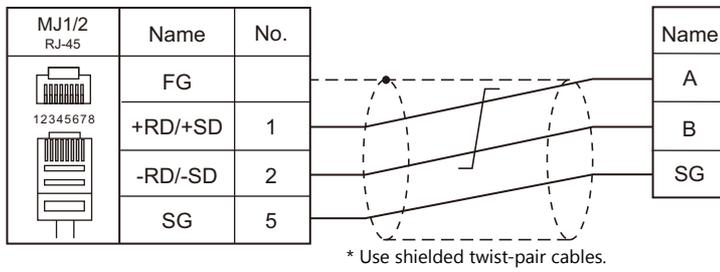


**Wiring diagram 2 - M4**

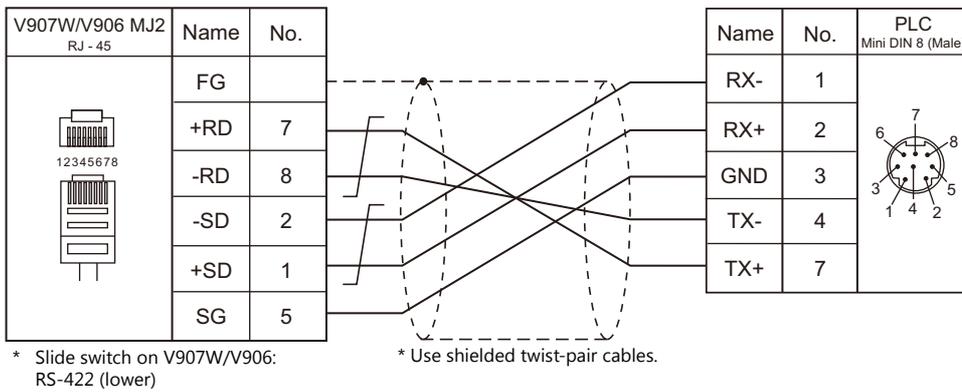

# MEMO

**MONITOUCH**



# 13. Telemecanique

---

## 13.1 PLC Connection

# 13.1 PLC Connection

## Serial Connection

PLC Selection on the Editor	CPU	Unit/Port	Signal Level	Connection			Ladder Transfer*2
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
TSX Micro	TSX37-xx TSX57-xx	TER AUX	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		×

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906.  
For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

## 13.1.1 TSX Micro

### Communication Setting

#### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<b>Multi-link</b>	PLC1 to PLC8 valid Local port Nos. 1 to 8 valid (4 as default)
Signal Level	<b>RS-422/485</b>	
Baud Rate	<u>9600 bps</u>	
Data Length	<b>8 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	None / <u>Odd</u> / Even	

#### PLC

##### TER / AUX Port

Make PLC settings using the application software "PL7 Junior". For more information, refer to the PLC manual issued by the manufacturer.

Item	Setting	Remarks
CHANNEL 0:	<b>UNI-TELWAY LINK</b>	
Transmission speed	9600 bits/s	
Parity	Even / Odd / None	

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
MW (Memory Word)	00H	
KW (Constant Word)	01H	Read only
M (Bit Memory)	02H	

## 13.1.2 Wiring Diagrams

### When Connected at CN1:

#### RS-422/RS-485


Wiring diagram 1 - C4

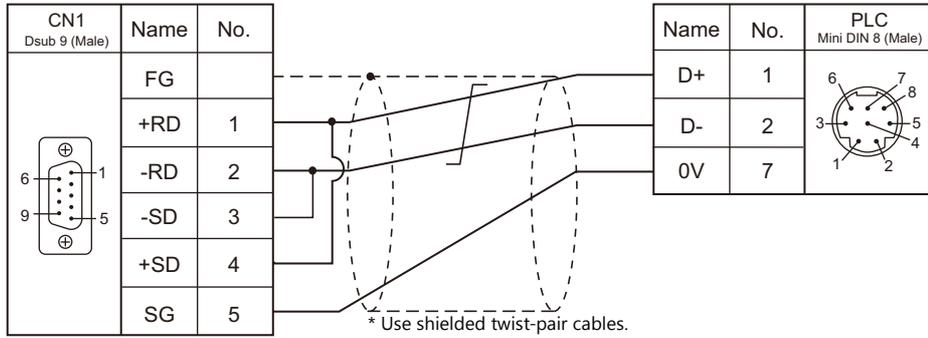

### When Connected at MJ1/MJ2:


#### RS-232C

Wiring diagram 1 - M4

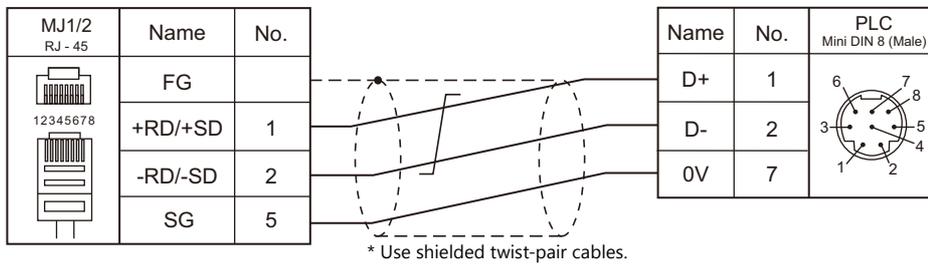

# MEMO

**MONITOUCH**



# 14. TOHO

---

## 14.1 Temperature Controller/Servo/Inverter Connection

# 14.1 Temperature Controller/Servo/Inverter Connection

## Digital Temperature Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
TTM-000	TTM-002-x-x-AM	Terminal block	RS-485	Wiring diagram 5 - C4	Wiring diagram 5 - M4		TTM-000.Lst
	TTM-004-x-x-AM TTM-004S-x-x-AX TTM-X04-x-x-AM TTM-X04S-x-x-AX			Wiring diagram 6 - C4	Wiring diagram 6 - M4		
	TTM-005-x-x-AM TTM-005S-x-x-AX TTM-006-x-x-AM TTM-006S-x-x-AX TTM-009-x-x-AM TTM-009S-x-x-AX			Wiring diagram 2 - C4	Wiring diagram 2 - M4		
	TTM-007-x-x-AM TTM-007S-x-x-AX			Wiring diagram 7 - C4	Wiring diagram 7 - M4		
TTM-00BT	TTM-00BT-0-R-M1 TTM-00BT-1-R-M1	TB3	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		TTM-00BT.Lst
	TTM-00BT-0-R-M2 TTM-00BT-1-R-M2		RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
TTM-200 (MODBUS RTU)	TTM-204	Terminal block	RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4		TD_TTM200.Lst
	TTM-205 TTM-209			Wiring diagram 3 - C4	Wiring diagram 3 - M4		
	TTM-207			Wiring diagram 4 - C4	Wiring diagram 4 - M4		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 14.1.1 TTM-000

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)


Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<b>RS-422/485</b>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	1 / <u>2</u> bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	1 to 32	
BCC Check	Without BCC / <u>With BCC</u>	

### Digital Temperature Controller

#### Communication setting

Make the communication settings in the communication setting mode (SET6) that is selected by the key on the front of the digital temperature controller.

(Underlined setting: default)

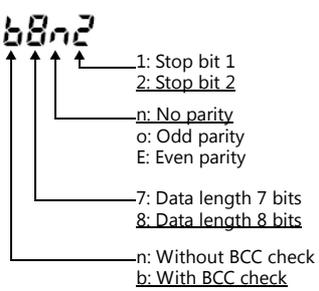Communication Setting	Item	Contents	Setting Example
<u>Prot</u>	Communication protocol	<u>0: TOHO communication protocol</u> * Not necessary for TTM-xxx-x-x-AxxM	0
<u>Con</u>	Communication parameter		b8n2
<u>bPS</u>	Communication setting	4.8: 4800 bps <u>9.6: 9600 bps</u> 19.2: 19200 bps	9.6
<u>Adr</u>	Communication address	<u>1</u> to 32	1
<u>Res</u>	Response delay time	<u>0</u> to 255 (ms)	0
<u>Mod</u>	Communication mode selection	<u>ro: Read only</u> rw: Read/write	rw

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
MW (monitor data)	00H	
SW (setting data)	01H	Always set "0" for SW00137 (communication protocol setting).
ST (character string data)	02H	6-byte character string data

### Read-only device memory

The following types of device memory are read-only.

Device Memory	Name	Remarks
MW00000	Measurement value (PV)	When the measurement value exceeds the upper limit, "32767" is displayed. When it falls below the lower limit, "-32768" is displayed.
MW00003	Output status monitoring	
MW00005	DI status monitoring	
SW00041	Input monitoring for event output 1CT	
SW00050	Input monitoring for event output 2CT	
SW00064	Monitoring for remaining time on timer	
ST00000	Measurement value (PV1)	

### Write-only device memory

The following type of device memory is write-only.

Device Memory	Name	Remarks
MW00002	Timer start / stop	

## Indirect Device Memory Designation

Specify the value obtained by subtracting "1" from the actual station number.

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Data save	1 - 8 (PLC1 - 8)	n	Station numbers 0 to 31*	2
		n + 1	Command: 0	

\* Specify the value obtained by subtracting "1" from the actual station number.

## 14.1.2 TTM-00BT

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1:n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 bps	
Data Length	<b>8 bits</b>	
Stop Bit	<b>2 bits</b>	
Parity	<b>None</b>	
Target Port No.	0 to 15	

#### Digital Temperature Controller

Settings related to communications can be made using switches on the controller. Before changing a setting, be sure to turn off the power to the digital temperature controller.


#### Unit number (station number)

(Underlined setting: default)

SW1	Contents	Setting Example
	0 to F (H) (0 to 15)	0

#### Baud rate

(Underlined setting: default)

SW2	Contents				Setting Example	
	DIP Switch	4800 bps	9600 bps	19200 bps	38400 bps	1: ON 2: OFF 3: OFF 4: OFF  Baud rate: 9600 bps
1	OFF	<u>ON</u>	OFF	ON		
2	OFF	<u>OFF</u>	ON	ON		
3	<u>OFF</u> (Not used)					
4	<u>OFF</u> (Not used)					

The following settings are fixed; data length: 8 bits, stop bit: 2 bits, and parity: none.


## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
MW (monitor data)	00H	
SW (setting data)	01H	

\* The memory bank number (0 to 8) and channel number (1 to 8) are required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.

Example: #2 : SW5134



### Address denotations

- To specify the memory bank currently in use, set "0" for the memory bank number. When specifying other memory banks, set the corresponding numbers.
- On the signal name reference list, every channel is designated as "0". Manually input the number (1 to 8) of the channel to use.

### Read-only device memory

The following types of device memory are read-only.

Device Memory	Name	Remarks
MW000	Measurement value (PV1)	*1
MW003	Control output monitor (OM1)	
SW041	CT measurement value 1 (CM1)	*2
SW050	CT measurement value 2 (CM2)	*2
SW083	CT measurement value 3 (CM3)	*2
SW092	CT measurement value 4 (CM4)	*2
SW101	CT measurement value 5 (CM5)	*2
SW110	CT measurement value 6 (CM6)	*2
SW119	CT measurement value 7 (CM7)	*2
SW130	DI monitor (DIM)	
SW131	Event output monitor 1 to 5 (EMI)	
SW132	Event output monitor 6 to 8 (EM2)	
SW133	Alarm monitor (ALM)	

\*1 When the measurement value exceeds the upper limit, "32767" is displayed. When it falls below the lower limit, "-32768" is displayed.

\*2 When the measurement value exceeds the upper limit, "32767" is displayed. When it falls below the lower limit or measurement is impossible, "-32768" is displayed.

## Indirect Device Memory Designation

	15	8 7	0
n + 0	Model		Device type
n + 1	Address No.		
n + 2	Bank No.	Bit designation	
n + 3	00	Station number	

- Specify the channel number (1 to 8) and address for the device memory number (address).

Example: Channel 5, address 134:

Specify "5134" (DEC) for the device memory number (address).

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Data save	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 0	
		n + 2	Channel (1 - 8)	

### 14.1.3 TTM-200 (MODBUS RTU)

#### Communication Setting

##### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 bps	
Data Length	<b>8 bits</b>	
Stop Bit	1 / <u>2</u> bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	1 to 31	

#### Digital Temperature Controller

##### Communication setting

Make the communication settings in the communication setting mode (SET17) that is selected by the key on the front of the digital temperature controller.

(Underlined setting: default)

Communication Setting	Item	Contents	Setting Example
<b>PRt</b>	Communication protocol *1	1: MODBUS RTU	1
<b>CoM</b>	Communication parameter	8N1: data length 8, without parity, stop bit 1 8N2: <u>data length 8, without parity, stop bit 2</u> 8o1: data length 8, odd parity, stop bit 1 8o2: data length 8, odd parity, stop bit 2 8E1: data length 8, even parity, stop bit 1 8E2: data length 8, even parity, stop bit 2	8N2
<b>bPS</b>	Communication setting	4.8: 4800 bps <u>9.6: 9600 bps</u> 19.2: 19200 bps 38.4: 38400 bps	9.6
<b>AdR</b>	Communication address	<u>1</u> to 31	1
<b>AWt</b>	Communication response delay time	<u>0</u> to 255 (ms)	0
<b>Mod</b>	Communication switching	0: Writing prohibited <u>1: Writing enabled</u> 2: Master of simultaneous rise in temperature 3: Slave of simultaneous rise in temperature	1

\*1 Select "Modbus RTU" for the communication protocol on the digital temperature controller when connecting with the V9.

#### Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
4 (holding register)	00H	No address of even-numbered digits can be specified.

### 14.1.4 Wiring Diagrams

#### When Connected at CN1:


#### RS-232C

Wiring diagram 1 - C2

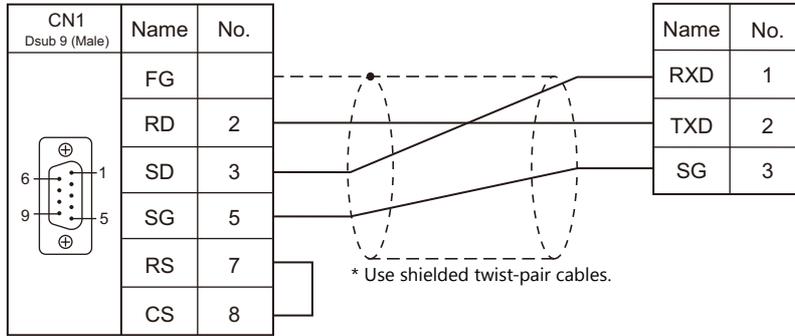


#### RS-422/RS-485


Wiring diagram 1 - C4

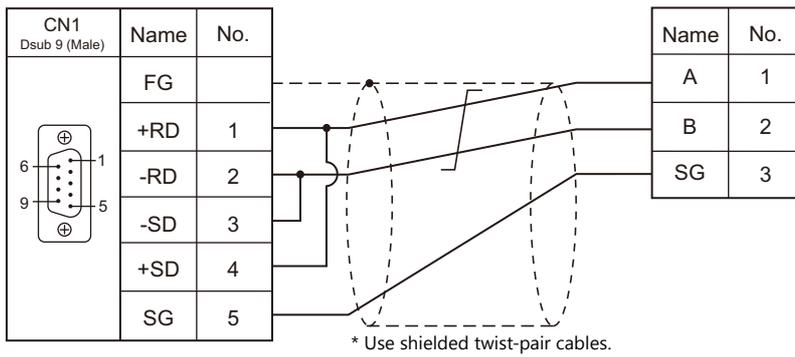


Wiring diagram 2 - C4

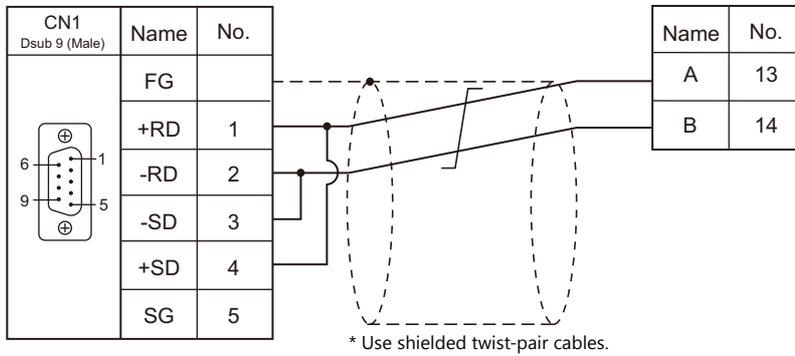


**Wiring diagram 3 - C4**

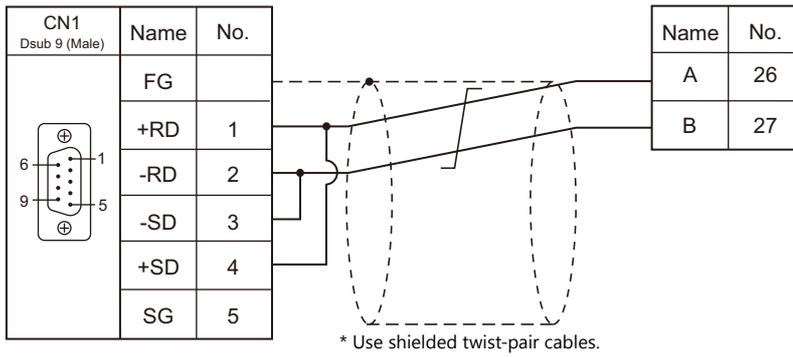


**Wiring diagram 4 - C4**

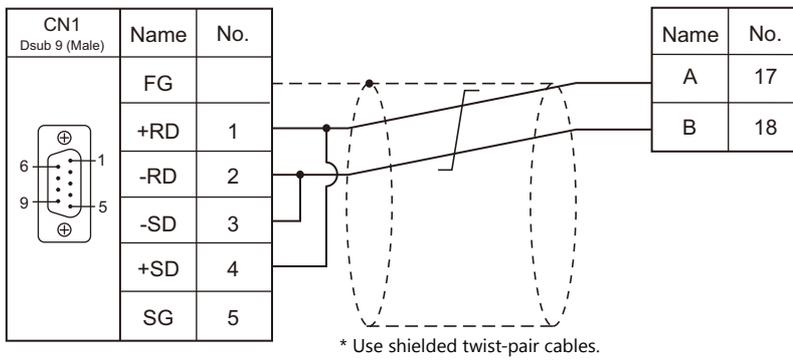


**Wiring diagram 5 - C4**

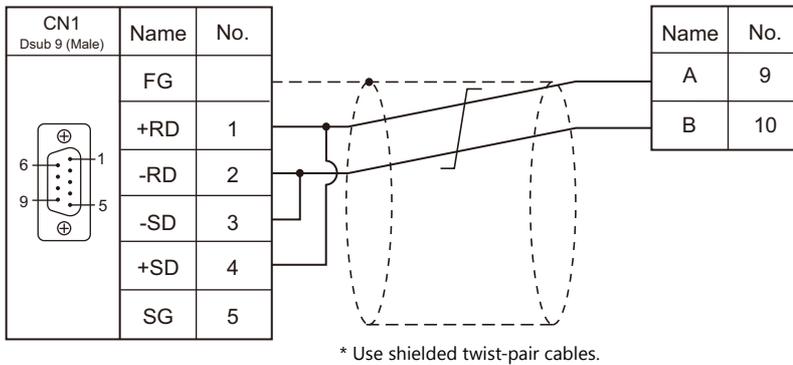

**Wiring diagram 6 - C4**

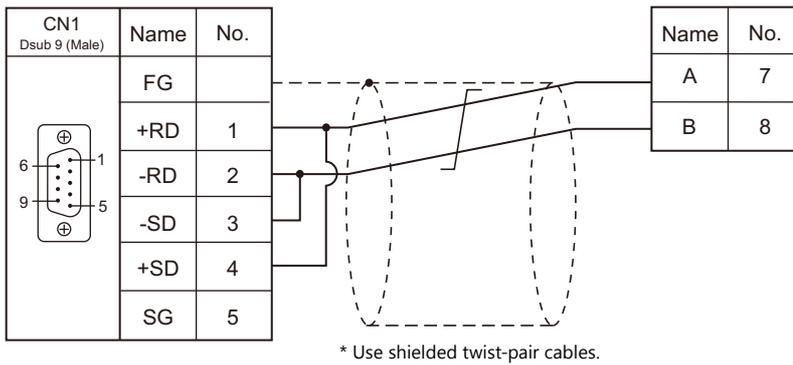


**Wiring diagram 7 - C4**

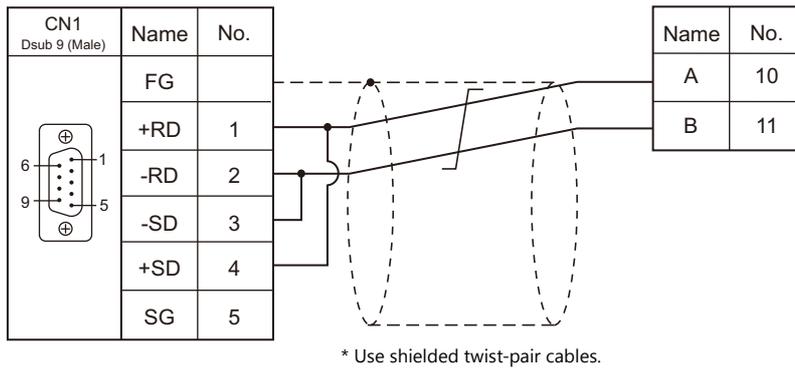

**When Connected at MJ1/MJ2:**


**RS-232C**

**Wiring diagram 1 - M2**

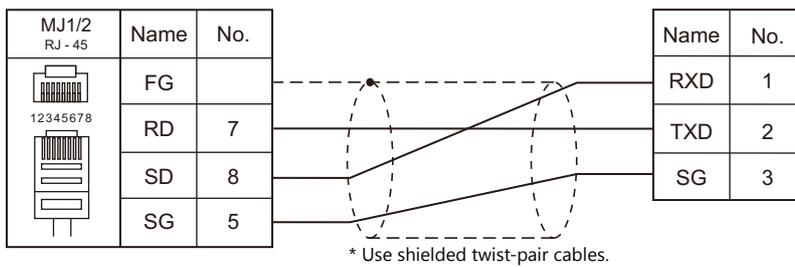


**RS-422/RS-485**


**Wiring diagram 1 - M4**

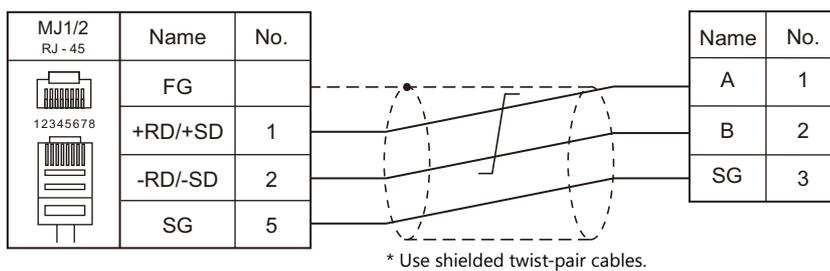


**Wiring diagram 2 - M4**

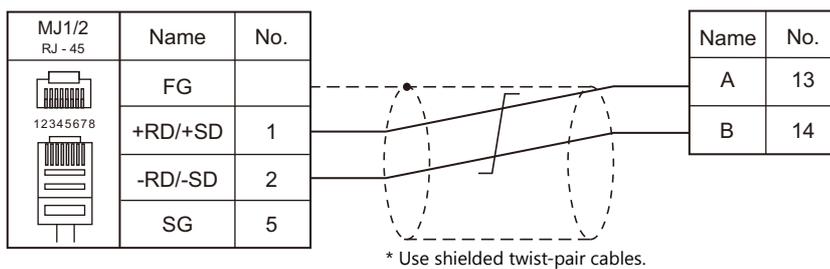


**Wiring diagram 3 - M4**

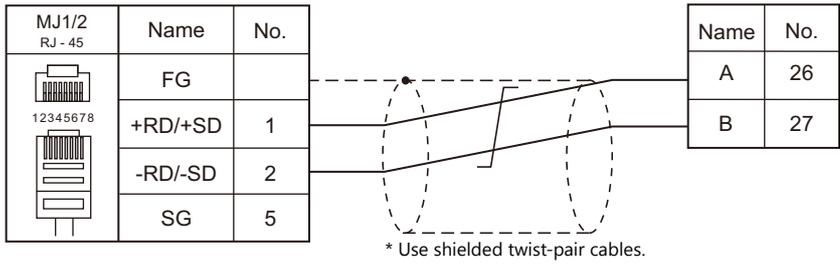


**Wiring diagram 4 - M4**

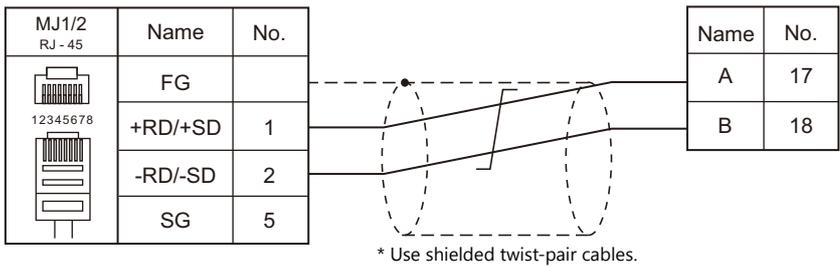


**Wiring diagram 5 - M4**

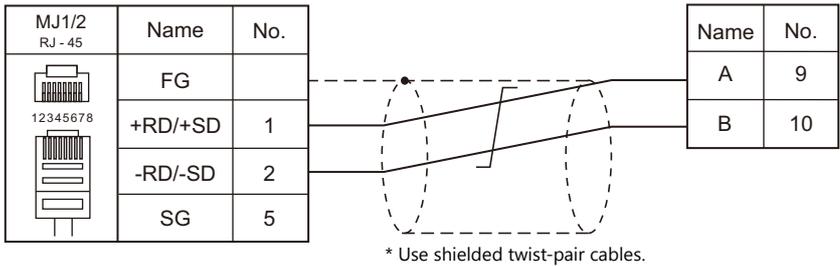

**Wiring diagram 6 - M4**

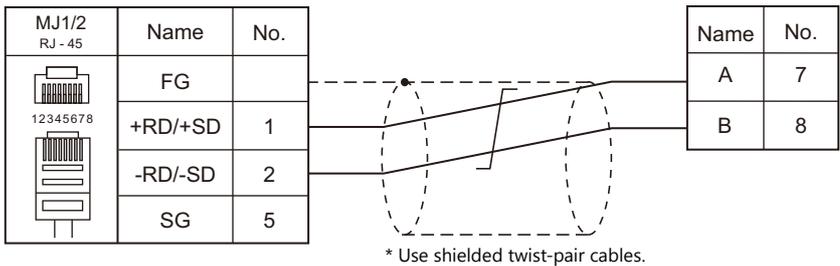

**Wiring diagram 7 - M4**

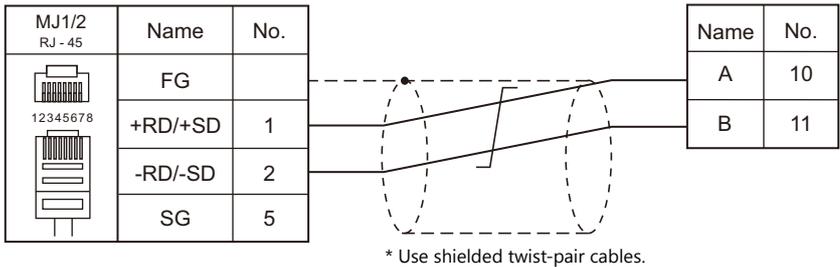

# 15. Tokyo Chokoku Marking Products

---

15.1 Thermo Controller/Servo/Inverter

## 15.1 Thermo Controller/Servo/Inverter

### Portable Dot Marker

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
MB3315/1010	MB3315 MB1010	RS-232C connector	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		TOCHO_MB. Lst

\*1 Set the slide switch for signal selection to the RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 15.1.1 MB3315/1010

### Communication Setting

#### Editor

##### Communication setting

Item	Setting	Remarks
Connection Mode	<b>1 : 1</b>	
Signal Level	<b>RS-232C</b>	
Baud Rate	<b>115200 bps</b>	
Data Length	<b>8 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>None</b>	

### Available Device Memory

There are no device memory.

### PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (=\$u n)		F2
Operation execution command	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	3
		n + 1	Command: 3	
		n + 2	Operation execution command 1: Start marking 2: Pause 3: Abort 4: Alarm reset 5: Origin return	
Status request	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	2
		n + 1	Command: 5	
		n + 2	Status 0: Standby 1: Marking operation in progress 2: Paused 3: Origin return in progress 5: Operating for any other reason 99: Alarm occurring	
File marking data settings	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	5+m
		n + 1	Command: 9	
		n + 2	File number: 1 to 255	
		n + 3	Field number: 1 to 21	
		n + 4	Number of characters in text: 1 to 50	
		n + 5 to n + (4 + m)	Marking data (max. 50 characters) *1	

Contents	F0	F1 (= \$u n)	F2																												
Marking data settings	1 to 8 (PLC1 to 8)	n	Station number: 0 (fixed)	7+m																											
		n + 1	Command: 1																												
		n + 2	Marking force: 0 to 10																												
		n + 3	Marking speed: 0 to 10																												
		n + 4	Serial setting: 0 (not used)																												
		n + 5	Origin return 0: Origin return after marking (normally used) 1: No origin return after marking																												
		n + 6	Number of sending fields: 1 to 21																												
		n + 7 to n + (6 + m)	Field data • Character data		<table border="1"> <thead> <tr> <th colspan="2">Field data</th> </tr> </thead> <tbody> <tr> <td>n + 7</td> <td>Field number: 1 to 21</td> </tr> <tr> <td>n + 8</td> <td>Data type *2 0: Fixed characters 1: Calendar 3: Logo 4: Vertical Y axis 5: Vertical X axis 6: Outer arc 7: Inner arc</td> </tr> <tr> <td>n + 9</td> <td>Fixed to 0</td> </tr> <tr> <td>n + 10</td> <td>Character height (mm) *3</td> </tr> <tr> <td>n + 11</td> <td>Character width ratio (%)</td> </tr> <tr> <td>n + 12</td> <td>Angle (deg)</td> </tr> <tr> <td>n + 13</td> <td>Character pitch (mm) *3</td> </tr> <tr> <td>n + 14</td> <td>Start position X (mm) *3</td> </tr> <tr> <td>n + 15</td> <td>Start position Y (mm) *3</td> </tr> <tr> <td>n + 16</td> <td>Character (bytes)</td> </tr> <tr> <td>n + 17 to n + (16 + α)</td> <td>Marking data (max. 50 characters) *1 *4</td> </tr> <tr> <td>n + (17 + α)</td> <td>Arc marking radius (mm) *2 *5</td> </tr> </tbody> </table>	Field data		n + 7	Field number: 1 to 21	n + 8	Data type *2 0: Fixed characters 1: Calendar 3: Logo 4: Vertical Y axis 5: Vertical X axis 6: Outer arc 7: Inner arc	n + 9	Fixed to 0	n + 10	Character height (mm) *3	n + 11	Character width ratio (%)	n + 12	Angle (deg)	n + 13	Character pitch (mm) *3	n + 14	Start position X (mm) *3	n + 15	Start position Y (mm) *3	n + 16	Character (bytes)	n + 17 to n + (16 + α)	Marking data (max. 50 characters) *1 *4	n + (17 + α)	Arc marking radius (mm) *2 *5
		Field data																													
		n + 7	Field number: 1 to 21																												
		n + 8	Data type *2 0: Fixed characters 1: Calendar 3: Logo 4: Vertical Y axis 5: Vertical X axis 6: Outer arc 7: Inner arc																												
		n + 9	Fixed to 0																												
		n + 10	Character height (mm) *3																												
		n + 11	Character width ratio (%)																												
		n + 12	Angle (deg)																												
		n + 13	Character pitch (mm) *3																												
		n + 14	Start position X (mm) *3																												
		n + 15	Start position Y (mm) *3																												
		n + 16	Character (bytes)																												
		n + 17 to n + (16 + α)	Marking data (max. 50 characters) *1 *4																												
		n + (17 + α)	Arc marking radius (mm) *2 *5																												
n + 7 to n + (6 + m)	• 2D data (two-dimensional barcode)	<table border="1"> <thead> <tr> <th colspan="2">Field data</th> </tr> </thead> <tbody> <tr> <td>n + 7</td> <td>Field number: 21 (fixed)</td> </tr> <tr> <td>n + 8</td> <td>Data type 0: Fixed characters 1: Calendar</td> </tr> <tr> <td>n + 9</td> <td>Barcode type 1: QR 2: Data matrix</td> </tr> <tr> <td>n + 10</td> <td>Barcode marking force: 1 to 10</td> </tr> <tr> <td>n + 11</td> <td>Barcode marking speed: 1 to 10</td> </tr> <tr> <td>n + 12</td> <td>Dimension 0: For QR code 1: One-dimensional 2: Two-dimensional</td> </tr> <tr> <td>n + 13</td> <td>Fixed to 0</td> </tr> <tr> <td>n + 14</td> <td>Angle (deg)</td> </tr> <tr> <td>n + 15</td> <td>Matrix size (mm) *3</td> </tr> <tr> <td>n + 16</td> <td>Start position X (mm) *3</td> </tr> <tr> <td>n + 17</td> <td>Start position Y (mm) *3</td> </tr> <tr> <td>n + 18</td> <td>Character (bytes)</td> </tr> <tr> <td>n + 17 to n + (16 + α)</td> <td>Marking data (max. 50 characters) *1</td> </tr> </tbody> </table>	Field data		n + 7	Field number: 21 (fixed)	n + 8	Data type 0: Fixed characters 1: Calendar	n + 9	Barcode type 1: QR 2: Data matrix	n + 10	Barcode marking force: 1 to 10	n + 11	Barcode marking speed: 1 to 10	n + 12	Dimension 0: For QR code 1: One-dimensional 2: Two-dimensional	n + 13	Fixed to 0	n + 14	Angle (deg)	n + 15	Matrix size (mm) *3	n + 16	Start position X (mm) *3	n + 17	Start position Y (mm) *3	n + 18	Character (bytes)	n + 17 to n + (16 + α)	Marking data (max. 50 characters) *1	
Field data																															
n + 7	Field number: 21 (fixed)																														
n + 8	Data type 0: Fixed characters 1: Calendar																														
n + 9	Barcode type 1: QR 2: Data matrix																														
n + 10	Barcode marking force: 1 to 10																														
n + 11	Barcode marking speed: 1 to 10																														
n + 12	Dimension 0: For QR code 1: One-dimensional 2: Two-dimensional																														
n + 13	Fixed to 0																														
n + 14	Angle (deg)																														
n + 15	Matrix size (mm) *3																														
n + 16	Start position X (mm) *3																														
n + 17	Start position Y (mm) *3																														
n + 18	Character (bytes)																														
n + 17 to n + (16 + α)	Marking data (max. 50 characters) *1																														

Return data: Data stored from controller to V series


\*1 Set marking data in ASCII format, and all other items in binary format.  
 \*2 When selecting "6: Outer arc" or "7: Inner arc" as the data type, configure the arc marking radius at "n + (17 + α)". For other than "6: Outer arc" or "7: Inner arc", configuration of "n + (17 + α)" is not necessary.  
 \*3 Include the tenths place in the setting value.  
 Example: 30 = 3.0 mm  
 \*4 When selecting "3: Logo" as the data type, set a logo number between 1 to 31. Set the logo number with a "\$" mark before and after the number, such as "\$01\$".  
 \*5 Set a whole value.  
 Example: 10 = 10 mm

## 15.1.2 Wiring Diagrams

### When Connected at CN1:

RS-232C


Wiring diagram 1 - C2

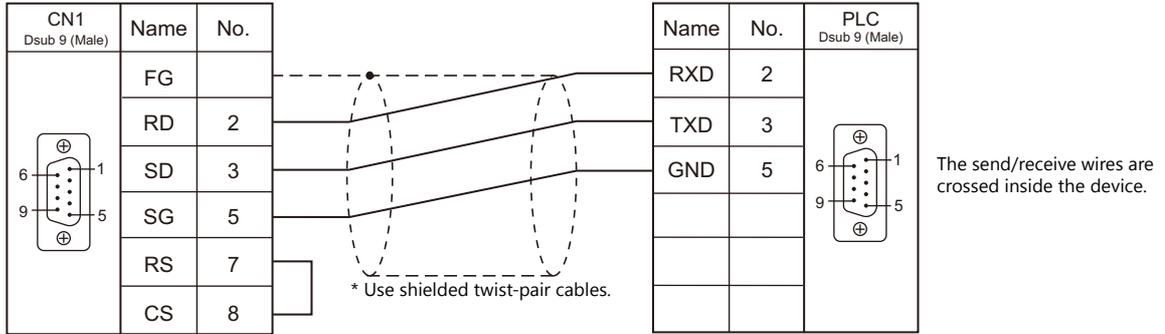

### When Connected at MJ1/MJ2:

RS-232C

Wiring diagram 1 - M2

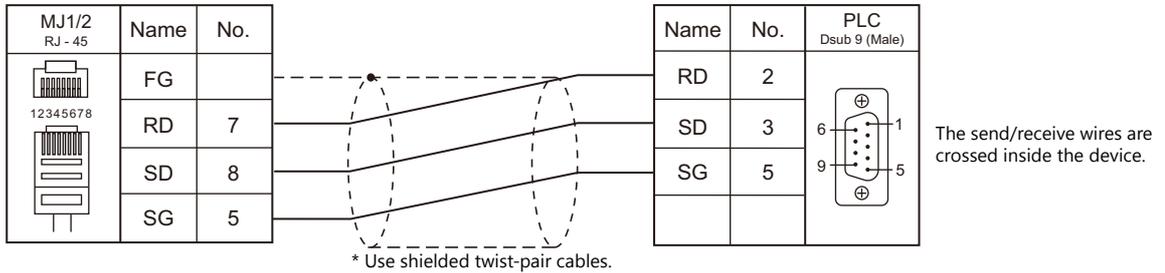

# 16. TOSHIBA

---

16.1 PLC Connection

16.2 Temperature Controller/Servo/Inverter Connection

# 16.1 PLC Connection

## Serial Connection

PLC Selection on the Editor	PLC/CPU			Unit/Port	Signal Level	Connection			Ladder Transfer *3
						CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
T series / V series (T compatible)	T series	T1	T1-16 T1-28 T1-40 T1-40S	Programmer port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
			CU111	RS-485	Wiring diagram 1 - C4		Wiring diagram 1 - M4		
		T1S	T1-40S	LINK port			×	Wiring diagram 2 - M4	
		T2	PU224	LINK port	RS-485	Wiring diagram 2 - C4			
		T2E	PU234E	Programmer port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		
				CM232E					
				CM231E	RS-485	Wiring diagram 1 - C4	×	Wiring diagram 1 - M4	
		T2N	PU215N PU235N PU245N	Programmer port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		
	LINK port			RS-232C					
				RS-485	Wiring diagram 3 - C4	×	Wiring diagram 3 - M4		
	T3	PU315 PU325	LINK port	RS-485	Wiring diagram 2 - C4	×	Wiring diagram 2 - M4		
	T3H	PU325H PU326H							
	V series	S2T	PU672T PU662T	Programmer port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		
				LINK port	RS-485	Wiring diagram 1 - C4	×	Wiring diagram 1 - M4	
		S2E	PU612E	Programmer port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		
				LINK port	RS-485	Wiring diagram 1 - C4	×	Wiring diagram 1 - M4	
		model 2000	S2PU22A S2PU32A S2PU72A S2PU72D S2PU82	LINK port	RS-485	Wiring diagram 1 - C4	×	Wiring diagram 1 - M4	
		model 3000	S3PU21 S3PU45A S3PU55A S3PU65A			Wiring diagram 2 - C4		Wiring diagram 2 - M4	
EX series		EX100	MPU12A	COMP. LINK	RS-485	Wiring diagram 1 - C4	×	Wiring diagram 1 - M4	×
		EX250 EX500		CMP6236A					
	EX2000	MPU-6620	COMP. LINK						

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*3 For the ladder transfer function, see the V9 Series Reference Manual 2.

## Ethernet Connection

PLC Selection on the Editor	PLC / CPU		Unit	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>
T series/ V series (T compatible) (Ethernet UDP/IP)	T2N series	PU235N PU245N	LAN port built into CPU	×	○	1024 to 65535 (Default: 10000)	○	×
	T3H series	PU325H PU326H	EN311					
	S2T series	PU672T PU662T	EN6**					
	model 2000	S2PU72 S2PU82	EN6**					
	model 3000	S3PU45 S3PU55 S3PU65	EN331 EN7**					
nv series (Ethernet UDP/IP)	nv series <sup>*3</sup>	PU811 PU866	EN811 FN812					

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*3 Connection via the LAN port built into the CPU is not available. Only the LAN port of the link unit can be used.

## 16.1.1 T Series / V Series (T Compatible)

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1</u> : <u>1</u> / 1 : n / Multi-link / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 bps	
Parity	None / <u>Odd</u> / Even	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Target Port No.	<u>1</u> to 31	

#### PLC

#### T1/T1S (Programmer Port)/CU111

#### System information

(Underlined setting: default)

Item	Setting	Remarks
Operation Mode	Computer link (ASCII)	
Signal Level	Programmer port: RS-232C CU111: RS-485	
Baud Rate	9600 bps (fixed)	
Parity	None / <u>Odd</u>	
Data Length	8 bits (fixed)	
Stop Bit	1 bit (fixed)	
Station No.	<u>1</u> to 31	

#### T1S (Link Port)


#### Special register (SW056), system information

(Underlined setting: default)

Item	Link Port	Remarks
Operation Mode	Computer link (ASCII)	Special register SW056 = 0 The setting takes effect when the EEPROM write command is executed and the power is turned off and back on again.
Signal Level	RS-485	
Baud Rate	4800 / 9600 / 19200 bps	
Parity	None / <u>Odd</u> / Even	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Station No.	<u>1</u> to 31	

## T2E/T2N (Programmer Port)

### Operation mode setting switch


Switch	Contents	Setting	Remarks
 SW6: COM	Programmer port parity setting	OFF: Odd parity ON: Without parity	The setting takes effect when the power is turned off and back on again.

The following settings are fixed; baud rate: 9600 bps, data length: 8 bits, and stop bit: 1 bit.

## T2E (Option Card CM231E/CM232E)

### Operation mode setting switch

The settings are made by the DIP switch on the front of the CPU module (PU234E).

Switch	Contents	Setting	Remarks
 SW4: CM0	Option communication mode setting Function: computer link	OFF	The settings take effect when the power is turned off and back on again.
SW5: CM1		OFF	

### Transmission parameter setting


Transmission parameters are set on the system information area of T2E.

(Underlined setting: default)

Item	Setting	Remarks
Signal Level	CM231E: RS-485 CM232E: RS-232C	The settings take effect when the EEPROM write command is executed and the power is turned off and back on again.
Baud Rate	4800 / 9600 / 19200 bps	
Parity	None / <u>Odd</u> / Even	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Station No.	<u>1</u> to 31	

## T2N (LINK Port)

### Operation mode setting switch

Switch	Contents	Setting	Remarks
	SW4: CM0	OFF	The settings take effect when the power is turned off and back on again.
	SW5: CM1	OFF	

### Communication port select switch

Switch	Contents	Setting	Remarks
	SW1	Signal Level	OFF: RS-485 ON: RS-232C

The following settings are fixed; baud rate: 9600 bps, data length: 8 bits, and stop bit: 1 bit.

### Transmission parameter setting

Transmission parameters are set on the system information area of T2N.

(Underlined setting: default)

Item	Setting	Remarks
Signal Level	CM231E: RS-485 CM232E: RS-232C	The settings take effect when the EEPROM write command is executed and the power is turned off and back on again.
Baud Rate	4800 / 9600 / 19200 bps	
Parity	None / <u>Odd</u> / Even	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Station No.	<u>1</u> to 31	

## T3/T3H (LINK Port)

### Transmission parameter setting

Transmission parameters are set on the system information area.

(Underlined setting: default)

Item	Setting	Remarks
Signal Level	RS-485	The settings take effect when the EEPROM write command is executed and the power is turned off and back on again.
Baud Rate	4800 / 9600 / 19200 bps	
Parity	None / <u>Odd</u> / Even	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Station No.	<u>1</u> to 31	

## S2E/S2T (Programmer Port)

### Operation mode setting switch

Switch	Contents	OFF	ON	Remarks
3 : P	Programmer port parity setting	Odd parity	Without parity	

The following settings are fixed; baud rate: 9600 bps, data length: 8 bits, and stop bit: 1 bit.

## S2E/S2T (LINK Port)

Set special registers and system information using the engineering tool.  
After making settings, execute the ROM write command and turn the power off and back it on again to determine the settings.

### Operation mode

Special Register	Setting	Remarks
SW069	0: Computer link (ASCII)	

### System information

(Underlined setting: default)

Item		Setting	Remarks
Computer Link Setting	Station No.	<u>1</u> to 31	
Connection Mode	Baud Rate	4800 / <u>9600</u> / 19200 bps	
	Parity	None / <u>Odd</u> / Even	
	Data Length	7 / <u>8</u> bits	
	Stop Bit	<u>1</u> / 2 bits	

### model2000/3000

Set module parameters using the engineering tool.

### Module parameter

(Underlined setting: default)

Item	Setting	Remarks
RS-485 Station No.	<u>1</u> to 31	
RS-485 Baud Rate (bit/s)	4800 / <u>9600</u> / 19200 / 38400 bps	
RS-485 Parity Setting	<u>None</u> / Odd / Even	
RS-485 Data Length	7 / <u>8</u> bits	
RS-485 Stop Bit	<u>1</u> / 2 bits	

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	
X (input)	01H	XW as word device
Y (output)	02H	YW as word device
R (auxiliary relay)	05H	RW as word device
L (link relay)	06H	LW as word device, not available with model2000 and model3000.
W (link register)	07H	Not available with model2000 and model3000
F (file register)	08H	
TN (timer/current value)	09H	Read only, not available with model2000 and model3000
CN (counter/current value)	0AH	Read only, not available with model2000 and model3000
TS (timer/contact)	0BH	Read only, not available with model2000 and model3000
CS (counter/contact)	0CH	Read only, not available with model2000 and model3000

## 16.1.2 T Series / V Series (T Compatible) (Ethernet UDP/IP)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]

Reset to Default	
Communication Setting	
Connection Mode	1:1
Retrials	3
Time-out Time(*10msec)	500
Send Delay Time(*msec)	0
Start Time(*sec)	0
Port No.	10001
Code	DEC
Text Process	LSB->MSB
Comm. Error Handling	Stop
Detail	
Priority	1
System device(\$s) V7 Compatible	None
Target Settings	
Connect To	1:192.0.0.2(PLC)
PLC Table	Setting...
Use Connection Check Device	None

- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

System device(\$s) V7 Compatible	
None	
Target Settings	
Connect To	1:192.0.0.2(PLC)
PLC Table	Setting...
Use Connection Check Device	None

Valid only for 1 : 1 connection  
Select the PLC for connection from those registered on the PLC table.

No.	Port Name	IP Address
0		
1	PLC	192.0.0.2
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		

Set the IP address, port number and whether or not to use the KeepAlive function for the PLC.

## PLC

### T2N/T3H/S2N Series

Configure a program with the PLC. For details, refer to the PLC manual issued by the manufacturer.

#### model 2000/model 3000

Make settings using the PLC tool software.

Item	Setting	Remarks
IP Address Type	CIEMAC_1200 type	
IP Address Primary	Set the IP address of the PLC.	
Subnet Mask Primary	Specify according to the environment.	

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	
X (input)	01H	XW as word device
Y (output)	02H	YW as word device
R (auxiliary relay)	05H	RW as word device
L (link relay)	06H	LW as word device, not available with T2N, model 2000 and model 3000.
W (link register)	07H	Not available with T2N, model 2000 and model 3000
F (file register)	08H	model 2000: V02.00 or later, model 3000: V02.72 or later only
TN (timer/current value)	09H	Read only, not available with model 2000 and model 3000
CN (counter/current value)	0AH	Read only, not available with model 2000 and model 3000
TS (timer/contact)	0BH	Read only, not available with model 2000 and model 3000
CS (counter/contact)	0CH	Read only, not available with model 2000 and model 3000

## 16.1.3 EX Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1</u> : <u>1</u> / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> bps	
Parity	None / <u>Odd</u> / Even	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Target Port No.	0 to 15	For EX200/500: 0 to 7

#### PLC

#### EX100

Make settings by using the switches on the CPU module. The following settings are fixed; data length: 8 bits, and stop bit: 1 bit.

#### Switch

Switch	Setting	Remarks
Communication switch	 LINK: computer link	The settings take effect when the power is turned off and back on again.
Station No.	 0 to F (= 0 to 15)	
Baud Rate	9600 bps (BR2: OFF, BR1: OFF) 4800 bps (BR2: OFF, BR1: ON)	
Parity	 Odd (PEN: ON, PR: OFF) Even (PEN: ON, PR: ON) None (PEN: OFF, PR: OFF/ON)	

**EX250/EX500**

Make settings by using the switches on the CPU module. The following settings are fixed; data length: 8 bits, and stop bit: 1 bit.

**Switch**

Switch	Setting	Remarks
Write enable switch		ON: Write enabled
Station No.		0 to 7
DNT8		SP0 0: EX control command enabled
		SP1 0: Block write command enabled
		SP2 1: ASCII mode
		BR 9600 bps (BR0: 1, BR1: 0, BR2: 0) 4800 bps (BR0: 0, BR1: 1, BR2: 0)
		PEN EVN Odd (PEN: 0, EVN: 1) Even (PEN: 0, EVN: 0) None (PEN: 1, EVN: 0/1)

**EX2000**

Make settings for system information (16. COMPUTER LINK) by using the graphic programmer.

**System information**

(Underlined setting: default)

Item	Setting	Remarks
STATION No.	<u>1</u> to 31	
BAUD RATE	4800 / 9600 bps	
PARITY	0: None 1: Odd 2: Even	
DATA LENGTH	8 bits (fixed)	
STOP BIT	1.0: 1 bits 2.0: 2 bits	

**Available Device Memory**

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	
X (input)	01H	XW as word device
Y (output)	02H	YW as word device
R (auxiliary relay)	03H	RW as word device
Z (link relay)	04H	ZW as word device
TN (timer/current value)	05H	Read only
CN (counter/current value)	06H	Read only

## 16.1.4 nv Series (Ethernet UDP/IP)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]

Reset to Default	
Communication Setting	
Connection Mode	1:1
Retrials	3
Time-out Time(*10msec)	500
Send Delay Time(*msec)	0
Start Time(*sec)	0
Port No.	10001
Code	DEC
Text Process	LSB->MSB
Comm. Error Handling	Stop
Detail	
Priority	1
System device(\$s) V7 Compatible	None
Target Settings	
Connect To	1:192.0.0.2(PLC)
PLC Table	Setting...
Use Connection Check Device	None

- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

System device(\$s) V7 Compatible	
None	
Target Settings	
Connect To	1:192.0.0.2(PLC)
PLC Table	Setting...
Use Connection Check Device	None

Valid only for 1 : 1 connection  
Select the PLC for connection from those registered on the PLC table.

No.	Port Name	IP Address
0		
1	PLC	192.0.0.2
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		

Set the IP address, port number and whether or not to use the KeepAlive function for the PLC.

PLC


EN811/FN812

IP address type

MODE	Switch number	Item	Setting																			
	6	IPF	<table border="1"> <thead> <tr> <th>IPF</th> <th>IPO</th> <th>IP1</th> <th>Contents</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>OFF</td> <td>IP172.16.64.xxx (Class B, least significant byte set by station address)</td> </tr> <tr> <td>OFF</td> <td>OFF</td> <td>ON</td> <td>P192.168.0.xxx (Class C, least significant byte set by station address)</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>ON</td> <td>Set IP address using PLC tool software.</td> </tr> </tbody> </table>				IPF	IPO	IP1	Contents	OFF	OFF	OFF	IP172.16.64.xxx (Class B, least significant byte set by station address)	OFF	OFF	ON	P192.168.0.xxx (Class C, least significant byte set by station address)	ON	ON	ON	Set IP address using PLC tool software.
	IPF	IPO					IP1	Contents														
	OFF	OFF					OFF	IP172.16.64.xxx (Class B, least significant byte set by station address)														
OFF	OFF	ON	P192.168.0.xxx (Class C, least significant byte set by station address)																			
ON	ON	ON	Set IP address using PLC tool software.																			
7	IPO																					
8	IP1																					

Station address (IP address)

Set the least significant byte of the IP address.

STN	Setting
	Setting range: 01 to FE (HEX) Example: To set "100" (64 HEX), set H to 6 and L to 4.

Port No.

Make settings using the PLC tool software. Default: 10000

Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	DW as word device
%IX (input)	01H	%IW as word device
%QX (output)	02H	%QW as word device
S (system register)	0DH	SW as word device
U (user register)	0EH	

\* Specification by variable names is not possible for %I (input), %Q (output), or U (user register). Specify addresses.

PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Computer status readout	1 to 8 (PLC1 to 8)	n	Station number	2
		n+1	Command: 0 (H)	
		n+2	Bit 0 to 3: Run mode Bits 4 to 11: System reserved Bits 12 to 15: Error information	


 Return data: Data stored from PLC to V series

## 16.1.5 Wiring Diagrams


### When Connected at CN1:

#### RS-232C

Wiring diagram 1 - C2

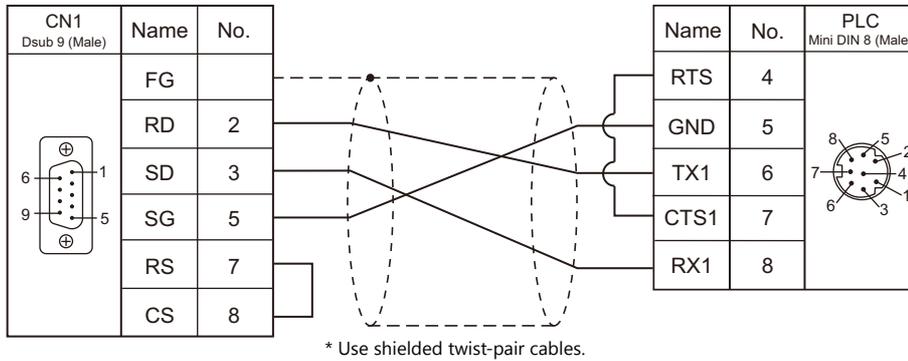


Wiring diagram 2 - C2

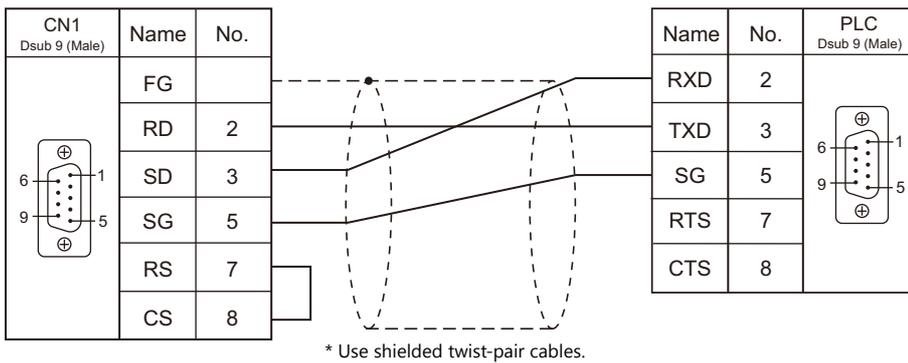


#### RS-422/RS-485


Wiring diagram 1 - C4

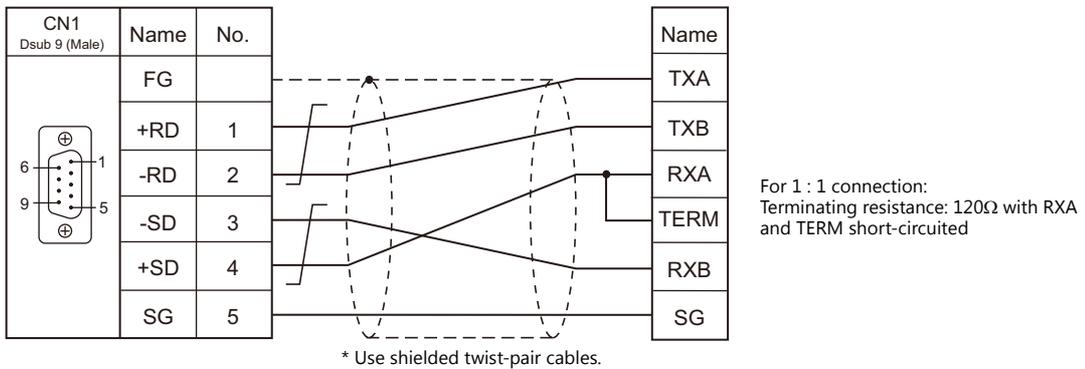

**Wiring diagram 2 - C4**

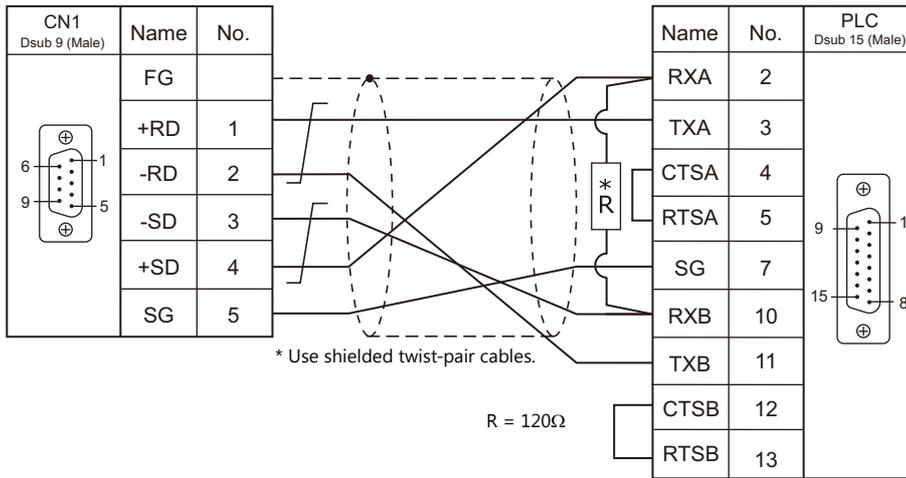


**Wiring diagram 3 - C4**

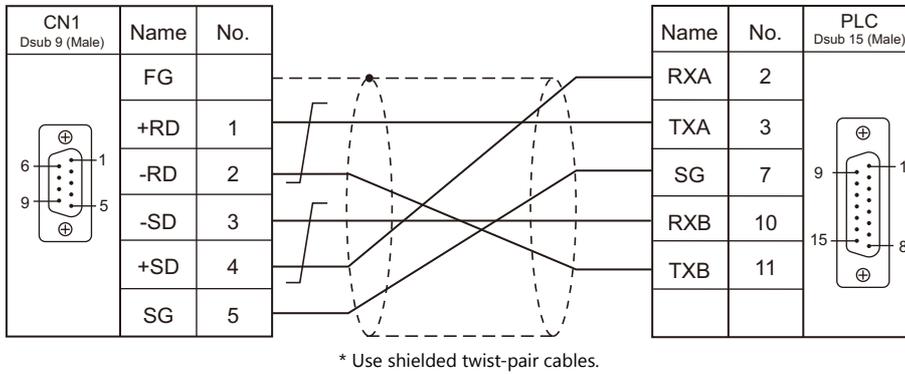


**When Connected at MJ1/MJ2:**

**RS-232C**

**Wiring diagram 1 - M2**

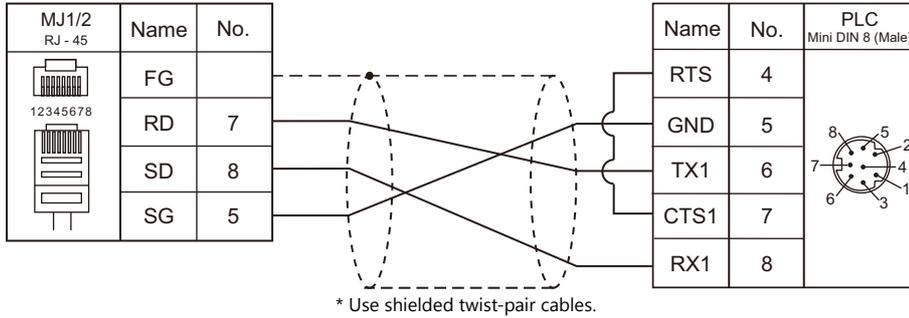


**Wiring diagram 2 - M2**

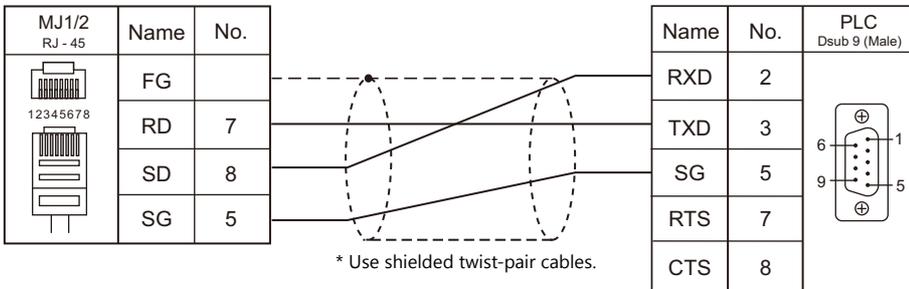


**RS-422/RS-485**


**Wiring diagram 1 - M4**

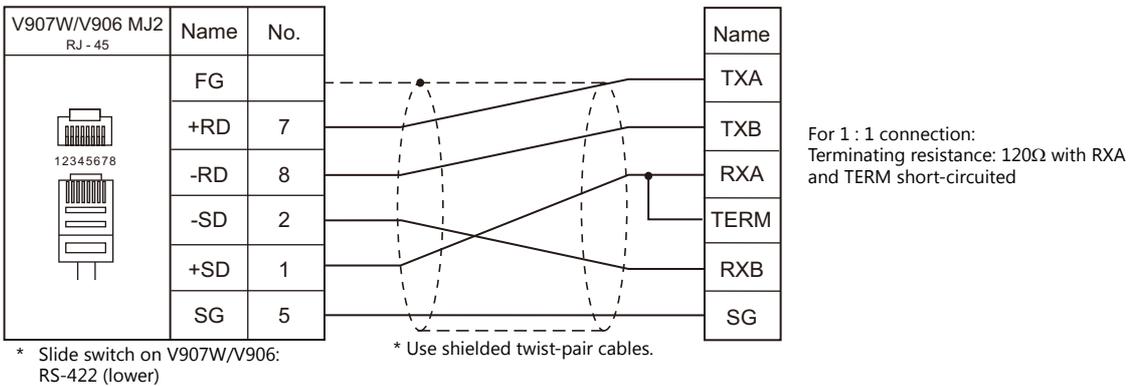

**Wiring diagram 2 - M4**

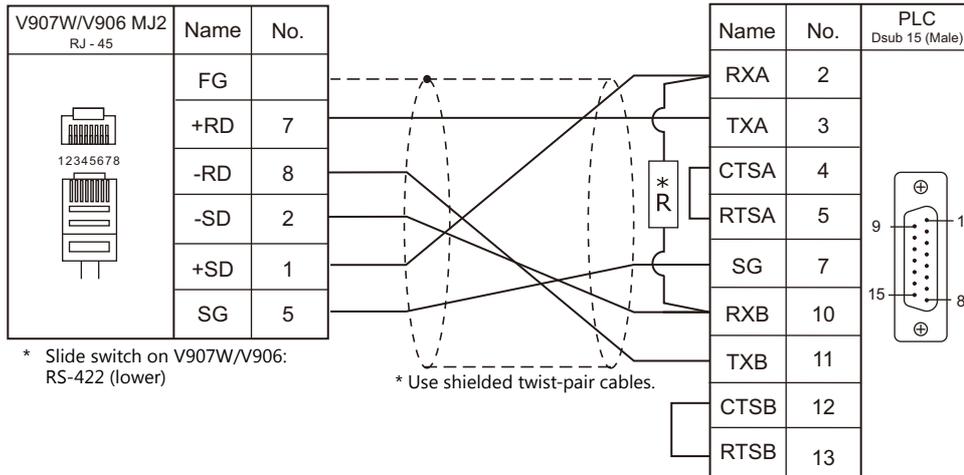

**Wiring diagram 3 - M4**

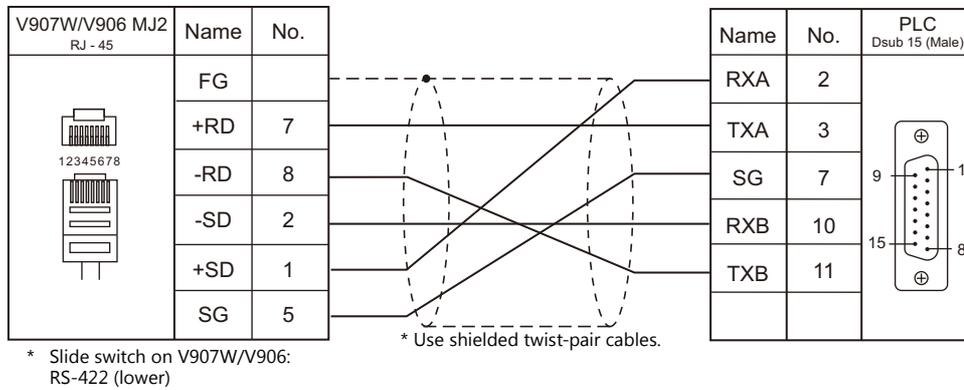

## 16.2 Temperature Controller/Servo/Inverter Connection

### Inverter

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
VF-S7	VF-S7	RS2001Z	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		VFS7.Lst
		RS4001Z	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 4 - M4	
VF-S9	VF-S9	RS2001Z	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		VFS9.Lst
		RS4001Z	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 4 - M4	
VF-S11	VF-S11	RS2001Z	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		VFS11.Lst
		RS20035		Wiring diagram 2 - C2	Wiring diagram 2 - M2		
		RS4001Z	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 4 - M4	
		RS4002Z					
RS4003Z							
VF-S15	VF-S15	RS-485 connector	RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		VFS15.Lst
VF-A7	VF-A7	RS2001Z	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		VFA7.Lst
		RS4001Z	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 4 - M4	
		RS-485 connector	RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4	Wiring diagram 5 - M4	
VF-AS1	VF-AS1	2-wire RS-485 connector	RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		VFAS1.Lst
		4-wire RS-485 connector		Wiring diagram 2 - C4	Wiring diagram 2 - M4	Wiring diagram 5 - M4	
VF-P7	VF-P7	RS2001Z	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		VFP7.Lst
		RS4001Z	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 4 - M4	
		RS-485 connector	RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4	Wiring diagram 5 - M4	
VF-PS1	VF-PS1	2-wire RS-485 connector	RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		VFPS1.Lst
		4-wire RS-485 connector		Wiring diagram 2 - C4	Wiring diagram 2 - M4	Wiring diagram 5 - M4	
VF-FS1	VF-FS1	Communication connector	RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		VFFS1.Lst
VF-MB1	VF-MB1	RS-485 connector	RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		VFMB1.Lst
VF-nC1	VF-nC1	RS2001Z	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		VFnC1.Lst
		RS4001Z	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 4 - M4	
		RS4002Z					
VF-nC3	VF-nC3	RS-485 connector	RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		VFnC3.Lst

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 16.2.1 VF-S7

### Communication Setting

#### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 31	

#### Inverter

##### Communication parameter (group No. 08)

The communication parameters can be set using keys attached to the inverter.

Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Parameter	Indication	Item	Setting	Default
Communication	F800	Baud rate	2: 4800 bps 3: <u>9600 bps</u>	3
	F801	Parity	0: None <u>1: Even</u> 2: Odd	1
	F802	Inverter number (station number)	<u>0</u> to 31	0
	F803	Communication error trip time	<u>0: Inactive</u> 1 to 100 seconds	0

The data length is fixed to "8 bits".

Changes to parameters take effect when the power is turned off and on again.

##### RS4001Z: baud rate and terminating resistance setting switch

Switch	Contents	Setting	Setting Example									
1, 2	Baud rate *	<table border="1"> <thead> <tr> <th></th> <th>4800</th> <th>9600</th> </tr> </thead> <tbody> <tr> <td>SW1</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>SW2</td> <td>ON</td> <td>ON</td> </tr> </tbody> </table>		4800	9600	SW1	OFF	ON	SW2	ON	ON	<p>Baud rate: 9600 bps Terminating resistance: Provided</p>
	4800	9600										
SW1	OFF	ON										
SW2	ON	ON										
3	Terminating resistance on the receiving side	ON: Provided OFF: Not provided										
4	Terminating resistance on the sending side	ON: Provided OFF: Not provided										

\* Set the same baud rate as the one set for the communication parameter "F800" of the inverter.



## 16.2.2 VF-S9

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 31	

#### Inverter

#### Communication parameter (group No. 08)

The communication parameters can be set using keys attached to the inverter.

Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)


Parameter	Indication	Item	Setting	Default
Communication	F800	Baud rate	2: 4800 bps 3: <u>9600 bps</u> 4: 19200 bps	3
	F801	Parity	0: None 1: <u>Even</u> 2: Odd	1
	F802	Inverter number (station number)	<u>0</u> to 31	0
	F803	Communication error trip time	<u>0</u> : Inactive 1 to 100 seconds	0
	F805	Transmission latency setting *	<u>0.00</u> : Normal communication 0.01 to 2.00 seconds	0.00

\* Necessary for the CPU version V110 and later

The data length is fixed to "8 bits".

Changes to parameters take effect when the power is turned off and on again.

#### RS4001Z: baud rate and terminating resistance setting switch

Switch	Contents	Setting	Setting Example									
1, 2	Baud rate *	<table border="1"> <thead> <tr> <th></th> <th>4800</th> <th>9600</th> </tr> </thead> <tbody> <tr> <td>SW1</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>SW2</td> <td>ON</td> <td>ON</td> </tr> </tbody> </table>		4800	9600	SW1	OFF	ON	SW2	ON	ON	 <p>Baud rate: 9600 bps Terminating resistance: Provided</p>
	4800	9600										
SW1	OFF	ON										
SW2	ON	ON										
3	Terminating resistance on the receiving side	ON: Provided OFF: Not provided										
4	Terminating resistance on the sending side	ON: Provided OFF: Not provided										

\* Set the same baud rate as the one set for the communication parameter "F800" of the inverter.



## 16.2.3 VF-S11

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 31	

#### Inverter

#### Communication parameter

The communication parameters can be set using keys attached to the inverter.

Be sure to match the settings to those made under [Communication Setting] of the editor.


(Underlined setting: default)

Parameter	Indication	Item	Setting	Default
Communication	F800	Baud rate	2: 4800 bps <u>3: 9600 bps</u> 4: 19200 bps	3
	F801	Parity	0: None <u>1: Even</u> 2: Odd	1
	F802	Inverter number (station number)	<u>0</u> to 31	0
	F803	Communication error trip time	<u>0: Inactive</u> 1 to 100 seconds	0
	F805	Transmission latency setting	<u>0.00: Normal communication</u> 0.01 to 2.00 seconds	0.00
	F829	Communication protocol selection	<u>0: Toshiba inverter protocol</u>	0

The data length is fixed to "8 bits".


Changes to parameters take effect when the power is turned off and on again.

#### RS4001Z: baud rate and terminating resistance setting switch

Switch	Contents	Setting	Setting Example									
1, 2	Baud rate *	<table border="1"> <thead> <tr> <th></th> <th>4800</th> <th>9600</th> </tr> </thead> <tbody> <tr> <td>SW1</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>SW2</td> <td>ON</td> <td>ON</td> </tr> </tbody> </table>		4800	9600	SW1	OFF	ON	SW2	ON	ON	 <p>Baud rate: 9600 bps Terminating resistance: Provided</p>
	4800	9600										
SW1	OFF	ON										
SW2	ON	ON										
3	Terminating resistance on the receiving side	ON: Provided OFF: Not provided										
4	Terminating resistance on the sending side	ON: Provided OFF: Not provided										

\* Set the same baud rate as the one set for the communication parameter "F800" of the inverter.


**RS4002Z: baud rate and bit length setting (SW1)**

Switch	Contents	Setting	Setting Example																
1 to 3	Baud rate *1	<table border="1"> <tr> <td></td> <td>4800</td> <td>9600</td> <td>19200</td> </tr> <tr> <td>SW1</td> <td>OFF</td> <td>ON</td> <td>OFF</td> </tr> <tr> <td>SW2</td> <td>ON</td> <td>ON</td> <td>OFF</td> </tr> <tr> <td>SW3</td> <td>OFF</td> <td>OFF</td> <td>ON</td> </tr> </table>		4800	9600	19200	SW1	OFF	ON	OFF	SW2	ON	ON	OFF	SW3	OFF	OFF	ON	 <p>Baud rate: 9600 bps Bit length: 12 bits</p>
			4800	9600	19200														
		SW1	OFF	ON	OFF														
		SW2	ON	ON	OFF														
SW3	OFF	OFF	ON																
4	Bit length *2	ON: 11 bits OFF: 12 bits																	



\*1 Set the same baud rate as the one set for the communication parameter "F800" of the inverter.

\*2 When the parity is provided, set 12 bits.

**RS4002Z: wiring system and terminating resistance setting (SW2)**

Switch	Contents	Setting	Setting Example									
1, 2	Wiring system	<table border="1"> <tr> <td></td> <td>4-wire system</td> <td>2-wire system</td> </tr> <tr> <td>SW1</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>SW2</td> <td>OFF</td> <td>ON</td> </tr> </table>		4-wire system	2-wire system	SW1	OFF	ON	SW2	OFF	ON	 <p>Wiring: 4-wire system Terminating resistance: Provided</p>
			4-wire system	2-wire system								
SW1	OFF	ON										
SW2	OFF	ON										
3	Terminating resistance on the receiving side	ON: Provided OFF: Not provided										
4	Terminating resistance on the sending side	ON: Provided OFF: Not provided										

**RS4003Z: wiring system (SW1), terminating resistance (SW2), and inverter number (SW5) setting**

Switch	Contents	Setting	Setting Example
SW1	Wiring system *1	2: 2-wire system 4: 4-wire system	 <p>Wiring: 4-wire system</p>
SW2	R Terminating resistance on the receiving side	S: Terminating resistance provided O: Terminating resistance not provided	 <p>Terminating resistance: Provided</p>
	T Terminating resistance on the sending side	S: Terminating resistance provided O: Terminating resistance not provided	
SW5	Inverter number *2	0 to 15	 <p>Inverter number: 0</p>

\*1 Set the both setting switches in the same positions.

\*2 When "0" is selected, the setting of the inverter's communication parameter "F802" takes effect.

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
--	00H	

Specify the storage device memory address on the [Device Input] dialog.


RAM: Store in RAM

EEPROM: Store in RAM + EEPROM

## Indirect Device Memory Designation

n + 0	15 Model (11 to 18)	8 7 Device type	0
n + 1	Address No.		
n + 2	Expansion code *	Bit designation	
n + 3	00	Station number	

\* Specify the storage device memory address in the expansion code.

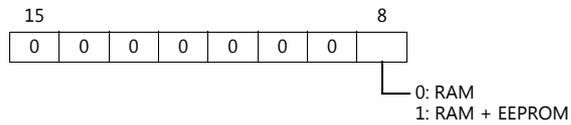



## 16.2.5 VF-A7

### Communication Setting

#### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	Fixed to "1" when 2-wire RS-485 connection is selected and the CPU version is V100 to V305
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 31	

#### Inverter

##### RS-485 Communication Port

##### Communication parameter

The communication parameters can be set using keys attached to the inverter.

Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Parameter	Indication	Item	Setting	Default
Communication	F801	Parity	0: None <u>1: Even</u> 2: Odd	1
	F802	Inverter number (station number)	<u>0</u> to 31	0
	F803	Communication timeout time	<u>0: OFF</u> 1 to 100 seconds	0
	F805	Transmission latency setting *1	<u>0.00: Normal communication</u> 0.01 to 2.00 seconds	0.00
	F820	Baud rate (RS-485 communication port)	2: 4800 bps <u>3: 9600 bps</u> 4: 19200 bps 5: 38400 bps	3
	F821	Wiring system	0: 2-wire system *2 <u>1: 4-wire system</u>	1
	F825	Transmission latency setting *1	<u>0.00: Normal communication</u> 0.01 to 2.00 seconds	0.00

\*1 When the CPU version is V100, make a setting for F805. For any version other than V100, make a setting for F825.

\*2 Not available with the CPU version of V300 or earlier. Use a 4-wire system for connection.

The data length is fixed to "8 bits".

Changes to parameters take effect when the power is turned off and on again.

### Common Serial Communication Port (RS2001Z / RS4001Z)

When the common serial communication port is used, the communication conversion unit "RS2001Z" or "RS4001Z" is necessary.

#### Communication parameter


The communication parameters can be set using keys attached to the inverter.  
Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Parameter	Indication	Item	Setting	Default
Communication	F800	Baud rate (Common serial)	2: 4800 bps <u>3: 9600 bps</u>	3
	F801	Parity	0: None <u>1: Even</u> 2: Odd	1
	F802	Inverter number (station number)	<u>0</u> to 31	0
	F803	Communication timeout time	<u>0: OFF</u> 1 to 100 seconds	0
	F805	Transmission latency setting	<u>0.00: Normal communication</u> 0.01 to 2.00 seconds	0.00

The data length is fixed to "8 bits".  
Changes to parameters take effect when the power is turned off and on again.

#### RS4001Z: baud rate and terminating resistance setting switch

Switch	Contents	Setting	Setting Example									
1, 2	Baud rate *	<table border="1"> <tr> <td></td> <td>4800</td> <td>9600</td> </tr> <tr> <td>SW1</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>SW2</td> <td>ON</td> <td>ON</td> </tr> </table>		4800	9600	SW1	OFF	ON	SW2	ON	ON	 <p>Baud rate: 9600 bps Terminating resistance: Provided</p>
	4800	9600										
SW1	OFF	ON										
SW2	ON	ON										
3	Terminating resistance on the receiving side	ON: Provided OFF: Not provided										
4	Terminating resistance on the sending side	ON: Provided OFF: Not provided										

\* Set the same baud rate as the one set for the communication parameter "F800" of the inverter.

### Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
--	00H	


Specify the storage device memory address on the [Device Input] dialog.

RAM: Store in RAM  
EEPROM: Store in RAM + EEPROM

### Indirect Device Memory Designation

	15	8	7	0
n + 0	Model (11 to 18)		Device type	
n + 1	Address No.			
n + 2	Expansion code *		Bit designation	
n + 3	00		Station number	

\* In the expansion code, specify the storage device memory address, and set which word, higher or lower, is to be read when 2-word address is specified (expansion bit designation).

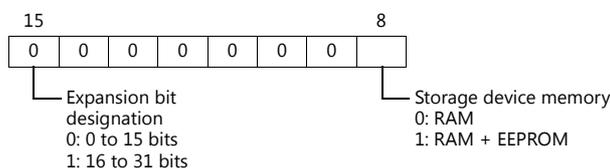

## 16.2.6 VF-AS1

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	9600 / <u>19200</u> / 38400 bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 31	

#### Inverter

#### 2-wire RS-485 Communication Port

#### Communication parameter

The communication parameters can be set using keys attached to the inverter.

Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Parameter	Indication	Item	Setting	Default
Communication	F800	Baud rate (2-wire RS-485)	0: 9600 bps <u>1: 19200 bps</u> 2: 38400 bps	1
	F801	Parity (Common to 2-wire and 4-wire)	0: None <u>1: Even</u> 2: Odd	1
	F802	Inverter number (station number)	<u>0</u> to 31	0
	F803	Communication timeout time (Common to 2-wire and 4-wire)	<u>0: OFF</u> 1 to 100 seconds	0
	F805	Transmission latency setting (2-wire RS-485)	<u>0.00: Normal communication</u> 0.01 to 2.00 seconds	0.00
	F807	Communication protocol selection (2-wire RS-485)	<u>0: Toshiba inverter protocol</u>	0

The data length is fixed to "8 bits".

Changes to parameters take effect when the power is turned off and on again.

## 4-wire RS-485 Communication Port

### Communication parameter

The communication parameters can be set using keys attached to the inverter.  
Be sure to match the settings to those made under [Communication Setting] of the editor.  
(Underlined setting: default)

### RS4001Z: baud rate and terminating resistance setting switch

Parameter	Indication	Item	Setting	Default
Communication	F801	Parity (Common to 2-wire and 4-wire)	0: None <u>1: Even</u> 2: Odd	1
	F802	Inverter number (station number)	0 to 31	0
	F803	Communication timeout time (Common to 2-wire and 4-wire)	<u>0: OFF</u> 1 to 100 seconds	0
	F820	Baud rate (4-wire RS-485)	0: 9600 bps <u>1: 19200 bps</u> 2: 38400 bps	1
	F825	Transmission latency setting (4-wire RS-485)	<u>0.00: Normal communication</u> 0.01 to 2.00 seconds	0.00
	F829	Communication protocol selection (4-wire RS-485)	<u>0: Toshiba inverter protocol</u>	0

The data length is fixed to "8 bits".

Changes to parameters take effect when the power is turned off and on again.

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
--	00H	

Specify the storage device memory address on the [Device Input] dialog.


RAM: Store in RAM

EEPROM: Store in RAM + EEPROM

## Indirect Device Memory Designation

n + 0	15	8 7	0
	Model (11 to 18)	Device type	
n + 1	Address No.		
n + 2	Expansion code *	Bit designation	
n + 3	00	Station number	

\* Specify the storage device memory address in the expansion code.

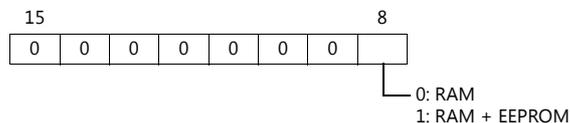

## 16.2.7 VF-P7

Settings are the same as those described in "16.2.5 VF-A7".

## 16.2.8 VF-PS1

Settings are the same as those described in "16.2.6 VF-AS1".



## 16.2.10 VF-MB1

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1:n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	9600 / <u>19200</u> / 38400bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 63	255: Broadcast

#### Inverter

#### Communication parameters

The communication parameters can be set using keys attached to the inverter.  
Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Parameter	Indication	Item	Setting	Default
Communication	F800	Baud rate	3: 9600 bps 4: <u>19200 bps</u> 5: 38400 bps	4
	F801	Parity	0: None <u>1: Even</u> 2: Odd	1
	F802	Inverter number (station number)	0 to 63	0
	F803	Communication timeout detection time	<u>0.0: Inactive</u> 1 to 100.0 seconds	0.0
	F805	Transmission latency setting	<u>0: Off</u> 0.00 to 2.00 seconds	0
	F829	Communication protocol selection	<u>0: Toshiba inverter protocol</u>	0

The data length is fixed to "8 bits".

Changes to parameters take effect when the power is turned off and on again.

### Available Device Memory

The available setting range of device memory varies depending on the connected device. Be sure to set within the range available with the device to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
--	00H	

Specify the storage target device memory address on the [Device Input] dialog.

RAM: Store to RAM.

EEPROM: Store to RAM and EEPROM.

#### Indirect Device Memory Designation

	15	8	7	0
n + 0	Models (11 to 18)		Device type	
n + 1	Address No.			
n + 2	Expansion code *		Bit designation	
n + 3	00		Station number	

\* Specify the storage target device memory address in the expansion code.

15	8
0	0
0	0
0	0
0	0
0	0
0	0
0	0
0	0

0: RAM  
1: RAM+EEPROM

## 16.2.11 VF-nC1

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 31	

#### Inverter

#### Communication parameter

The communication parameters can be set using keys attached to the inverter.

Be sure to match the settings to those made under [Communication Setting] of the editor.


(Underlined setting: default)

Parameter	Indication	Item	Setting	Default
Communication	F800	Baud rate	2: 4800 bps 3: <u>9600 bps</u> 4: 19200 bps	3
	F801	Parity	0: None 1: <u>Even</u> 2: Odd	1
	F802	Inverter number (station number)	<u>0</u> to 31	0
	F803	Communication timeout time	<u>0</u> : OFF 1 to 100 seconds	0

The data length is fixed to "8 bits".


Changes to parameters take effect when the power is turned off and on again.

#### RS4001Z: baud rate and terminating resistance setting switch

Switch	Contents	Setting	Setting Example									
1, 2	Baud rate *	<table border="1"> <thead> <tr> <th></th> <th>4800</th> <th>9600</th> </tr> </thead> <tbody> <tr> <td>SW1</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>SW2</td> <td>ON</td> <td>ON</td> </tr> </tbody> </table>		4800	9600	SW1	OFF	ON	SW2	ON	ON	 <p>Baud rate: 9600 bps Terminating resistance: Provided</p>
	4800	9600										
SW1	OFF	ON										
SW2	ON	ON										
3	Terminating resistance on the receiving side	ON: Provided OFF: Not provided										
4	Terminating resistance on the sending side	ON: Provided OFF: Not provided										

\* Set the same baud rate as the one set for the communication parameter "F800" of the inverter.

#### RS4002Z: baud rate and bit length setting switch

Switch	Contents	Setting	Setting Example																
1 to 3	Baud rate * <sup>1</sup>	<table border="1"> <thead> <tr> <th></th> <th>4800</th> <th>9600</th> <th>19200</th> </tr> </thead> <tbody> <tr> <td>SW1</td> <td>OFF</td> <td>ON</td> <td>OFF</td> </tr> <tr> <td>SW2</td> <td>ON</td> <td>ON</td> <td>OFF</td> </tr> <tr> <td>SW3</td> <td>OFF</td> <td>OFF</td> <td>ON</td> </tr> </tbody> </table>		4800	9600	19200	SW1	OFF	ON	OFF	SW2	ON	ON	OFF	SW3	OFF	OFF	ON	 <p>Baud rate: 9600 bps Bit length: 12 bits</p>
	4800	9600	19200																
SW1	OFF	ON	OFF																
SW2	ON	ON	OFF																
SW3	OFF	OFF	ON																
4	Bit length * <sup>2</sup>	ON: 11 bits OFF: 12 bits																	

\*<sup>1</sup> Set the same baud rate as the one set for the communication parameter "F800" of the inverter.

\*<sup>2</sup> When the parity is provided, set 12 bits.



## 16.2.12 VF-nC3

### Communication Setting

#### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1:n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	9600 / <u>19200</u> / 38400 bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>0</u> to 63	255: Broadcast

#### Inverter

##### Communication parameters

The communication parameters can be set using keys attached to the inverter.

Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Parameter	Indication	Item	Setting	Default
Communication	F800	Baud rate	3: 9600 bps 4: <u>19200 bps</u> 5: 38400 bps	4
	F801	Parity	0: None 1: <u>Even</u> 2: Odd	1
	F802	Inverter number (station number)	<u>0</u> to 63	0
	F803	Communication error timeout time detection	<u>0.0: Inactive</u> 1 to 100.0 seconds	0.0
	F805	Transmission latency setting	<u>0: Off</u> 0.00 to 2.00 seconds	0
	F829	Communication protocol selection	<u>0: Toshiba inverter protocol</u>	0

The data length is fixed to "8 bits".

Changes to parameters take effect when the power is turned off and on again.

### Available Device Memory

The available setting range of device memory varies depending on the connected device. Be sure to set within the range available with the device to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
--	00H	

Specify the storage target device memory address on the [Device Input] dialog.


RAM: Store to RAM.

EEPROM: Store to RAM and EEPROM.

#### Indirect Device Memory Designation

	15	8 7	0
n + 0	Models (11 to 18)		Device type
n + 1	Address No.		
n + 2	Expansion code *		Bit designation
n + 3	00		Station number

\* Specify the storage target device memory address in the expansion code.

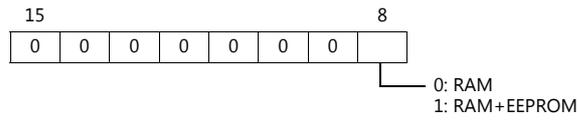


## 16.2.13 Wiring Diagrams


### When Connected at CN1:

#### RS-232C

Wiring diagram 1 - C2

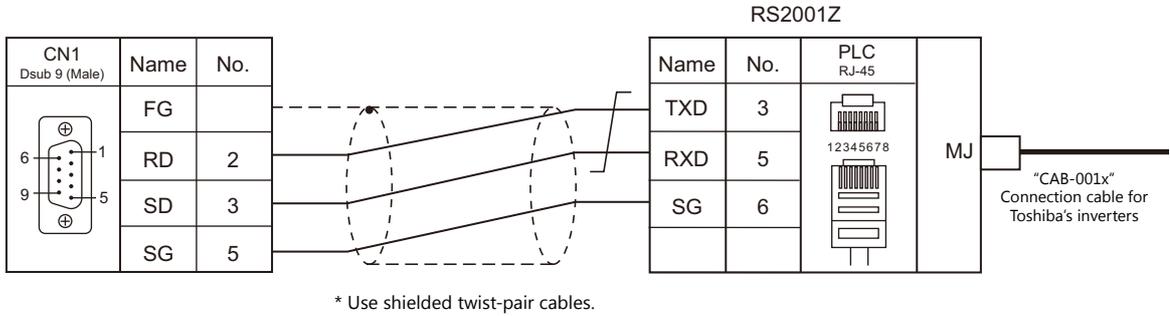


Wiring diagram 2 - C2

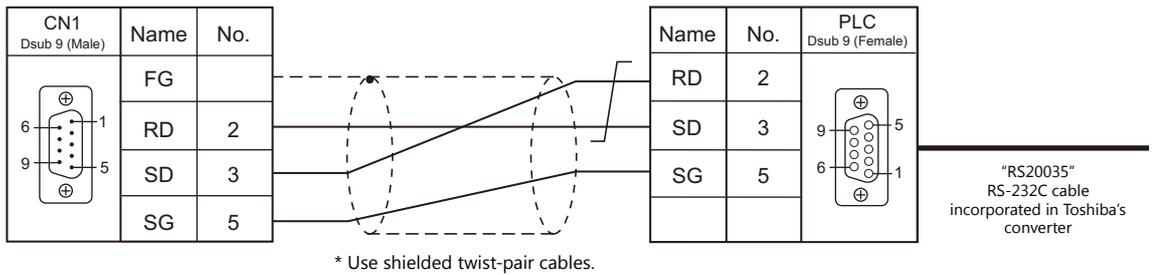


#### RS-422/RS-485


Wiring diagram 1 - C4

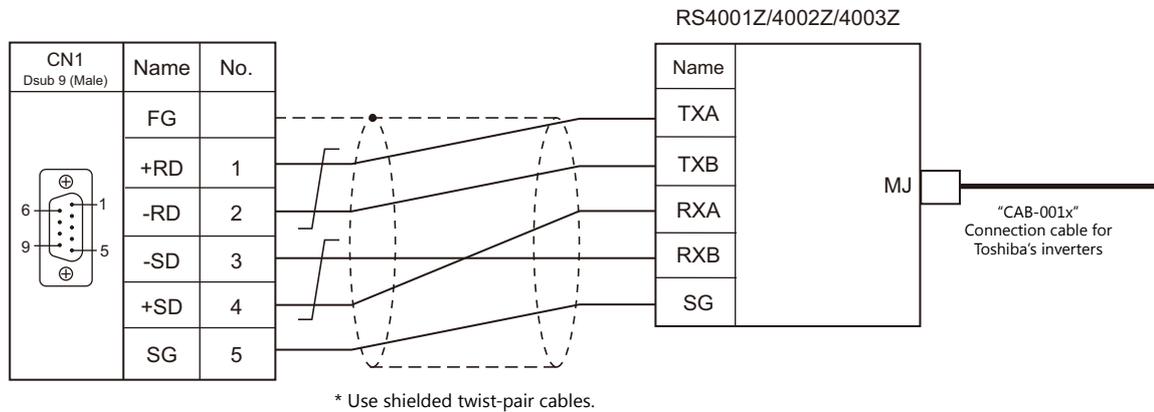

**Wiring diagram 2 - C4**

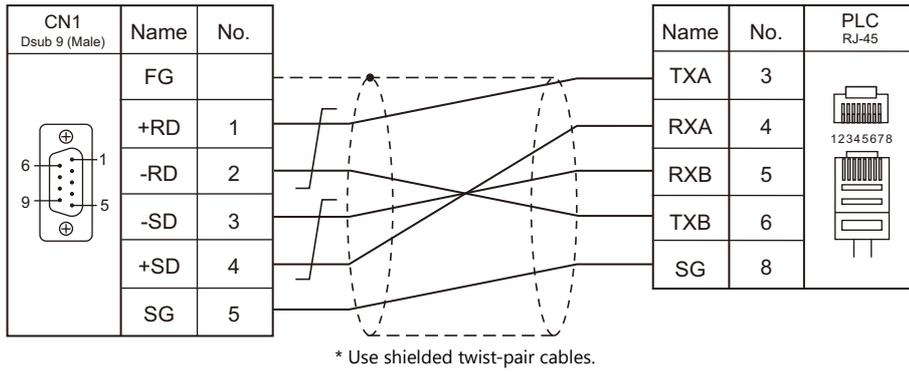


**Wiring diagram 3 - C4**

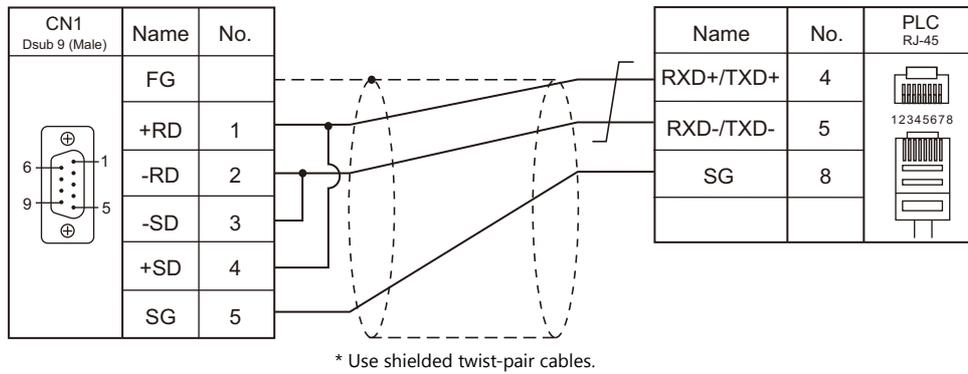


**When Connected at MJ1/MJ2:**

**RS-232C**

**Wiring diagram 1 - M2**

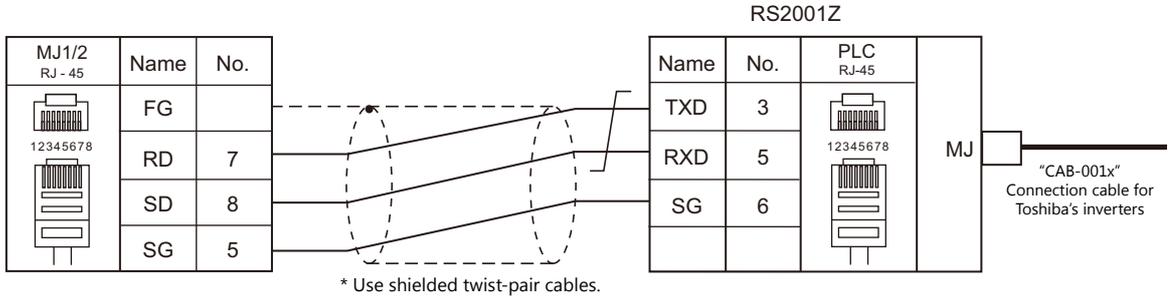


**Wiring diagram 2 - M2**

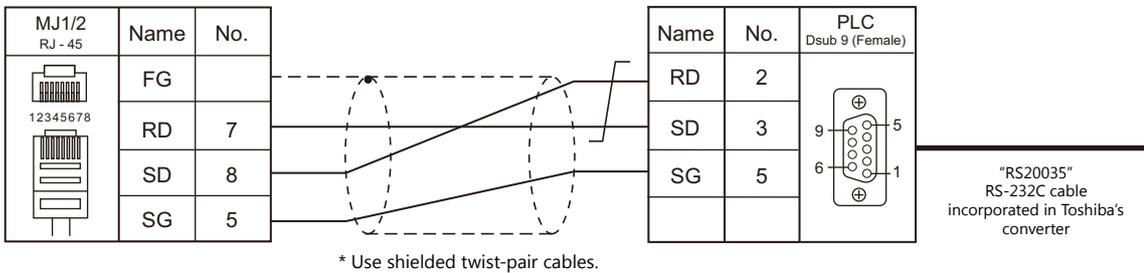


**RS-422/RS-485**


**Wiring diagram 1 - M4**

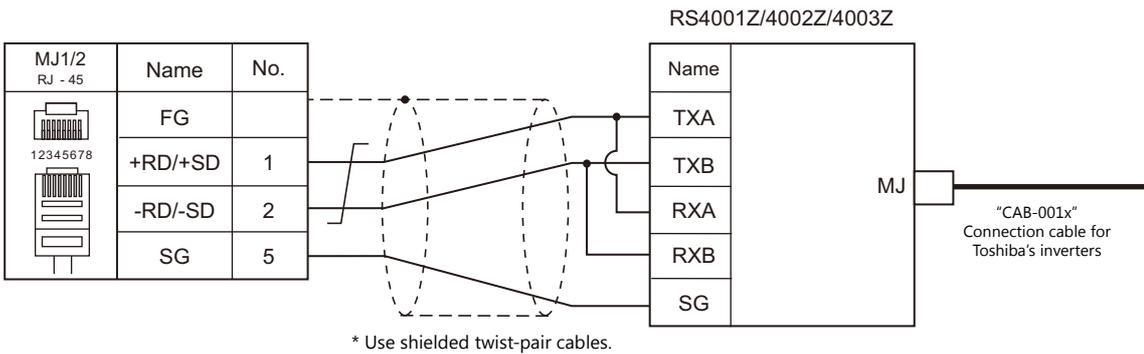


**Wiring diagram 2 - M4**

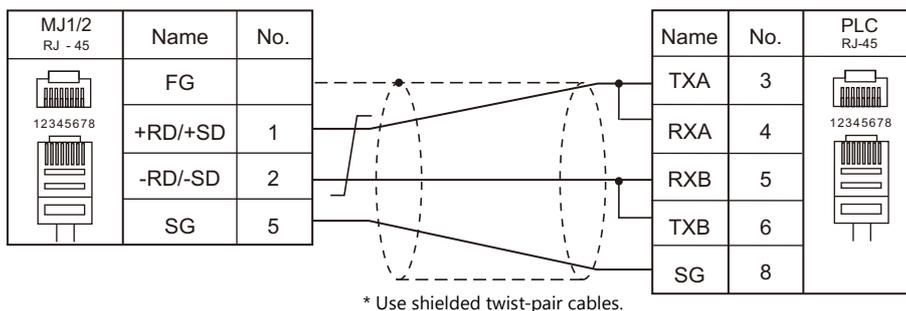


**Wiring diagram 3 - M4**

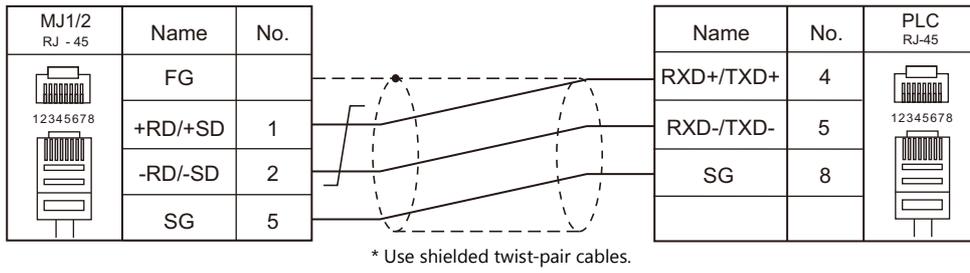

**Wiring diagram 4 - M4**

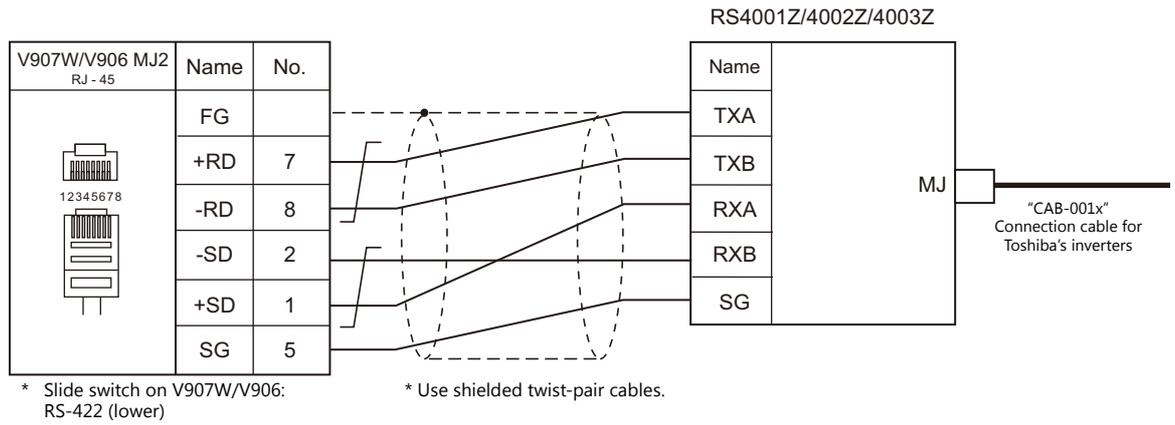


**Wiring diagram 5 - M4**

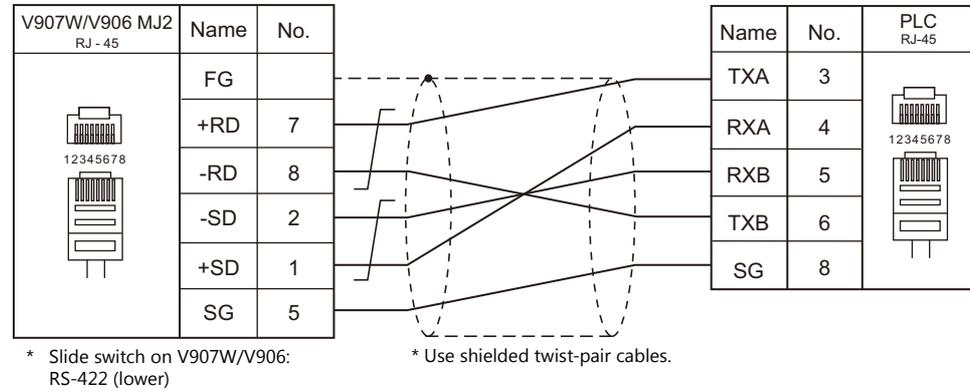

# MEMO

**MONITOUCH**



# 17. TOSHIBA MACHINE

---

17.1 PLC Connection

17.2 Temperature Controller/Servo/Inverter Connection

# 17.1 PLC Connection

## Serial Connection

PLC Selection on the Editor	CPU		Unit/Port		Signal Level	Connection			Ladder Transfer *2
						CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
TC200	TC200	TCCUH	Port of the CPU	RS-232C port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
			TCCMW TCCMO						
	TCCUHS TCCUHSC TCCUHSAC	Port of the CPU	RS-232C port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2			
		TCCMWA TCCMWS TCCMOA TC232CA							
	TCmini	TC3-01	CN16		RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			CN17A CN17B		RS-485 *3	Wiring diagram 1 - C4	Wiring diagram 1 - M4		
		TC3-02	CN18		RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			CN20A CN20B		RS-485 *4	Wiring diagram 2 - C4	Wiring diagram 2 - M4		
		TC5-02	CN18		RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			CN24A CN24B		RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		
		TC5-03	CN13		RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			CN14 CN18		RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4		
		TC8-00	CN13		RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			CN11		RS-485*5	Wiring diagram 4 - C4	Wiring diagram 4 - M4		
		TC9-00	CN11		RS-485	Wiring diagram 3 - C4	Wiring diagram 3 - M4		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*3 CPUs version LT3CU01-D0 or later support RS-485. Check the CPU version.

\*4 CPUs version LT3CU02-F0 or later support RS-485. Check the CPU version.

\*5 CPUs version LT8CU00-A0 or later support RS-485. Check the CPU version.

## 17.1.1 TC200

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	*1
Baud Rate	<u>9600</u> / 19200 / 38400 / 57600 / 115200 bps	
Parity	<u>None</u>	
Data Length	<u>8 bits</u>	
Stop Bit	<u>2 bits</u>	

\*1 For RS-422/485 communications, set a transmission delay time to 4 msec or longer.

#### TC200

#### TCCUH

Make the setting for communication using the ladder tool.

(Underlined setting: default)

Item	Setting	Remarks
Baud Rate	<u>9600</u> / 19200 bps	Set the baud rate in the system flag "A00F" OFF: 9600 bps ON: 19200 bps
Parity	<u>None</u>	
Data Length	<u>8 bits</u>	
Stop Bit	<u>2 bit</u>	
Station Number	<u>1</u>	

#### TCCMW / TCCMO

No particular setting is necessary on the PLC. The PLC always performs communication functions using the following parameters. Be sure to match the settings to those made under [Communication Setting] of the editor.

Item	Setting	Remarks
Baud Rate	<u>9600 bps</u>	
Parity	<u>None</u>	
Data Length	<u>8 bits</u>	
Stop Bit	<u>2 bit</u>	
Station Number	<u>1</u>	

#### Function setting switch (MODE)

Switch	Setting	Remarks
3	ON	Link master station
4	OFF	Link slave station
5	OFF	Remote master station
6	OFF	Remote slave station

When this switch is OFF, communications between V8 and PLC are not possible.

**TCCUHS / TCCUHSC / TCCUHSAC**

Set the communication format in the application software.

(Underlined setting: default)

Item	Setting	Remarks																									
Baud rate	<u>9600</u> / 19200 / 38400 / 57600 / 115200 bps	<table border="1"> <thead> <tr> <th colspan="3">System Flag</th> <th rowspan="2">Baud Rate (bps)</th> </tr> <tr> <th>A00F</th> <th>A154</th> <th>A155</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> <td>0</td> <td>9600</td> </tr> <tr> <td>1</td> <td>0</td> <td>0</td> <td>19200</td> </tr> <tr> <td rowspan="3">-</td> <td>1</td> <td>0</td> <td>38400</td> </tr> <tr> <td>0</td> <td>1</td> <td>57600</td> </tr> <tr> <td>1</td> <td>1</td> <td>115200</td> </tr> </tbody> </table>	System Flag			Baud Rate (bps)	A00F	A154	A155	0	0	0	9600	1	0	0	19200	-	1	0	38400	0	1	57600	1	1	115200
System Flag			Baud Rate (bps)																								
A00F	A154	A155																									
0	0	0	9600																								
1	0	0	19200																								
-	1	0	38400																								
	0	1	57600																								
	1	1	115200																								

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

**TCCMWA / TCCMWS / TCCMOA / TC232CA**

Be sure to match the settings to those made under [Communication Setting] of the editor.

Item	Setting	Remarks
Baud rate	9600 / 19200 / 38400 / 57600 bps	57600 bps not supported by TC232CA

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

**Function setting switches (MODE)**

Switch	ON/OFF	Setting	Remarks
3	ON	Link master station	Communication disabled with this switch set to OFF
4	OFF	Link slave station	
5	OFF	Remote master station	
6	OFF	Remote slave station	

**TCmini****TC3-01****CN16**

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

Because of the baud rate auto-detection feature (4800/9600/19200/38400 bps), no baud rate setting is needed on the PLC.

**CN17A/CN17B**

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

Because of the baud rate auto-detection feature (4800/9600/19200/38400 bps), no baud rate setting is needed on the PLC.

Setting Item	Register	Contents	Setting	Remarks
Software setting	D11F	Mode setting	<b>4: Host communication mode</b>	Setting changes take effect when the power is turned off and on again.

Setting Item	Jumper	Item	Setting
Hardware setting	JP2	Terminating resistance	<b>With terminating resistance</b>
	JP3	Half duplex / full duplex selection	<b>Half duplex</b>
	JP4		
	JP15		
			JP2: Jumper JP3: Jumper JP4: Jumper Jumper across pins 2 and 3 of JP15

**TC3-02****CN18**

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)


Because of the baud rate auto-detection feature (4800/9600/19200/38400 bps), no baud rate setting is needed on the PLC.

**CN20A/CN20B**

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

Because of the baud rate auto-detection feature (4800/9600/19200/38400 bps), no baud rate setting is needed on the PLC.

Setting Item	Register	Contents	Setting	Remarks
Software setting	D26F	Mode setting	<b>4: Host communication mode</b>	Setting changes take effect when the power is turned off and on again.

Setting Item	DIP Switch (SW2)	Contents	Setting
Hardware setting		SW2-1 SW2-2 SW2-3 SW2-4 SW2-7	Half duplex / full duplex selection
		SW2-6	Terminating resistance

**TC5-02****CN18**


Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

Because of the baud rate auto-detection feature (9600/19200/38400 bps), no baud rate setting is needed on the PLC.

**CN24A/CN24B**

Setting Item	Register	Contents	Setting	Remarks
Software setting	D37E	Baud rate setting	0: 9600 bps 1: 19200 bps 2: 38400 bps	Setting changes take effect when the power is turned off and on again.
	D37F	Mode setting	<b>3: Host communication mode</b>	

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

Setting Item	DIP Switch (SW2)	Contents	Setting
Hardware setting		SW2-7	Terminating resistance <b>ON: Provided</b>

**TC5-03****CN13**

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

Because of the baud rate auto-detection feature (9600/19200/38400 bps), no baud rate setting is needed on the PLC.

**CN14/CN18**

Setting Item	Register	Contents	Setting	Remarks
Software setting	D37E	Baud rate setting	0: 9600 bps 1: 19200 bps 2: 38400 bps	Setting changes take effect when the power is turned off and on again.
	D37F	Mode setting	<b>3: Host communication mode</b>	

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

Setting Item	DIP Switch (SW1)	Contents	Setting
Hardware setting		SW1-1 SW1-2 SW1-3 SW1-4 SW1-7	Half duplex / full duplex selection
		SW1-6	Terminating resistance

**TC8-00****CN13**

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)


Because of the baud rate auto-detection feature (9600/19200/38400 bps), no baud rate setting is needed on the PLC.

**CN11**

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)

Because of the baud rate auto-detection feature (9600/19200/38400 bps), no baud rate setting is needed on the PLC.

Setting Item	Register	Contents	Setting	Remarks
Software setting	D37F	Mode setting	<b>8004H: Host communication mode</b>	Setting changes take effect when the power is turned off and on again.

Setting Item	DIP Switch (SW5)	Contents	Setting						
Hardware setting		SW5-1 SW5-2 SW5-3 SW5-4 SW5-5	Half duplex / full duplex selection		SW5-1	SW5-2	SW5-3	SW5-4	SW5-5
		SW5-7	Terminating resistance	<b>ON: Provided</b>					
				<b>Half duplex</b>	<b>OFF</b>	<b>OFF</b>	<b>ON</b>	<b>ON</b>	<b>ON</b>

**TC9-00****CN11**

Setting Item	Register	Contents	Setting	Remarks
Software setting	D12E	Baud rate setting	0: 9600 bps 1: 19200 bps 2: 38400 bps	Setting changes take effect when the power is turned off and on again.
	D12F	Mode setting	<b>0: Host communication mode</b>	

Parity: none, data length: 8 bits, stop bit: 2 bits, station No. 1 (fixed)


**Available Device Memory**

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (universal register 1)	00H	
B (universal register 2)	01H	
X (input relay)	02H	XW as word device
Y (output relay)	03H	YW as word device
R (internal relay)	04H	RW as word device
G (extension internal relay 1)	05H	GW as word device
H (extension internal relay 2)	06H	HW as word device
L (latch relay)	07H	LW as word device
S (shift register)	08H	SW as word device
E (edge relay)	09H	EW as word device
P (timer counter register 1/current value)	0AH	
V (timer counter register 2/set value)	0BH	
T (timer/contact)	0CH	TW as word device
C (counter/contact)	0DH	CW as word device
A (special auxiliary relay)	0EH	AW as word device
U (universal register 3)	0FH	TCCMWA / TCCMWS / TCCMOA / TC232CA only
M (universal register 4)	10H	TCCMWA / TCCMWS / TCCMOA / TC232CA only
Q (universal register 5)	11H	TCCMWA / TCCMWS / TCCMOA / TC232CA only
I (input relay 2)	12H	IW as word device; supported by TCCMWA / TCCMWS / TCCMOA / TC232CA only
O (output relay 2)	13H	OW as word device; supported by TCCMWA / TCCMWS / TCCMOA / TC232CA only
J (extension internal relay 3)	14H	JW as word device; supported by TCCMWA / TCCMWS / TCCMOA / TC232CA only
K (extension internal relay 4)	15H	KW as word device; supported by TCCMWA / TCCMWS / TCCMOA / TC232CA only

### Address denotations

Ex.) F70



### Indirect Device Memory Designation

	15	8	7	0
n+0	Models		Device Type	
n+1	Address No. (word designation)			
n+2	00	Bit designation		
n+3	00	Station number		

#### Address No. (n+1)

- Word device (D, B, V, P, U, M, Q)

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Not used					Rack No.				Module No.			Resister No.			

Ex.) D 052F (Rack No. 5, Module No. 2, Resister No. F)  
 n+1 = 0000 0010 1010 1111(BIN) = 02AF(HEX)

- Bit device (X, Y, R, G, H, L, S, E, T, C, A, I, O, J, K)

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Not used									Rack No.			Module No.			

Ex.) R 0F1A (Rack No. F, Module No. 1, Terminal No. A)  
 n+1 = 0000 0000 0111 1001(BIN) = 0079(HEX)

#### Bit designation (n+2)

- When you use the command of BSET/BCLR/BINV, set the terminal No.


Ex.) R 0F1A (Rack No. F, Module No. 1, terminal No. A)  
 n+2 = 000A(HEX)

## 17.1.2 Wiring Diagrams

### When Connected at CN1:


#### RS-232C

Wiring diagram 1 - C2

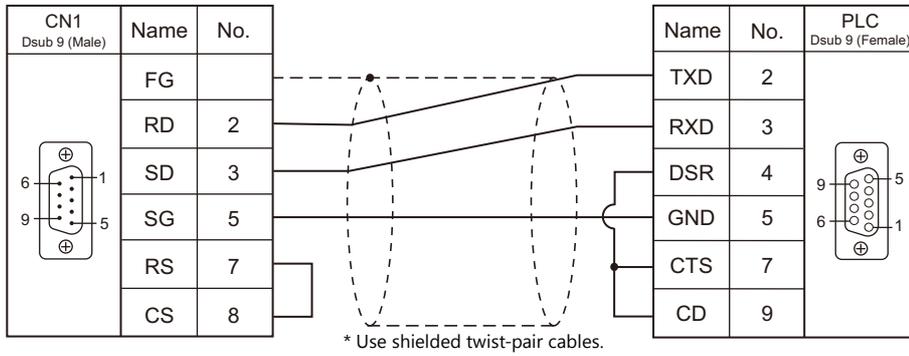


#### RS-422/RS-485


Wiring diagram 1 - C4

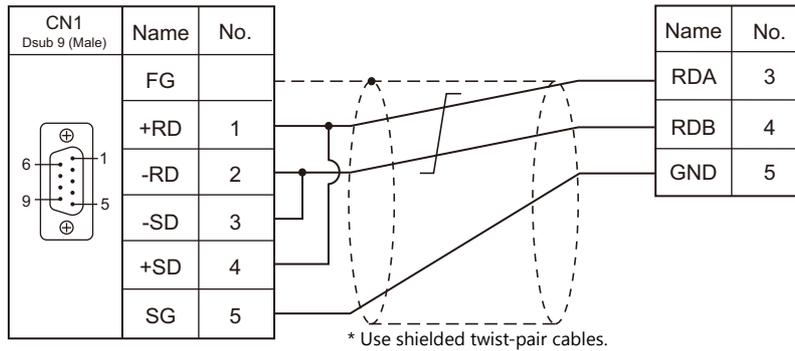


Wiring diagram 2 - C4

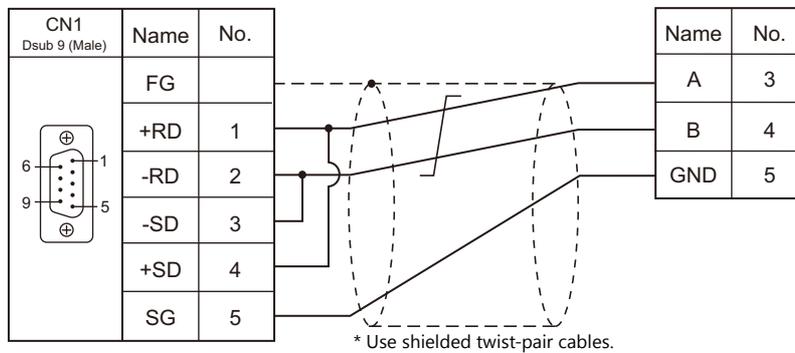

**Wiring diagram 3 - C4**

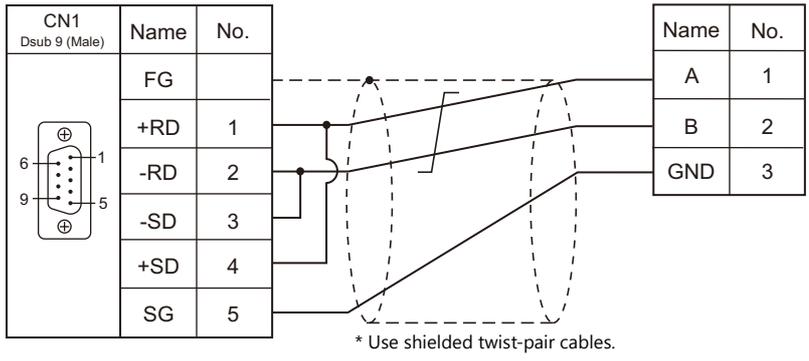


**Wiring diagram 4 - C4**

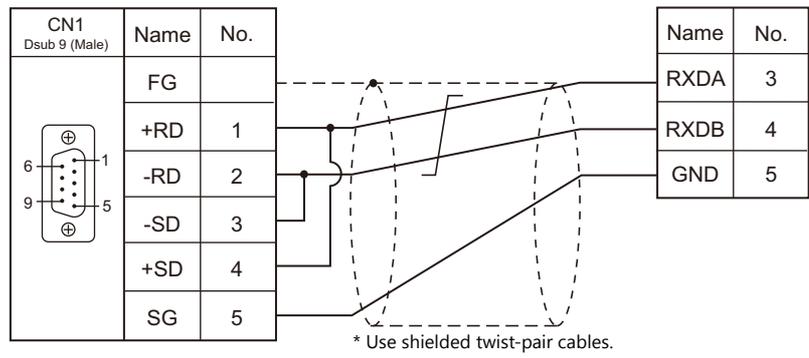

**When Connected at MJ1/MJ2:**


**RS-232C**

**Wiring diagram 1 - M2**

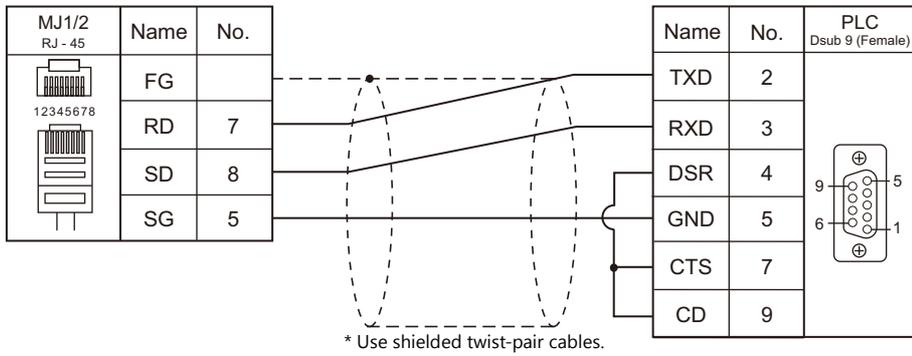


**RS-422/RS-485**


**Wiring diagram 1 - M4**

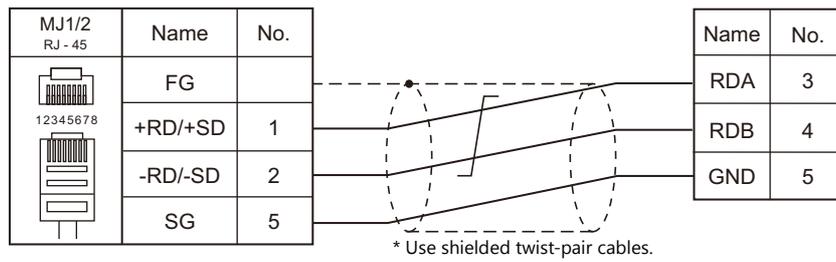


**Wiring diagram 2 - M4**

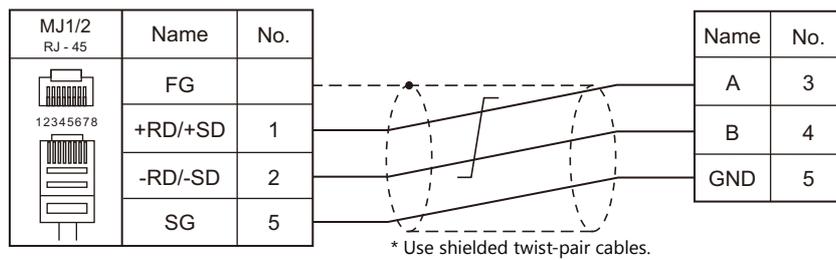

**Wiring diagram 3 - M4**

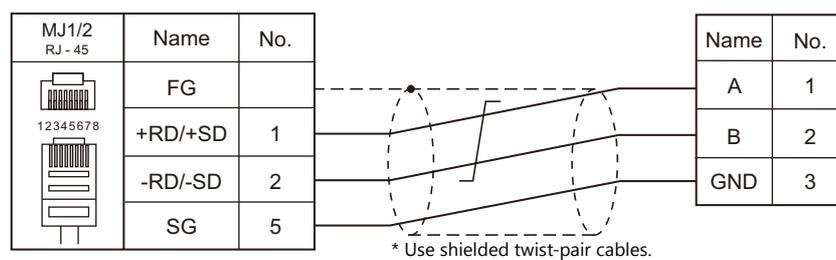

**Wiring diagram 4 - M4**

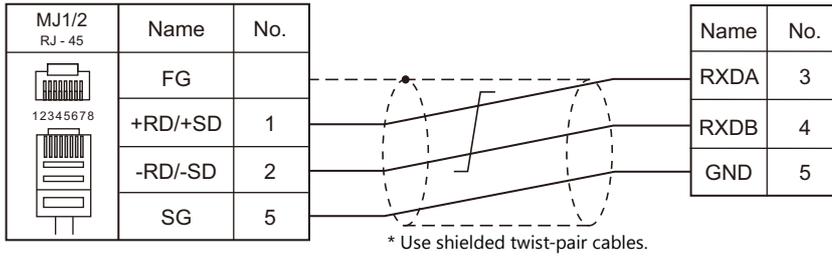

## 17.2 Temperature Controller/Servo/Inverter Connection

### Servo Amplifier

PLC Selection on the Editor	Model		Port	Signal Level	Connection			Lst File
					CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>	
VELCONIC series	NCBOY-80	VLPSX-xxxPx-xRx	CN14	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4	-

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 17.2.1 VELCONIC Series

### Communication Setting

#### Editor

##### Communication setting


(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1</u> : n	
Signal Level	<u>RS-422/485</u>	
Baud Rate	<u>4800</u> / 9600 / 19200 / 38400 / 57600 / 115K bps	
Parity	<u>None</u> / Odd / Even	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	


#### Servo Amplifier

##### Parameter

The communication parameters can be set using keys attached to the servo amplifier. Set the following parameters under [Communication Setting] of the editor.

Parameter	Item	Setting	Remarks
A.n-	Axis number	0 to 63	
PP45	Baud rate setting	<u>0</u> : 4800 bps 1: 9600 bps 2: 19.2k bps 3: 38.4k bps 4: 57.6k bps 6: 115.2k bps	
PP48	RS-485 setting	 Parity <u>0</u> : None 1: Even 2: Odd  Stop bit <u>0</u> : <u>1</u> bit 1: 2 bits	The setting takes effect when the power is turned off and back on again.
UP01	Control mode	<u>23</u> : <u>RS-485 (VLBus-A)</u>	

##### Terminating resistance setting (SW1)

SW1	Item	Setting		
		When one unit is connected	When multiple units are connected	
 SW1-1 SW1-2	Terminating resistance	SW1-1	OFF	ON
		SW1-2	ON	ON

### Available Device Memory

The macro commands "PLC\_CTL" is used for reading and writing data.  
 For more information on the macro command, see "PLC\_CTL" (page 17-13).

**PLC\_CTL**

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)	F2																																
Device memory information designation	1 - 8 (PLC1 - 8)	n	Station number: 0000 to 003F (H)	7																															
		n + 1	Command: 000C (H)																																
		n + 2	Data to write (D1/D0)																																
			<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="8">D1</th> <th colspan="8">D0</th> </tr> <tr> <th>15</th><th>14</th><th>13</th><th>12</th><th>11</th><th>10</th><th>9</th><th>8</th> <th>7</th><th>6</th><th>5</th><th>4</th><th>3</th><th>2</th><th>1</th><th>0</th> </tr> </thead> </table> <p>Bit 0: IN58 : MPGM0 (MPG/step scale factor)                      Bit 1: IN59 : MPGM1 (MPG/step scale factor)                      Bit 2: IN5A : CCD0 (4-step electric current limitation select)                      Bit 3: IN5B : CCD1 (4-step electric current limitation select)                      Bit 4: IN5C : ACSEL0 (4-step acceleration/deceleration time select)                      Bit 5: IN5D : ACSEL1 (4-step acceleration/deceleration time select)                      Bit 6: IN5E : RPAMOD (parameter change mode)                      Bit 7: IN5F : RPASTB (parameter change strobe)                      Bit 8 to 14: IN50 to IN56 : PNCMD0 to PNCMD6 (point command)                      Bit 15: IN57 : -</p>		D1								D0								15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
		D1								D0																									
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																				
n + 3	Data to write (D3/D2)																																		
	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="8">D3</th> <th colspan="8">D2</th> </tr> <tr> <th>15</th><th>14</th><th>13</th><th>12</th><th>11</th><th>10</th><th>9</th><th>8</th> <th>7</th><th>6</th><th>5</th><th>4</th><th>3</th><th>2</th><th>1</th><th>0</th> </tr> </thead> </table> <p>Bit 0 to 5, 8 to 15: IN40 to IN4D : OVR0 to OVR13 (override)                      Bit 6: IN4E : -                      Bit 7: IN4F : DCNT (start signal confirm)</p>	D3								D2								15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0		
D3								D2																											
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																				
n + 4 to n + 5	Data to write (D7/D6/D5/D4)	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>D7</th> <th>D6</th> <th>D5</th> <th>D4</th> </tr> </thead> <tbody> <tr> <td>31 to 24</td> <td>23 to 16</td> <td>15 to 8</td> <td>7 to 0</td> </tr> </tbody> </table> <p>Bit 0 to 31: IN20 to IN3F : PCMD0 to PCMD31 (position command)</p>	D7	D6	D5	D4	31 to 24	23 to 16	15 to 8	7 to 0																									
D7	D6	D5	D4																																
31 to 24	23 to 16	15 to 8	7 to 0																																
n + 6	Data to write (D9/D8)	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="8">D9</th> <th colspan="8">D8</th> </tr> <tr> <th>15</th><th>14</th><th>13</th><th>12</th><th>11</th><th>10</th><th>9</th><th>8</th> <th>7</th><th>6</th><th>5</th><th>4</th><th>3</th><th>2</th><th>1</th><th>0</th> </tr> </thead> </table> <p>Bit 0: IN18 : TEACH (teaching)                      Bit 1: IN19 : MODE0 (operation mode)                      Bit 2: IN1A : MODE1 (operation mode)                      Bit 3: IN1B : CSEL0 (command select)                      Bit 4: IN1C : CSEL1 (command select)                      Bit 5: IN1D : FSEL0 (speed select)                      Bit 6: IN1E : FSEL1 (speed select)                      Bit 7: IN1F : PCLR (current value clear)                      Bit 8: IN10 : RUN (running)                      Bit 9: IN11 : RESET (reset)                      Bit 10: IN12 : START (start)                      Bit 11: IN13 : JOGP (jog +)                      Bit 12: IN14 : JOGM (jog -)                      Bit 13: IN15 : FSTP (temporary stop)                      Bit 14: IN16 : LSSEL (LS positioning select)                      Bit 15: IN17 : ECLR (deviation counter clear)</p>	D9								D8								15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	
D9								D8																											
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																				

Contents	F0	F1 (= \$u n)	F2																																
Device memory information designation	1 - 8 (PLC1 - 8)	<p>n + 7</p> <p>Data to read (D1'/D0') *</p> <table border="1"> <tr> <th colspan="8">D1'</th> <th colspan="8">D0'</th> </tr> <tr> <td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td> <td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> </table> <p>Bit 0 to 7: OUT58 to OUT5F : MIN0 to MIN7 (IN0 to IN7: input monitor)                      Bit 8 to 14: OUT50 to OUT56 : PN0 to PN6 (point number)                      Bit 15: OUT57 : RPAFIN (respond to parameter change)</p>	D1'								D0'								15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	7
		D1'								D0'																									
		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
		<p>n + 8</p> <p>Data to read (D3'/D2') *</p> <table border="1"> <tr> <th colspan="8">D3'</th> <th colspan="8">D2'</th> </tr> <tr> <td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td> <td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> </table> <p>Bit 0 to 15: OUT40 to OUT4F : FEED0 to FEED15 / CURR0 to CURR15 (number of rotations/current)</p>	D3'								D2'								15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	
D3'								D2'																											
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																				
<p>n + 9 to n + 10</p> <p>Data to read (D7'/D6'/D5'/D4') *</p> <table border="1"> <tr> <th>D7'</th> <th>D6'</th> <th>D5'</th> <th>D4'</th> </tr> <tr> <td>31 to 24</td> <td>23 to 16</td> <td>15 to 8</td> <td>7 to 0</td> </tr> </table> <p>Bit 0 to 31: OUT20 to OUT3F : POSI0 to POSI31 (current value)</p>	D7'	D6'	D5'	D4'	31 to 24	23 to 16	15 to 8	7 to 0																											
D7'	D6'	D5'	D4'																																
31 to 24	23 to 16	15 to 8	7 to 0																																
<p>n + 11</p> <p>Data to read (D9'/D8') *</p> <table border="1"> <tr> <th colspan="8">D9'</th> <th colspan="8">D8'</th> </tr> <tr> <td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td> <td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> </table> <p>Bit 0: OUT18 : LSALM (LS error)                      Bit 1: OUT19 : TENBL (teaching enabled)                      Bit 2: OUT1A : BLV (battery voltage drop)                      Bit 3: OUT1B : WARN (warning)                      Bit 4: OUT1C : POK (positioning OK)                      Bit 5: OUT1D : MFEED (rotation monitor)                      Bit 6: OUT1E : MCURR (current monitor)                      Bit 7: OUT1F : SSTOP (stopped due to error)                      Bit 8: OUT10 : SST (servo normal output)                      Bit 9: OUT11 : SRDY (servo ready)                      Bit 10: OUT12 : GRUN (servo locked)                      Bit 11: OUT13 : MZM (home position memorize in progress)                      Bit 12: OUT14 : HOME (stopped at home position)                      Bit 13: OUT15 : DEN (operation finish)                      Bit 14: OUT16 : INP (in position)                      Bit 15: OUT17 : AFSTP / CLA (temporarily stopped/current control in progress)</p>	D9'								D8'								15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0			
D9'								D8'																											
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																				

Return data: Data stored from servo amplifier to V series


\* Data must be written before executing reading of data. Specify control values of the servo amplifier for the device memory address of data to write (n + 2 to n + 6). Then data is stored in the device memory address of data to read (n + 7 to n + 11).

## 17.2.2 Wiring Diagrams

### When Connected at CN1:

#### RS-422/RS-485


Wiring diagram 1 - C4

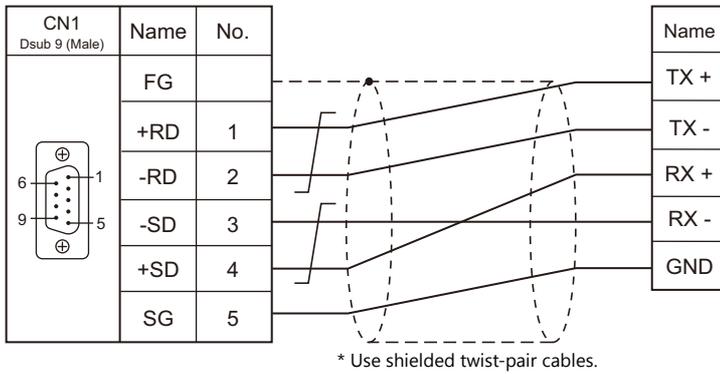


### When Connected at MJ1/MJ2:

#### RS-422/RS-485

Wiring diagram 1 - M4

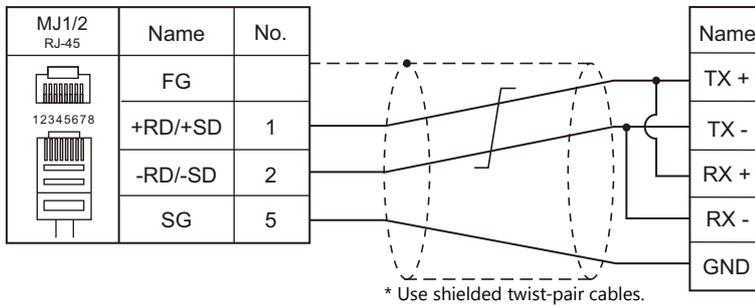


Wiring diagram 2 - M4

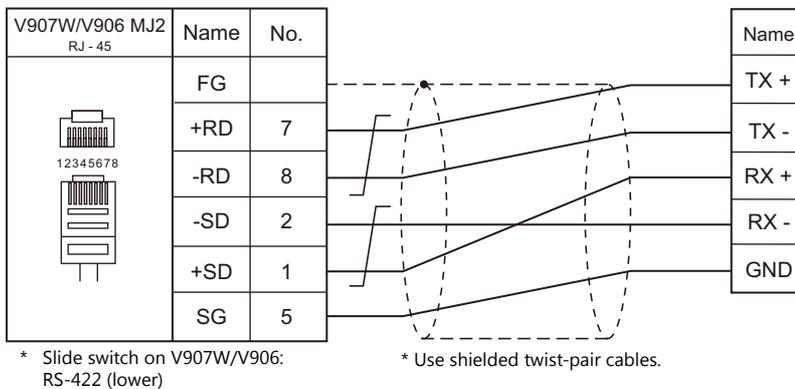

# MEMO

**MONITOUCH**



# 18. TURCK

---

## 18.1 PLC Connection

# 18.1 PLC Connection

## Ethernet Connection

PLC Selection on the Editor	CPU	LAN Port	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>	Lst File
BL Series Distributed I/O (MODBUS TCP/IP)	BL20-GW-EN BL20-PG-EN	10/100 MBit	○	×	502 (Max. 10 units)	○	×	BL_Mod_Eth. Lst
	BL67-GW-EN BL67-PG-EN	ETHERNET						

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

## 18.1.1 BL Series Distributed I/O (MODBUS TCP/IP)

### Communication Setting

#### Editor

##### Communication setting


Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].


#### PLC

Configure the IP address using the rotary switch and "I/O Assistant" ladder software.

##### Rotary switch

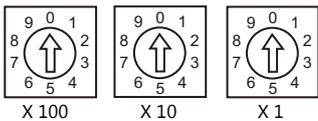SW	Setting	Remarks
IP Address Setting 	000: 192.168.1.254 1 to 254: Specify the least significant byte of the IP address. 500: Specify using I/O Assistant	For 1 to 254, the three high-order bytes enable I/O Assistant settings.

##### Address tool (I/O Assistant)

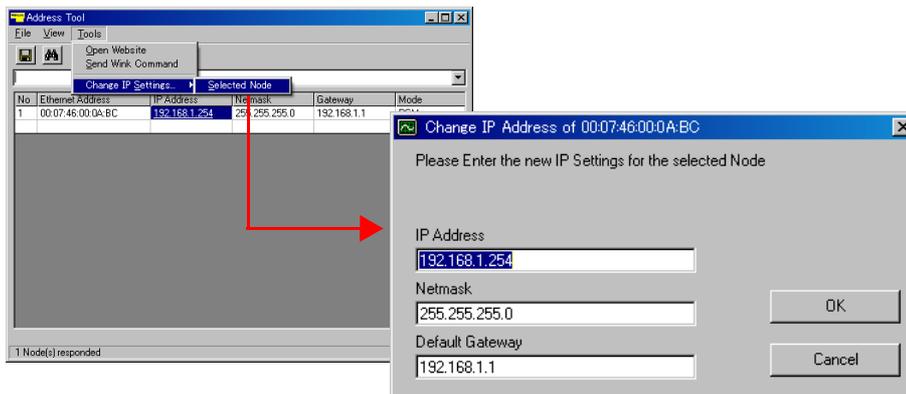

Item	Setting	Remarks
IP Address	Set the IP address of the PLC.	
Netmask	Set the subnet mask of the PLC.	
Default Gateway	Specify according to the environment.	

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
---	02H	

# 19. UNIPULSE

---

## 19.1 Temperature Controller/Servo/Inverter Connection

## 19.1 Temperature Controller/Servo/Inverter Connection

### Digital Indicator

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
F340A	F340A	Option RS-232C interface	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		UP_F340A.Lst
F371	F371	Built-in RS-232C interface	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		UP_F371.Lst
		Option RS-485 interface	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

### Load Cell Indicator

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
F800	F800	Option RS-232C interface	RS-232C	Wiring diagram 1 - C2	Wiring diagram 2 - M2		UP_F800.Lst
		Option RS-485 interface	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4	
F805A	F805A	RS-232C interface	RS-232C	Wiring diagram 1 - C2	Wiring diagram 2 - M2		UP_F805A.Lst
		Option RS-485 interface	RS-485	Wiring diagram 1 - C4	×	Wiring diagram 2 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

### Weighing Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
F720A	F720A	Built-in RS-232C interface	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		UP_F720A.Lst
		Option RS-485 interface	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 19.1.1 F340A

### Communication Setting

#### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 31	

#### Digital Indicator

The communication parameters can be set using keys attached to the digital indicator. Be sure to match the settings to those made under [Communication Setting] of the editor.

##### Setting mode 4

(Underlined setting: default)

Parameter	Item	Setting	Setting Example
Mode 4 / RS-232C <input checked="" type="radio"/> HI <input type="radio"/> OK <input type="radio"/> LOW <input checked="" type="radio"/> PEAK <input type="radio"/> HOLD <input checked="" type="radio"/> Blink <input type="radio"/> Off	Communication mode	<b>0: Communication mode 0 *</b>	02000  Communication mode: 0 Baud rate: 9600 bps Character length: 7 bits Parity bit: Odd Stop bit: 1 bit
	Baud rate	2: 4800 bps <u>3: 9600 bps</u>	
	Character length	<u>0: 7 bits</u> 1: 8 bits	
	Parity bit	0: None <u>1: Odd</u> 2: Even	
	Stop bit	<u>0: 1 bit</u> 1: 2 bits	

\* When establishing a communication with the V series, be sure to select "communication mode 0".

### Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (specified value, status read out)	00H	Double-word, read only
W (setting value)	01H	Double-word, W24 and W34: read only

#### R (Specified Value, Status Read Out)

Address	Name	Remarks									
0	Specified value read out	Read only									
10	Status read out Bit <table border="1" style="display: inline-table; vertical-align: middle;"> <tr> <td>-</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> </table> LO output signal OK output signal HI output signal Hold Stabilized Close-to-zero output signal	-	7	6	5	4	3	2	1	0	Read only
-	7	6	5	4	3	2	1	0			

## W (Setting Value)

Address	Name	Remarks
01	Upper limit	*1
02	Lower limit	*1
03	Comparison between upper limit and lower limit	*1
04	Hysteresis	*1
05	Digital offset	*1
06	Close to zero	*1
11	Digital filter	*1
12	Analog filter	*1
13	MD (stabilized time)	*1
14	MD (stabilized width)	*1
15	Zero tracking (time)	*1
16	Zero tracking (width)	*1
17	Hold mode	*1
18	Automatic print	*1
19	Hold value print	*1
21	LOCK	
22	Minimum scale	*2
23	Display count	*2
24	Applied voltage	Read only
31	BCD data update rate	*1
32	RS-232C	*1
33	D/A zero setting	*1
34	D/A full scale setting	Read only

\*1 Writing is prohibited when the setting value is "LOCK". The setting value "LOCK" is specified in "setting mode 3" of F340A.

\*2 Writing is prohibited when the calibration value is "LOCK". The calibration value "LOCK" is specified in "setting mode 3" of F340A.

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
		n	Station number	
Hold	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 0	
Hold reset	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 1	
Digital zero *1	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 2	
Digital zero reset *1	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 3	
Print command *2	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 4	

\*1 Valid only when "1" is set for the calibration value "LOCK". The calibration value "LOCK" is specified in "setting mode 3" of F340A.

\*2 Outputs a print command to SIF.

## 19.1.2 F371

### Communication Setting

#### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	0 to 31	
CR/LF	CR/LF / <u>CR</u>	

#### Digital Indicator

The communication parameters can be set using keys attached to the digital indicator. Be sure to match the settings to those made under [Communication Setting] of the editor.

##### Built-in RS-232C Interface

##### Communication setting

(Underlined setting: default)

Item	Setting	Setting Example
Communication Mode	<u>Communication mode 0</u> *	Communication mode 0
Baud Rate	4800 / <u>9600</u> / 19200 bps	9600 bps
Character Length	7 / <u>8</u> bits	7 bits
Stop Bit	<u>1</u> / 2 bits	1 bit
Parity Bit	<u>None</u> / Odd / Even	None
Terminator	<u>CR</u> / CR + LF	CR

\* When establishing a communication with the V series, be sure to select "communication mode 0".

##### RS-485 Communication Interface (Option)

##### Option setting

(Underlined setting: default)

Item	Setting	Setting Example
Communication Mode	<u>Communication mode 0</u> *	Communication mode 0
Baud Rate	4800 / <u>9600</u> / 19200 bps	9600 bps
Character Length	7 / <u>8</u> bits	7 bits
Stop Bit	<u>1</u> / 2 bits	1 bit
Parity Bit	<u>None</u> / Odd / Even	None
Terminator	<u>CR</u> / CR + LF	CR
ID	0000 to 9999	0000
Terminating Resistance	With terminating resistance / <u>Without terminating resistance</u>	With terminating resistance
Communication Mode	2-wire / <u>4-wire</u>	2-wire

\* When establishing a communication with the V series, be sure to select "communication mode 0".

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (specified value, status read out)	00H	Double-word, read only
W (setting value)	01H	Double-word
RG (waveform data read out)	02H	Double-word, read only

### R (Specified Value, Status Read Out)

Address	Name	Remarks									
0	Specified value read out	Read only									
10	Status read out Bit <table border="1" style="display: inline-table; vertical-align: middle;"> <tr><td>-</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td></tr> </table> LO output signal OK output signal HI output signal Hold Stabilized Close-to-zero output signal	-	7	6	5	4	3	2	1	0	Read only
-	7	6	5	4	3	2	1	0			
11	Status read out Bit <table border="1" style="display: inline-table; vertical-align: middle;"> <tr><td>-</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td></tr> </table> LL output signal HH output signal -OVER +LOAD -LOAD +OVER	-	7	6	5	4	3	2	1	0	Read only
-	7	6	5	4	3	2	1	0			

### W (Setting Value)

Address	Name	Remarks
11	Higher-higher limit	*1
12	Higher limit	*1
13	Lower limit	*1
14	Lower-lower limit	*1
15	Hysteresis	*1
48	Digital offset setting	*2
16	Close to zero	*1
21	Hold mode	
81	Hold range setting	
22	Hold time	*1
23	Auto start level	*1
24	Minimum count	
25	Local maximum value detection level	
26	Inflection point judgment value	
27	Detection time A	
28	Detection time B	
31	Graph mode	
32	Interval time	
33	Trigger level	*1
34	Level detection mode	*1
1F	Setting CH	
44	Calibration value select	*2
29	Hold point shift amount	

\*1 Writing is prohibited when the setting value is "LOCK". The setting value "LOCK" is specified for "motion setting" of F371.

\*2 Writing is prohibited when the calibration value is "LOCK". The calibration value "LOCK" is specified for "motion setting" of F371.

### RG (Waveform Data Read Out)

Address	Name	Remarks
0	Waveform data 0	Read only
1	Waveform data 1	Read only
:	:	:
199	Waveform data 199	Read only

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Digital zero	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 2	
Digital zero reset	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 3	
Print command *1	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 4	
Waveform hold point data read out *2	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 5	
		n + 2	Data No.	
		n + 3 to n + 4	Data	

 Return data: Data stored from controller to V series

\*1 Outputs a print command to SIF.

\*2 Return data is given when "HOLD" is set to ON on the hold screen of F371 and "START" is selected on the graph screen.

## 19.1.3 F800

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 31	
CR/LF	<u>CR/LF</u> / CR	

#### Load Cell Indicator

The communication parameters can be set using keys attached to the load cell indicator. Be sure to match the settings to those made under [Communication Setting] of the editor.

#### Setting mode 2

(Underlined setting: default)

Parameter	Item	Setting	Setting Example
RS-232C/485 I/F setting 	Baud rate	2: 4800 bps <u>3: 9600 bps</u> 4: 19200 bps 6: 38400 bps	30101  Baud rate: 9600 bps Character length: 7 bits Parity bit: Odd Stop bit: 1 bit Terminator: CR + LF
	Character length	<u>0: 7 bits</u> 1: 8 bits	
	Parity bit	0: None <u>1: Odd</u> 2: Even	
	Stop bit	<u>0: 1 bit</u> 1: 2 bits	
	Terminator	0: CR <u>1: CR + LF</u>	

#### Setting mode 3 (only for RS-485 communication)

(Underlined setting: default)

Parameter	Item	Setting	Setting Example
ID number 	ID *	<u>0000</u> to 9999	0001

\* When multiple units of F800 are connected, the ID number must be set to a value other than "0000".

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (specified value, status read out)	00H	Double-word, read only
W (setting value)	01H	Double-word

### R (Specified Value, Status Read Out)

Address	Name	Remarks
0000	Total weight read out	Read only
0001	Net weight read out	Read only
0002	Tare read out	Read only
0010	Status read out 1 HOLD	Read only
0011	Status read out 1 Zero error	Read only
0012	Status read out 1 Stabilized	Read only
0013	Status read out 1 Taring	Read only
0014	Status read out 1 Total weight display / net weight display	Read only
0015	Status read out 1 LOCK / terminal at rear	Read only
0020	Status read out 2 Bulk supply	Read only
0021	Status read out 2 Medium supply	Read only
0022	Status read out 2 Fine supply	Read only
0023	Status read out 2 Insufficient	Read only
0024	Status read out 2 Correct amount	Read only
0025	Status read out 2 Excessive amount	Read only
0026	Status read out 2 Finish	Read only
0030	Status read out 3 Close to zero	Read only
0031	Status read out 3 Lower limit	Read only
0032	Status read out 3 Upper limit	Read only
0033	Status read out 3 Discharge	Read only
0040	Status read out 4 Weight error	Read only
0041	Status read out 4 Error	Read only
0042	Status read out 4 Operation mode	Read only
0043	Status read out 4 Weight value overflow	Read only
0044	Status read out 4 Calibration error	Read only
0045	Status read out 4 Sequence error	Read only
0050	Cumulative count read out	Read only
0051	Cumulative value read out	Read only

### W (Setting Value)

Address	Name	Remarks
00	Code No.	
10	Bulk supply	*1
11	Below the preset amount	*1
12	Preset amount	*1
13	Excessive amount	*1
14	Insufficient	*1
15	Gap	*1
16	Automatic gap control value	*1, *2
17	Offset supply time	*1, *2
20	Timer	*2
21	Comparison prohibit time	*2
22	Upper limit	*2
23	Lower limit	*2
24	Close to zero	
25	Taring setting	
26	AZ count	*2
27	Judgment count	*2
28	Discharge time	*2
29	Weighing start time	

Address	Name	Remarks
30	Sequence mode	*2
31	Weighing function 1	*2
32	Weighing function 2	*2
33	Weighing function 3	*2
34	Function key prohibited	*2
35	Filter	*2
36	Motion detection	*2
37	Zero tracking	*2
40	Weight value	*2
41	Maximum weighing value	*2
42	Minimum scale	*2
43	Net weight excessive	*2
44	Total weight excessive	*2
45	Function select	*2
46	Gravitational acceleration offset	*2
50	Maximum weight	*1, read only
51	Minimum weight	*1, read only
52	Maximum - minimum	*1, read only
53	Average weight	*1, read only
54	Population standard deviation	*1, read only
55	Sample standard deviation	*1, read only

\*1 Set for each code.

\*2 Writing is prohibited when "LOCK" is set.

"LOCK" can be set by short-circuiting the LOCK terminal on the terminal block at the rear of F800. For more information, refer to the instruction manual of F800.

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Zero calibration *1	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 0	
		n + 2	Error result	
Span calibration *1	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 1	
		n + 2	Error result	
Switching to total weight display *2	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 2	
Switching to net weight display *2	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 3	
Taring	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 4	
Taring reset	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 5	
Digital zero	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 6	
Digital zero reset	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 7	
Totalize command	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 8	
Cumulative data clear	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 9	
Cumulative data all clear	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 10	
Cumulative data read out	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 11	
		n + 2	Code No.	
		n + 3 - n + 4	Weighing value	
Weighing data read out	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 12	
		n + 2	Code No.	
		n + 3 - n + 4	Weighing value	

Contents	F0	F1 (= \$u n)		F2
Time-out change *3	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 13	
		n + 2	Time-out value (ms)	

 Return data: Data stored from controller to V series

- \*1 Calibration is performed based on the value at W40, W41 and W42.  
Since a response is given after completion of the calibration on F800, it takes time before the receipt of a response after the calibration command is executed. Before executing the calibration command, execute the time-out change command.
- \*2 The display cannot be changed when "1: external input mode" is set for "total weight/net weight display change" of extended function 1 in setting mode 4 of F800.
- \*3 Used to change the time-out time of V9 to apply when the PLC\_CTL command is used. It takes time before a response is sent back after the calibration command is executed. Set a time-out time according to your use environment. The default value is "0", and the time set for [Time-out Time] under [Communication Setting] in the [PLC Properties] dialog is applied.

## 19.1.4 F805A

### Communication Setting

#### Editor

##### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 31	
CR/LF	<u>CR/LF</u> / CR	

#### Load Cell Indicator

The communication parameters can be set using keys attached to the load cell indicator. Be sure to match the settings to those made under [Communication Setting] of the editor.

##### Built-in RS-232C Interface

##### Communication setting

(Underlined setting: default)

Setting Items	Setting	Remarks
Baud rate selection	4800 / <u>9600</u> / 19200 bps	
Character length	<u>7</u> / 8 bits	
Parity bit	None / <u>Odd</u> / Even	
Stop bit	<u>1</u> / 2 bits	
Terminator	CR / <u>CR + LF</u>	

##### RS-485 Communication Interface (Option)

##### Setting mode 4

(Underlined setting: default)

Item	Setting	Remarks
Baud rate	4800 / <u>9600</u> / 19200 bps	
Character length	<u>7</u> / 8 bits	
Parity bit	None / <u>Odd</u> / Even	
Stop bit	<u>1</u> / 2 bits	
Terminator	CR / <u>CR + LF</u>	
ID *	<u>0</u> - 99	

\* When multiple units of F805A are connected, the ID number must be set to a value other than "0".

##### Rt switch

Rt switch	OFF	ON	Remarks
Rt ON  OFF	Terminating resistance OFF	Terminating resistance ON	

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (specified value / status read out)	00H	Double-word, read only
W (setting value)	01H	Double-word

### R (Specified Value / Status Read Out)

Address	Name	Remarks
0000	Total weight read out	Read only
0001	Net weight read out	Read only
0002	Tare read out	Read only
0010	Status read out 1 Hold	Read only
0011	Status read out 1 Zero error	Read only
0012	Status read out 1 Stabilized	Read only
0013	Status read out 1 Taring	Read only
0014	Status read out 1 Weight display	Read only
0015	Status read out 1 LOCK / terminal at rear	Read only
0016	Status read out 1 LOCK (soft)	Read only
0020	Status read out 2 Bulk supply	Read only
0021	Status read out 2 Medium supply	Read only
0022	Status read out 2 Fine supply	Read only
0023	Status read out 2 Insufficient	Read only
0024	Status read out 2 Correct amount	Read only
0025	Status read out 2 Excessive amount	Read only
0026	Status read out 2 Finish	Read only
0030	Status read out 3 Close to zero	Read only
0031	Status read out 3 Lower limit	Read only
0032	Status read out 3 Upper limit	Read only
0033	Status read out 3 Discharge	Read only
0034	Status read out 3 Total final	Read only
0040	Status read out 4 Weight error	Read only
0041	Status read out 4 Error	Read only
0042	Status read out 4 Operation mode	Read only
0043	Status read out 4 Weight value overflow	Read only
0044	Status read out 4 Calibration error	Read only
0045	Status read out 4 Sequence error	Read only
0050	Cumulative count read out	Read only
0051	Cumulative value read out	Read only

### W (Setting Value)

Address	Name	Remarks
0000	Code No.	*1
0100	Bulk supply	*1
0110	Below the preset amount	*1
0120	Preset amount	*1
0130	Excessive amount	*1
0140	Insufficient	*1
0150	Gap	*1
0160	Automatic gap control value	*1, *2
0170	Offset supply time	*1, *2
0180	Total comparison selection	*1
0190	Total final	*1
01A0	Total times	*1
0200	With or without upper and lower limit comparison	*2
0210	Comparison between upper limit and lower limit	*2
0220	Upper limit	*2
0230	Lower limit	*2
0240	With or without close to zero comparison	*2

Address	Name	Remarks
0250	Close to zero	*2
0260	With or without comparison between excess and insufficient	*2
0270	Comparison between excess and insufficient mode	*2
0280	Completion signal output mode	*2
0290	Completion output time	*2
02A0	Judgment time	*2
02B0	Comparison prohibit time	*2
02C0	Cut-out control mode	*2
02D0	Automatic gap correction factor	*2
02E0	With or without automatic gap correction	*2
02F0	Average times for automatic gap correction	*2
0300	Display count	*2
0310	Digital filter	*2
0320	Analog filter	*2
0330	Stabilized time filter	*2
0331	MD mode	*2
0340	MD time	*2
0350	MD width	*2
0360	ZT time	*2
0370	ZT width	*2
0380	DZ control value	*2
0400	Sequence mode	*2
0401	Near zero check at start	*2
0402	Weight value check at start	*2
0403	With or without offset supply	*2
0404	Discharge gate control	*2
0410	Judgment count	*2
0420	AZ count	*2
0430	Discharge time	*2
0440	START/STOP key prohibit	*2
0500	Digital taring	*2
0501	G/N display switch	*2
0502	Sign for discharge control	*2
0503	TARE/DZ key prohibit	*2
0504	GROSS/NET key prohibit	*2
0510	Taring setting	*2
0520	Automatic totalize command	*2
0530	Weighing code specification	*2
0540	Setting code specification	*2
0550	Setting per code key prohibit	*2
0600	Weight value	*3
0610	Maximum weighing value	*3
0620	Minimum scale	*3
0630	Net weight excessive	*2
0640	Total weight excessive	*2
0650	Decimal place	*3
0660	Unit setting	*2
0670	1/4 memory	*2
0680	Gravitational acceleration offset	*2
0690	Applied voltage	*3
0700	Graphic mode	*2
0710	Trigger level	*2
0720	X (time) axis end point	*2
0730	Y (weight) axis start point	*2
0740	Z (weight) axis end point	*2
0800	Average weight	Read only
0810	Maximum weight	Read only
0820	Minimum weight	Read only
0830	Population standard deviation	Read only
0840	Sample standard deviation	Read only
0850	Maximum - minimum	Read only
0900	LOCK (soft)	
0910	Language	*2

Address	Name	Remarks
0920	System speed	*2
0930	Backlight ON	*2
0940	Backlight OFF	*2
0A00	Totalize command	*2
0A01	One-touch taring	*2
0A02	Taring range	*2
0A03	Taring display	*2
0A04	Digital taring expansion	*2
0A10	SIFII ID	*2
0A20	Overscale display	*2
0B00	D/A output mode	*2
0B10	D/A zero output	*2
0B20	D/A full scale	*2
0B60	Data update rate	*2
0B70	D/A output ch	*2

\*1 Specify for each code.

\*2 Writing is prohibited when "LOCK (soft)" is set.

\*3 Writing is prohibited when "LOCK (soft, hard)" is set.

### Address denotations

The address denotation of the device memory W is shown below.



## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Descriptions	F0	F1 (= \$u n)		F2
Zero calibration	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 0	
		n + 2	Error result	
Span calibration	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 1	
		n + 2	Error result	
Display change total weight	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 2	
Display change net weight	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 3	
Taring	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 4	
Taring reset	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 5	
Digital zero	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 6	
Digital zero reset	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 7	
Totalize command	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 8	
Cumulative data clear	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 9	
Cumulative data all clear	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 10	
Cumulative data read out	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 11	
		n + 2	Code No.	
		n + 3 - n + 4	Weighing value	

Descriptions	F0	F1 (= \$u n)		F2
Weighing data read out	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 12	
		n + 2	Code No.	
		n + 3 - n + 4	Weighing value	
Time-out change *1	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 13	
		n + 2	Time-out value (ms)	
Backlight ON	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 14	

 Return data: Data stored from controller to V series

\*1 Used to change the time-out time of the V9 to apply when the PLC\_CTL command is used. It takes time before a response is sent back after the calibration command is executed. Set a time-out time according to your use environment. The default value is "0", and the value varies according to the time set for [Time-out Time] under [Communication Setting] in the [PLC Properties] dialog.

## 19.1.5 F720A

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 bps	
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 31	
CR/LF	<u>CR/LF</u> / CR	


#### Weighing Controller

The communication parameters can be set using keys attached to the weighing controller. Be sure to match the settings to those made under [Communication Setting] of the editor.

#### Built-in RS-232C Interface

#### Setting mode 4



(Underlined setting: default)

Parameter	Item	Setting	Setting Example
RS-232C I/F setting 	Baud rate	2: 4800 bps <u>3: 9600 bps</u> 4: 19200 bps 5: 38400 bps	30101  Baud rate: 9600 bps Character length: 7 bits Parity bit: Odd Stop bit: 1 bit Communication mode: Communication mode 0 (CR + LF)
	Character length	<u>0: 7 bits</u> 1: 8 bits	
	Parity bit	0: None <u>1: Odd</u> 2: Even	
	Stop bit	<u>0: 1 bit</u> 1: 2 bits	
	Communication mode	0: Communication mode 0 (CR) <u>1: Communication mode 0 (CR + LF)</u>	

## RS-485 Communication Interface (Option)


### Setting mode 4

(Underlined setting: default)

Parameter	Item	Setting	Setting Example
RS-485 I/F setting 	Baud rate	2: 4800 bps <u>3: 9600 bps</u> 4: 19200 bps 5: 38400 bps	30101  Baud rate: 9600 bps Character length: 7 bits Parity bit: Odd Stop bit: 1 bit Terminator: CR + LF
	Character length	<u>0: 7 bits</u> 1: 8 bits	
	Parity bit	0: None <u>1: Odd</u> 2: Even	
	Stop bit	<u>0: 1 bit</u> 1: 2 bits	
	Terminator	0: CR <u>1: CR + LF</u>	
ID setting 	ID *	<u>0000</u> to 9999	0001

\* When multiple units of F720A are connected, the ID number must be set to a value other than "0000".

### Rt switch

Rt switch	OFF	ON	Remarks
	Terminating resistance OFF	Terminating resistance ON	

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
R (specified value, status read out)	00H	Double-word, read only
W (setting value)	01H	Double-word

### R (Specified Value, Status Read Out)

Address	Name	Remarks
0000	Total weight read out	Read only
0001	Net weight read out	Read only
0002	Tare read out	Read only
0010	Status read out 1 Hold	Read only
0011	Status read out 1 Zero error	Read only
0012	Status read out 1 Stabilized	Read only
0013	Status read out 1 Taring	Read only
0014	Status read out 1 Weight display	Read only
0015	Status read out 1 Rear terminal LOCK	Read only
0020	Status read out 2 Bulk supply	Read only
0021	Status read out 2 Medium supply	Read only
0022	Status read out 2 Fine supply	Read only
0023	Status read out 2 Insufficient	Read only
0024	Status read out 2 Correct amount	Read only
0025	Status read out 2 Excessive amount	Read only
0026	Status read out 2 Finish	Read only
0030	Status read out 3 Close to zero	Read only

Address	Name	Remarks
0031	Status read out 3 Lower limit	Read only
0032	Status read out 3 Upper limit	Read only
0040	Status read out 4 Weight error	Read only
0041	Status read out 4 Error	Read only
0042	Status read out 4 Operation mode	Read only
0043	Status read out 4 Weight value overflow	Read only
0044	Status read out 4 Calibration error	Read only
0045	Status read out 4 Sequence error	Read only
0050	Cumulative count read out	Read only
0051	Cumulative value read out	Read only

## W (Setting Value)

Address	Name	Remarks
10	Bulk supply	*1
11	Below the preset amount	*1
12	Preset amount	*1
13	Excessive amount	*1
14	Insufficient	*1
15	Gap	*1
16	Automatic gap control value	*2
17	Offset supply time	*2
20	Judgment time	*2
21	Comparison prohibit time	*2
22	Upper limit	*1
23	Lower limit	*1
24	Close to zero	*1
25	Taring setting	*1
26	AZ count	*2
27	Judgment count	*2
28	Completion output time	*2
30	Sequence mode	*2
31	Weighing function 1	*2
32	Weighing function 2	*2
33	Weighing function 3	*2
34	Function key prohibited	*2
35	Analog filter	*2
36	Digital filter	*2
37	Motion detection	*2
38	Zero tracking time	*2
39	Zero tracking width	*2
3A	Setting LOCK	
40	Weight value	*2, *3
41	Maximum weighing value	*2, *3
42	Minimum scale	*2, *3
43	Net weight excessive	*2, *3
44	Total weight excessive	*2, *3
45	Function select	*2
46	Gravitational acceleration offset (area number input)	*2
47	DZ control value	*2, *3
48	Gravitational acceleration offset (acceleration input)	*2
50	Extended function select 1	*2
51	Taring function limitation	*2
52	D/A output mode	*2
53	D/A zero output setting	*2
54	D/A full scale	*2
55	Input select	*2
56	Output select	*2
80	Average weight	Read only
81	Maximum	Read only
82	Minimum	Read only
83	Population standard deviation	Read only

Address	Name	Remarks
84	Sample standard deviation	Read only
85	Maximum - minimum	Read only
86	Cumulative count	Read only
87	Latest cumulative data	Read only

- \*1 Writing is prohibited when LOCK1 is ON. "LOCK1" can be set at "setting value LOCK" in setting mode 4 of F720A.  
 \*2 Writing is prohibited when LOCK2 is ON. "LOCK2" can be set at "setting value LOCK" in setting mode 4 of F720A.  
 \*3 Writing is prohibited when the LOCK switch is set in the ON position. The LOCK switch is provided at the rear of F720A.

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Zero calibration *1	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 0	
		n + 2	Error result	
Span calibration *1	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 1	
		n + 2	Error result	
Switching to total weight display *2	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 2	
Switching to net weight display *2	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 3	
Taring	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 4	
Taring reset	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 5	
Digital zero	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 6	
Digital zero reset	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 7	
Totalize command	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 8	
Cumulative data clear	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 9	
Cumulative data read out	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 11	
		n + 2	Fixed value 00	
		n + 3 - n + 4	Weighing value	
Time-out change *3	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 13	
		n + 2	Time-out value (ms)	

 Return data: Data stored from controller to V series


- \*1 Calibration is performed based on the value at W40, W41 and W42.  
 Since a response is given after completion of the calibration on F720A, it takes time before the receipt of a response after the calibration command is executed. Before executing the calibration command, execute the time-out change command.  
 \*2 The display cannot be changed when "1: external input mode" is set for "total weight/net weight display change" of extended function 1 in setting mode 4 of F720A.  
 \*3 Used to change the time-out time of V9 to apply when the PLC\_CTL command is used. It takes time before a response is sent back after the calibration command is executed. Set a time-out time according to your use environment. The default value is "0", and the value varies according to the time set for [Time-out Time] under [Communication Setting] in the [PLC Properties] dialog.

### 19.1.6 Wiring Diagrams


#### When Connected at CN1:

#### RS-232C


Wiring diagram 1 - C2

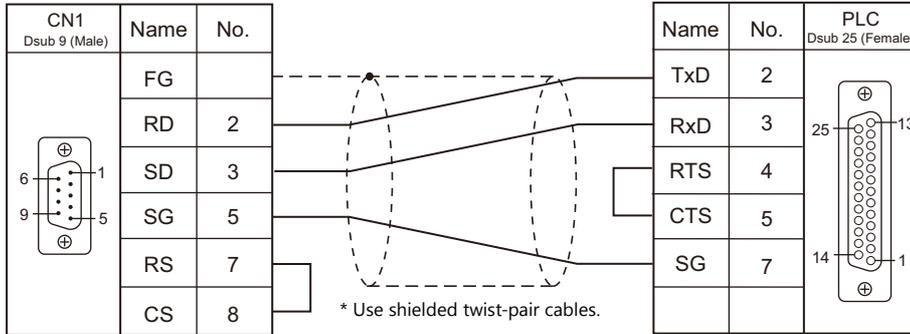

Wiring diagram 2 - C2

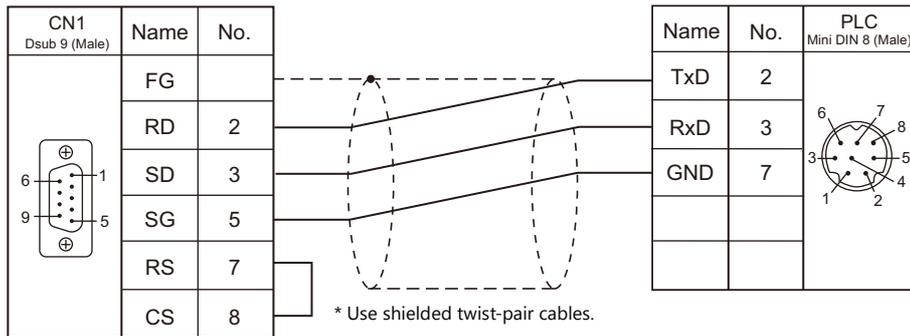


Wiring diagram 3 - C2

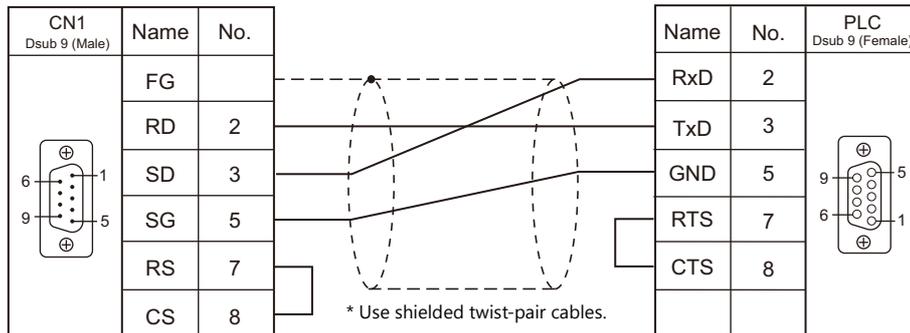

RS-485


Wiring diagram 1 - C4

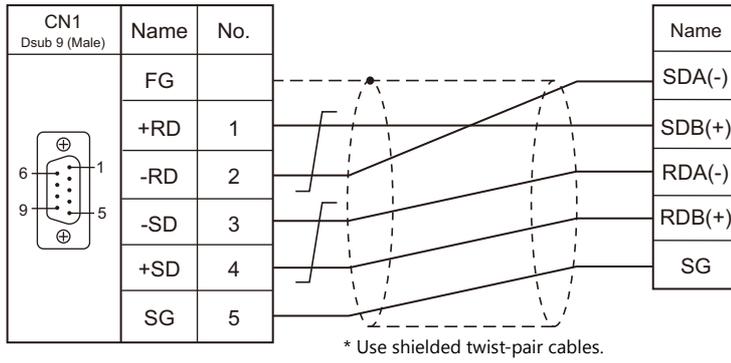


When Connected at MJ1/MJ2:

RS-232C


Wiring diagram 1 - M2

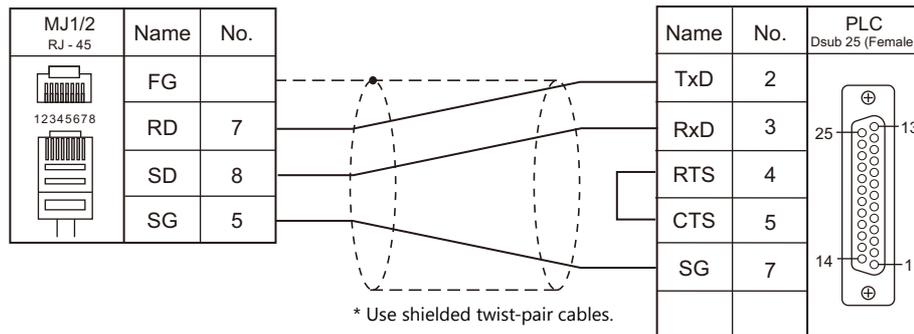

Wiring diagram 2 - M2

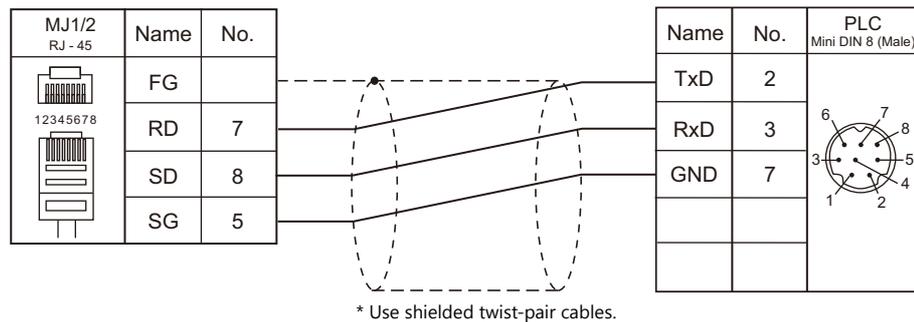


**Wiring diagram 3 - M2**

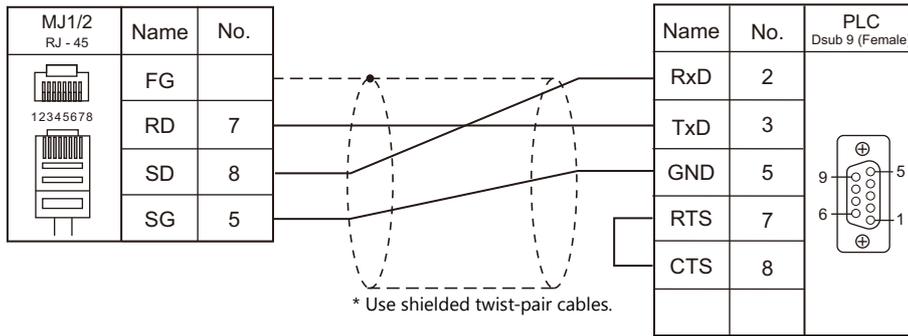


**RS-485**

**Wiring diagram 1 - M4**

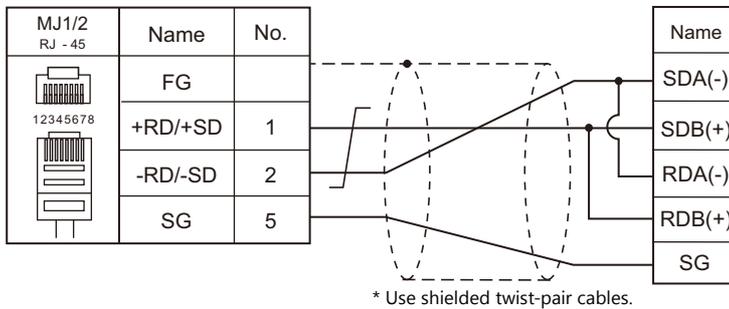

**Wiring diagram 2 - M4**

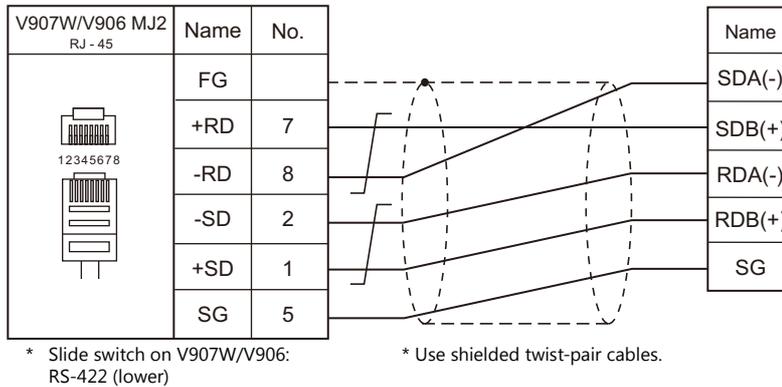

# 20. UNITRONICS

---

20.1 PLC Connection

## 20.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	PLC	Port	Signal Level	Connection			Ladder Transfer <sup>*2</sup>
				CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906	
M90/M91/ Vision Series (ASCII)	M90	COM1	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
	M91 V130 V350-35-R2	COM1	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		
	V230 V260 V280 V290 V530	COM1	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
		COM2	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
				RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	
	V120 V290-19-C30BT/40BT V560 V570 V1040 V1210	COM1/COM2	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

### Ethernet Connection

PLC Selection on the Editor	Model	Unit	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>
Vision Series (ASCII Ethernet TCP/IP)	V230 V260 V280 V290 V530 V560 V570 V1040 V1210	V200-19-ET1	○	×	0 to 65535 (Default: 20256) (Max. 4 units)	○	×
	V130 V350	V100-17-ET2					
	V1040 V1210	Built-in Ethernet port					

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

## 20.1.1 M90/M91/Vision Series (ASCII)

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / Multi-link2 / Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / 19200 / 38400 / <u>57600</u> / 115K bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	0 to 31	Specify "0" for RS-422/485 communication. On the PLC side, specify a number from "64" to "127".

#### PLC

#### Parameter

Parameters must be set in Information Mode or by creating a ladder program using the software "VisiLogic". For more information, refer to the instruction manual issued by UNITRONICS.

When using RS-485 communication, be sure to create the ladder program.

#### M91

#### RS232/RS485 Jumper Setting


(Underlined setting: default)

Jumper Setting	Item	Setting	Remarks									
	No. 1 No. 2	Signal level	<table border="1"> <thead> <tr> <th></th> <th>No. 1</th> <th>No. 2</th> </tr> </thead> <tbody> <tr> <td><u>RS232</u></td> <td>A</td> <td>A</td> </tr> <tr> <td>RS485</td> <td>B</td> <td>B</td> </tr> </tbody> </table>		No. 1	No. 2	<u>RS232</u>	A	A	RS485	B	B
		No. 1	No. 2									
<u>RS232</u>	A	A										
RS485	B	B										
No. 3 No. 4	RS485 terminating resistance	<table border="1"> <thead> <tr> <th></th> <th>No. 3</th> <th>No. 4</th> </tr> </thead> <tbody> <tr> <td><u>Provided</u></td> <td>A</td> <td>A</td> </tr> <tr> <td>Not provided</td> <td>B</td> <td>B</td> </tr> </tbody> </table>		No. 3	No. 4	<u>Provided</u>	A	A	Not provided	B	B	
	No. 3	No. 4										
<u>Provided</u>	A	A										
Not provided	B	B										

#### V130 / V350-35-R2


#### RS232 to RS485 Jumper Setting

(Underlined setting: default)

Jumper Setting	Item	Setting	Remarks									
	COMM	Signal level	<table border="1"> <thead> <tr> <th></th> <th>232</th> <th>232</th> </tr> </thead> <tbody> <tr> <td><u>RS232</u></td> <td>232</td> <td>232</td> </tr> <tr> <td>RS485</td> <td>485</td> <td>485</td> </tr> </tbody> </table>		232	232	<u>RS232</u>	232	232	RS485	485	485
	232	232										
<u>RS232</u>	232	232										
RS485	485	485										
	TERM	RS485 terminating resistance	<table border="1"> <thead> <tr> <th></th> <th>ON</th> <th>ON</th> </tr> </thead> <tbody> <tr> <td><u>Provided</u></td> <td>ON</td> <td>ON</td> </tr> <tr> <td>Not provided</td> <td>OFF</td> <td>OFF</td> </tr> </tbody> </table>		ON	ON	<u>Provided</u>	ON	ON	Not provided	OFF	OFF
	ON	ON										
<u>Provided</u>	ON	ON										
Not provided	OFF	OFF										

**V230 / V260 / V280 / V290 / V530****RS232/RS485 Jumper Setting**

(Underlined setting: default)

Jumper Setting	Item	Setting	Remarks																				
	No. 1 No. 2 No. 3 No. 4	Signal level/ RS485 terminating resistance	<table border="1"> <thead> <tr> <th></th> <th>No. 1</th> <th>No. 2</th> <th>No. 3</th> <th>No. 4</th> </tr> </thead> <tbody> <tr> <td><u>RS232</u></td> <td>A</td> <td>A</td> <td>A</td> <td>A</td> </tr> <tr> <td>RS485</td> <td>B</td> <td>B</td> <td>B</td> <td>B</td> </tr> <tr> <td>RS485 With resistance</td> <td>A</td> <td>A</td> <td>B</td> <td>B</td> </tr> </tbody> </table>		No. 1	No. 2	No. 3	No. 4	<u>RS232</u>	A	A	A	A	RS485	B	B	B	B	RS485 With resistance	A	A	B	B
				No. 1	No. 2	No. 3	No. 4																
			<u>RS232</u>	A	A	A	A																
			RS485	B	B	B	B																
RS485 With resistance	A	A	B	B																			


**V120****RS232/RS485 Jumper Setting**

(Underlined setting: default)

Jumper Setting	Item	Setting	Remarks									
	No. 1 No. 2	<table border="1"> <thead> <tr> <th></th> <th>No. 1</th> <th>No. 2</th> </tr> </thead> <tbody> <tr> <td><u>RS232</u></td> <td>A</td> <td>A</td> </tr> <tr> <td>RS485</td> <td>B</td> <td>B</td> </tr> </tbody> </table>		No. 1	No. 2	<u>RS232</u>	A	A	RS485	B	B	
	No. 1	No. 2										
<u>RS232</u>	A	A										
RS485	B	B										
	No. 3 No. 4	<table border="1"> <thead> <tr> <th></th> <th>No. 3</th> <th>No. 4</th> </tr> </thead> <tbody> <tr> <td><u>Provided</u></td> <td>A</td> <td>A</td> </tr> <tr> <td>Not provided</td> <td>B</td> <td>B</td> </tr> </tbody> </table>		No. 3	No. 4	<u>Provided</u>	A	A	Not provided	B	B	
	No. 3	No. 4										
<u>Provided</u>	A	A										
Not provided	B	B										
	No. 5 No. 6	<table border="1"> <thead> <tr> <th></th> <th>No. 5</th> <th>No. 6</th> </tr> </thead> <tbody> <tr> <td><u>RS232</u></td> <td>A</td> <td>A</td> </tr> <tr> <td>RS485</td> <td>B</td> <td>B</td> </tr> </tbody> </table>		No. 5	No. 6	<u>RS232</u>	A	A	RS485	B	B	
	No. 5	No. 6										
<u>RS232</u>	A	A										
RS485	B	B										
	No. 7 No. 8	<table border="1"> <thead> <tr> <th></th> <th>No. 7</th> <th>No. 8</th> </tr> </thead> <tbody> <tr> <td><u>Provided</u></td> <td>A</td> <td>A</td> </tr> <tr> <td>Not provided</td> <td>B</td> <td>B</td> </tr> </tbody> </table>		No. 7	No. 8	<u>Provided</u>	A	A	Not provided	B	B	
	No. 7	No. 8										
<u>Provided</u>	A	A										
Not provided	B	B										

**V290-19-C30B/V290-19-T40B/V560/V570/V1040/V1210****RS232/RS485 DIP Switch Settings**

(Underlined setting: default)

Dip SW	Item	Setting	Remarks																												
	Signal level RS485 terminating resistance	<table border="1"> <thead> <tr> <th></th> <th>No. 1</th> <th>No. 2</th> <th>No. 3</th> <th>No. 4</th> <th>No. 5</th> <th>No. 6</th> </tr> </thead> <tbody> <tr> <td><u>RS232</u></td> <td>ON</td> <td>ON</td> <td>ON</td> <td>OFF</td> <td>ON</td> <td>OFF</td> </tr> <tr> <td>RS485</td> <td>OFF</td> <td>OFF</td> <td>OFF</td> <td>ON</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>RS485 With resistance</td> <td>ON</td> <td>ON</td> <td>OFF</td> <td>ON</td> <td>OFF</td> <td>ON</td> </tr> </tbody> </table>		No. 1	No. 2	No. 3	No. 4	No. 5	No. 6	<u>RS232</u>	ON	ON	ON	OFF	ON	OFF	RS485	OFF	OFF	OFF	ON	OFF	ON	RS485 With resistance	ON	ON	OFF	ON	OFF	ON	These settings are common to both COM1 and COM2.
	No. 1	No. 2	No. 3	No. 4	No. 5	No. 6																									
<u>RS232</u>	ON	ON	ON	OFF	ON	OFF																									
RS485	OFF	OFF	OFF	ON	OFF	ON																									
RS485 With resistance	ON	ON	OFF	ON	OFF	ON																									


### VisiLogic

(Underlined setting: default)

Item	Setting	Remarks	
Direct Contact	<b>SB: 2</b>	For more information, refer to the VisiLogic instruction manual.	
Set PLC Name	Specify a desired name.		
Com Init	Com Port		COM1 / COM2
	Data Bits		7 / 8
	Standard		RS232 / RS485
	Baud Rate		4800 / 9600 / 19200 / 38400 / 54600 / 115200 bps
	Parity		NONE / EVEN / ODD
Stop Bits	1 / 2		


### Direct Contact

Specify "2" for the SB address and register it into the ladder program.

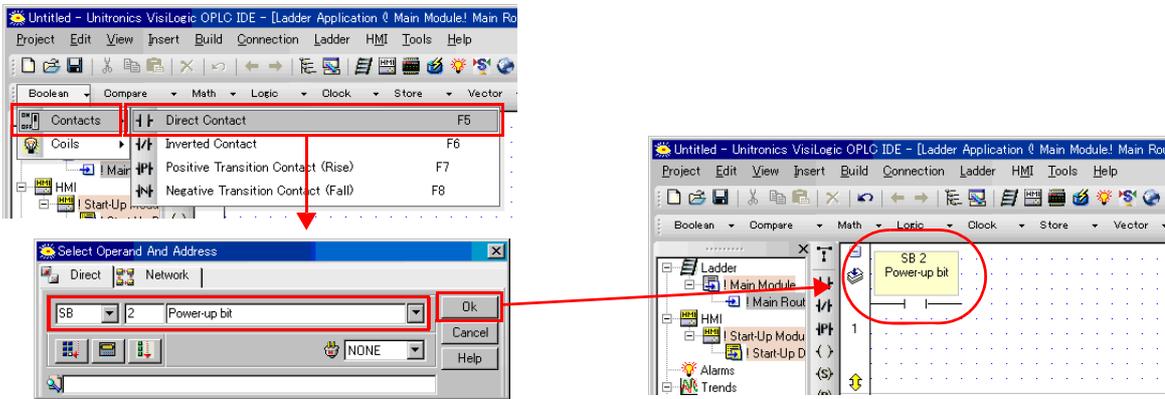




### Set PLC Name

Specify a desired PLC name.

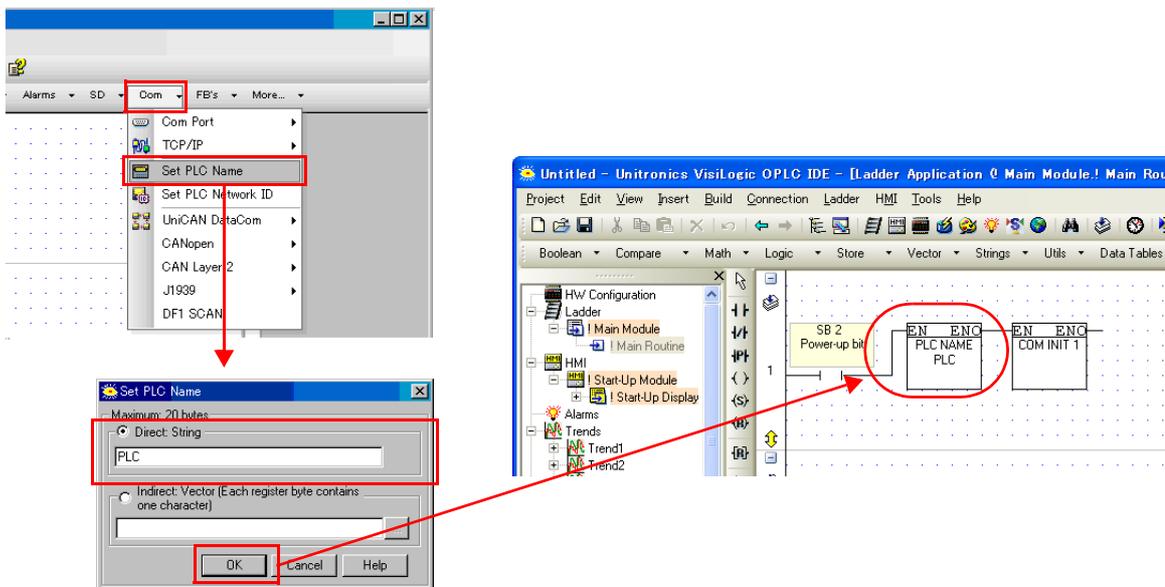

## Com Init

Make settings for [COM Port], [Data Bits], [Standard], [Baud Rate], [Parity] and [Stop Bits].

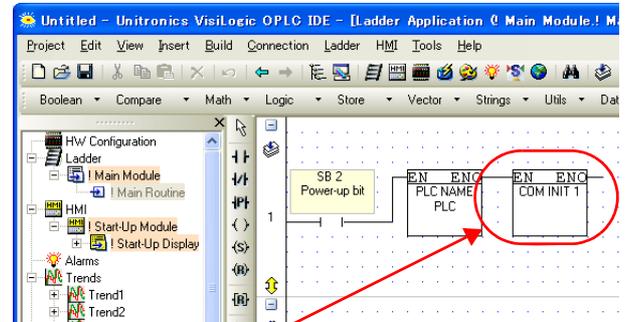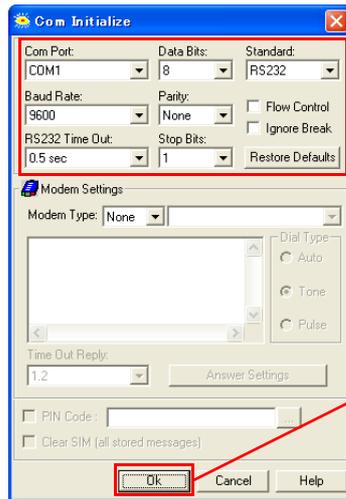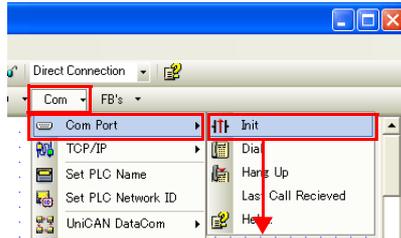

## Available Device Memory


The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory		TYPE	Remarks
MB	(Memory bit)	00H	
MI	(Memory int)	01H	
ML	(Memory long)	02H	Double-word
MD	(Memory double)	03H	Double-word
MF	(Memory float)	04H	Real number. Bit designation is not possible.
SB	(System bit)	05H	
SI	(System int)	06H	
SL	(System long)	07H	Double-word
SD	(System double)	08H	Double-word
INP	(Input)	09H	Read only
OUT	(Output)	0AH	
TS	(Timer scan bit)	0BH	Read only
TP	(Timer preset)	0CH	Double-word, read only
TC	(Timer current)	0DH	Double-word, read only
CS	(Counter scan bit)	0EH	Read only
CP	(Counter preset)	0FH	Read only
CC	(Counter current)	10H	Read only

## Indirect Device Memory Designation

	15	8	7	0
n + 0	Model		Device type	
n + 1	Address No.			
n + 2	Expansion code *		Bit designation	
n + 3	00		Station number	

\* In the expansion code, set which word, higher or lower, is to be read when a double-word address is specified (expansion bit designation).

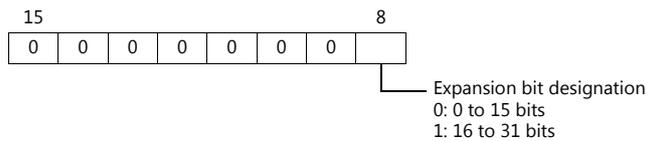

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
PLC operation status setting	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 0000H	
		n + 2	PLC status 0: Run 1: Stop 2: Memory init and reset 3: Reset 4: Switch to BootStrap <sup>*1</sup>	
Sending key data from remote unit <sup>*2</sup>	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 0001H	
		n + 2	Key data	
Unit ID read out	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 0002H	
		n + 2	Unit ID	
Unit ID setting	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 0003H	
		n + 2	Unit ID	
Version acquisition	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 0004H	
		n + 2 to n + 29	Version, model type (CHAR data)	

 Return data: Data stored from PLC to V series

\*1 After the setting is made, the PLC must be shut off and restarted.

\*2 This command is used when a password is entered into the PLC from the V9 series. Since the password consists of four digits, the command must be executed four times.

Detail of the key data:  
40 to 49: "0" to "9"


## 20.1.2 Vision Series (ASCII Ethernet TCP/IP)

### Communication Setting


#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]

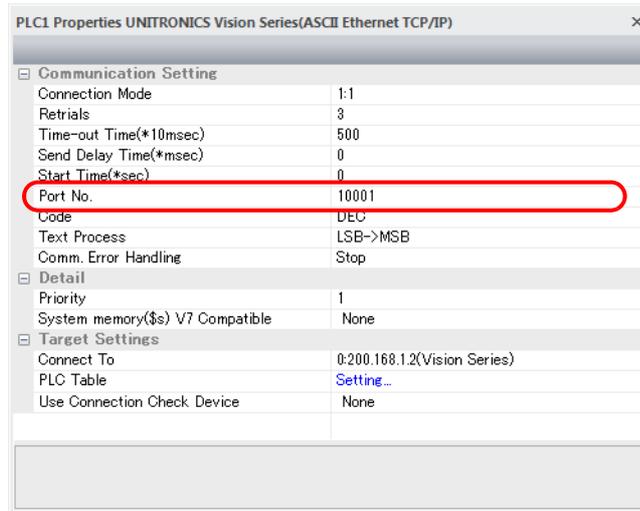

- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

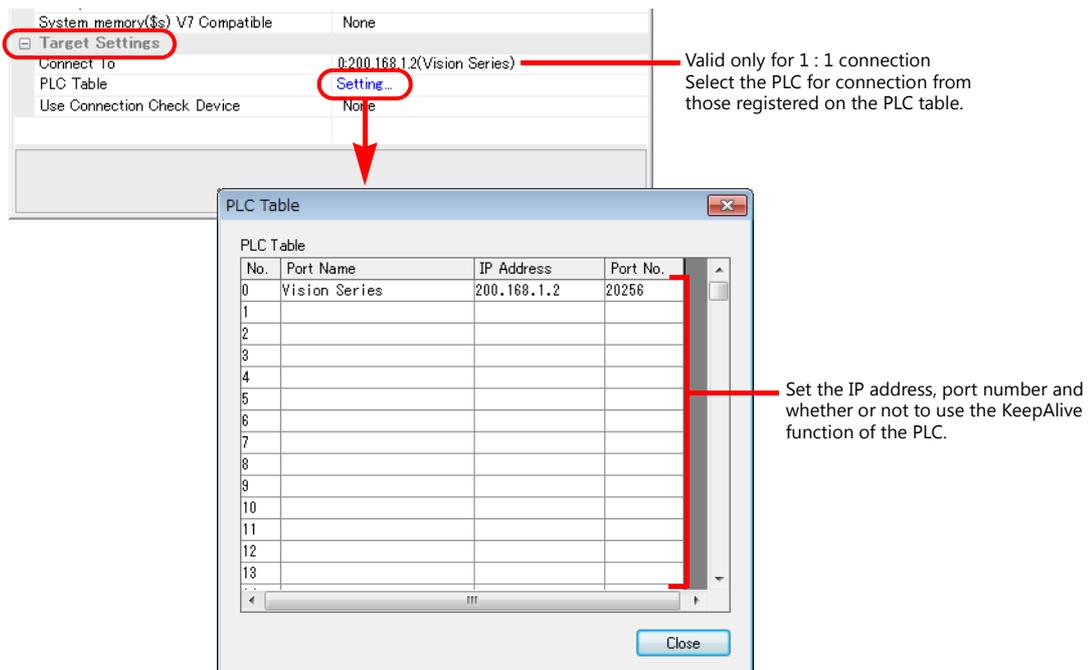

PLC

Parameter


Parameters must be set in Information Mode or by creating a ladder program using the software "VisiLogic". For more information, refer to the instruction manual issued by UNITORONICS.

VisiLogic

Item	Setting	Remarks	
Direct Contact	<b>SB: 2</b>	For more information, refer to the VigLogic instruction manual.	
Set PLC Name	Specify a desired name.		
Com Init	IP Address		IP address of the Vision Series
	Subnet Mask		Specify according to the environment.
	Default Gateway		Specify according to the environment.
Socket Init	Socket		Socket1
	Protocol		<b>TCP</b>
	Local Port	0 to 65535 (default: 20256)	
	Master/Slave	<b>Slave</b>	


Direct Contact

Specify "2" for the SB address and register it into the ladder program.

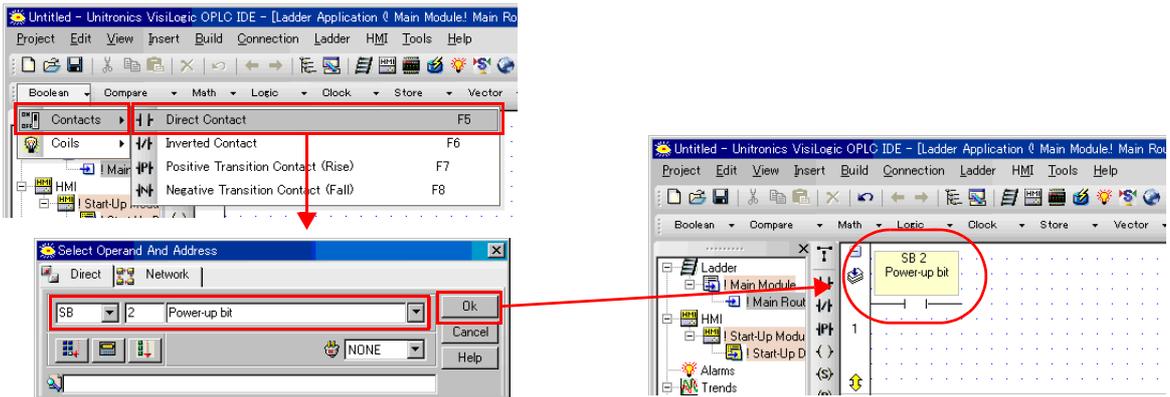


Set PLC Name

Specify a desired PLC name.

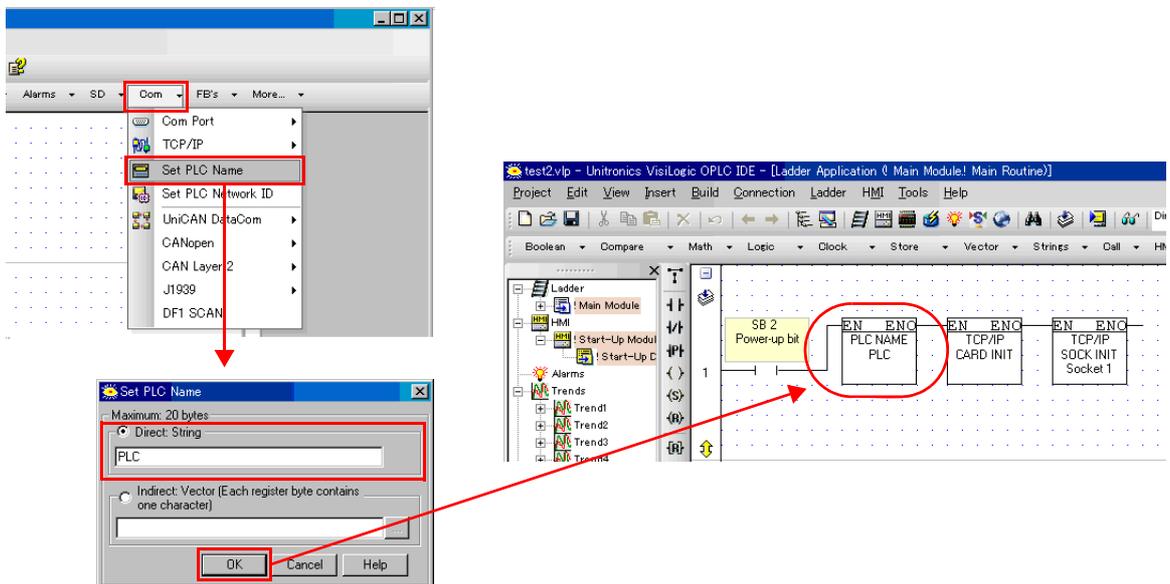


### Com Init

Specify the IP address, subnet mask and default gateway.

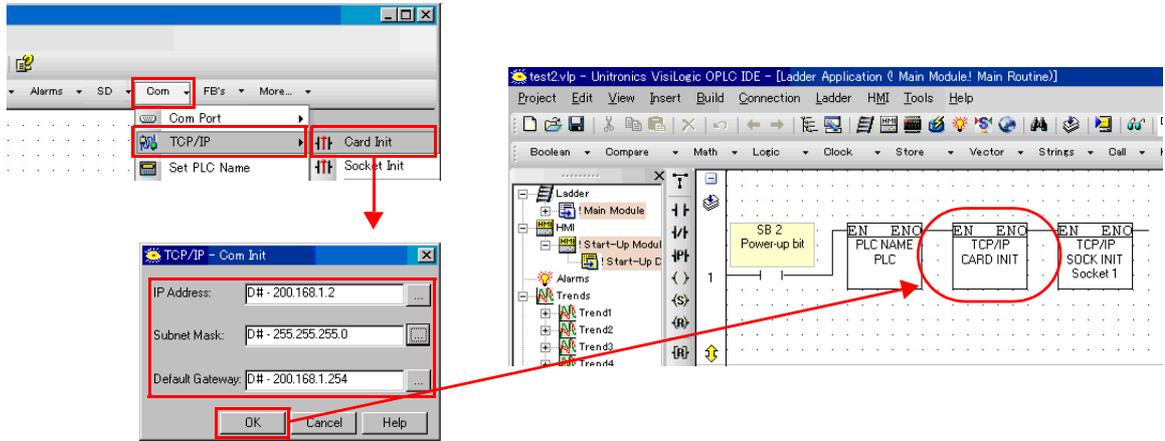

### Socket Init

Make settings for [Socket], [Protocol], [Local Port], and [Master/Slave].

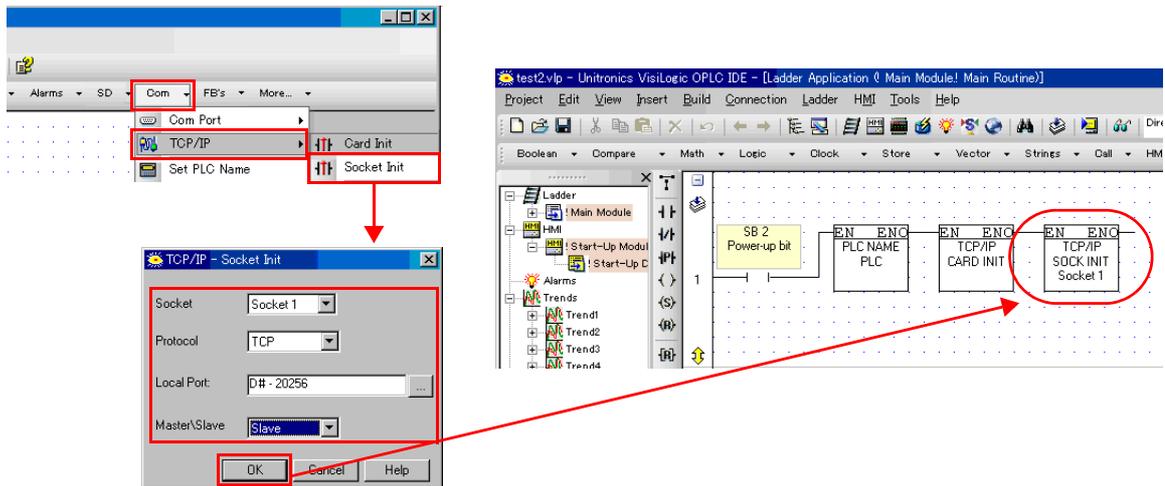

## Available Device Memory


The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
MB (Memory bit)	00H	
MI (Memory int)	01H	
ML (Memory long)	02H	Double-word
MD (Memory double)	03H	Double-word
MF (Memory float)	04H	Real number. Bit designation is not possible.
SB (System bit)	05H	
SI (System int)	06H	
SL (System long)	07H	Double-word
SD (System double)	08H	Double-word
INP (Input)	09H	Read only
OUT (Output)	0AH	
TS (Timer scan bit)	0BH	Read only
TP (Timer preset)	0CH	Double-word, read only
TC (Timer current)	0DH	Double-word, read only
CS (Counter scan bit)	0EH	Read only
CP (Counter preset)	0FH	Read only
CC (Counter current)	10H	Read only

## Indirect Device Memory Designation

	15	8 7	0
n + 0	Model		Device type
n + 1	Address No.		
n + 2	Expansion code *		Bit designation
n + 3	00		Station number

\* In the expansion code, set which word, higher or lower, is to be read when a double-word address is specified (expansion bit designation).

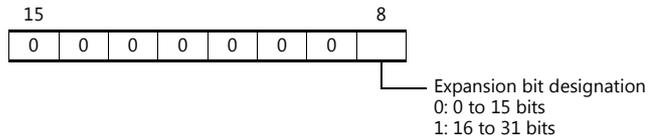

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)	F2
PLC operation status setting	1 - 8 (PLC1 - 8)	n	Station number
		n + 1	Command: 0000H
		n + 2	PLC status 0: Run 1: Stop 2: Memory init and reset 3: Reset 4: Switch to BootStrap *1
Sending key data from remote unit *2	1 - 8 (PLC1 - 8)	n	Station number
		n + 1	Command: 0001H
		n + 2	Key data
Unit ID read out	1 - 8 (PLC1 - 8)	n	Station number
		n + 1	Command: 0002H
		n + 2	Unit ID
Unit ID setting	1 - 8 (PLC1 - 8)	n	Station number
		n + 1	Command: 0003H
		n + 2	Unit ID
Version data acquisition	1 - 8 (PLC1 - 8)	n	Station number
		n + 1	Command: 0004H
		n + 2 to n + 29	Version, model type (CHAR data)

Return data: Data stored from PLC to V series

\*1 After the setting is made, the PLC must be shut off and restarted.

\*2 This command is used when a password is entered into the PLC from the V9 series. Since the password consists of four digits, the command must be executed four times.


Detail of the key data:  
40 to 49: "0" to "9"

### 20.1.3 Wiring Diagrams

#### When Connected at CN1:


#### RS-232C

Wiring diagram 1 - C2

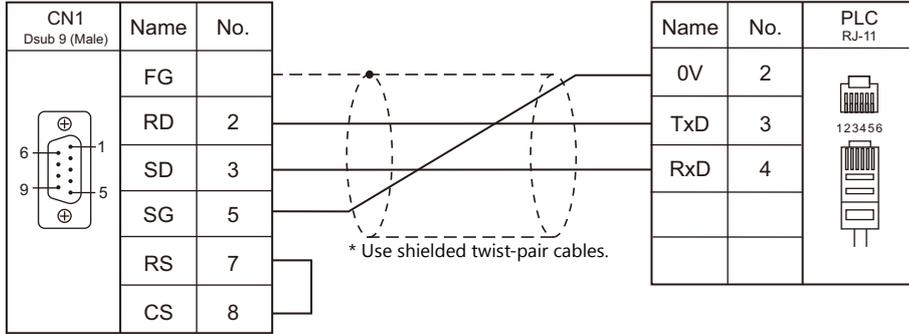

#### RS-422/RS-485


Wiring diagram 1 - C4

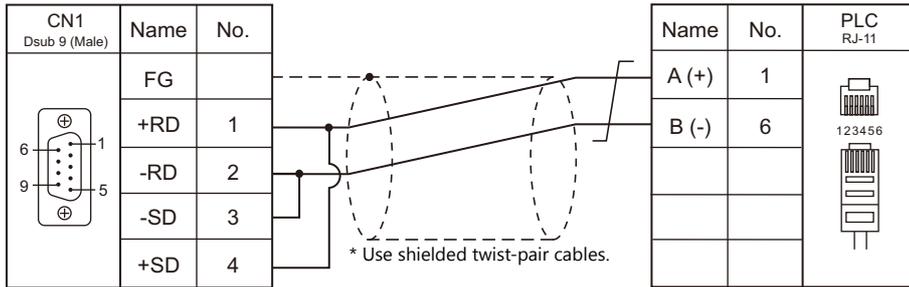

**When Connected at MJ1/MJ2:**


**RS-232C**

**Wiring diagram 1 - M2**

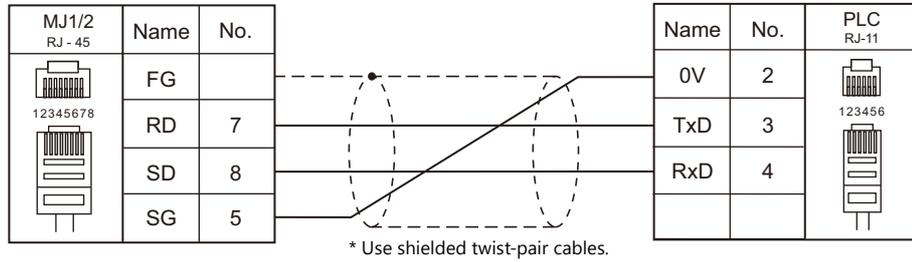


**RS-422/RS-485**

**Wiring diagram 1 - M4**

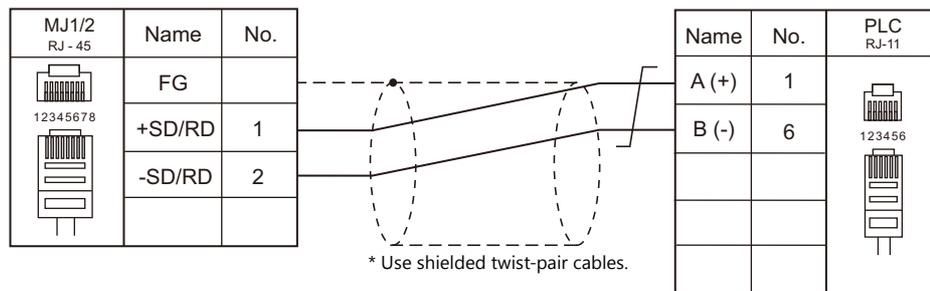

# MEMO

**MONITOUCH**



# 21. ULVAC

---

21.1 Thermo Controller/Servo/Inverter

## 21.1 Thermo Controller/Servo/Inverter

### Vacuum Gauge

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
G-TRAN series	SH2-2	Serial communication port	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		UL_GT .Lst
			RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		
	SW1-2	Serial communication port	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2		
			RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		

\*1 Set the slide switch for signal selection to the RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 21.1.1 G-TRAN Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)


Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	<u>9600</u> / 19200 / 38400 bps	
Data Length	<b>8 bits</b>	
Stop Bit	<b>1 bit</b>	
Parity	<b>None</b>	
Target Port No.	0 to 99	

#### SH2

#### Baud rate

bps	Setting	Baud Rate	Remarks
	0	9600 bps	
	1	19200 bps	
	2	38400 bps	

#### Station number


MSD / LSD	Setting	Remarks
	0 to 99	MSD: tens place, LSD: ones place "00" may be allocated to the host for RS-485 communication.

#### SW1

#### Baud rate

bps	Baud Rate	Remarks
	9600 bps	
	19200 bps	
	38400 bps	

#### Station number

MSD / LSD	Setting	Remarks
	0 to 99	MSD: tens place, LSD: ones place "00" may be allocated to the host for RS-485 communication.

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available with the device to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
S (status)	00H	
FIL (filament current check)	01H	Read only, available only for SH2 models
T (model, software version acquisition)	02H	Read only
ERR (error details check)	03H	Read only, available only for SH2 models <sup>*1</sup>

\*1 Use a character display part.

### S (status)

Address	Name	Remarks
0	Status	

### FIL (filament current check)

Address	Name	Remarks
0	Filament current value	

### T (model, software version acquisition)

Address	Name	Remarks
0	1st and 2nd bytes of model and software version	
1	3rd and 4th bytes of model and software version	
2	5th and 6th bytes of model and software version	
3	7th byte of model and software version	

### ERR (error details check)

Address	Name	Remarks
0	Error details	Character string data

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Measurement value and status reading	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 0	
		n + 2	Measured pressure (significand) <sup>*1</sup>	
		n + 3	Measured pressure (power of ten) <sup>*1</sup>	
		n + 4	Status	
Zero point adjustment <sup>*2</sup>	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 1	
Atmospheric pressure adjustment	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 2	
Zero point, atmospheric pressure adjustment reset <sup>*2</sup>	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 3	
Set point 1 setting value reading	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 4	
		n + 2	Setting value (significand) <sup>*1</sup>	
		n + 3	Setting value (power of ten) <sup>*1</sup>	
Set point 2 setting value reading	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 5	
		n + 2	Setting value (significand) <sup>*1</sup>	
		n + 3	Setting value (power of ten) <sup>*1</sup>	

Contents	F0	F1 (= \$u n)		F2
Set point 1 setting value writing	1 to 8 (PLC1 to 8)	n	Station number	4
		n + 1	Command: 6	
		n + 2	Setting value (significand) <sup>*1</sup>	
		n + 3	Setting value (power of ten) <sup>*1</sup>	
Set point 2 setting value writing	1 to 8 (PLC1 to 8)	n	Station number	4
		n + 1	Command: 7	
		n + 2	Setting value (significand) <sup>*1</sup>	
		n + 3	Setting value (power of ten) <sup>*1</sup>	

 Return data: Data stored from controller to V series


- \*1 To read/write the cube of  $5.00 \times 10$ , store "5" (5.00) for "n + 2 (significand)" and "3" for "n + 3 (power of ten)".  
Enable 2 decimal places for data display parts to show significands.
- \*2 Available only for SW1 models

## 21.1.2 Wiring Diagrams


### When Connected at CN1:

#### RS-232C

Wiring diagram 1 - C2

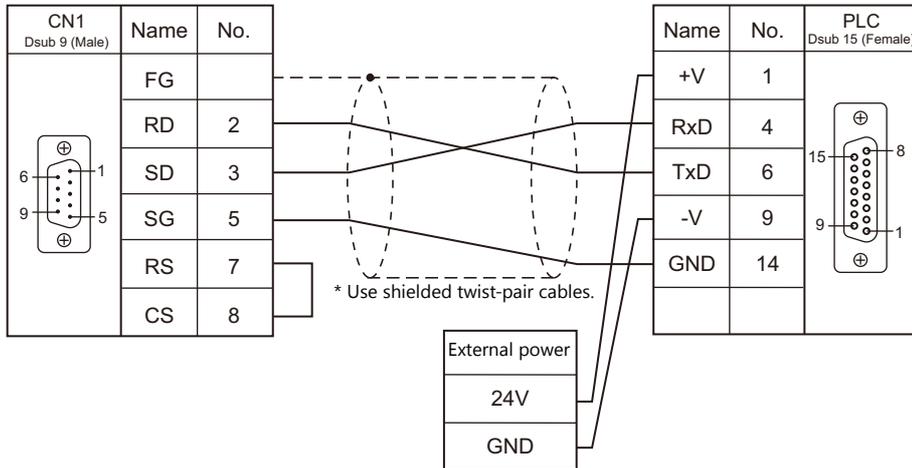


Wiring diagram 2 - C2

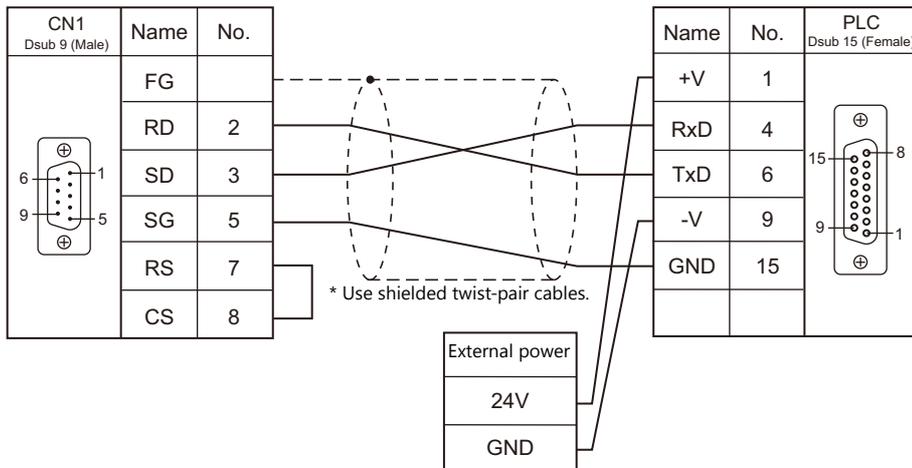

RS-422/485


Wiring diagram 1 - C4

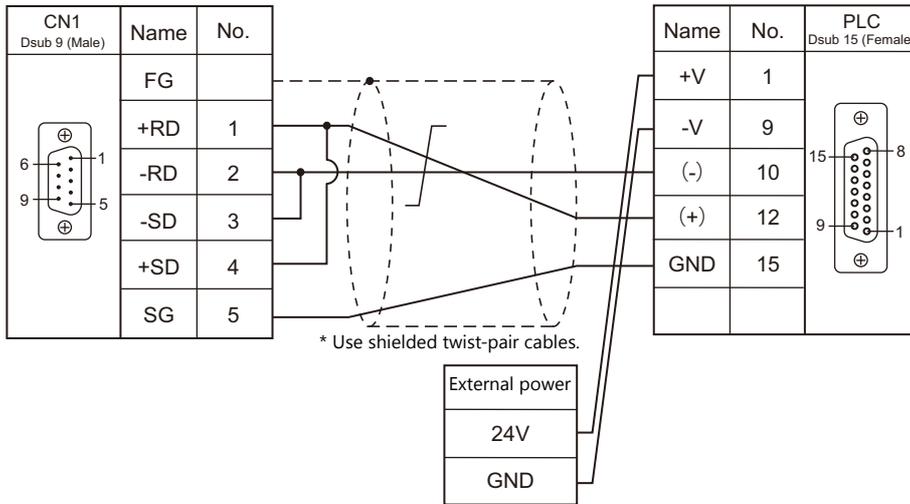


**When Connected at MJ1/MJ2:**

**RS-232C**

**Wiring diagram 1 - M2**

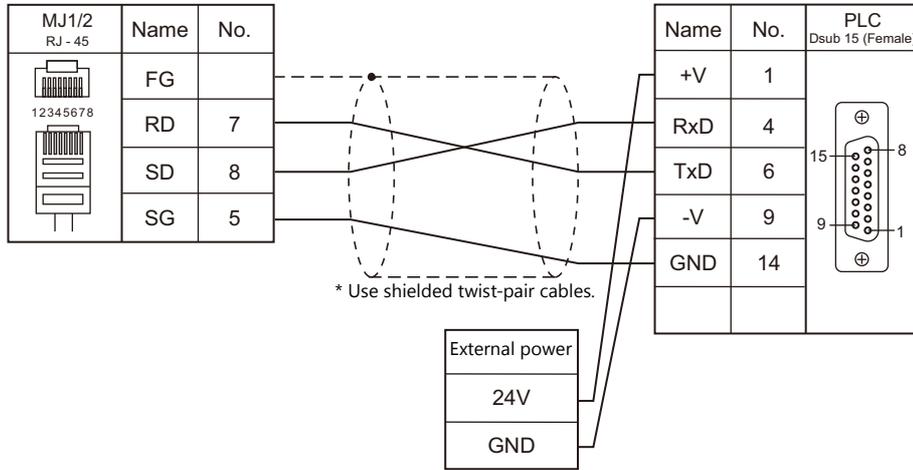


**Wiring diagram 2 - M2**

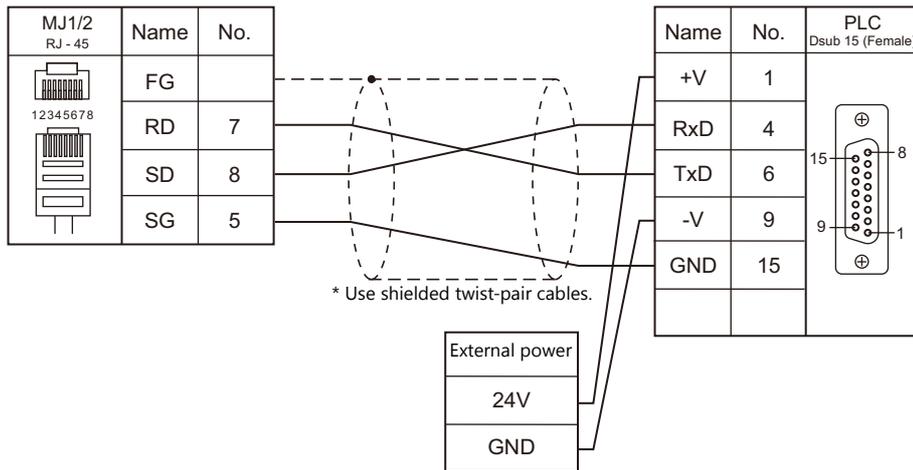


**RS-422/485**

**Wiring diagram 1 - M4**

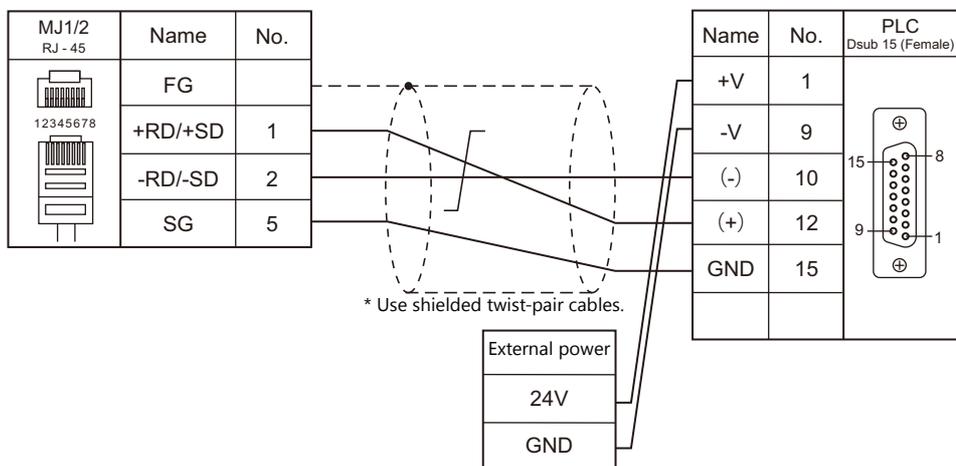

# MEMO

**MONITOUCH**



# 22. VIGOR

---

## 22.1 PLC Connection

## 22.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU	Unit/Port		Signal Level	Connection			Ladder Transfer <sup>*3</sup>
					CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>	
M series	M1-CPU1	COM PORT	M-232R	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
			M-485R	RS-422/485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*3 For the ladder transfer function, see the V9 Series Reference Manual 2.

## 22.1.1 M Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / <u>19200</u> / 38400bps	
Data Length	<u>7 bits</u>	
Stop Bit	<u>1 bit</u>	
Parity	<u>Even</u>	
Target Port No.	<u>0</u> to 255	

#### PLC

Make PLC settings using the application software "Ladder Master". For more information, refer to the PLC manual issued by the manufacturer.

#### M-232R / M-485R

(Underlined setting: default)

Item	Setting	Remarks
Application	<b>Computer Link</b>	
Computer Link Detail	Station Number	0 to 255
	Baud Rate	4800 / 9600 / <u>19200</u> / 38400bps 38400 bps supported by M-485R only

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
D (Data register / Special register)	00H	D0 to D8191, D9000 to D9255
X (Input relay)	01H	
Y (Output relay)	02H	
M (Internal relay / Special relay)	03H	M0 to M5119, M9000 to M9255
S (Internal relay / Step relay)	04H	
T (Timer / Current value)	05H	
C (Counter / Current value)	06H	
32C (High-speed counter / Current value)	07H	Double-word
TS (Timer / Contact)	08H	
CS (Counter / Contact)	09H	
TC (Timer / Coil)	0AH	
CC (Counter / Coil)	0BH	

## 22.1.2 Wiring Diagrams

### When Connected at CN1:


#### RS-232C

Wiring diagram 1 - C2

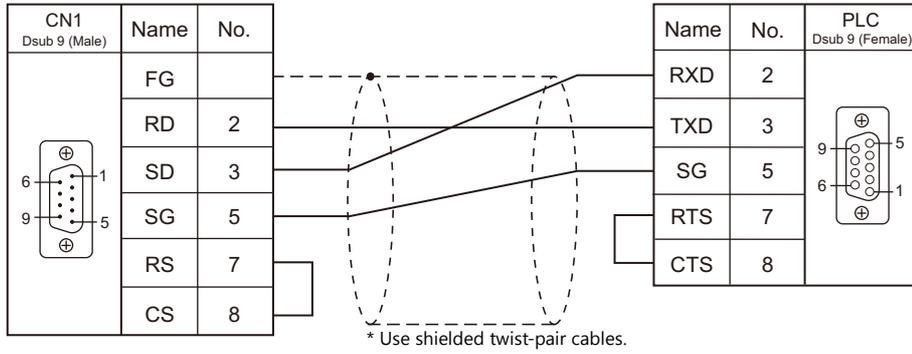

#### RS-422/RS-485


Wiring diagram 1 - C4

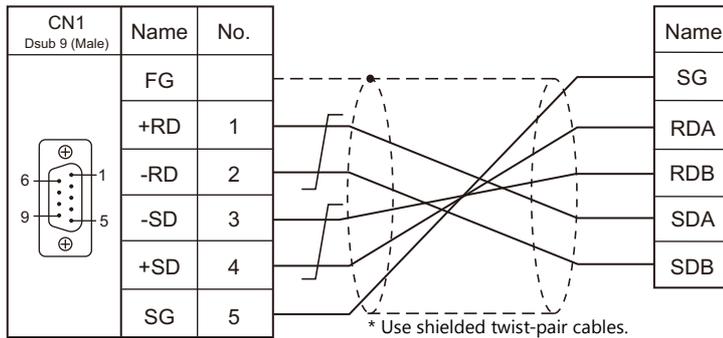

**When Connected at MJ1/MJ2:**


**RS-232C**

**Wiring diagram 1 - M2**

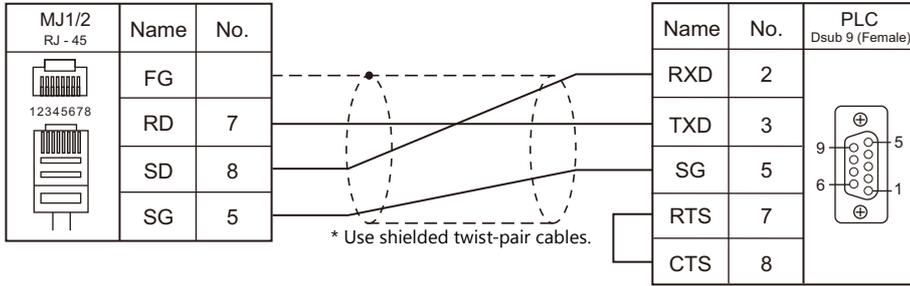


**RS-422/RS-485**

**Wiring diagram 1 - M4**

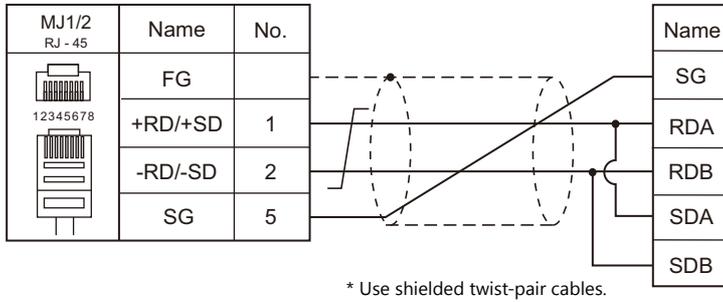

**Wiring diagram 2 - M4**

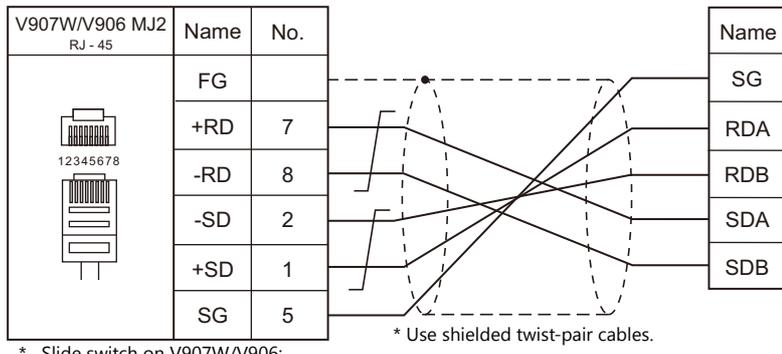

\* Slide switch on V907W/V906:  
RS-422 (lower)

# 23. WAGO

---

## 23.1 PLC Connection

## 23.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU	Unit/Port	Signal Level	Connection			Ladder Transfer <sup>*3</sup>
				CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>	
750 series (MODBUS RTU)	750-314 750-316 750-814 750-816 750-873	Fieldbus connector	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		×
	RS-422		Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 2 - M4		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*3 For the ladder transfer function, see the V9 Series Reference Manual 2.

### Ethernet Connection

PLC Selection on the Editor	CPU	Unit	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>
750 series (MODBUS Ethernet)	750-341 750-342 750-841 750-842 750-871 750-873	CPU with built-in Ethernet	○	○	502 (fixed) <sup>*3</sup>	○	×

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*3 A maximum of 15 units including the ladder tool can be connected.

## 23.1.1 750 Series (MODBUS RTU)

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 / 115K bps	Up to 19200 bps is available on 750-312, 750-314, 750-812 and 750-814. 4800 and 38400 bps are not available on 750-873.
Data Length	<b>8 bits</b>	
Stop Bit	<u>1</u> / 2 bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	0 to 255	Select station No. 0 for a broadcast command.

#### Bus Coupler / Bus Controller


#### 750-312 / 750-314 / 750-315 / 750-316

#### Node address rotary switch

Address	Contents	Setting Example
x1  x10 	1 to 99	1

#### DIP switch FR

(Underlined setting: default)

DIP Switch FR	Contents	Setting Example																												
FR1 FR2 FR3	<table border="1"> <thead> <tr> <th>Baud Rate</th> <th>FR1</th> <th>FR2</th> <th>FR3</th> </tr> </thead> <tbody> <tr> <td>4800 bps</td> <td>ON</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td><u>9600 bps</u></td> <td><u>OFF</u></td> <td><u>ON</u></td> <td><u>ON</u></td> </tr> <tr> <td>19200 bps</td> <td>ON</td> <td>ON</td> <td>ON</td> </tr> <tr> <td>38400 bps*</td> <td>OFF</td> <td>OFF</td> <td>OFF</td> </tr> <tr> <td>57600 bps*</td> <td>ON</td> <td>OFF</td> <td>OFF</td> </tr> <tr> <td>115 kbps*</td> <td>OFF</td> <td>ON</td> <td>OFF</td> </tr> </tbody> </table> <p>* Available only on 750-315 and 750-316.</p>	Baud Rate	FR1	FR2	FR3	4800 bps	ON	OFF	ON	<u>9600 bps</u>	<u>OFF</u>	<u>ON</u>	<u>ON</u>	19200 bps	ON	ON	ON	38400 bps*	OFF	OFF	OFF	57600 bps*	ON	OFF	OFF	115 kbps*	OFF	ON	OFF	
Baud Rate	FR1	FR2	FR3																											
4800 bps	ON	OFF	ON																											
<u>9600 bps</u>	<u>OFF</u>	<u>ON</u>	<u>ON</u>																											
19200 bps	ON	ON	ON																											
38400 bps*	OFF	OFF	OFF																											
57600 bps*	ON	OFF	OFF																											
115 kbps*	OFF	ON	OFF																											
FR4 FR5 FR6	<table border="1"> <thead> <tr> <th>Parity</th> <th>Data Length</th> <th>Stop Bit</th> <th>FR4</th> <th>FR5</th> <th>FR6</th> </tr> </thead> <tbody> <tr> <td><u>None</u></td> <td rowspan="3"><u>8 bits</u></td> <td rowspan="3"><u>1 bit</u></td> <td><u>OFF</u></td> <td><u>OFF</u></td> <td><u>OFF</u></td> </tr> <tr> <td>Even</td> <td>ON</td> <td>OFF</td> <td>OFF</td> </tr> <tr> <td>Odd</td> <td>OFF</td> <td>ON</td> <td>OFF</td> </tr> <tr> <td>None</td> <td></td> <td>2 bits</td> <td>ON</td> <td>ON</td> <td>OFF</td> </tr> </tbody> </table>	Parity	Data Length	Stop Bit	FR4	FR5	FR6	<u>None</u>	<u>8 bits</u>	<u>1 bit</u>	<u>OFF</u>	<u>OFF</u>	<u>OFF</u>	Even	ON	OFF	OFF	Odd	OFF	ON	OFF	None		2 bits	ON	ON	OFF	Baud rate: 9600 bps Parity: None Data length: 8 bits Stop bit: 1 bit		
Parity	Data Length	Stop Bit	FR4	FR5	FR6																									
<u>None</u>	<u>8 bits</u>	<u>1 bit</u>	<u>OFF</u>	<u>OFF</u>	<u>OFF</u>																									
Even			ON	OFF	OFF																									
Odd			OFF	ON	OFF																									
None		2 bits	ON	ON	OFF																									

\* Before making settings on the DIP switch FR, be sure to turn off the power to the bus coupler.

**DIP switch P**

(Underlined setting: default)

DIP Switch P	Contents	OFF	ON	Setting Example		
P1 P2 P3	End of communication frame data	End of Data	P1	P2	P3	
		<u>Three frames</u>	<u>OFF</u>	<u>OFF</u>	<u>OFF</u>	
		100 msec	ON	OFF	OFF	
		200 msec	OFF	ON	OFF	
		500 msec	ON	ON	OFF	
		1 sec.	OFF	OFF	ON	
		1 msec	ON	OFF	ON	
		10 msec	OFF	ON	ON	
50 msec	ON	ON	ON			
P4	Data transfer mode	ASCII mode	<u>RTU mode</u>			
P5	Error check code	Ignored	<u>Executed</u>			
P6	Others	<u>OFF</u>				
P7						
P8						

\* Before making settings on the DIP switch P, be sure to turn off the power to the bus coupler.

**Terminating resistance**

Make settings only when 750-312 or 750-315 is used.

- For 2-wire system
- For 4-wire system



**750-812 / 750-814 / 750-815 / 750-816**


**Node address rotary switch**

Address	Contents	Setting Example
<p>x1</p> <p>x10</p>	1 to 99	1

**PLC-PRG (PRG-FBD)**

Set communication parameters using the ladder tool “WAGO-I/O-PRO 32” or “WAGO-I/O-PRO CAA”. For more information, refer to the PLC manual issued by the manufacturer.

- \* When setting the communication parameters, set the node address rotary switch to “0” and the operation mode switch in the upper (“run”) or center (“stop”) position.

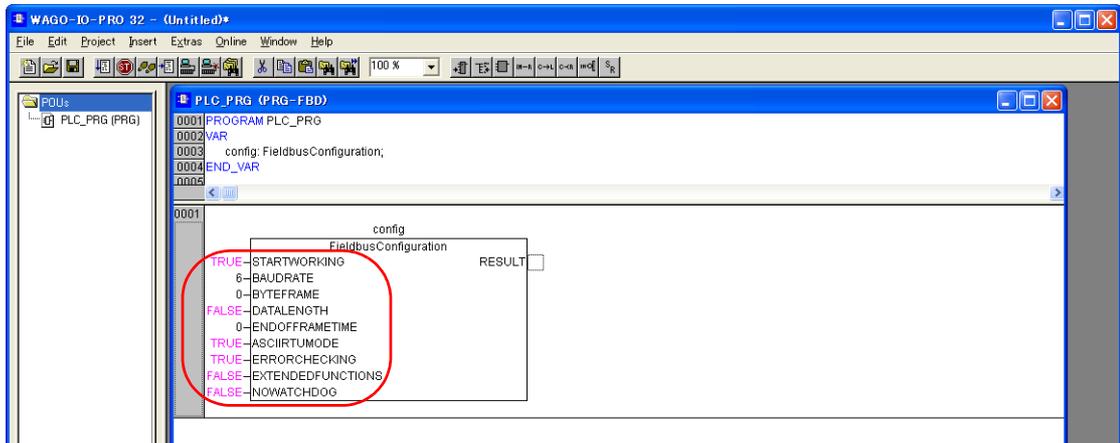

(Underlined setting: default)

Setting Items	Contents	Setting Example																		
STARTWORKING	<b>TRUE</b>	<b>TRUE</b>																		
BAUDRATE	<table border="1"> <thead> <tr> <th>Baud rate</th> <th>Value</th> </tr> </thead> <tbody> <tr> <td>4800 bps</td> <td>5</td> </tr> <tr> <td><u>9600 bps</u></td> <td><u>6</u></td> </tr> <tr> <td>19200 bps</td> <td>7</td> </tr> <tr> <td>38400 bps</td> <td>0*</td> </tr> <tr> <td>57600 bps</td> <td>1*</td> </tr> <tr> <td>115 kbps</td> <td>2*</td> </tr> </tbody> </table> <p>* Available only on 750-815 and 750-816.</p>	Baud rate	Value	4800 bps	5	<u>9600 bps</u>	<u>6</u>	19200 bps	7	38400 bps	0*	57600 bps	1*	115 kbps	2*	6				
Baud rate	Value																			
4800 bps	5																			
<u>9600 bps</u>	<u>6</u>																			
19200 bps	7																			
38400 bps	0*																			
57600 bps	1*																			
115 kbps	2*																			
BYTEFRAME	<table border="1"> <thead> <tr> <th>Parity</th> <th>Stop Bits</th> <th>Value</th> </tr> </thead> <tbody> <tr> <td><u>No</u></td> <td rowspan="3">1</td> <td><u>0</u></td> </tr> <tr> <td>Even</td> <td>1</td> </tr> <tr> <td>Odd</td> <td>2</td> </tr> <tr> <td>No</td> <td>2</td> <td>3</td> </tr> </tbody> </table>	Parity	Stop Bits	Value	<u>No</u>	1	<u>0</u>	Even	1	Odd	2	No	2	3	0					
Parity	Stop Bits	Value																		
<u>No</u>	1	<u>0</u>																		
Even		1																		
Odd		2																		
No	2	3																		
DATALENGTH	<b>8: FALSE</b>	<b>FALSE</b>																		
ENDOFFRAMETIME	<table border="1"> <thead> <tr> <th>End of Frame Time</th> <th>Value</th> </tr> </thead> <tbody> <tr> <td><u>3 x Frame Time</u></td> <td><u>0</u></td> </tr> <tr> <td>100 ms</td> <td>1</td> </tr> <tr> <td>200 ms</td> <td>2</td> </tr> <tr> <td>500 ms</td> <td>3</td> </tr> <tr> <td>1s</td> <td>4</td> </tr> <tr> <td>1 ms</td> <td>5</td> </tr> <tr> <td>10 ms</td> <td>6</td> </tr> <tr> <td>50 ms</td> <td>7</td> </tr> </tbody> </table>	End of Frame Time	Value	<u>3 x Frame Time</u>	<u>0</u>	100 ms	1	200 ms	2	500 ms	3	1s	4	1 ms	5	10 ms	6	50 ms	7	0
End of Frame Time	Value																			
<u>3 x Frame Time</u>	<u>0</u>																			
100 ms	1																			
200 ms	2																			
500 ms	3																			
1s	4																			
1 ms	5																			
10 ms	6																			
50 ms	7																			
ASCIIRUMODE	<b>RTU: TRUE</b>	<b>TRUE</b>																		
ERRORCHECKING	<table border="1"> <thead> <tr> <th>Error Check</th> <th>Value</th> </tr> </thead> <tbody> <tr> <td>ignored</td> <td>FALSE</td> </tr> <tr> <td><u>being processed</u></td> <td><u>TRUE</u></td> </tr> </tbody> </table>	Error Check	Value	ignored	FALSE	<u>being processed</u>	<u>TRUE</u>	TRUE												
Error Check	Value																			
ignored	FALSE																			
<u>being processed</u>	<u>TRUE</u>																			
EXTENDEDFUNCTIONS	<table border="1"> <thead> <tr> <th>Extended Functions</th> <th>Value</th> </tr> </thead> <tbody> <tr> <td><u>without</u></td> <td><u>FALSE</u></td> </tr> <tr> <td>available</td> <td>TRUE</td> </tr> </tbody> </table>	Extended Functions	Value	<u>without</u>	<u>FALSE</u>	available	TRUE	FALSE												
Extended Functions	Value																			
<u>without</u>	<u>FALSE</u>																			
available	TRUE																			
NOWATCHDOG	<table border="1"> <thead> <tr> <th>Watchdog</th> <th>Value</th> </tr> </thead> <tbody> <tr> <td><u>switched on</u></td> <td><u>FALSE</u></td> </tr> <tr> <td>switched off</td> <td>TRUE</td> </tr> </tbody> </table>	Watchdog	Value	<u>switched on</u>	<u>FALSE</u>	switched off	TRUE	FALSE												
Watchdog	Value																			
<u>switched on</u>	<u>FALSE</u>																			
switched off	TRUE																			

## Terminating resistance

Make settings only when 750-812 or 750-815 is used.

- For 2-wire system
- For 4-wire system




## 750-873

Connect the computer to 750-873 and start the web browser.

Click [Modbus] on the browser menu. The password entry dialog appears. To log on as an administrator, enter "admin" for the user name and "wago" for the password, and click [OK].

Make settings for [Serial Port Settings] and [Modbus RTU Settings] on the screen. For more information, refer to the PLC manual issued by the manufacturer.

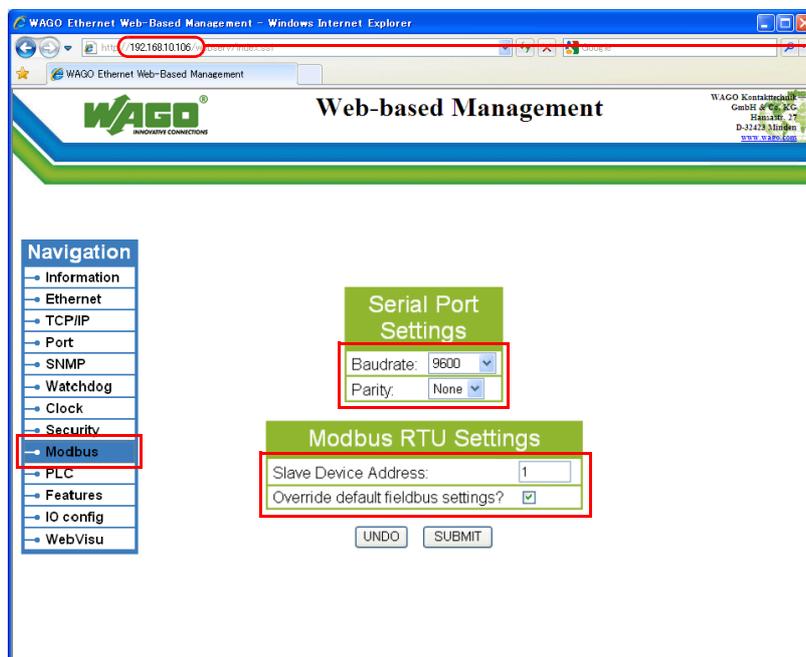

Enter the IP address of the bus coupler or bus controller on Internet Explorer, and press the [Enter] key to display the browser menu.

(Underlined setting: default)

Item	Setting	Remarks
Serial Port Settings	Baudrate	<u>9600</u> / 19200 / 57600 / 115K bps
	Parity	<u>None</u> / Odd / Even
Modbus RTU Settings	Slave Device Address	1 to 255
	Override default fieldbus settings?	<b>Checked</b>

\* After settings are made, click [SUBMIT], and turn the power off and back on again.

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
%MX (internal contact point)	00H	%MW as word device
%IX (input variable)	01H	%IW as word device
%QX (output variable)	02H	%QW as word device


## 23.1.2 750 Series (MODBUS Ethernet)

### Communication Setting


#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Connection port on the V9 unit:  
The [Target Port No.] for the connected device on the [Hardware Setting] window ([System Setting] → [Hardware Setting])
  - When using TCP/IP:  
Select [Built-in LAN (TCP)].
  - When using UDP/IP:  
Select [Built-in LAN (UDP)].
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]

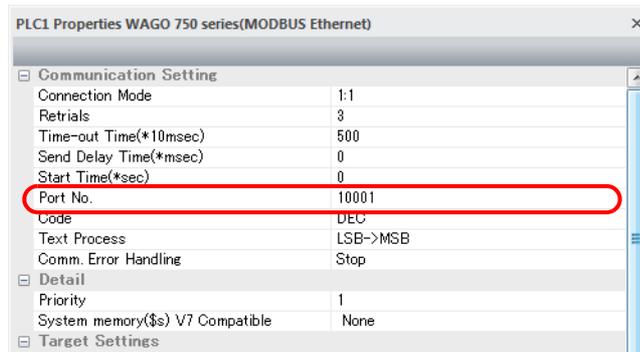

- IP address and port number (No. 502) of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

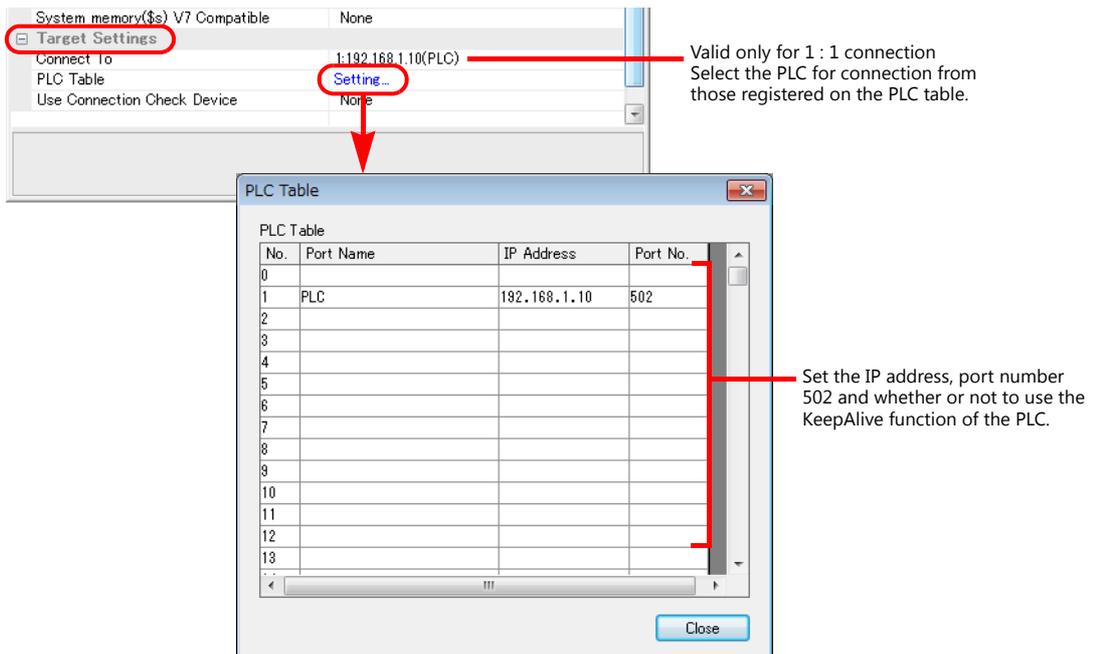


## Bus Coupler / Bus Controller

Make PLC settings by using "WAGO BootP Server" or "WAGO Ethernet Settings". For more information, refer to the PLC manual issued by the manufacturer.

\* For 750-342 and 750-842, only "WAGO BootP Server" can be used.

### WAGO BootP Server

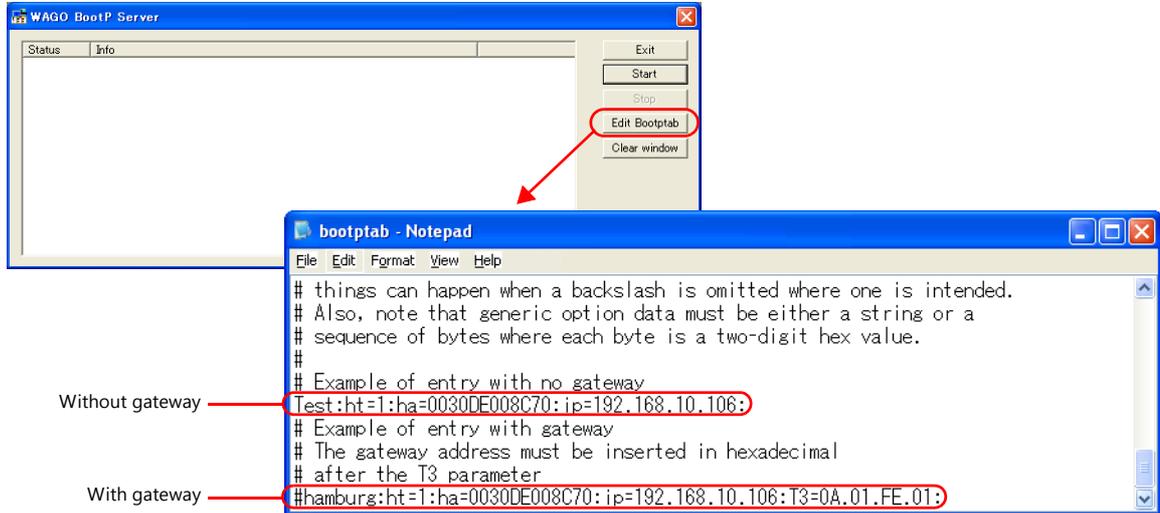

Example: `Test:ht=1:ha=0030DE008C70:ip=192.168.10.106:`

Node name | MAC address | IP address  
Hardware type

\* When setting the subnet mask (sm) and gateway (gw), make settings following the IP address as shown below:

Example: `Test:ht=1:ha=003-DE000002:ip=192.168.10.106:sm=255.255.255.0:T3=0A.01.FE.01:`

Node name | MAC address | IP address | Subnet mask | Gateway (HEX)  
Hardware type

Contents	Setting
Node name	Use one-byte alphanumeric characters.
Hardware type	<b>ht=1</b>
MAC address	<b>ha</b> =MAC address (shown on the bus coupler or bus controller)
IP address table	<b>ip</b> =IP address of the PLC
Subnet mask	<b>sm</b> =subnet mask
Gateway	<b>T3</b> =gateway address (HEX) * To be set when the bus coupler or bus controller lies beyond the gateway

\* When making settings for 750-871, set all DIP switches in the OFF positions.

\* The port number is fixed to "502".

Delete either "#" mark at the beginning of "with gateway" or "without gateway" and save the text file. The setting with no "#" mark will take effect.

#### Notes on setting the IP address using "BootP Server"


In the initial condition, the IP address set on "BootP Server" is cleared when the power is turned off and back on again. To retain the IP address even when the power has been turned off and back on again, the BootP protocol must be disabled after the IP address is set.

Connect the computer to the bus coupler or bus controller, and start the web browser. Remove the check mark from [BootP] for [Port] on the browser menu.

Click [SUBMIT] and turn the power off and back it on again. The BootP protocol becomes disabled.

\* When [Port] is clicked, the password may be required. For more information, see "Enabling Modbus UDP and Modbus TCP protocols" (page 23-8).

**WAGO Ethernet Settings ([TCP/IP] tab window)**

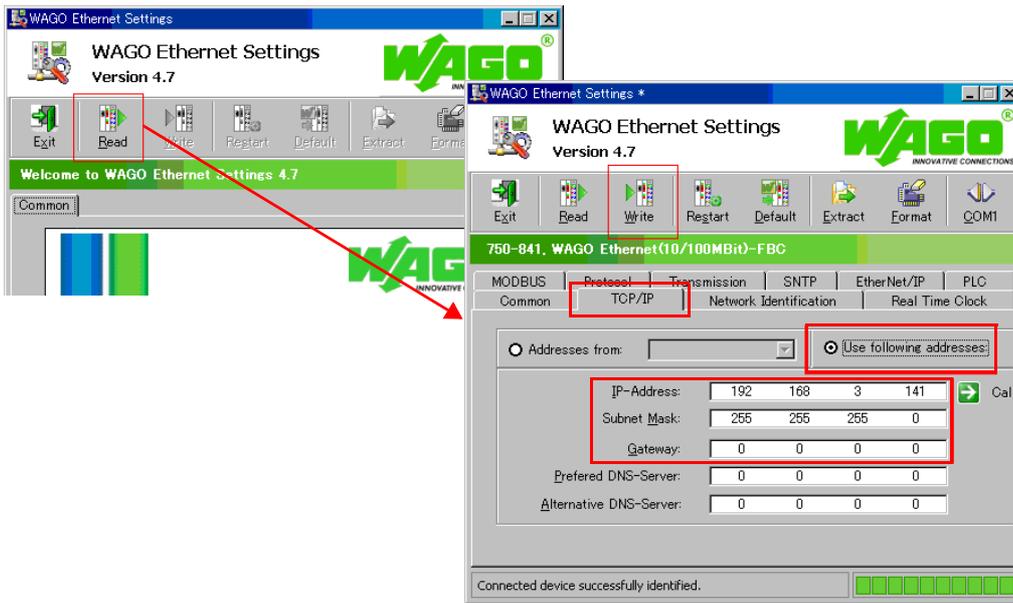


Contents	Setting	Remarks
IP-Address	Make settings in accordance with the network environment.	
Subnet Mask		
Gateway		

- \* When making settings for 750-871, set all DIP switches in the OFF positions.
- \* The port number is fixed to "502".

**Enabling Modbus UDP and Modbus TCP protocols**


When both Modbus UDP and Modbus TCP protocols are checked (enabled), communication using either protocol becomes possible without selecting a communication protocol on the bus coupler or bus controller. For more information, refer to the PLC manual issued by the manufacturer.

- Setting on the web browser  
 Connect the computer to the bus coupler or bus controller, and start the web browser.  
 Click [Port] on the browser menu. The password entry dialog appears. To log on as an administrator, enter "admin" for the user name and "wago" for the password, and click [OK].  
 Check both [Modbus UDP] and [Modbus TCP]. Click [SUBMIT], and turn the power off and back on again.  
 \* In the initial condition, both Modbus UDP and Modbus TCP are enabled (checked).

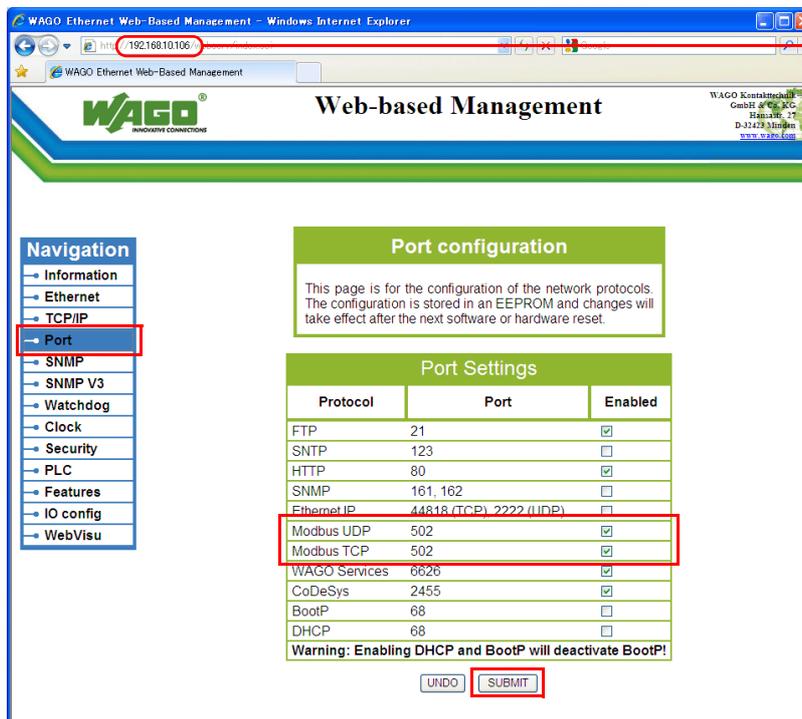

Enter the IP address of the bus coupler or bus controller on Internet Explorer, and press the [Enter] key to display the browser menu.

- Setting on the [WAGO Ethernet Settings] window ([Protocol] tab window)  
 \*\*"WAGO Ethernet Settings" cannot be used with 750-342 or 750-842.  
 Check  Modbus TCP (Port 502) and  Modbus UDP (Port 502) in the [Protocol] tab window and write the settings into the bus coupler or bus controller.

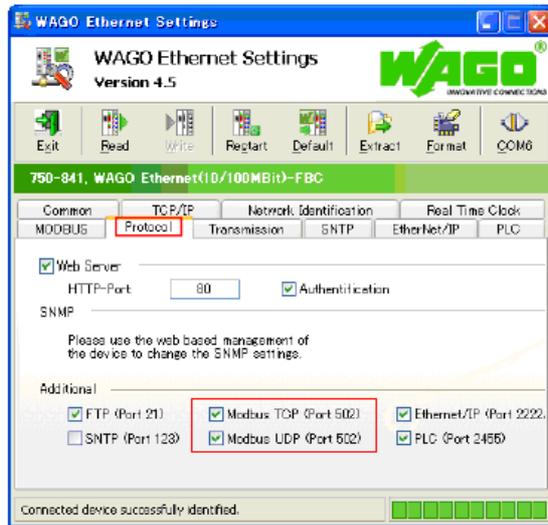

### 750-871

The least significant byte of the IP address can be set by the DIP switch.  
 Note that the IP address must be set on "WAGO BootP Server" or "WAGO Ethernet Settings" in advance.  
 When any of the DIP switches is set in the ON position upon power-on, the IP address set by the DIP switch will take effect.

DIP Switch	Setting Example	Remarks
	50 [DEC] (00110010 BIN)	Set the least significant byte of the IP address (1 to 254). Switch 1 = LSB, switch 8 = MSB

### 750-873

Connect the computer to the bus coupler or bus controller, and start the web browser. Be sure to uncheck [Override default fieldbus settings?] for [Modbus RTU Settings] in the [Modbus] browser menu.

- \* When [Modbus] is clicked, the password may be required. For more information, see "750-873" (page 23-5).
- \* In the initial condition, [Override default fieldbus settings?] is unchecked.

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
%MX (internal contact point)	00H	%MW as word device
%IX (input variable)	01H	%IW as word device
%QX (output variable)	02H	%QW as word device

### 23.1.3 Wiring Diagrams

#### When Connected at CN1:


#### RS-232C

Wiring diagram 1 - C2

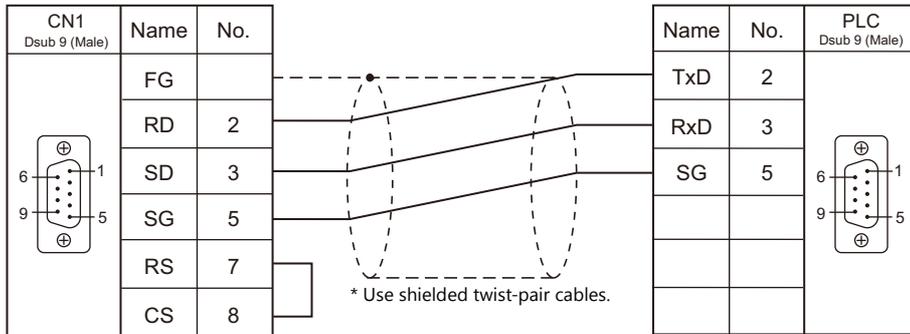

#### RS-422/RS-485


Wiring diagram 1 - C4

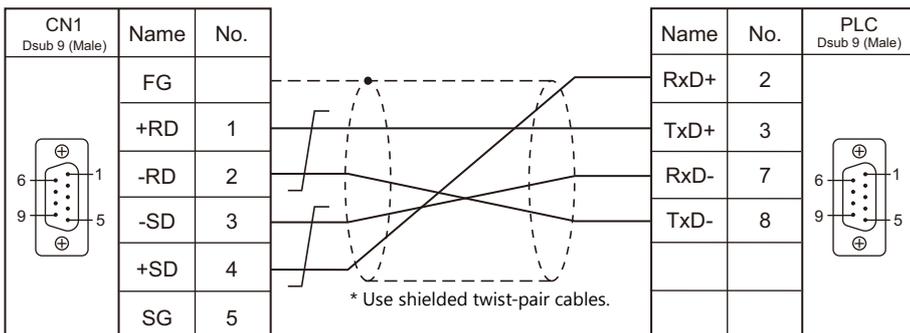

#### When Connected at MJ1/MJ2:


#### RS-232C

Wiring diagram 1 - M2

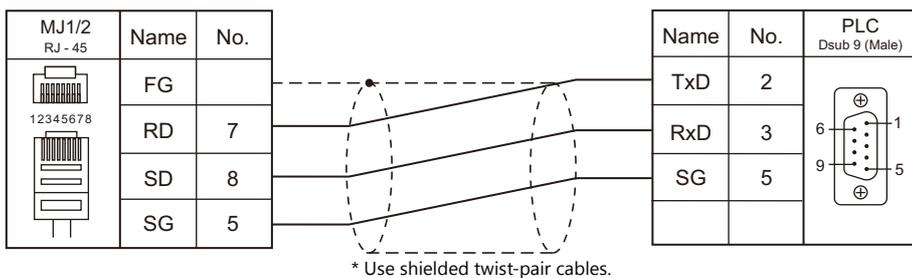


RS-422/RS-485

Wiring diagram 1 - M4

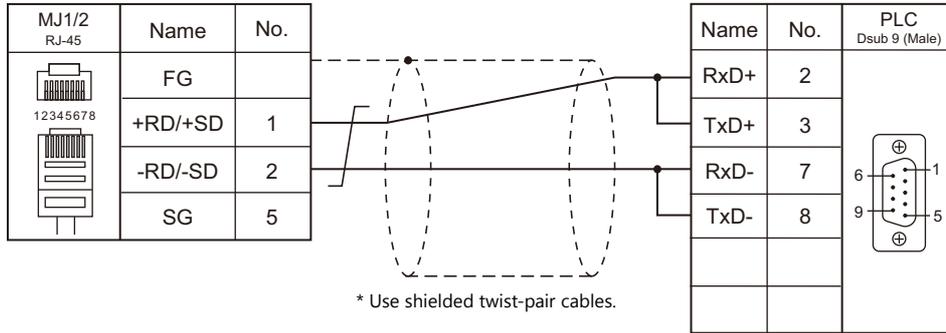


Wiring diagram 2 - M4

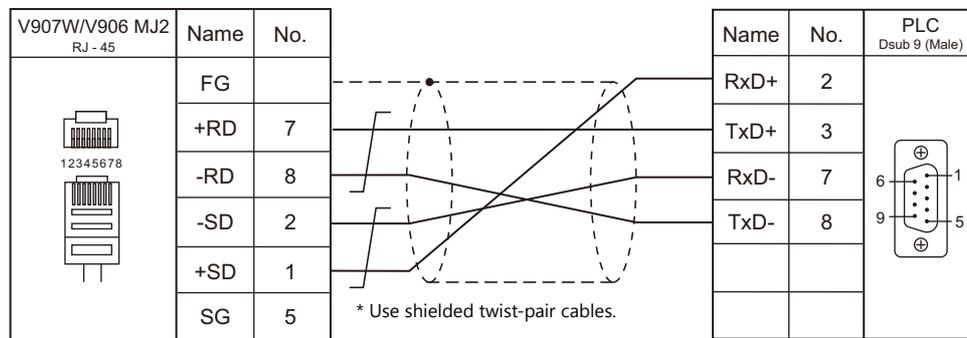

\* Slide switch on V907W/V906:  
RS-422 (lower)

# MEMO

**MONITOUCH**



# 24.XINJE

---

## 24.1 PLC Connection

## 24.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU	Unit/Port		Signal Level	Connection			Ladder Transfer <sup>*2</sup>
					CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906	
XC Series (MODBUS RTU)	XC2 XC3 XC5	COM1 (Mini-DIN 8-pin)		RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2	×	
		COM2 (Mini-DIN 8-pin)						
		COM2 (Terminal block)		RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4		
	XC-COM-BD	COM3	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2			
			RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4			

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

## 24.1.1 XC Series (MODBUS RTU)

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)


Item	Setting	Remarks
Connection Mode	<u>1</u> : 1 / 1 : n / Multi-link2 Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / <u>19200</u> / 38400 / 57600 / 115200 bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	0 to 254	0: Broadcast

#### PLC

Make communication settings by using the application software "XCPro" or writing the setting values directly into the FD address.

For more information, refer to the PLC manual issued by the manufacturer.

#### PLC Config

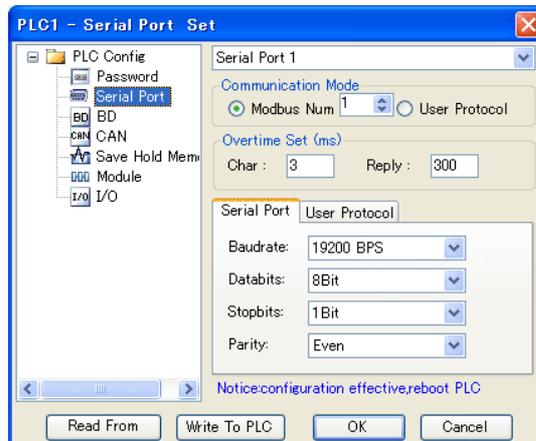

(Underlined setting: default)

Item	Setting	Remarks	
Serial Port	Serial Port 1 - 3	Select a COM port to which the V9 is connected.	
	Communication Mode	Modbus Num <u>1</u> to 254	
	Serial Port	Baudrate	4800 / 9600 / <u>19200</u> / 38400 / 57600 / 115200 Bps
		Databits	7 / <u>8</u> Bits
		Stopbits	<u>1</u> / 2 Bits
Parity		None / Odd / <u>Even</u>	
BD	BD Config	BD Serial Port	
		This setting is used when using "XC-COM-BD".	

After writing the settings, turn the PLC power off and on again.

## FD address

Port	FD	Setting	Remarks																							
COM1	FD8210	Communication mode: Station number setting	Changes can be made using the application software. Of the settings made with the application software and FD address, the one made last will be used.																							
	FD8211	Communication format: Baud rate, data length, stop bit, parity settings bit <table border="1" style="display: inline-table; margin: 5px;"> <tr> <td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> </table> <table style="display: inline-table; margin: 5px;"> <tr> <td style="text-align: center;">Parity</td> <td style="text-align: center;">Stopbits</td> <td style="text-align: center;">Databits</td> <td style="text-align: center;">Baudrate</td> </tr> <tr> <td style="text-align: center;">0: None 1: Odd 2: Even</td> <td style="text-align: center;">0: 2 Bits 2: 1 Bit</td> <td style="text-align: center;">0: 8 Bits 1: 7 Bits</td> <td style="text-align: center;">4: 4800 BPS 5: 9600 BPS 6: 19200 BPS 7: 38400 BPS 8: 57600 BPS 9: 115200 BPS</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	Parity	Stopbits	Databits	Baudrate	0: None 1: Odd 2: Even	0: 2 Bits 2: 1 Bit	0: 8 Bits 1: 7 Bits
15	14	13		12	11	10	9	8	7	6	5	4	3	2	1	0										
Parity	Stopbits	Databits		Baudrate																						
0: None 1: Odd 2: Even	0: 2 Bits 2: 1 Bit	0: 8 Bits 1: 7 Bits		4: 4800 BPS 5: 9600 BPS 6: 19200 BPS 7: 38400 BPS 8: 57600 BPS 9: 115200 BPS																						
COM2	FD8220	Same as COM1																								
	FD8221																									
COM3	FD8230	Same as COM1																								
	FD8231																									

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	
M (auxiliary relays)	01H	
X (input relay)	02H	
Y (output relay)	03H	
S (status relays)	04H	
T (timer)	05H	
TD (timer data)	06H	
C (counter)	07H	
CD (counter data)	08H	
FD (flashROM register)	09H	

## Indirect Device Memory Designation

	15	8	7	0
n + 0	Model		Device type	
n + 1	Address No.			
n + 2	Expansion code		Bit designation	
n + 3	00		Station number	

- For X or Y device memory:  
Convert the address from octal notation (OCT) to decimal (DEC) and divide by 16. Specify the quotient as the address number. Specify the remainder for bit designation.

Example: Indirect device memory designation of "X31"  
 $31 \text{ (OCT)} \rightarrow 25 \text{ (DEC)} \div 16 = 1 \text{ remainder } 9$


Specify "1" (DEC) for the address number, and "9" (DEC) for the bit designation.

## 24.1.2 Wiring Diagrams


### When Connected at CN1:

#### RS-232C

Wiring diagram 1 - C2

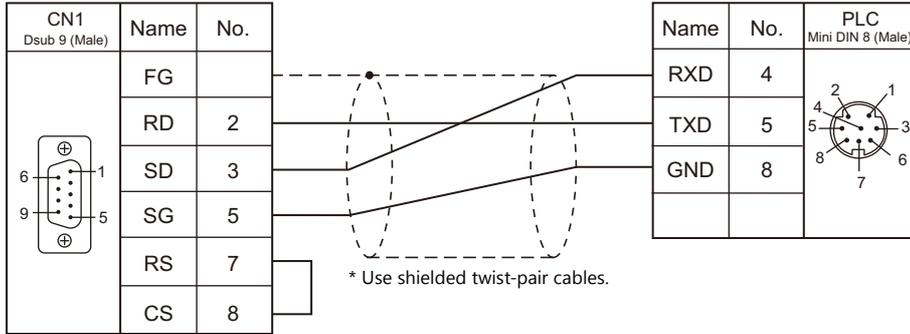


Wiring diagram 2 - C2

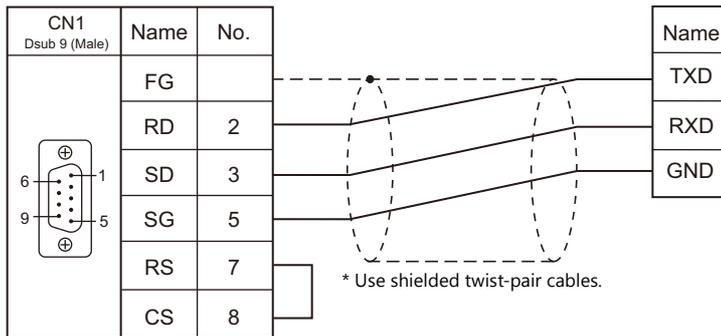

#### RS-422/RS-485


Wiring diagram 1 - C4

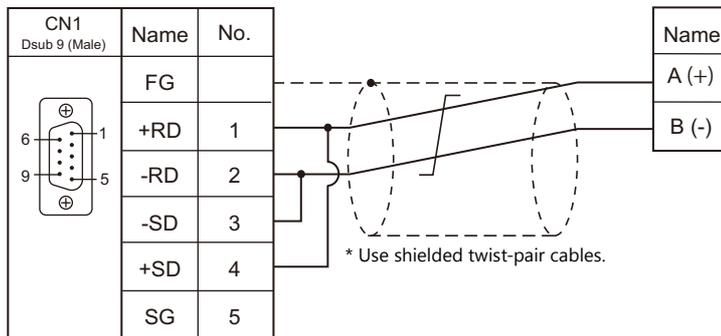


**When Connected at MJ1/MJ2:**

**RS-232C**

**Wiring diagram 1 - M2**

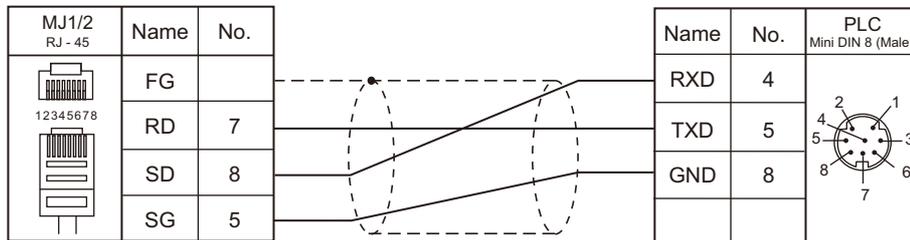


**Wiring diagram 2 - M2**

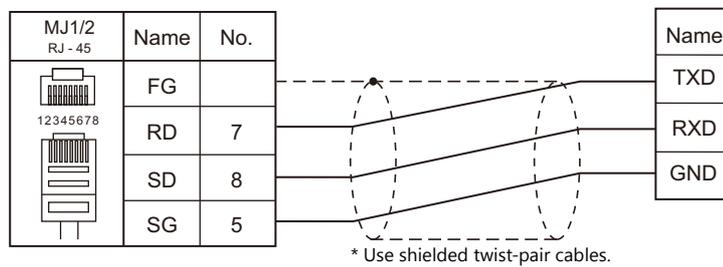


**RS-422/RS-485**

**Wiring diagram 1 - M4**

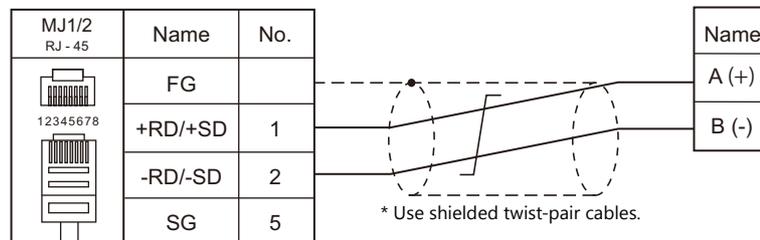

# MEMO

**MONITOUCH**



# 25. YAMAHA

---

## 25.1 Temperature Controller/Servo/Inverter Connection

## 25.1 Temperature Controller/Servo/Inverter Connection

### Serial Connection

#### Robot Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
RCX142	RCX142	COM	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		Y_RCX142.lst
	RCX222						
	RCX240						

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 25.1.1 RCX142

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / Multi-link2 / Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u>	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 bps	
Data Length	7 / <u>8 bits</u>	
Stop Bit	<u>1 bit</u>	
Parity	None / <u>Odd</u> / Even	
CR/LF	<u>CR</u> / CR/LF	

#### Robot Controller

#### RCX142/RCX240

Set communication parameters using the MPB programming box (RPB programming box for RCX240). For more information, refer to the instruction manual for the robot controller issued by the manufacturer.

(Underlined setting: default)

Mode	Sub Menu	Item	Setting	Remarks
SYSTEM	CMU	1. CMU mode	<u>ONLINE</u>	
		2. Data bits <sup>*1</sup>	7 / <u>8 bits</u>	
		3. Baud rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 bps	
		4. Stop bit	<u>1</u> / 2 bits	
		5. Parity	NON / <u>ODD</u> / EVEN	
		6. Termination code	CR / <u>CRLE</u>	
		7. XON/XOFF control <sup>*2</sup>	<u>NO</u>	
		8. RTS/CTS control <sup>*2</sup>	<u>NO</u>	

\*1 If Japanese is selected for the interface language, set the data bit to "8".

#### RCX222

Set communication parameters using the RPB programming box. For more information, refer to the instruction manual for the robot controller issued by the manufacturer.

(Underlined setting: default)

Mode	Sub Menu	Item	Setting	Remarks
SYSTEM	CMU	1. CMU mode	<u>ONLINE</u>	
		2. Data bits <sup>*1</sup>	7 / <u>8 bits</u>	
		3. Baud rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 bps	
		4. Stop bit	<u>1</u> / 2 bits	
		5. Parity	NON / <u>ODD</u> / EVEN	
		6. Termination code	CR / <u>CRLE</u>	
		7. Flow control	<u>NO</u>	

\*1 If Japanese is selected for the interface language, set the data bit to "8".

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
LANG (interface language)	00H	
ACSL (access level)	01H	
ARM1 (arm status (main robot))	02H	
ARM2 (arm status (sub robot))	03H	
BRKP (break point)	04H	
EXEL (execution level)	05H	
MODS (mode status)	06H	
ORIG (origin return status)	07H	Read only
ABSR (absolute reset status)	08H	Double-word, read only
SERV (servo status)	09H	Double-word, read only
SEQE (sequence program execution status)	0AH	
UNIT (point unit coordinate system)	0BH	
VERS (version)	0CH	Read only
WHR1 (current position in pulse coordinate system (main group))	0DH	Double-word, read only
WHR2 (current position in pulse coordinate system (sub group))	0EH	Double-word, read only
WXY1 (current position in XY coordinate system (main group))	0FH	Double-word, read only
WXY2 (current position in XY coordinate system (sub group))	10H	Double-word, read only
SIFT (shift status)	11H	Read only
HAND (hand status)	12H	Read only
MEMR (remaining memory capacity)	13H	Double-word, read only
EMGS (emergency stop status)	14H	Read only
SELF (error status in self-diagnosis)	15H	Read only
OPTS (option slot status)	16H	Read only
PRGS (program execution status)	17H	Read only
TSKS (running or suspended status of task)	18H	Read only
TSKM (task operation status)	19H	Read only

### LANG (interface language)

Address	Name	Setting Range
0	Interface language	0: Japanese 1: English

### ACSL (access level)

Address	Name	Setting Range
0	Access level	0 to 3

### ARM1 (arm status (main robot))

Address	Name	Setting Range
0	Current arm setting	0: Right-hand system 1: Left-hand system
1	Arm setting at the time of program reset	0: Right-hand system 1: Left-hand system

### ARM2 (arm status (sub robot))

Address	Name	Setting Range
0	Current arm setting	0: Right-hand system 1: Left-hand system
1	Arm setting at the time of program reset	0: Right-hand system 1: Left-hand system

**BRKP (break point)**

Address	Name	Setting Range
0	Line number of break point 1	0 to 19999
1	Line number of break point 2	0 to 19999
2	Line number of break point 3	0 to 19999
3	Line number of break point 4	0 to 19999

**EXEL (execution level)**

Address	Name	Setting Range
0	Execution level	0 to 8

**MODS (mode status)**

Address	Name	Setting Range
0	Mode status	0: AUTO 1: PROGRAM 2: MANUAL 3: SYSTEM

**ORIG (origin return status)**

Address	Name	Setting Range
0	Origin return status	0: Completed 1: Not completed

**ABSR (absolute reset status)**

Address	Name	Setting Range
0	Completed or not completed	0: Completed 1: Not completed
1	Status of each axis (output only when address 0 is set to "1" (absolute reset not completed))	00000000 to 99999999 XXXXXXXX ┌──────────┴──────────┐ └── Axis 1 0: Not completed : 1: Completed └── Axis 8 9: Not applicable

**SERV (servo status)**

Address	Name	Setting Range
0	Motor power ON/OFF status	0: Motor power ON 1: Motor power OFF
1	Status of each axis	00000000 to 99999999 XXXXXXXX ┌──────────┴──────────┐ └── Axis 1 0: Mechanical brake ON + dynamic brake ON : 1: Servo ON └── Axis 8 2: Mechanical brake OFF + dynamic brake OFF 9: Not applicable

**SEQE (sequence program execution status)**

Address	Name	Setting Range
0	Availability	0: Disabled 1: Enabled 3: Enabled, and output cleared at the time of emergency stop
1	Execution status	0: Stopped 1: In progress

**UNIT (point unit coordinate system)**

Address	Name	Setting Range
0	Point unit coordinate system	0: Joint coordinates in units of pulse 1: Cartesian coordinates in units of mm or deg.

**VERS (version)**

Address	Name	Setting Range
0	Host version	
1	Host revision	
2	MPB/RPB version	
3	Driver version 1	
4	Driver version 2	
5	Driver version 3	
6	Driver version 4	
7	Driver version 5	
8	Driver version 6	
9	Driver version 7	
10	Driver version 8	
11	Option unit version	

**WHR1 (current position in pulse coordinate system (main group))**

Address	Name	Setting Range
0	Current position of axis 1 in the pulse coordinate system (main group)	-999999 to 999999
1	Current position of axis 2 in the pulse coordinate system (main group)	-999999 to 999999
2	Current position of axis 3 in the pulse coordinate system (main group)	-999999 to 999999
3	Current position of axis 4 in the pulse coordinate system (main group)	-999999 to 999999
4	Current position of axis 5 in the pulse coordinate system (main group)	-999999 to 999999
5	Current position of axis 6 in the pulse coordinate system (main group)	-999999 to 999999

**WHR2 (current position in pulse coordinate system (sub group))**

Address	Name	Setting Range
0	Current position of axis 1 in the pulse coordinate system (sub group)	-999999 to 999999
1	Current position of axis 2 in the pulse coordinate system (sub group)	-999999 to 999999
2	Current position of axis 3 in the pulse coordinate system (sub group)	-999999 to 999999
3	Current position of axis 4 in the pulse coordinate system (sub group)	-999999 to 999999
4	Current position of axis 5 in the pulse coordinate system (sub group)	-999999 to 999999
5	Current position of axis 6 in the pulse coordinate system (sub group)	-999999 to 999999

**WXY1 (current position in XY coordinate system (main group))**

Address	Name	Setting Range
0	Current position of axis 1 in units of "mm" (main group)	-999999 to 999999
1	Current position of axis 2 in units of "mm" (main group)	-999999 to 999999
2	Current position of axis 3 in units of "mm" (main group)	-999999 to 999999
3	Current position of axis 4 in units of "mm" (main group)	-999999 to 999999
4	Current position of axis 5 in units of "mm" (main group)	-999999 to 999999
5	Current position of axis 6 in units of "mm" (main group)	-999999 to 999999

**WXY2 (current position in XY coordinate system (sub group))**

Address	Name	Setting Range
0	Current position of axis 1 in units of "mm" (sub group)	-999999 to 999999
1	Current position of axis 2 in units of "mm" (sub group)	-999999 to 999999
2	Current position of axis 3 in units of "mm" (sub group)	-999999 to 999999
3	Current position of axis 4 in units of "mm" (sub group)	-999999 to 999999
4	Current position of axis 5 in units of "mm" (sub group)	-999999 to 999999
5	Current position of axis 6 in units of "mm" (sub group)	-999999 to 999999

**SIFT (shift status)**

Address	Name	Setting Range
0	Shift number selected for main robot	0 to 9
1	Shift number selected for sub robot	0 to 9

**HAND (hand status)**

Address	Name	Setting Range
0	Hand number selected for main robot	0 to 3
1	Hand number selected for sub robot	4 to 7

**MEMR (remaining memory capacity)**

Address	Name	Setting Range
0	Remaining source area (unit: byte)	
1	Remaining object area (unit: byte)	

**EMGS (emergency stop status)**

Address	Name	Setting Range
0	Emergency stop status	0: Normal 1: Emergency stop

**SELF (error status in self-diagnosis)**

Address	Name	Setting Range
0 to 49	Error status 1	[Error group No.] . [Error category No.] : [Error message] (CHAR)
50 to 99	Error status 2	
100 to 149	Error status 3	
150 to 199	Error status 4	
200 to 249	Error status 5	

**OPTS (option slot status)**

Address	Name	Setting Range
0 to 49	Option slot status 1	Option board name (CHAR)
50 to 99	Option slot status 2	
100 to 149	Option slot status 3	
150 to 199	Option slot status 4	

**PRGS (program execution status)**

Address	Name	Setting Range
0 to 49	Name of currently selected program	Program name (CHAR)
50	Current task number	1 to 8
51	Line number of current program	1 to 9999
52	Priority of current task	17 to 47

**TSKS (running or suspended status of task)**

Address	Name	Setting Range
0	Number of task currently running or suspended (No. 1)	1 to 8
1	Number of task currently running or suspended (No. 2)	1 to 8
2	Number of task currently running or suspended (No. 3)	1 to 8
3	Number of task currently running or suspended (No. 4)	1 to 8
4	Number of task currently running or suspended (No. 5)	1 to 8
5	Number of task currently running or suspended (No. 6)	1 to 8
6	Number of task currently running or suspended (No. 7)	1 to 8
7	Number of task currently running or suspended (No. 8)	1 to 8

**TSKM (task operation status)**

Address	Name	Setting Range
0	Number of line being executed in task (No. 1)	1 to 9999
1	Task status (No. 1)	0: In progress 1: Suspended 2: Stopped
2	Priority (No. 1)	17 to 47
3	Number of line being executed in task (No. 2)	1 to 9999
4	Task status (No. 2)	0: In progress 1: Suspended 2: Stopped
5	Priority of task (No. 2)	17 to 47
6	Number of line being executed in task (No. 3)	1 to 9999
7	Task status (No. 3)	0: In progress 1: Suspended 2: Stopped
8	Priority of task (No. 3)	17 to 47
9	Number of line being executed in task (No. 4)	1 to 9999
10	Task status (No. 4)	0: In progress 1: Suspended 2: Stopped
11	Priority of task (No. 4)	17 to 47
12	Number of line being executed in task (No. 5)	1 to 9999
13	Task status (No. 5)	0: In progress 1: Suspended 2: Stopped
14	Priority of task (No. 5)	17 to 47
15	Number of line being executed in task (No. 6)	1 to 9999
16	Task status (No. 6)	0: In progress 1: Suspended 2: Stopped
17	Priority of task (No. 6)	17 to 47
18	Number of line being executed in task (No. 7)	1 to 9999
19	Task status (No. 7)	0: In progress 1: Suspended 2: Stopped
20	Priority of task (No. 7)	17 to 47
21	Number of line being executed in task (No. 8)	1 to 9999
22	Task status (No. 8)	0: In progress 1: Suspended 2: Stopped
23	Priority of task (No. 8)	17 to 47

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)		F2
Program operation	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 0	
		n + 2	0: RESET 1: RUN 2: STEP 3: SKIP 4: NEXT 5: STOP	
Switching of execution task	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 1	
Manual speed change	1 - 8 (PLC1 - 8)	n	Station number	4
		n + 1	Command: 2	
		n + 2	0: Main robot 1: Sub robot	
		n + 3	Manual movement speed: 1 to 100	
Moving to absolute reset position	1 - 8 (PLC1 - 8)	n	Station number	5
		n + 1	Command: 3	
		n + 2	0: Main robot 1: Sub robot	
		n + 3	Designated axis: 1 to 6	
Absolute reset for each axis	1 - 8 (PLC1 - 8)	n	Station number	4
		n + 1	Command: 4	
		n + 2	0: Main robot 1: Sub robot	
		n + 3	Designated axis: 1 to 6	
Memory area initialization	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 5	
		n + 2	0: Program data 1: Point data 2: Shift data 3: Hand data 4: Pallet data 5: Point comment data 6: All of above data (program, point, shift, hand, pallet and point comment) 7: Parameter data 8: All data	
Communication port initialization	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 6	
Error log initialization	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 7	
Resetting of internal emergency stop flag	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 8	
Acquisition of controller configuration status	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 9	
		n + 2 to n + 3	Acquired text	
Acquisition of message line information displayed on MPB/RPB	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 10	
		n + 2 to n + 3	Acquired text	
Acquisition of error message	1 - 8 (PLC1 - 8)	n	Station number	4
		n + 1	Command: 11	
		n + 2	Top number of acquired data: 1 to 500	
		n + 3	Last number of acquired data: 1 to 500	
		n + 4 - n + 5	Acquired text	

Contents	F0	F1 (= \$u n)		F2
Acquisition of speed setting status	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 12	
		n + 2	Setting for automatic movement speed (main group): 1 to 100	
		n + 3	Setting for manual movement speed (main group): 1 to 100	
		n + 4	Setting for automatic movement speed (sub group): 1 to 100	
		n + 5	Setting for manual movement speed (sub group): 1 to 100	
Command execution interruption	1 - 8 (PLC1 - 8)	n	Station number	2
		n + 1	Command: 13	
Reading of point data	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 14	
		n + 2	Point number: 0 to 9999	
		n + 3	Coordinate system 0: Pulse (integer) 1 or greater: mm (decimal places)	
		n + 4 to n + 5	Point data 1	
		n + 6 to n + 7	Point data 2	
		n + 8 to n + 9	Point data 3	
		n + 10 to n + 11	Point data 4	
		n + 12 to n + 13	Point data 5	
		n + 14 to n + 15	Point data 6	
n + 16	Extended hand system flag setting 0: No setting 1: Right-hand system 2: Left-hand system			
Writing of point data	1 - 8 (PLC1 - 8)	n	Station number	17
		n + 1	Command: 15	
		n + 2	Point number: 0 to 9999	
		n + 3	Coordinate system 0: Pulse (integer) 1 or greater: mm (decimal places)	
		n + 4 to n + 5	Point data 1	
		n + 6 to n + 7	Point data 2	
		n + 8 to n + 9	Point data 3	
		n + 10 to n + 11	Point data 4	
		n + 12 to n + 13	Point data 5	
		n + 14 to n + 15	Point data 6	
n + 16	Extended hand system flag setting 0: No setting 1: Right-hand system 2: Left-hand system			
Reading of parameter (controller)	1 - 8 (PLC1 - 8)	n	Station number	5
		n + 1	Command: 16	
		n + 2 to n + 4	Parameter label (six alphabetical characters)	
		n + 5	Type 0: Entire controller	
		n + 6 to n + 7	Parameter data	
		n + 8 to n + 9	Comment	
Reading of parameter (main robot / main robot + sub robot)	1 - 8 (PLC1 - 8)	n	Station number	5
		n + 1	Command: 16	
		n + 2 to n + 4	Parameter label (six alphabetical characters)	
		n + 5	Type 1: Main robot 2: Main robot + sub robot	
		n + 6 to n + 7	Parameter data (main robot)	
		n + 8 to n + 9	Parameter data (sub robot)	
		n + 10 to n + 11	Comment	

Contents	F0	F1 (= \$u n)		F2
Reading of parameter (4-axis/8-axis)	1 - 8 (PLC1 - 8)	n	Station number	5
		n + 1	Command: 16	
		n + 2 to n + 4	Parameter label (six alphabetical characters)	
		n + 5	Type 3: 4-axis 4: 8-axis	
		n + 6 to n + 7	Parameter data (axis 1)	
		n + 8 to n + 9	Parameter data (axis 2)	
		n + 10 to n + 11	Parameter data (axis 3)	
		n + 12 to n + 13	Parameter data (axis 4)	
		n + 14 to n + 15	Parameter data (axis 5)	
		n + 16 to n + 17	Parameter data (axis 6)	
		n + 18 to n + 19	Parameter data (axis 7)	
		n + 20 to n + 21	Parameter data (axis 8)	
		n + 22 to n + 23	Comment	
Writing of parameter (controller)	1 - 8 (PLC1 - 8)	n	Station number	$8 + (m + 1) / 2$
		n + 1	Command: 17	
		n + 2 to n + 4	Parameter label (six alphabetical characters)	
		n + 5	Type 0: Entire controller	
		n + 6 to n + 7	Parameter data	
		n + 8 -	Comment: m	
Writing of parameter (main robot / main robot + sub robot)	1 - 8 (PLC1 - 8)	n	Station number	$10 + (m + 1) / 2$
		n + 1	Command: 17	
		n + 2 to n + 4	Parameter label (six alphabetical characters)	
		n + 5	Type 1: Main robot 2: Main robot + sub robot	
		n + 6 to n + 7	Parameter data (main robot)	
		n + 8 to n + 9	Parameter data (sub robot)	
Writing of parameter (4-axis/8-axis)	1 - 8 (PLC1 - 8)	n	Station number	$22 + (m + 1) / 2$
		n + 1	Command: 17	
		n + 2 to n + 4	Parameter label (six alphabetical characters)	
		n + 5	Type 3: 4-axis 4: 8-axis	
		n + 6 to n + 7	Parameter data (axis 1)	
		n + 8 to n + 9	Parameter data (axis 2)	
		n + 10 to n + 11	Parameter data (axis 3)	
		n + 12 to n + 13	Parameter data (axis 4)	
		n + 14 to n + 15	Parameter data (axis 5)	
		n + 16 to n + 17	Parameter data (axis 6)	
		n + 18 to n + 19	Parameter data (axis 7)	
n + 20 to n + 21	Parameter data (axis 8)			
n + 22 -	Comment: m			
Reading of shift coordinate value definition	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 18	
		n + 2	Shift coordinate number: 0 to 9	
		n + 3	Coordinate system 0: Pulse (integer) 1 or greater: mm (decimal places)	
		n + 4 to n + 5	Shift coordinate 1 (S)	
		n + 6 to n + 7	Shift coordinate 2 (S)	
		n + 8 to n + 9	Shift coordinate 3 (S)	
		n + 10 to n + 11	Shift coordinate 4 (S)	
		n + 12 to n + 13	Shift coordinate 1 (SP)	
		n + 14 to n + 15	Shift coordinate 2 (SP)	
		n + 16 to n + 17	Shift coordinate 3 (SP)	
		n + 18 to n + 19	Shift coordinate 4 (SP)	
		n + 20 to n + 21	Shift coordinate 1 (SM)	
		n + 22 to n + 23	Shift coordinate 2 (SM)	
		n + 24 to n + 25	Shift coordinate 3 (SM)	
n + 26 to n + 27	Shift coordinate 4 (SM)			

Contents	F0	F1 (= \$u n)		F2
Writing of shift coordinate value definition	1 - 8 (PLC1 - 8)	n	Station number	28
		n + 1	Command: 19	
		n + 2	Shift coordinate number: 0 to 9	
		n + 3	Coordinate system 0: Pulse (integer) 1 or greater: mm (decimal places)	
		n + 4 to n + 5	Shift coordinate 1 (S)	
		n + 6 to n + 7	Shift coordinate 2 (S)	
		n + 8 to n + 9	Shift coordinate 3 (S)	
		n + 10 to n + 11	Shift coordinate 4 (S)	
		n + 12 to n + 13	Shift coordinate 1 (SP)	
		n + 14 to n + 15	Shift coordinate 2 (SP)	
		n + 16 to n + 17	Shift coordinate 3 (SP)	
		n + 18 to n + 19	Shift coordinate 4 (SP)	
		n + 20 to n + 21	Shift coordinate 1 (SM)	
		n + 22 to n + 23	Shift coordinate 2 (SM)	
		n + 24 to n + 25	Shift coordinate 3 (SM)	
n + 26 to n + 27	Shift coordinate 4 (SM)			
Reading of hand definition	1 - 8 (PLC1 - 8)	n	Station number	3
		n + 1	Command: 20	
		n + 2	Hand number: 0 to 7	
		n + 3	Coordinate system 0: Pulse (integer) 1 or greater: mm (decimal places)	
		n + 4 to n + 5	Hand 1	
		n + 6 to n + 7	Hand 2	
		n + 8 to n + 9	Hand 3	
n + 10	Hand attachment to R axis 0: None 1: Attached			
Writing of hand definition	1 - 8 (PLC1 - 8)	n	Station number	11
		n + 1	Command: 21	
		n + 2	Hand number: 0 to 7	
		n + 3	Coordinate system 0: Pulse (integer) 1 or greater: mm (decimal places)	
		n + 4 to n + 5	Hand 1	
		n + 6 to n + 7	Hand 2	
		n + 8 to n + 9	Hand 3	
		n + 10	Hand attachment to R axis 0: None 1: Attached	

Contents	F0	F1 (= \$u n)		F2	
Reading of pallet definition	1 - 8 (PLC1 - 8)	n	Station number	3	
		n + 1	Command: 22		
		n + 2	Pallet number: 0 to 19		
		n + 3	NX		
		n + 4	NY		
		n + 5	NZ		
		n + 6	Coordinate system 0: Pulse (integer) 1 or greater: mm (decimal places)		
		n + 7 to n + 8	Coordinate data 1 for P [1]		
		n + 9 to n + 10	Coordinate data 2 for P [1]		
		n + 11 to n + 12	Coordinate data 3 for P [1]		
		n + 13 to n + 14	Coordinate data 4 for P [1]		
		n + 15 to n + 16	Coordinate data 5 for P [1]		
		n + 17 to n + 18	Coordinate data 6 for P [1]		
		n + 19 to n + 20	Coordinate data 1 for P [2]		
		n + 21 to n + 22	Coordinate data 2 for P [2]		
		n + 23 to n + 24	Coordinate data 3 for P [2]		
		n + 25 to n + 26	Coordinate data 4 for P [2]		
		n + 27 to n + 28	Coordinate data 5 for P [2]		
		n + 29 to n + 30	Coordinate data 6 for P [2]		
		n + 31 to n + 32	Coordinate data 1 for P [3]		
		n + 33 to n + 34	Coordinate data 2 for P [3]		
		n + 35 to n + 36	Coordinate data 3 for P [3]		
		n + 37 to n + 38	Coordinate data 4 for P [3]		
		n + 39 to n + 40	Coordinate data 5 for P [3]		
		n + 41 to n + 42	Coordinate data 6 for P [3]		
		n + 43 to n + 44	Coordinate data 1 for P [4]		
		n + 45 to n + 46	Coordinate data 2 for P [4]		
		n + 47 to n + 48	Coordinate data 3 for P [4]		
		n + 49 to n + 50	Coordinate data 4 for P [4]		
		n + 51 to n + 52	Coordinate data 5 for P [4]		
		n + 53 to n + 54	Coordinate data 6 for P [4]		
		n + 55 to n + 56	Coordinate data 1 for P [5]		
n + 57 to n + 58	Coordinate data 2 for P [5]				
n + 59 to n + 60	Coordinate data 3 for P [5]				
n + 61 to n + 62	Coordinate data 4 for P [5]				
n + 63 to n + 64	Coordinate data 5 for P [5]				
n + 65 to n + 66	Coordinate data 6 for P [5]				

Contents	F0	F1 (= \$u n)		F2	
Writing of pallet definition	1 - 8 (PLC1 - 8)	n	Station number	67	
		n + 1	Command: 23		
		n + 2	Pallet number: 0 to 19		
		n + 3	NX		
		n + 4	NY		
		n + 5	NZ		
		n + 6	Coordinate system 0: Pulse (integer) 1 or greater: mm (decimal places)		
		n + 7 to n + 8	Coordinate data 1 for P [1]		
		n + 9 to n + 10	Coordinate data 2 for P [1]		
		n + 11 to n + 12	Coordinate data 3 for P [1]		
		n + 13 to n + 14	Coordinate data 4 for P [1]		
		n + 15 to n + 16	Coordinate data 5 for P [1]		
		n + 17 to n + 18	Coordinate data 6 for P [1]		
		n + 19 to n + 20	Coordinate data 1 for P [2]		
		n + 21 to n + 22	Coordinate data 2 for P [2]		
		n + 23 to n + 24	Coordinate data 3 for P [2]		
		n + 25 to n + 26	Coordinate data 4 for P [2]		
		n + 27 to n + 28	Coordinate data 5 for P [2]		
		n + 29 to n + 30	Coordinate data 6 for P [2]		
		n + 31 to n + 32	Coordinate data 1 for P [3]		
		n + 33 to n + 34	Coordinate data 2 for P [3]		
		n + 35 to n + 36	Coordinate data 3 for P [3]		
		n + 37 to n + 38	Coordinate data 4 for P [3]		
		n + 39 to n + 40	Coordinate data 5 for P [3]		
		n + 41 to n + 42	Coordinate data 6 for P [3]		
		n + 43 to n + 44	Coordinate data 1 for P [4]		
		n + 45 to n + 46	Coordinate data 2 for P [4]		
		n + 47 to n + 48	Coordinate data 3 for P [4]		
		n + 49 to n + 50	Coordinate data 4 for P [4]		
		n + 51 to n + 52	Coordinate data 5 for P [4]		
		n + 53 to n + 54	Coordinate data 6 for P [4]		
		n + 55 to n + 56	Coordinate data 1 for P [5]		
n + 57 to n + 58	Coordinate data 2 for P [5]				
n + 59 to n + 60	Coordinate data 3 for P [5]				
n + 61 to n + 62	Coordinate data 4 for P [5]				
n + 63 to n + 64	Coordinate data 5 for P [5]				
n + 65 to n + 66	Coordinate data 6 for P [5]				
Reading of device port	1 - 8 (PLC1 - 8)	n	Station number	4	
		n + 1	Command: 24		
		n + 2	Device port 0: DI port 1: DO port 2: MO port 3: TO port 4: LO port 5: SI port 6: SO port		
		n + 3	Port number: 0 to 7, 10 to 17, 20 to 27		
		n + 4	Point data		
Writing of device port	1 - 8 (PLC1 - 8)	n	Station number	5	
		n + 1	Command: 25		
		n + 2	Device port 1: DO port 2: MO port 3: TO port 4: LO port 6: SO port		
		n + 3	Port number: 0 to 7, 10 to 17, 20 to 27		
		n + 4	Point data		

Contents	F0	F1 (= \$u n)		F2
Reading of dynamic variable (Data type: integer/real number)	1 - 8 (PLC1 - 8)	n	Station number	15
		n + 1	Command: 26	
		n + 2 to n + 9	Variable name (max. 16 characters)	
		n + 10	Variable type 0: Simple variable 1: One-dimensional array variable 2: Two-dimensional array variable 3: Three-dimensional array variable	
		n + 11	Subscript for one dimension <sup>*1</sup>	
		n + 12	Subscript for two dimensions <sup>*2</sup>	
		n + 13	Subscript for three dimensions <sup>*3</sup>	
		n + 14	Data type 0: Integer 1: Real number	
n + 15 to n + 16	Data			
Reading of dynamic variable (Data type: text)	1 - 8 (PLC1 - 8)	n	Station number	15
		n + 1	Command: 26	
		n + 2 to n + 9	Variable name (max. 16 characters)	
		n + 10	Variable type 0: Simple variable 1: One-dimensional array variable 2: Two-dimensional array variable 3: Three-dimensional array variable	
		n + 11	Subscript for one dimension <sup>*1</sup>	
		n + 12	Subscript for two dimensions <sup>*2</sup>	
		n + 13	Subscript for three dimensions <sup>*3</sup>	
		n + 14	Data type 2: Text	
n + 15 -	Data (max. 70 characters)			
Writing of dynamic variable (Data type: integer/real number)	1 - 8 (PLC1 - 8)	n	Station number	17
		n + 1	Command: 27	
		n + 2 to n + 9	Variable name (max. 16 characters)	
		n + 10	Variable type 0: Simple variable 1: One-dimensional array variable 2: Two-dimensional array variable 3: Three-dimensional array variable	
		n + 11	Subscript for one dimension <sup>*1</sup>	
		n + 12	Subscript for two dimensions <sup>*2</sup>	
		n + 13	Subscript for three dimensions <sup>*3</sup>	
		n + 14	Data type 0: Integer 1: Real number	
n + 15 to n + 16	Data			
Writing of dynamic variable (Data type: text)	1 - 8 (PLC1 - 8)	n	Station number	15 + (m + 1) / 2
		n + 1	Command: 27	
		n + 2 to n + 9	Variable name (max. 16 characters)	
		n + 10	Variable type 0: Simple variable 1: One-dimensional array variable 2: Two-dimensional array variable 3: Three-dimensional array variable	
		n + 11	Subscript for one dimension <sup>*1</sup>	
		n + 12	Subscript for two dimensions <sup>*2</sup>	
		n + 13	Subscript for three dimensions <sup>*3</sup>	
		n + 14	Data type 2: Text	
n + 15 -	Data (max. 70 characters): m			
Robot language execution	1 - 8 (PLC1 - 8)	n	Station number	2 + (m + 1) / 2
		n + 1	Command: 28	
		n + 2 -	Command text: m	

Contents	F0	F1 (= \$u n)		F2
Inching	1 - 8 (PLC1 - 8)	n	Station number	5
		n + 1	Command: 29	
		n + 2	0: Main robot 1: Sub robot	
		n + 3	Specified axis 1: X axis 2: Y axis 3: Z axis 4: R axis 5: A axis 6: B axis	
		n + 4	Direction of movement 0: Positive direction 1: Negative direction	
JOG	1 - 8 (PLC1 - 8)	n	Station number	5
		n + 1	Command: 30	
		n + 2	0: Main robot 1: Sub robot	
		n + 3	Specified axis 1: X axis 2: Y axis 3: Z axis 4: R axis 5: A axis 6: B axis	
		n + 4	Direction of movement 0: Positive direction 1: Negative direction	
Origin return	1 - 8 (PLC1 - 8)	n	Station number	4
		n + 1	Command: 31	
		n + 2	0: Main robot 1: Sub robot	
		n + 3	Specified axis 1: X axis 2: Y axis 3: Z axis 4: R axis 5: A axis 6: B axis	
		n + 4	Direction of movement 0: Positive direction 1: Negative direction	
Teaching	1 - 8 (PLC1 - 8)	n	Station number	4
		n + 1	Command: 32	
		n + 2	0: Main robot 1: Sub robot	
		n + 3	Point number: 0 to 9999	
		n + 4		
Reading of static variable	1 - 8 (PLC1 - 8)	n	Station number	4
		n + 1	Command: 34	
		n + 2	Data type 0: Integer (SGI) 1: Real number (SGR)	
		n + 3	Variable number: 0 to 7	
		n + 4 to n + 5	Data	
Writing of static variable	1 - 8 (PLC1 - 8)	n	Station number	6
		n + 1	Command: 35	
		n + 2	Data type 0: Integer (SGI) 1: Real number (SGR)	
		n + 3	Variable number: 0 to 7	
		n + 4 to n + 5	Data	

 Return data: Data stored from controller to V series

\*1 Valid in the case where a number other than "0" (simple variable) is specified for the variable type.

\*2 Valid in the case where "2" (two-dimensional array variable) or "3" (three-dimensional array variable) is specified for the variable type.


\*3 Valid in the case where "3" (three-dimensional array variable) is specified for the variable type.

## 25.1.2 Wiring Diagrams

### When Connected at CN1:

#### RS-232C


Wiring diagram 1 - C2

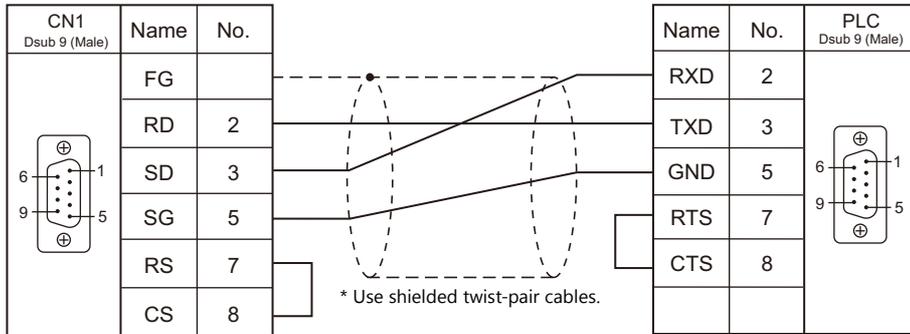

### When Connected at MJ1/MJ2:

#### RS-232C

Wiring diagram 1 - M2

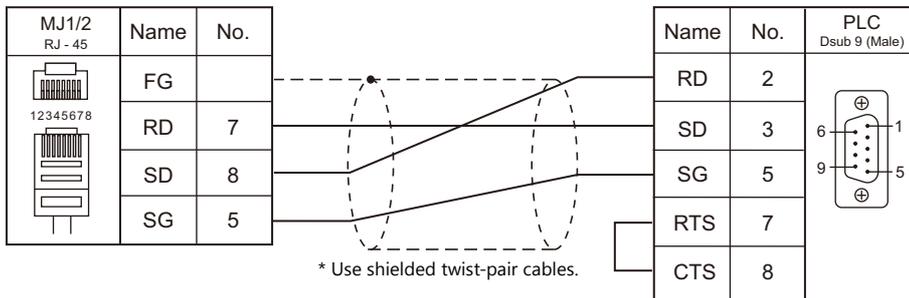

# 26. Yaskawa Electric

---

## 26.1 PLC Connection

## 26.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU	Unit/Port	Signal Level	Connection			Ladder Transfer <sup>*3</sup>	
				CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>		
Memobus	GL60 series	JAMSC-IF60 JAMSC-IF61 JAMSC-IF611	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2			
		JAMSC-IF612 JAMSC-IF613	RS-422	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 6 - M4		
	GL120 GL130 series	Memobus port on the CPU module	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2			
		JAMSC-120NOM 27100	RS-422	Wiring diagram 2 - C4	Wiring diagram 2 - M4	Wiring diagram 7 - M4		
	PROGIC-8	PORT2 on the CPU unit	RS-232C	Wiring diagram 2 - C2	Wiring diagram 2 - M2			
CP9200SH/ MP900	CP9200SH	CP-217IF	CN1	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2	X	
			CN2	RS-232C	Wiring diagram 3 - C2	Wiring diagram 3 - M2		
			CN3	RS-422	Wiring diagram 3 - C4	Wiring diagram 3 - M4		Wiring diagram 8 - M4
	MP920 MP930	Memobus port on the CPU module	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2			
		217IF	CN1 CN2	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2		
			CN3	RS-422	Wiring diagram 4 - C4	Wiring diagram 4 - M4		Wiring diagram 9 - M4
MP2200 MP2300 MP2300S	217IF-01 218IF-01	PORT	RS-232C	Wiring diagram 4 - C2	Wiring diagram 4 - M2			
		RS422/485	RS-422	Wiring diagram 5 - C4	Wiring diagram 5 - M4	Wiring diagram 10 - M4		
MP2000 series	MP2200 MP2300 MP2300S	217IF-01 218IF-01 218IF-02 260IF-01 261IF-01 215AIF-01	PORT	RS-232C	Wiring diagram 4 - C2	Wiring diagram 4 - M2		
			RS422/485	RS-422	Wiring diagram 5 - C4	Wiring diagram 5 - M4	Wiring diagram 10 - M4	
		217IF-01	RS422/485	RS-422	Wiring diagram 5 - C4	Wiring diagram 5 - M4	Wiring diagram 10 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*3 For the ladder transfer function, see the V9 Series Reference Manual 2.

### Ethernet Connection

To speed up communications, we recommend you to select "CP/MP Expansion Memobus (UDP/IP)".

PLC Selection on the Editor	CPU	Unit	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>
MP2300 (MODBUS TCP/IP)	MP2300S MP2400	218IFA (built-in LAN port)	○	X	Set the desired number using the tool.	○	X
	MP2200 MP2300 MP2300S	218IF-01					
CP/MP Expansion Memobus (UDP/IP)	MP2300S MP2400	218IFA (built-in LAN port)	X	○	Default 9999	○	X
	MP2200 MP2300 MP2300S	218IF-01					
MP2000 series (UDP/IP)	MP2200 (CPU-03) MP2310 MP2300S MP2400	218IFA (Built-in LAN port)	X	○	Default 9999	○	X
	MP2200 (CPU-04)	218IFC (Built-in LAN port)					
	MP2200 (CPU-01/02/03/04) MP2300 MP2310 MP2300S	218IF-01 218IF-02 263IF-01					

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

## 26.1.1 Memobus

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1</u> :1 / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / <u>19200</u> bps	
Data Length	8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>1</u> to 31	
Transmission Mode	<u>Type 1</u> / Type 2	For GL60 series or PROGIC-8: Type 1: special binary code For GL120/130 series: Type 2: standard binary code

#### PLC

Be sure to match the settings to those made under [Communication Setting] of the editor. For more information, refer to the PLC manual issued by the manufacturer.

Item	Setting	Remarks
Signal Level	RS-232C / RS-422	
Baud Rate	4800 / 9600 / 19200 bps	
Data Length	<b>8 bits</b>	RTU mode
Stop Bit	1 bit	
Parity	Even	
Station No.	1 to 31	
Error Check	<b>CRC</b>	
Port Delay Timer	<b>0</b>	

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
4 (holding register)	00H	
3 (input register)	01H	Including constant register, read only
R (link register)	02H	
A (extension register)	03H	
0 (coil)	04H	
D (link coil)	05H	
1 (input relay)	06H	Read only
7 (constant register)	07H	

## 26.1.2 CP9200SH/MP900

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1</u> :1 / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / <u>19200</u> / 38400 / 57600 / 76800 bps	
Data Length	8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>1</u> to 31	

#### PLC

#### CP-217IF

Be sure to match the settings to those made under [Communication Setting] of the editor.  
For more information on communication settings, refer to the PLC manual issued by the manufacturer.

#### Memobus Port on the CPU Module (MP920, MP930) / 217IF

#### Module configuration

Item	Setting	Remarks
Transmission Protocol	<b>Memobus</b>	
Master/Slave	<b>Slave</b>	
Device Address	1 to 31	
Serial I/F	RS-232	
Transmission Mode	<b>RTU</b>	
Data Length	<b>8 bits</b>	
Parity Bit	Even	
Stop Bit	1 stop	
Baud Rate	19.2K	For connection via RS-422 on "217IF", 76800 bps can also be selected. For more information, refer to the PLC manual issued by the manufacturer.

**217IF-01, 218IF-01****Module configuration**


Item	Setting	Remarks
Transmission Protocol	<b>Memobus</b>	
Master/Slave	<b>Slave</b>	
Device Address	1	
Serial I/F	RS-232 / RS-485	
Transmission Mode	<b>RTU</b>	
Data Length	<b>8 bits</b>	
Parity Bit	Even	
Stop Bit	1 stop	
Baud Rate	19.2K	The maximum baud rate available is 76.8 kbps.
Automatic Reception	Specified / Not Specified	To speed up communications, select [Not Specified]. When [Not Specified] is selected, the MSG-RCV function is required. For more information, refer to the PLC manual issued by the manufacturer.
Automatic Reception Setting	As desired	Make the setting when [Specified] is selected for [Automatic Reception].

**Available Device Memory**

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
MW (holding register)	00H	MB as bit device
IW (input register)	01H	IB as bit device, read only
MB (coil)	04H	MW as word device
IB (input relay)	06H	IW as word device, read only

When setting device memory MB/IB, set the bit numbers in the hexadecimal notation.



## 26.1.3 MP2300 (MODBUS TCP/IP)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

### 218IFA (Built-in LAN Port)

#### Module configuration

Item	Setting	Remarks
IP Address	Set the IP address of "218IFA".	
Subnet Mask	Set the subnet mask of "218IFA".	
Local Port	256 to 65535	Cannot set the same number as the one set for another connection number.
Target IP Address	<b>000.000.000.000</b>	Connected in the "Unpassive open" mode *
Target Port	<b>0000</b>	
Connection Type	<b>TCP</b>	
Protocol Type	<b>MODBUS TCP/IP</b>	
Code	<b>BIN</b>	
Automatic Reception	<b>Valid</b>	When "Valid" is checked, the operation equivalent to the MSG-RCV function is automatically performed.

\* Gives a response to the connection request issued by the station whose address is within the range specified by the subnet mask regardless of its IP address setting.

### 218IF-01 (MP2200, MP2300)

Make the settings as shown below and create a program of the MSG-RCV function. For more information, refer to the PLC manual issued by the manufacturer.

#### Module configuration

Item	Setting	Remarks
IP Address	Set the IP address of "218IF-01".	
Local Port	256 to 65534	Cannot set the same number as the one set for another connection number.
Target IP Address	<b>000.000.000.000</b>	Connected in the "Unpassive open" mode *
Target Port	<b>0000</b>	
Connection Type	<b>TCP</b>	
Protocol Type	<b>MODBUS TCP/IP</b>	
Code	<b>BIN</b>	


\* Gives a response to the connection request issued by the station whose address is within the range specified by the subnet mask regardless of its IP address setting.

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
MW (holding register)	00H	MB as bit device
IW (input register)	01H	IB as bit device, read only
MB (coil)	04H	MW as word device
IB (input relay)	06H	IW as word device, read only

When setting device memory MB/IB, set the bit numbers in the hexadecimal notation.



## 26.1.4 CP/MP Expansion Memobus (UDP/IP)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

#### 218IFA (Built-in LAN Port)

##### Module configuration

Item	Setting	Remarks
IP Address	Set the IP address of "218IFA".	
Subnet Mask	Set the subnet mask of "218IFA".	
Local Port	256 to 65535	Except 9998 and 10000. Cannot set the same number as the one set for another connection number.
Target IP Address	Set the IP address of the V series.	
Target Port	Set the port number of the V series.	
Connection Type	<b>UDP</b>	
Protocol Type	<b>Extension Memobus</b>	
Code	<b>BIN</b>	
Automatic Reception	<b>Valid</b>	When "Valid" is checked, the operation equivalent to the MSG-RCV function is automatically performed.

#### 218IF-01

Make the settings as shown below and create a program of the MSG-RCV function. For more information, refer to the PLC manual issued by the manufacturer.

##### Module configuration


Item	Setting	Remarks
IP Address	Set the IP address of "218IF-01".	
Local Port	255 to 65535	Cannot set the same number as the one set for another connection number.
Target IP Address	Set the IP address of the V series.	
Target Port	Set the port number of the V series.	
Connection Type	<b>UDP</b>	
Protocol Type	<b>Extension Memobus</b>	
Code	<b>BIN</b>	

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
MW (holding register)	00H	MB as bit device
IW (input register)	01H	IB as bit device, read only
MB (coil)	04H	MW as word device
IB (input relay)	06H	IW as word device, read only

When setting device memory MB/IB, set the bit numbers in the hexadecimal notation.



## 26.1.5 MP2000 Series

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / <u>19200</u> / 38400 / 57600 / 76800 bps	
Data Length	8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>1</u> to 31	

#### PLC

#### 217IF-01, 218IF-01, 218IF-02, 260IF-01, 261IF-01, 215AIF-01

#### Module configuration


Item	Setting	Remarks
Transmission Protocol	<b>Memobus</b>	
Master/Slave	<b>Slave</b>	
Device Address	1	
Serial I/F	RS-232/RS-485	
Transmission Mode	<b>RTU</b>	
Data Length	<b>8Bit</b>	
Parity Bit	even	
Stop Bit	1Stop	
Baud Rate	19.2K	The maximum baud rate available is 76.8 kbps.

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
MW (holding register)	00H	MB as bit device
IW (input register)	01H	IB as bit device
MB (coil)	04H	MW as word device *1
IB (input relay)	06H	IW as word device
SW (system register)	08H	SB as bit device
SB (system)	09H	SW as word device *1
OW (output register)	0AH	OB as bit device
OB (output)	0BH	OW as word device

\*1 When setting device memory MB/SB, set the bit numbers in the hexadecimal notation.



## 26.1.6 MP2000 Series (UDP/IP)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

##### Module configuration


Item	Setting	Remarks
IP Address	Set the IP address.	
Subnet Mask	Set the subnet mask.	
System Port (engineering port)	256 to 65535	Default 9999: 2181FA / 2181F-02 / 26131F-01 10000: 2181F-01

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
MW (holding register)	00H	MB as bit device
IW (input register)	01H	IB as bit device
MB (coil)	04H	MW as word device *1
IB (input relay)	06H	IW as word device
SW (system register)	08H	SB as bit device
SB (system)	09H	SW as word device *1
OW (output register)	0AH	OB as bit device
OB (output)	0BH	OW as word device

\*1 When setting device memory MB/SB, set the bit numbers in the hexadecimal notation.




## 26.1.7 Wiring Diagrams


### When Connected at CN1:

#### RS-232C


Wiring diagram 1 - C2

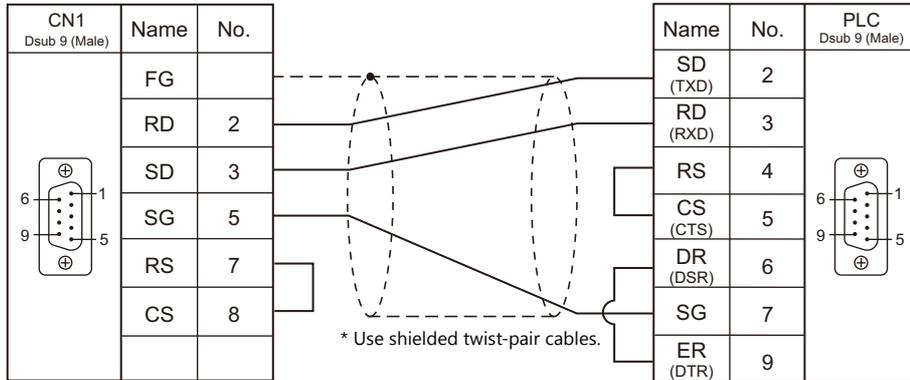


Wiring diagram 2 - C2

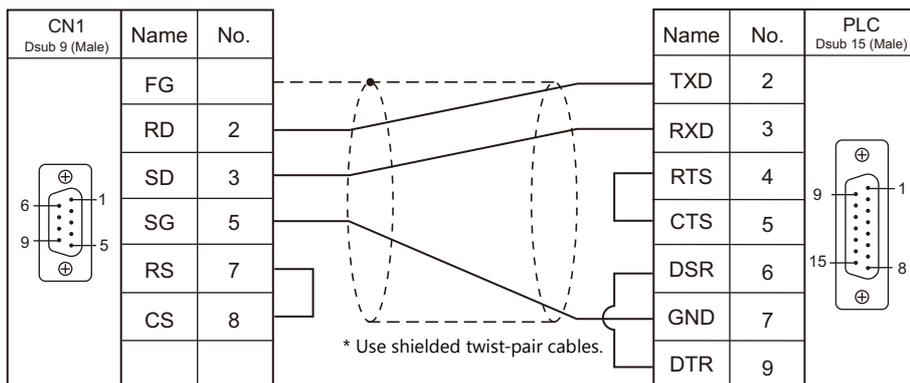

Wiring diagram 3 - C2

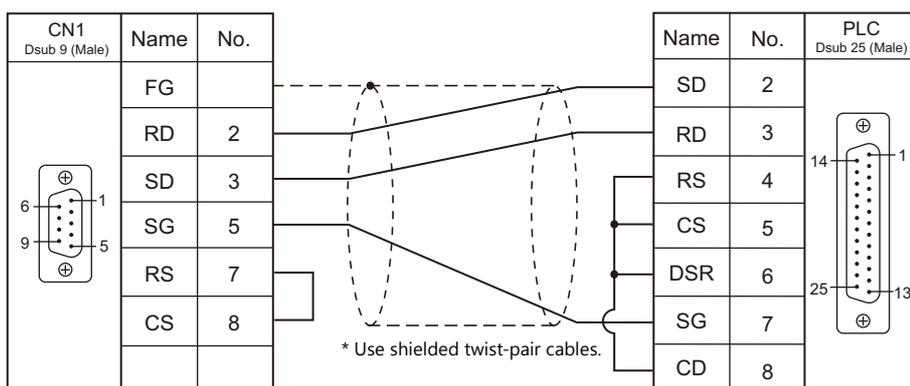


**Wiring diagram 4 - C2**

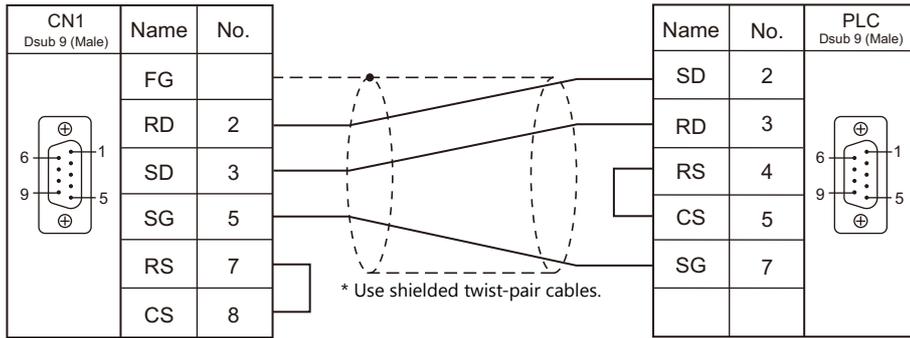


**RS-422/RS-485**


**Wiring diagram 1 - C4**

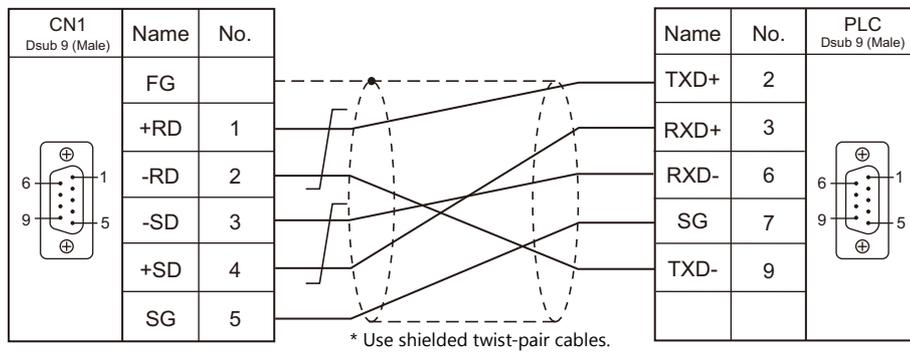


**Wiring diagram 2 - C4**

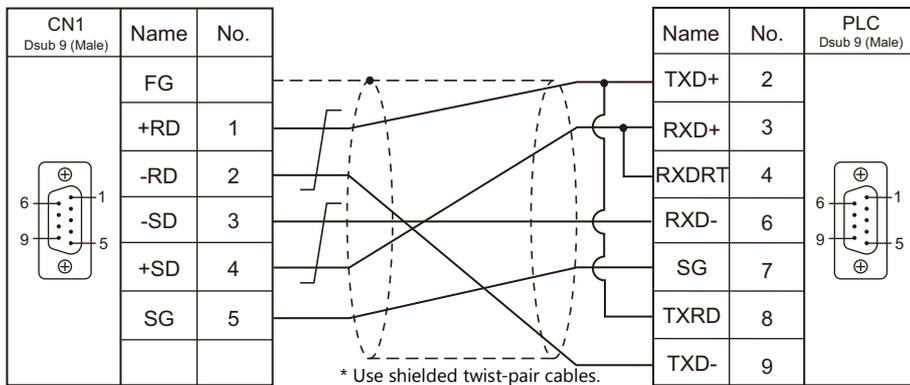


**Wiring diagram 3 - C4**

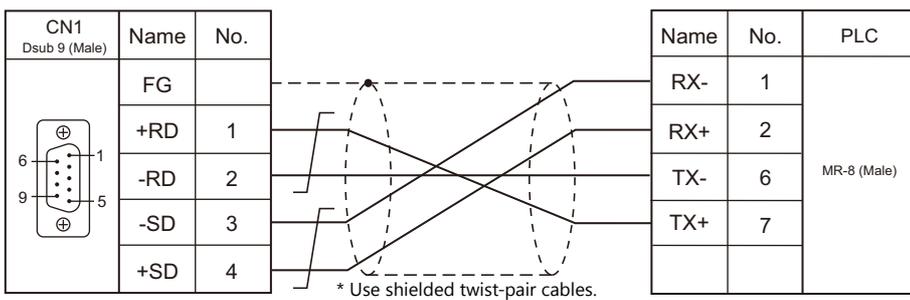

**Wiring diagram 4 - C4**

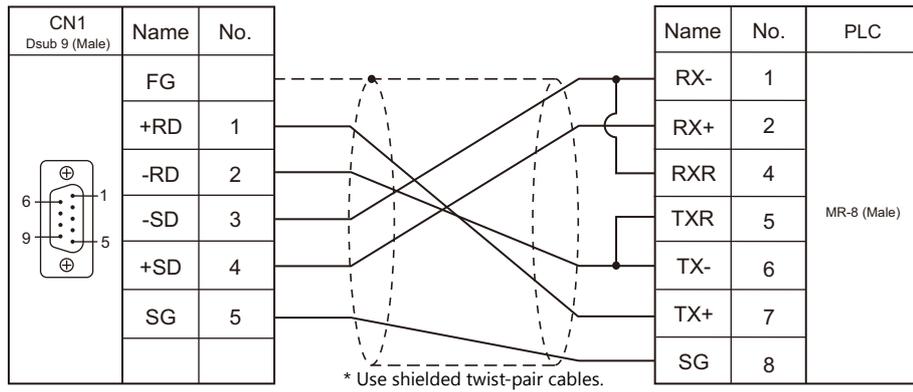


**Wiring diagram 5 - C4**

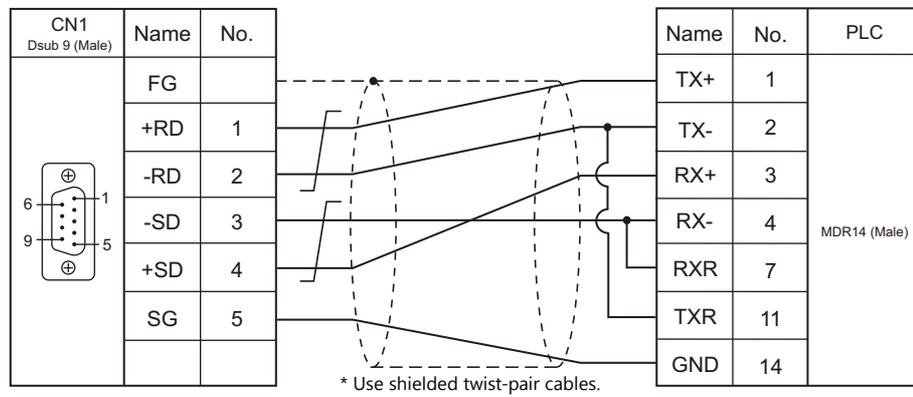


**When Connected at MJ1/MJ2:**

**RS-232C**


**Wiring diagram 1 - M2**

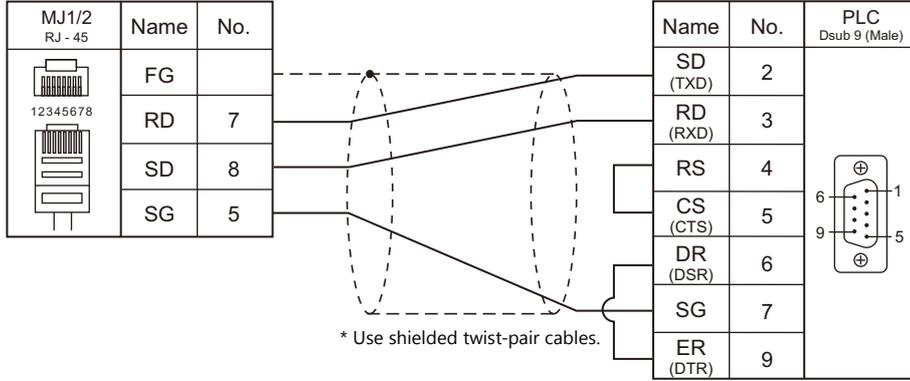


**Wiring diagram 2 - M2**

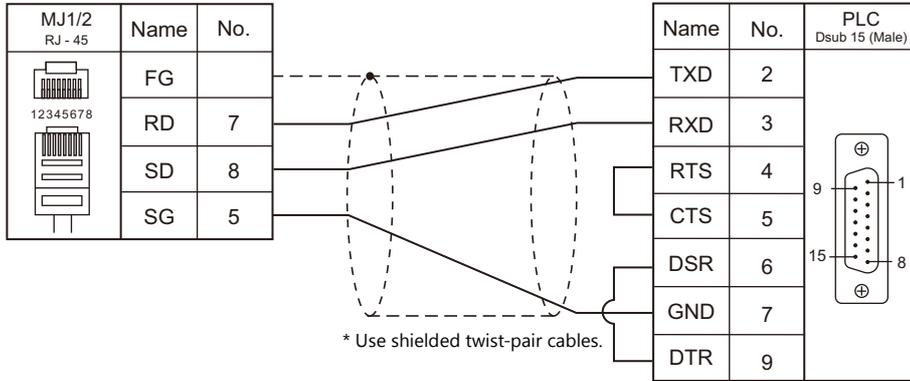


**Wiring diagram 3 - M2**

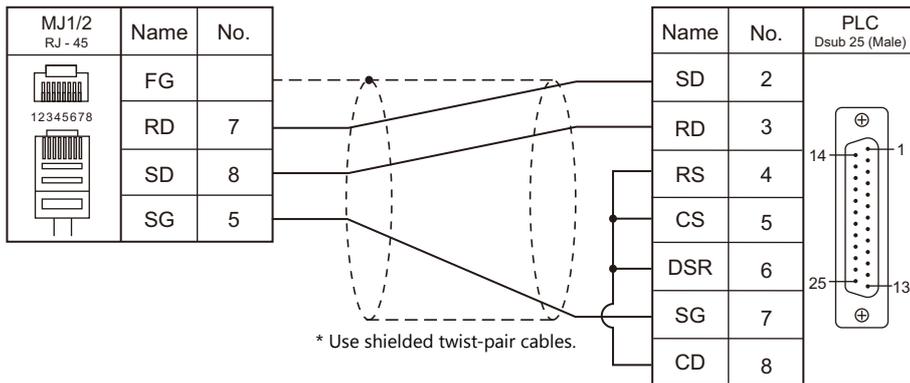

**Wiring diagram 4 - M2**

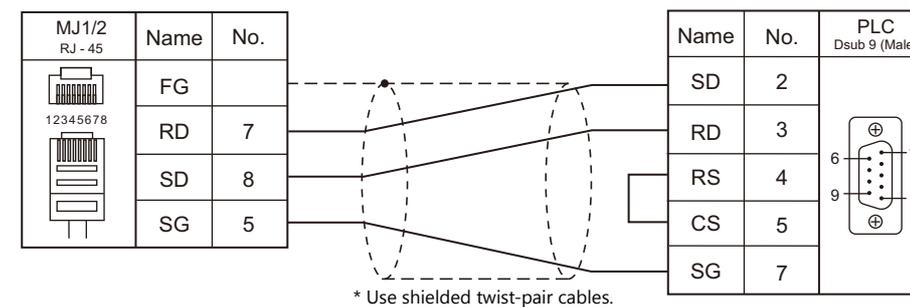


**Wiring diagram 5 - M2**

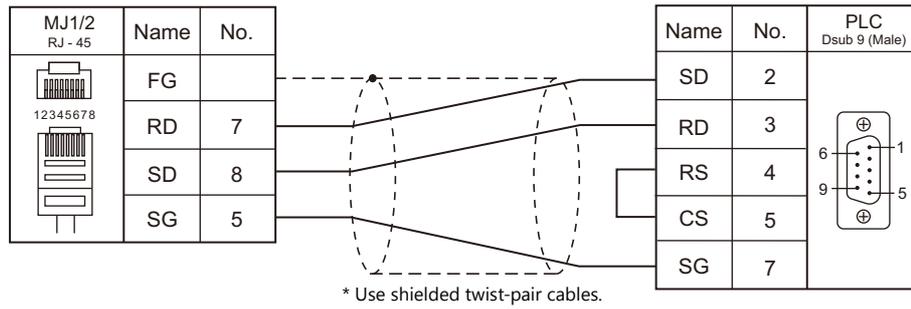


**RS-422/RS-485**


**Wiring diagram 1 - M4**

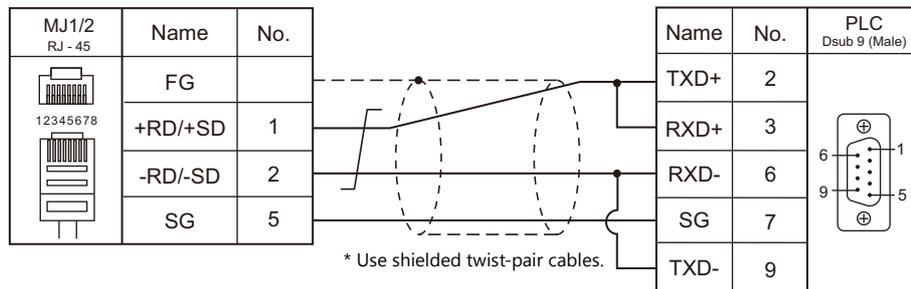


**Wiring diagram 2 - M4**

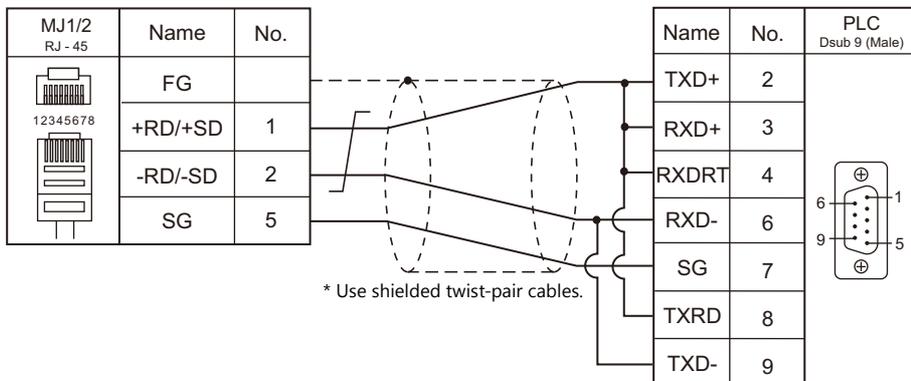


**Wiring diagram 3 - M4**

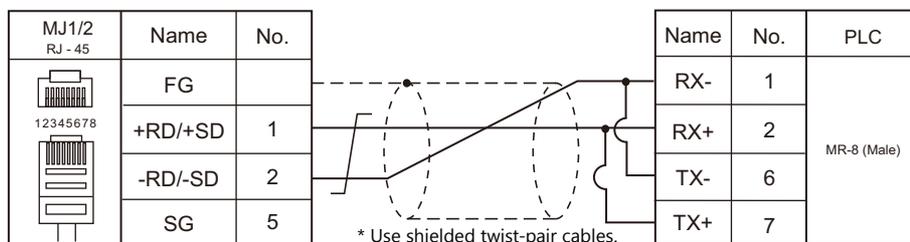


**Wiring diagram 4 - M4**

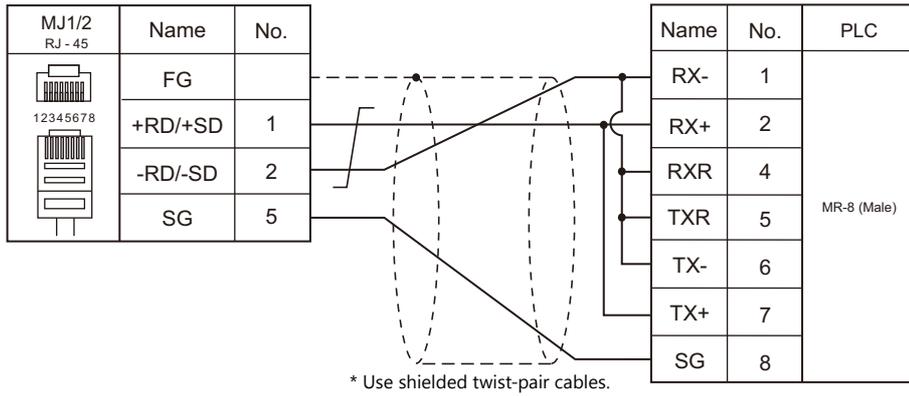


**Wiring diagram 5 - M4**

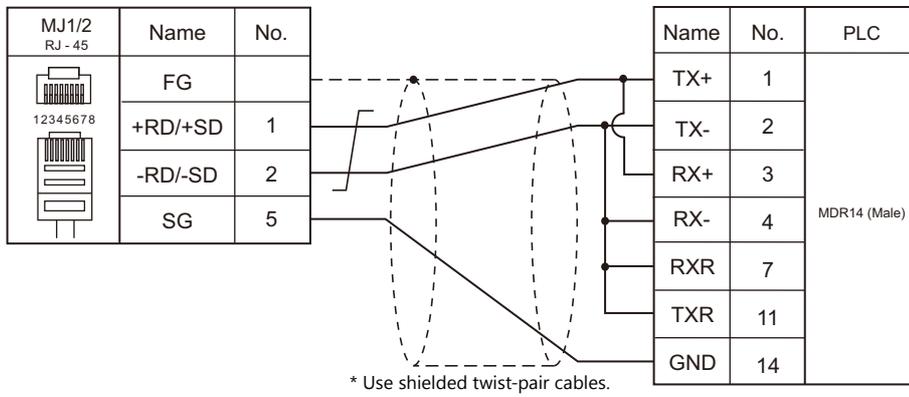


**Wiring diagram 6 - M4**

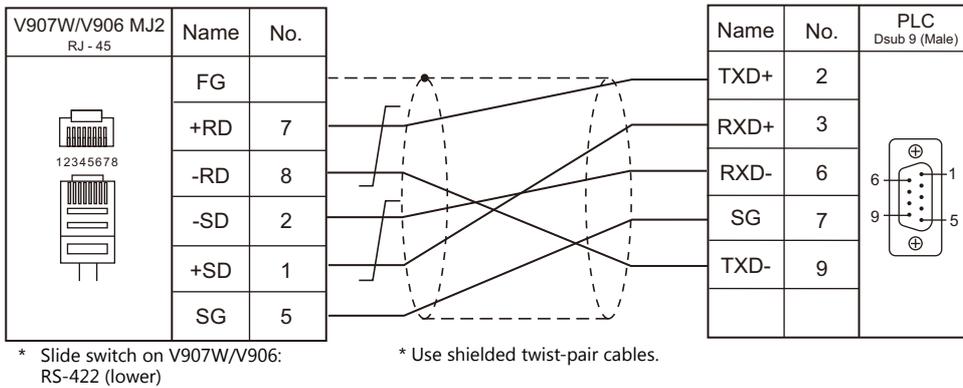

**Wiring diagram 7 - M4**

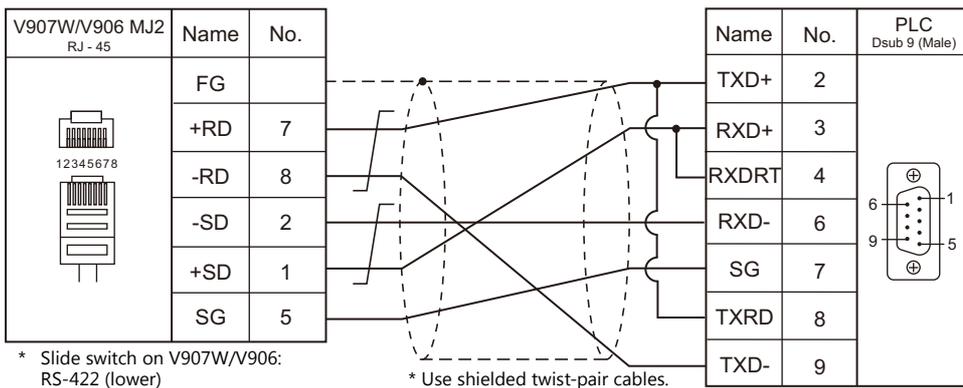


**Wiring diagram 8 - M4**

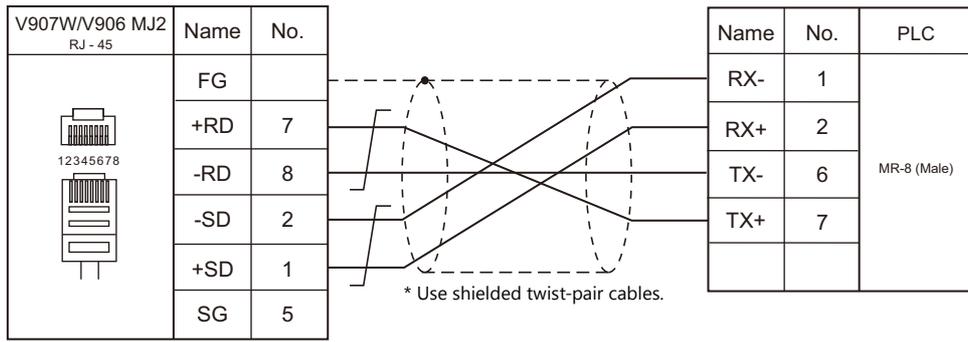


\* Slide switch on V907W/V906:  
RS-422 (lower)

**Wiring diagram 9 - M4**

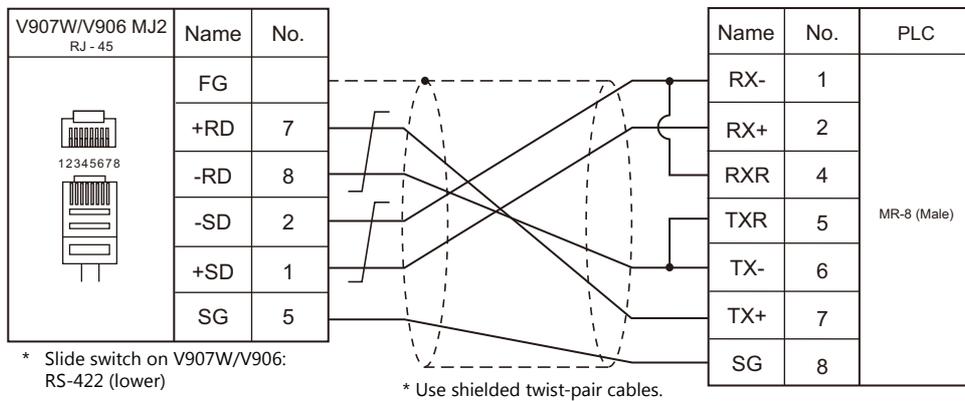

\* Slide switch on V907W/V906:  
RS-422 (lower)


**Wiring diagram 10 - M4**

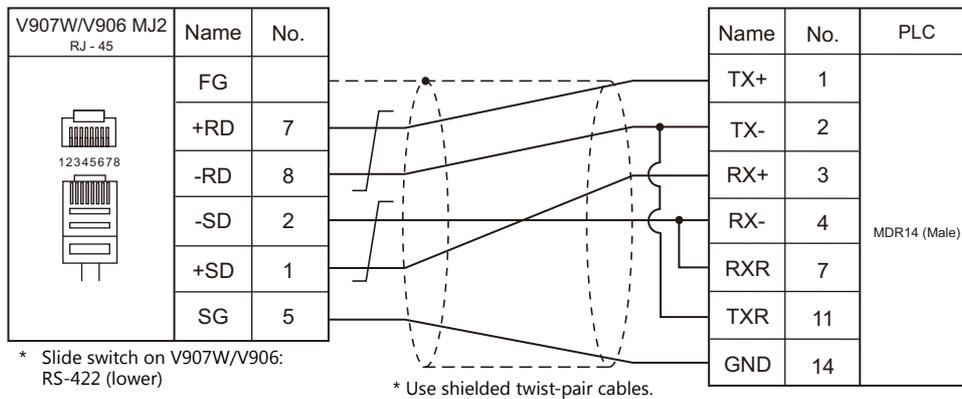

\* Slide switch on V907W/V906:  
RS-422 (lower)

# MEMO

**MONITOUCH**



# 27. Yokogawa Electric

---

27.1 PLC Connection

27.2 Temperature Controller/Servo/Inverter Connection

## 27.1 PLC Connection

### Serial Connection

PLC Selection on the Editor	CPU	Unit/Port	Signal Level	Connection			Ladder Transfer <sup>*3</sup>
				CN1	MJ1/MJ2 <sup>*1</sup>	MJ2 (4-wire) V907W/V906 <sup>*2</sup>	
FA-M3	F3SP21-0N F3SP25-2N F3SP35-5N	PROGRAMMER port	RS-232C	Yokogawa's "KM11-xT" + Gender changer <sup>*5</sup>	Yokogawa's "KM11-xT" + Wiring diagram 2 - M2		○
	F3SP20-0N F3SP21-0N F3SP25-2N F3SP35-5N	F3LC01-1N <sup>*4</sup>	RS-232C	Wiring diagram 1 - C2 or Hakko Electronics' cable "D9-YO2-09" <sup>*6</sup>	Wiring diagram 1 - M2		×
		F3LC11-1N		Wiring diagram 1 - C4 or Hakko Electronics' cable "D9-YO4-0T" <sup>*7</sup>	Wiring diagram 1 - M4	Wiring diagram 2 - M4	
FA-M3R	F3SP28-3N/3S F3SP38-6N/6S F3SP53-4H/4S F3SP58-6H/6S F3SP59-7S	PROGRAMMER port	RS-232C	Yokogawa's "KM11-xT" + Gender changer <sup>*5</sup>	Yokogawa's "KM11-xT" + Wiring diagram 2 - M2		○
	F3SP28-3N/3S F3SP38-6N/6S F3SP53-4H/4S F3SP58-6H/6S F3SP59-7S F3SP66-4S F3SP67-6S F3SP71-4N/4S F3SP76-7N/7S	F3LC11-1N F3LC11-1F F3LC12-1F	RS-232C	Wiring diagram 1 - C2 or Hakko Electronics' cable "D9-YO2-09" <sup>*6</sup>	Wiring diagram 1 - M2		×
		F3LC11-2N F3LC11-2F	RS-422	Wiring diagram 1 - C4 or Hakko Electronics' cable "D9-YO4-0T" <sup>*7</sup>	Wiring diagram 1 - M4	Wiring diagram 2 - M4	
F3SP66-4S F3SP67-6S	SIO port	RS-232C	Yokogawa's "KM21-2T" + Gender changer <sup>*5</sup>	Yokogawa's "KM21-2T" + Wiring diagram 2 - M2		×	
FA-M3V	F3SP71-4N/4S F3SP76-7N/7S	F3LC11-1N F3LC11-1F F3LC12-1F	RS-232C	Wiring diagram 1 - C2 or Hakko Electronics' cable "D9-YO2-09" <sup>*6</sup>	Wiring diagram 1 - M2		×
		F3LC11-2N F3LC11-2F	RS-422	Wiring diagram 1 - C4 or Hakko Electronics' cable "D9-YO4-0T" <sup>*7</sup>	Wiring diagram 1 - M4	Wiring diagram 2 - M4	

<sup>\*1</sup> Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906.

For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

<sup>\*2</sup> Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

<sup>\*3</sup> For the ladder transfer function, see the V9 Series Reference Manual 2.

<sup>\*4</sup> When the link unit "F3LC01-1N" is used, the communication setting and available device memory are the same as those for "FA-500". However, "B" (common register) cannot be used.

<sup>\*5</sup> Use a D-sub gender changer (9-pin, female-to-male) commercially available.

Manufacturer	Model
Black Box	FA440-R2
Misumi	DGC-9PP

<sup>\*6</sup> Cable length: D9-YO2-09- □ M (□ = 2, 3, 5)

<sup>\*7</sup> Cable length: D9-YO4-0T- □ M (□ = 2, 15)

## Ethernet Connection

PLC Selection on the Editor	CPU	Unit/Port	TCP/IP	UDP/IP	Port No.	Keep Alive <sup>*1</sup>	Ladder Transfer <sup>*2</sup>
FA-M3/FA-M3R (Ethernet UDP/IP)	FA-M3/FA-M3R	F3LE01-5T	×	○	12289	○	×
		F3LE11-0T F3LE12-0T			12289 12291		
FA-M3/FA-M3R (Ethernet UDP/IP ASCII)	FA-M3/FA-M3R	F3LE01-5T	×	○	12289	○	×
		F3LE11-0T F3LE12-0T			12289 12291		
		T/TX			12289 12291		
FA-M3/FA-M3R (Ethernet TCP/IP)	FA-M3/FA-M3R	F3LE01-5T	○	×	12289 <sup>*3</sup>	○	×
		F3LE11-0T F3LE12-0T			12289 <sup>*3</sup> 12291 <sup>*3</sup>		
		T/TX			12289 <sup>*3</sup> 12291 <sup>*3</sup>		
FA-M3/FA-M3R (Ethernet TCP/IP ASCII)	FA-M3/FA-M3R	F3LE01-5T	○	×	12289 <sup>*3</sup>	○	×
		F3LE11-0T F3LE12-0T			12289 <sup>*3</sup> 12291 <sup>*3</sup>		
		T/TX			12289 <sup>*3</sup> 12291 <sup>*3</sup>		
FA-M3V (Ethernet)	F3SP71-4N/4S F3SP76-7N/7S	F3LE01-5T	○	○	12289 <sup>*3</sup>	○	×
		F3LE11-0T F3LE12-0T			12289 <sup>*3</sup> 12291 <sup>*3</sup>		
		10BASE-T/ 100BASE-TX			12289 <sup>*3</sup> 12291 <sup>*3</sup>		
FA-M3V (Ethernet ASCII)	F3SP71-4N/4S F3SP76-7N/7S	F3LE01-5T	○	○	12289 <sup>*3</sup>	○	×
		F3LE11-0T F3LE12-0T			12289 <sup>*3</sup> 12291 <sup>*3</sup>		
		10BASE-T/ 100BASE-TX			12289 <sup>*3</sup> 12291 <sup>*3</sup>		

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

\*2 For the ladder transfer function, see the V9 Series Reference Manual 2.

\*3 For TCP/IP connection, the number of V9 series units that can be connected to one port is limited.  
 3LE01-5T/F3LE11-0T/CPU built-in LAN port: Max. 8 units  
 F3LE12-0T: Max. 9 units

## 27.1.1 FA-M3/FA-M3R

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1:n / Multi-link / Multi-link2 / Multi-link2 (Ethernet) / 1:n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / 19200 / 38400 / 57600 / 76800 / <u>115K</u> bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	0 to 31	
Transmission Mode	With Sum Check / <u>Without Sum Check</u>	

#### PLC

#### CPU Programmer Port / SIO Port


(Underlined setting: default)

Item	Programmer port	SIO Port
Communication Mode	<u>9600 bps, even parity</u> 9600 bps, no parity 19200 bps, even parity 19200 bps, no parity 38400 bps, even parity 38400 bps, no parity 57600 bps, even parity 57600 bps, no parity 115200 bps, even parity 115200 bps, no parity	9600 bps, even parity 9600 bps, no parity 19200 bps, even parity 19200 bps, no parity 38400 bps, even parity 38400 bps, no parity 57600 bps, even parity 57600 bps, no parity <u>115200 bps, even parity</u> 115200 bps, no parity
PC Link Function	<b>Use</b>	
Sum check	Provided / <u>Not provided</u>	
Terminal Character	<b>None</b>	
Protection Function	<b>None</b>	
Data Length	<b>8</b>	

**PC Link Module**

**Station number setting**

(Underlined setting: default)

Station Number Setting	Setting	Setting Example
	<p><u>01</u> to 32</p>	<p>01</p>

**Baud rate setting switch**

**F3LC01-1N / F3LC11-1N / F3LC11-2N**

(Underlined setting: default)

Baud Rate Setting Switch	Setting	Baud Rate	Remarks
	4	4800 bps	
	<u>5</u>	<u>9600 bps</u>	
	6	19200 bps	


**F3LC11-1F / F3LC12-1F / F3LC11-2F**

(Underlined setting: default)

Baud Rate Setting Switch	Setting	Baud Rate	Remarks
	4	4800 bps	
	5	9600 bps	
	7	19200 bps	
	9	38400 bps	
	A	57.6 kbps	
	<u>C</u>	<u>115.2 kbps</u>	

**Data format setting switch**

(Underlined setting: default)

Switch	Functions	OFF	ON	Setting Example
1	Data length	7	<u>8</u>	
2	Parity	<u>Not provided</u>	Provided	
3		<u>Odd</u>	Even	
4	Stop bit	<u>1</u>	2	
5	Sum check	<u>Not provided</u>	Provided	
6	Terminal character	<u>Not provided</u>	Provided	
7	Protection function	<u>Not provided</u>	Provided	
8	-	-	-	

**Function setting switch**


All OFF

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.


Device Memory	TYPE	Remarks
D (data register)	00H	
R (common register)	01H	
V (index register)	02H	
W (link register)	03H	
Z (special register)	04H	
TP (count-down timer/current value)	05H	
TS (timer/set value)	06H	Read only
CP (count-down counter/current value)	07H	
CS (counter/set value)	08H	Read only
X (input relay)	09H	
Y (output relay)	0AH	
I (internal relay)	0BH	
E (common relay)	0CH	
L (link relay)	0DH	
M (special relay)	0EH	
B (file register)	0FH	
SW (special module register)	10H	
SL (special module register)	11H	Double-word
F (cache register)	12H	Available only with F3SP71-4N/4S and F3SP76-7N/7S CPU.

\* The CPU number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.



### SW/SL device memory

The SW or SL device memory is used to read/write data from/into the data position number of the specified special module. For more information, refer to the PLC manual issued by the manufacturer. The address denotation of the SW or SL device memory is shown below.

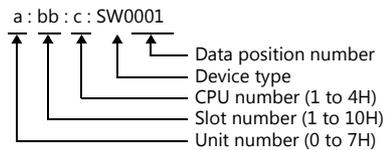

### Indirect Device Memory Designation

- For X/Y device memory

	15	8 7	0
n + 0	Model		Device type
n + 1	Address No.		
n + 2	Expansion code *		Bit designation
n + 3	00		Station number

\* For the expansion code, specify the value obtained by subtracting "1" from the actual CPU number.

Example: When specifying "X935" by indirect device memory designation



Converting "A" into a binary number  
9 (DEC) = 1001 (BIN)

09	08	07	06	05	04	03	02	01	00
0	0	0	0	0	0	1	0	0	1

Converting "BB" into a binary number  
35 (DEC) = 100011 (BIN)

07	06	05	04	03	02	01	00
0	0	1	0	0	0	1	1

Bit No.  
Obtained by subtracting "1" from this value.

Arranging the values X, Y and Z in the following order

15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00
0	0	0	0	1	0	0	1	0	0	0	0	0	0	1	0

0000100100000010 (BIN) = 902 (HEX): Address No.  
0011 (BIN) = 3 (HEX) - 1 = 2 (HEX): Bit No.

Example: When specifying "X76705" by indirect device memory designation



Converting "AAA" into a binary number  
767 (DEC) = 1011111111 (BIN)

09	08	07	06	05	04	03	02	01	00
1	0	1	1	1	1	1	1	1	1

Converting "BB" into a binary number  
05 (DEC) = 101 (BIN)

07	06	05	04	03	02	01	00
0	0	0	0	0	1	0	1

Bit No.  
Obtained by subtracting "1" from this value.

Arranging the values X, Y and Z in the following order


15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00
1	1	1	1	1	1	1	1	1	0	0	0	0	0	0	0

1111111110000000 (BIN) = FF80 (HEX): Address No.  
0101 (BIN) = 5 (HEX) - 1 = 4 (HEX): Bit No.

• For SW/SL device memory

	15	8	7	0
n + 0	Model		Device type	
n + 1	Address No. *1			
n + 2	Unit number (0 to 7H)		Slot number (1 to 10H)	
n + 3	Expansion code *2		Bit designation	
n + 4	00		Station number	

\*1Specify the data position for the address number. The value to specify is obtained by subtracting "1" from the actual data position.  
\*2Specify the expansion bit and the CPU number in the expansion code.

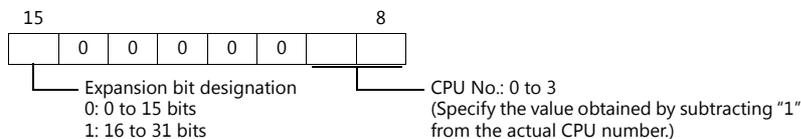

• Other than X/Y/SW/SL device memory

For the device memory address number, specify the value obtained by subtracting "1" from the actual address.  
For the expansion code, specify the value obtained by subtracting "1" from the actual CPU number.

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Contents	F0	F1 (= \$u n)	F2	
User log registration number read	1 - 8 (PLC1 - 8)	n	CPU No. + station No.  0001H ┌── Station No.: 01 to 1F └── CPU No. CPU No. 1: 00 CPU No. 2: 01 CPU No. 3: 02 CPU No. 4: 03	2
		n + 1	Command: FFFFH	
		n + 2	Registration number (Stores the same number as the one stored in special register Z105.)	
Latest user log read	1 - 8 (PLC1 - 8)	n	CPU No. + station No.  0001H ┌── Station No.: 01 to 1F └── CPU No. CPU No. 1: 00 CPU No. 2: 01 CPU No. 3: 02 CPU No. 4: 03	2
		n + 1	Command: 0000H	
		n + 2	Header 0: Normal -1: Error (data not exist/communication error)	
		n + 3	Year (ASCII)	
		n + 4	Month (ASCII)	
		n + 5	Day (ASCII)	
		n + 6	Hour (ASCII)	
		n + 7	Minute (ASCII)	
		n + 8	Second (ASCII)	
		n + 9	Main code (DEC)	
		n + 10	Sub code (DEC)	
"n"th user log read	1 - 8 (PLC1 - 8)	n	CPU No. + station No.  0001H ┌── Station No.: 01 to 1F └── CPU No. CPU No. 1: 00 CPU No. 2: 01 CPU No. 3: 02 CPU No. 4: 03	2
		n + 1	Command: 0001H to 003FH	
		n + 2	Header 0: Normal -1: Error (data not exist/communication error)	
		n + 3	Year (ASCII)	
		n + 4	Month (ASCII)	
		n + 5	Day (ASCII)	
		n + 6	Hour (ASCII)	
		n + 7	Minute (ASCII)	
		n + 8	Second (ASCII)	
		n + 9	Main code (DEC)	
		n + 10	Sub code (DEC)	

Contents	F0	F1 (= \$u n)		F2
Latest system log read	1 - 8 (PLC1 - 8)	n	CPU No. + station No.  <pre> 0001H ├── Station No.: 01 to 1F └── CPU No.     CPU No. 1: 00     CPU No. 2: 01     CPU No. 3: 02     CPU No. 4: 03                     </pre>	2
		n + 1	Command: 0100H	
		n + 2	Error type 0: System error 1: Basic error 2: Sequence error 3: I/O error	
		n + 3	Error code	
		n + 4	Year (ASCII)	
		n + 5	Month (ASCII)	
		n + 6	Day (ASCII)	
		n + 7	Hour (ASCII)	
		n + 8	Minute (ASCII)	
		n + 9	Second (ASCII)	
		n + 10 -	Additional information (max. 11 words) <sup>+1</sup>	
"n"th system log read	1 - 8 (PLC1 - 8)	n	CPU No. + station No.  <pre> 0001H ├── Station No.: 01 to 1F └── CPU No.     CPU No. 1: 00     CPU No. 2: 01     CPU No. 3: 02     CPU No. 4: 03                     </pre>	2
		n + 1	Command: 0101H to 017FH	
		n + 2	Error type 0: System error 1: Basic error 2: Sequence error 3: I/O error	
		n + 3	Error code	
		n + 4	Year (ASCII)	
		n + 5	Month (ASCII)	
		n + 6	Day (ASCII)	
		n + 7	Hour (ASCII)	
		n + 8	Minute (ASCII)	
		n + 9	Second (ASCII)	
		n + 10 -	Additional information (max. 11 words) <sup>+1</sup>	
Alarm information clear	1 - 8 (PLC1 - 8)	n	CPU No. + station No.  <pre> 0001H ├── Station No.: 01 to 1F └── CPU No.     CPU No. 1: 00     CPU No. 2: 01     CPU No. 3: 02     CPU No. 4: 03                     </pre>	2
		n + 1	Command: FFEH	

Contents	F0	F1 (= \$u n)		F2	
Mounted module name readout	1 - 8 (PLC1 - 8)	n	CPU No. + station No.  0001H └─┬─┘ ├─ Station No.: 01 to 1F └─ CPU No. CPU No. 1: 00 CPU No. 2: 01 CPU No. 3: 02 CPU No. 4: 03	3	
		n + 1	Command: FFFDH		
		n + 2	Unit No.: 0 to 7		
		n + 3 to n + 4	Module name (ASCII)		
		n + 5	Module information of slot 1 *2		I/O type (DEC) 0: Without I/O relay 1: Input relay only 2: Output relay only 3: With both input and output
		n + 6			Number of I/O relays (DEC)
		n + 7 to n + 8	Module information of slot 2 *2		Module name (ASCII)
		n + 9			I/O type (DEC) 0: Without I/O relay 1: Input relay only 2: Output relay only 3: With both input and output
		n + 10			Number of I/O relays (DEC)
		:	:		:
		n + 63 to n + 64	Module information of slot 16 *2		Module name (ASCII)
		n + 65			I/O type (DEC) 0: Without I/O relay 1: Input relay only 2: Output relay only 3: With both input and output
		n + 66			Number of I/O relays (DEC)

Return data: Data stored from PLC to V series

\*1 Additional information (max. 11 words)

- For "system error"  
No additional information
- For "basic error"

n + 10 to n + 13	Block name (8 bytes)
n + 14 to n + 16	Command number: 5-digit string pattern in decimal notation (5 bytes)

- For "sequence error"

n + 10 to n + 13	Program name (8 bytes)
n + 14 to n + 17	Subprogram name (8 bytes)
n + 18 to n + 20	Row number: 5 digits in decimal notation (5 bytes)

- For "I/O error"

n + 10 to n + 11	Slot number (4 bytes)
n + 12 to n + 13	Detailed error (4 bytes)

\*2 When no module is mounted, "(space)" is assigned for the module name and "0" is assigned for the I/O type and the number of I/O relays.

## 27.1.2 FA-M3/FA-M3R (Ethernet UDP/IP)

### Communication Setting

#### Editor


Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

### Ethernet Module


#### Condition setting switch

SW9	BIT	Contents	Setting															
	1	Data format setting	F3LE01-5T <table border="1" data-bbox="1029 1034 1393 1097"> <tr> <td>Port No.</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>12289</td> <td>ASCII</td> <td><b>Binary</b></td> </tr> </table> F3LE11-0T/F3LE12-0T <table border="1" data-bbox="1029 1173 1393 1265"> <tr> <td>Port No.</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>12289</td> <td>ASCII</td> <td><b>Binary</b></td> </tr> <tr> <td>12291</td> <td><b>Binary</b></td> <td>ASCII</td> </tr> </table>	Port No.	OFF	ON	12289	ASCII	<b>Binary</b>	Port No.	OFF	ON	12289	ASCII	<b>Binary</b>	12291	<b>Binary</b>	ASCII
	Port No.	OFF	ON															
	12289	ASCII	<b>Binary</b>															
	Port No.	OFF	ON															
	12289	ASCII	<b>Binary</b>															
	12291	<b>Binary</b>	ASCII															
	2	Write protection	OFF: not protected															
	3	System reserved	OFF															
4																		
5																		
6																		
7	Line handling at TCP time-out <sup>*1</sup>	OFF: close																
8	Operation mode	OFF: normal																

\*1 F3LE01-5T only  
\*2 Port number: 12289

#### IP address setting switch

(Underlined setting: default)

IP Address Setting Switch	Setting	Remarks
	<u>0.0.0.0</u> to 255.255.255.255	Set in hexadecimal notation.  Example HEX C0.A8.FA.D2 ↓ DEC 192.168.250.210

## T/TX, 10BASE-T/100BASE-TX Ports

### CPU properties

Setting	Setting Items	Setting	Remarks
NETWORK	NETWORK_SELECT	1	
ETHERNET	ETHER_MY_IPADDRESS	0.0.0.0 - 255.255.255.255	IP address
	ETHER_SUBNET_MASK	0.0.0.0 - 255.255.255.255	Subnet mask
HIGHER-LEVEL_LINK_SERVICE	HLLINK_PROTOCOL_A	<b>1: UDP/IP</b>	Port 12289
	HLLINK_DATA_FORMAT_A	<b>1: binary code</b>	
	HLLINK_PROTOCOL_B	<b>1: UDP/IP</b>	Port 12291
	HLLINK_DATA_FORMAT_B	<b>1: binary code</b>	
	HLLINK_PROTECT	0: write enabled	

## Available Device Memory

The contents of "Available Device Memory" are the same as those described in "27.1.1 FA-M3/FA-M3R".

## PLC\_CTL

The contents of "PLC\_CTL" are the same as those described in "27.1.1 FA-M3/FA-M3R".

\* The station number can be specified in the range from 0 to FFH.

For the station number, specify the PLC table number set for [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

### 27.1.3 FA-M3/FA-M3R (Ethernet UDP/IP ASCII)

#### Communication Setting

##### Editor


Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

##### PLC

#### Ethernet Module


##### Condition setting switch

SW9	BIT	Contents	Setting															
	1	Data format setting	F3LE01-5T <table border="1"> <tr> <th>Port No.</th> <th>OFF</th> <th>ON</th> </tr> <tr> <td>12289</td> <td><b>ASCII</b></td> <td>Binary</td> </tr> </table> F3LE11-0T/F3LE12-0T <table border="1"> <tr> <th>Port No.</th> <th>OFF</th> <th>ON</th> </tr> <tr> <td>12289</td> <td><b>ASCII</b></td> <td>Binary</td> </tr> <tr> <td>12291</td> <td>Binary</td> <td><b>ASCII</b></td> </tr> </table>	Port No.	OFF	ON	12289	<b>ASCII</b>	Binary	Port No.	OFF	ON	12289	<b>ASCII</b>	Binary	12291	Binary	<b>ASCII</b>
	Port No.	OFF	ON															
	12289	<b>ASCII</b>	Binary															
	Port No.	OFF	ON															
	12289	<b>ASCII</b>	Binary															
	12291	Binary	<b>ASCII</b>															
	2	Write protection	OFF: not protected															
	3	System reserved	OFF															
4																		
5																		
6																		
7	Line handling at TCP time-out*1	OFF: close																
8	Operation mode	OFF: normal																

\*1 F3LE01-5T only

##### IP address setting switch

(Underlined setting: default)

IP Address Setting Switch	Setting	Remarks
	<u>0.0.0.0</u> to 255.255.255.255	Set in hexadecimal notation. Example HEX C0.A8.FA.D2 ↓ DEC 192.168.250.210

## T/TX, 10BASE-T/100BASE-TX Ports

### CPU properties

Setting	Setting Items	Setting	Remarks
NETWORK	NETWORK_SELECT	1	
ETHERNET	ETHER_MY_IPADDRESS	0.0.0.0 to 255.255.255.255	IP address
	ETHER_SUBNET_MASK	0.0.0.0 to 255.255.255.255	Subnet mask
HIGHER-LEVEL_LINK_SERVICE	HLLINK_PROTOCOL_A	<b>1: UDP/IP</b>	Port 12289
	HLLINK_DATA_FORMAT_A	<b>0: ASCII format</b>	
	HLLINK_PROTOCOL_B	<b>1: UDP/IP</b>	Port 12291
	HLLINK_DATA_FORMAT_B	<b>0: ASCII format</b>	
	HLLINK_PROTECT	0: write enabled	

## Available Device Memory

The contents of "Available Device Memory" are the same as those described in "27.1.1 FA-M3/FA-M3R".

## PLC\_CTL

The contents of "PLC\_CTL" are the same as those described in "27.1.1 FA-M3/FA-M3R".

\* The station number can be specified in the range from 0 to FFH.

For the station number, specify the PLC table number set for [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

## 27.1.4 FA-M3/FA-M3R (Ethernet TCP/IP)

### Communication Setting

#### Editor


Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC


##### Ethernet Module

##### Condition setting switch

SW9	BIT	Contents	Setting															
	1	Data format setting	F3LE01-5T <table border="1" style="margin-left: 20px;"> <tr> <td>Port No.</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>12289</td> <td>ASCII</td> <td><b>Binary</b></td> </tr> </table> F3LE11-0T/F3LE12-0T <table border="1" style="margin-left: 20px;"> <tr> <td>Port No.</td> <td>OFF</td> <td>ON</td> </tr> <tr> <td>12289</td> <td>ASCII</td> <td><b>Binary</b></td> </tr> <tr> <td>12291</td> <td><b>Binary</b></td> <td>ASCII</td> </tr> </table>	Port No.	OFF	ON	12289	ASCII	<b>Binary</b>	Port No.	OFF	ON	12289	ASCII	<b>Binary</b>	12291	<b>Binary</b>	ASCII
	Port No.	OFF	ON															
	12289	ASCII	<b>Binary</b>															
	Port No.	OFF	ON															
	12289	ASCII	<b>Binary</b>															
	12291	<b>Binary</b>	ASCII															
	2	Write protection	OFF: not protected															
	3	System reserved	OFF															
4																		
5																		
6																		
7	Line handling at TCP time-out <sup>*1</sup>	OFF: close																
8	Operation mode	OFF: normal																

\*1 F3LE01-5T only  
\*2 Port number: 12289

##### IP address setting switch

IP Address Setting Switch	Setting	Remarks
	<p style="text-align: center;"><u>0.0.0.0</u> to 255.255.255.255</p>	Set in hexadecimal notation.  Example HEX C0.A8.FA.D2 ↓ DEC 192.168.250.210

## T/TX, 10BASE-T/100BASE-TX Ports

### CPU properties

Setting	Setting Items	Setting	Remarks
NETWORK	NETWORK_SELECT	1	
ETHERNET	ETHER_MY_IPADDRESS	0.0.0.0 - 255.255.255.255	IP address
	ETHER_SUBNET_MASK	0.0.0.0 - 255.255.255.255	Subnet mask
HIGHER-LEVEL_LINK_SERVICE	HLLINK_PROTOCOL_A	<b>0: TCP/IP</b>	Port 12289
	HLLINK_DATA_FORMAT_A	<b>1: binary code</b>	
	HLLINK_PROTOCOL_B	<b>0: TCP/IP</b>	Port 12291
	HLLINK_DATA_FORMAT_B	<b>1: binary code</b>	
	HLLINK_PROTECT	0: write enabled	

## Available Device Memory

The contents of "Available Device Memory" are the same as those described in "27.1.1 FA-M3/FA-M3R".

## PLC\_CTL

The contents of "PLC\_CTL" are the same as those described in "27.1.1 FA-M3/FA-M3R".

\* The station number can be specified in the range from 0 to FFH.

For the station number, specify the PLC table number set for [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

## 27.1.5 FA-M3/FA-M3R (Ethernet TCP/IP ASCII)

### Communication Setting

#### Editor


Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

### Ethernet Module


#### Condition setting switch

SW9	BIT	Contents	Setting															
	1	Data format setting	F3LE01-5T <table border="1"> <tr> <th>Port No.</th> <th>OFF</th> <th>ON</th> </tr> <tr> <td>12289</td> <td><b>ASCII</b></td> <td>Binary</td> </tr> </table> F3LE11-0T/F3LE12-0T <table border="1"> <tr> <th>Port No.</th> <th>OFF</th> <th>ON</th> </tr> <tr> <td>12289</td> <td><b>ASCII</b></td> <td>Binary</td> </tr> <tr> <td>12291</td> <td>Binary</td> <td><b>ASCII</b></td> </tr> </table>	Port No.	OFF	ON	12289	<b>ASCII</b>	Binary	Port No.	OFF	ON	12289	<b>ASCII</b>	Binary	12291	Binary	<b>ASCII</b>
	Port No.	OFF	ON															
	12289	<b>ASCII</b>	Binary															
	Port No.	OFF	ON															
	12289	<b>ASCII</b>	Binary															
	12291	Binary	<b>ASCII</b>															
	2	Write protection	OFF: not protected															
	3	System reserved	OFF															
4																		
5																		
6																		
7	Line handling at TCP time-out*1	OFF: close																
8	Operation mode	OFF: normal																

\*1 F3LE01-5T only

#### IP address setting switch

(Underlined setting: default)

IP Address Setting Switch	Setting	Remarks
	<u>0.0.0.0</u> to 255.255.255.255	Set in hexadecimal notation. Example HEX <u>C0.A8.FA.D2</u> ↓ DEC 192.168.250.210

## T/TX, 10BASE-T/100BASE-TX Ports

### CPU properties

Setting	Setting Items	Setting	Remarks
NETWORK	NETWORK_SELECT	1	
ETHERNET	ETHER_MY_IPADDRESS	0.0.0.0 to 255.255.255.255	IP address
	ETHER_SUBNET_MASK	0.0.0.0 to 255.255.255.255	Subnet mask
HIGHER-LEVEL_LINK_SERVICE	HLLINK_PROTOCOL_A	<b>0: TCP/IP</b>	Port 12289
	HLLINK_DATA_FORMAT_A	<b>0: ASCII format</b>	
	HLLINK_PROTOCOL_B	<b>0: TCP/IP</b>	Port 12291
	HLLINK_DATA_FORMAT_B	<b>0: ASCII format</b>	
	HLLINK_PROTECT	0: write enabled	

## Available Device Memory

The contents of "Available Device Memory" are the same as those described in "27.1.1 FA-M3/FA-M3R".

## PLC\_CTL

The contents of "PLC\_CTL" are the same as those described in "27.1.1 FA-M3/FA-M3R".

\* The station number can be specified in the range from 0 to FFH.

For the station number, specify the PLC table number set for [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

## 27.1.6 FA-M3V

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)


Item	Setting	Remarks
Connection Mode	<u>1:1</u> / 1 : n / Multi-link / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-232C</u> / RS-422/485	
Baud Rate	4800 / 9600 / 19200 / 38400 / 57600 / 76800 / <u>115K</u> bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	<u>None</u> / Odd / Even	
Target Port No.	0 to 31	
Transmission Mode	With Sum Check / <u>Without Sum Check</u>	

#### PLC

#### PC Link Module

#### Station number setting

(Underlined setting: default)

Station No.	Setting	Example
	<u>01</u> to 32	01

#### Baud rate setting switch

#### F3LC11-1N / F3LC11-2N

(Underlined setting: default)

Baud Rate Setting Switch	Setting	Baud Rate	Remarks
	4	4800 bps	
	<u>5</u>	<u>9600 bps</u>	
	6	19200 bps	

#### F3LC11-1F / F3LC12-1F / F3LC11-2F

(Underlined setting: default)

Baud Rate Setting Switch	Setting	Baud Rate	Remarks
	4	4800 bps	
	5	9600 bps	
	7	19200 bps	
	9	38400 bps	
	A	57.6 Kbps	
	<u>C</u>	<u>115.2 Kbps</u>	

### Data format setting switch

(Underlined setting: default)

Switches	Function	OFF	ON	Example
1	Data length	7	<u>8</u>	
2	Parity	<u>Not provided</u>	Provided	
3		<u>Odd</u>	Even	
4	Stop bit	<u>1</u>	2	
5	Checksum	<u>Not provided</u>	Provided	
6	Terminal character	<u>Not provided</u>	Provided	
7	Protection function	<u>Not provided</u>	Provided	
8	-	-	-	

### Function setting switch

All OFF

## Available Device Memory

The contents of "Available Device Memory" are the same as those described in "27.1.1 FA-M3/FA-M3R".

## PLC\_CTL

The contents of "PLC\_CTL" are the same as those described in "27.1.1 FA-M3/FA-M3R".

## 27.1.7 FA-M3V (Ethernet)

### Communication Setting

#### Editor


Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Connection port on the V9 unit:  
The [Target Port No.] for the connected device on the [Hardware Setting] window ([System Setting] → [Hardware Setting])
  - When using TCP/IP:  
Select [Built-in LAN (TCP)].
  - When using UDP/IP:  
Select [Built-in LAN (UDP)].
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

### Ethernet Module


#### Condition setting switch

SW9	BIT	Contents	Setting		
	1	Data format setting	F3LE01-5T		
			Port No.	OFF	ON
			12289	ASCII	<b>Binary</b>
			F3LE11-0T/F3LE12-0T		
	Port No.	OFF	ON		
	12289	ASCII	<b>Binary</b>		
	12291	<b>Binary</b>	ASCII		
	2	Write protection	OFF: not protected		
3	System reserve	OFF			
4					
5					
6					
7	Line handling at TCP time-out <sup>*1</sup>	OFF: close			
8	Operation mode	OFF: normal			

\*1 F3LE01-5T only

## IP address setting switch

(Underlined setting: default)

IP Address Setting Switch	Setting	Remarks
	<u>0.0.0.0</u> to 255.255.255.255	Set in hexadecimal notation. Example: HEX C0.A8.FA.D2 ↓ DEC 192.168.250.210

## 10BASE-T/100BASE-TX Ports

### CPU properties

Setting	Setting Items	Setting Values	Remarks
NETWORK	NETWORK_SELECT	1	
ETHERNET	ETHER_MY_IPADDRESS	0.0.0.0 to 255.255.255.255	IP address
	ETHER_SUBNET_MASK	0.0.0.0 to 255.255.255.255	Subnet mask
HIGHER-LEVEL_LINK_SERVICE	HLLINK_PROTOCOL_A	0: TCP/IP 1: UDP/IP	Port 12289
	HLLINK_DATA_FORMAT_A	<b>1: binary code</b>	
	HLLINK_PROTOCOL_B	0: TCP/IP 1: UDP/IP	Port 12291
	HLLINK_DATA_FORMAT_B	<b>1: binary code</b>	
	HLLINK_PROTECT	0: write enabled	

## Available Device Memory

The contents of "Available Device Memory" are the same as those described in "27.1.1 FA-M3/FA-M3R".

## PLC\_CTL

The contents of "PLC\_CTL" are the same as those described in "27.1.1 FA-M3/FA-M3R".

\* The station number can be specified in the range from 0 to FFH.

For the station number, specify the PLC table number set for [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

## 27.1.8 FA-M3V (Ethernet ASCII)

### Communication Setting

#### Editor


Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Connection port on the V9 unit:  
The [Target Port No.] for the connected device on the [Hardware Setting] window ([System Setting] → [Hardware Setting])
  - When using TCP/IP:  
Select [Built-in LAN (TCP)].
  - When using UDP/IP:  
Select [Built-in LAN (UDP)].
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### PLC

### Ethernet Module


#### Condition setting switch

SW9	Bits	Contents	Setting		
	1	Data format setting	F3LE01-5T		
			Port No.	OFF	ON
			12289	<b>ASCII</b>	Binary
			F3LE11-0T/F3LE12-0T		
	Port No.	OFF	ON		
	12289	<b>ASCII</b>	Binary		
	12291	Binary	<b>ASCII</b>		
	2	Write protection	OFF: not protected		
3	System reserve	OFF			
4					
5					
6					
7	Line handling at TCP time-out*1	OFF: close			
8	Operation mode	OFF: normal			

\*1 F3LE01-5T only

## IP address setting switch

(Underlined setting: default)

IP Address Setting Switch	Setting	Remarks
	<u>0.0.0.0</u> to 255.255.255.255	Set in hexadecimal notation. Example: HEX C0.A8.FA.D2 ↓ DEC 192.168.250.210

## 10BASE-T/100BASE-TX Ports

### CPU properties

Setting	Setting Items	Setting Values	Remarks
NETWORK	NETWORK_SELECT	1	
ETHERNET	ETHER_MY_IPADDRESS	0.0.0.0 to 255.255.255.255	IP address
	ETHER_SUBNET_MASK	0.0.0.0 to 255.255.255.255	Subnet mask
HIGHER-LEVEL_LINK_SERVICE	HLLINK_PROTOCOL_A	0: TCP/IP 1: UDP/IP	Port 12289
	HLLINK_DATA_FORMAT_A	<b>0: ASCII format</b>	
	HLLINK_PROTOCOL_B	0: TCP/IP 1: UDP/IP	Port 12291
	HLLINK_DATA_FORMAT_B	<b>0: ASCII format</b>	
	HLLINK_PROTECT	0: write enabled	

## Available Device Memory

The contents of "Available Device Memory" are the same as those described in "27.1.1 FA-M3/FA-M3R".

## PLC\_CTL

The contents of "PLC\_CTL" are the same as those described in "27.1.1 FA-M3/FA-M3R".

\* The station number can be specified in the range from 0 to FFH.

For the station number, specify the PLC table number set for [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].


## 27.1.9 Wiring Diagrams

### When Connected at CN1:

#### RS-232C

##### Wiring diagram 1 - C2


Hakko Electronics' cable "D9-YO2-09-□ M" (□ = 2, 3, 5)

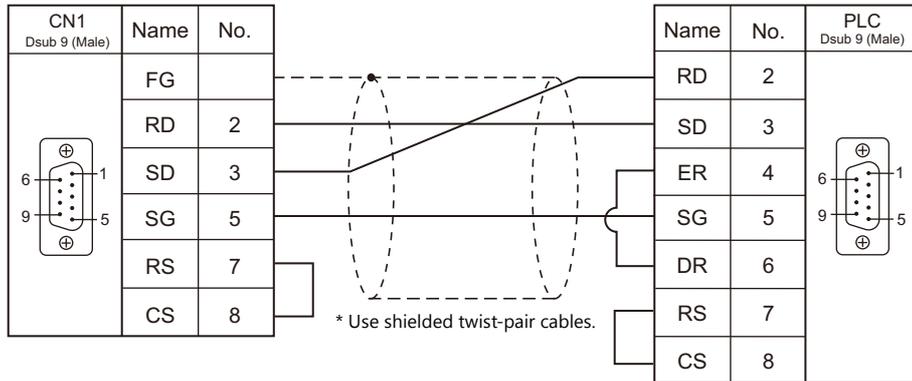

#### RS-422/RS-485

##### Wiring diagram 1 - C4


Hakko Electronics' cable "D9-YO4-0T-□ M" (□ = 2, 15)

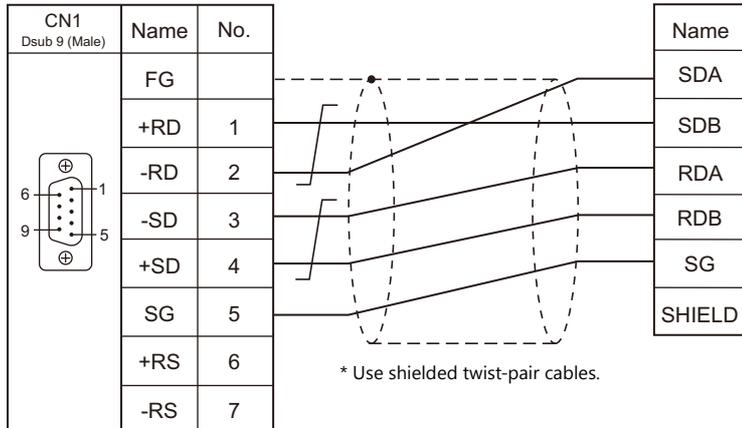


**When Connected at MJ1/MJ2:**

**RS-232C**

**Wiring diagram 1 - M2**

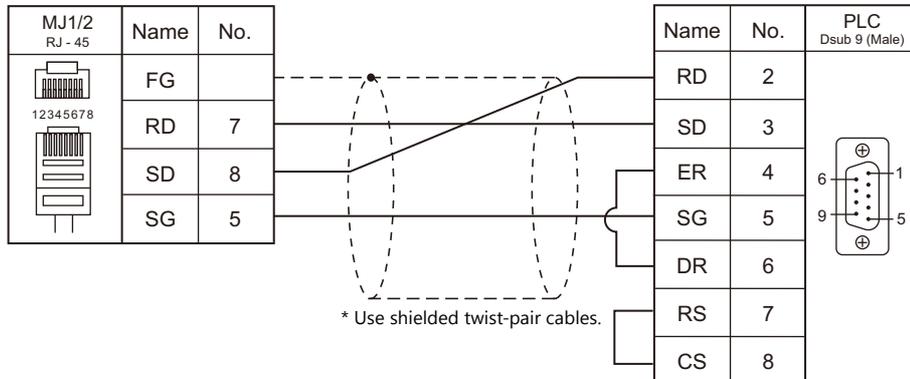


**Wiring diagram 2 - M2**

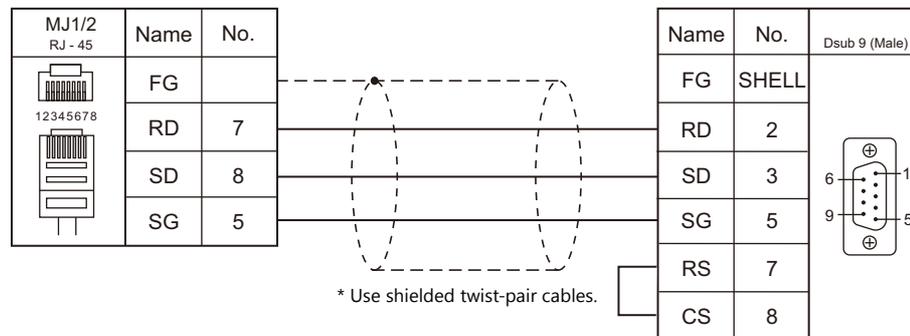


**RS-422/RS-485**

**Wiring diagram 1 - M4**

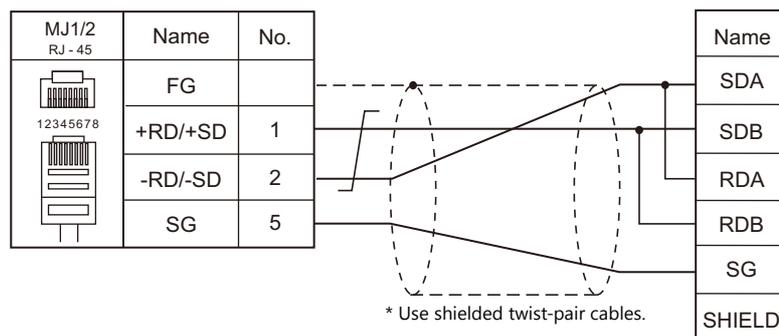

**Wiring diagram 2 - M4**

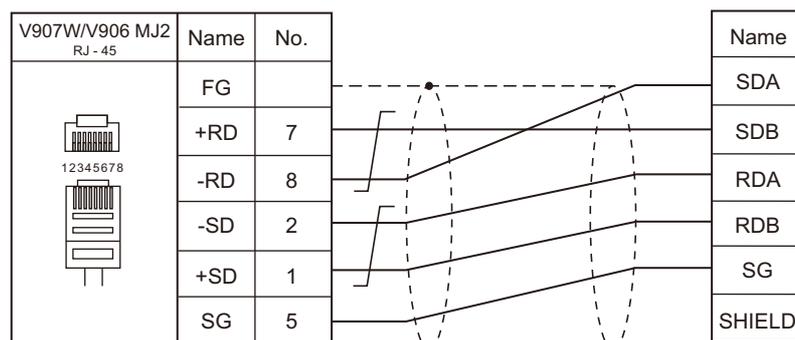

\* Slide switch on V907W/V906:  
RS-422 (lower)

\* Use shielded twist-pair cables.

## 27.2 Temperature Controller/Servo/Inverter Connection

### Temperature Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906	
UT100	UT130-xx/RS UT150-xx/RS UT152-xx/RS UT155-xx/RS	RS-485 port	RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4		UT100.Lst

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

### Digital Indicating Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
UT750	UT750-01 UT750-11 UT750-51	RS-485 port	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 3 - M4	UT750.Lst
		High-speed RS-485 port	RS-485	Wiring diagram 2 - C4	Wiring diagram 2 - M4		
UT550	UT550-01, 02 UT550-11, 12 UT550-21, 22 UT550-31, 32 UT550-41, 42	RS-485 port	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 3 - M4	UT550.Lst
UT520	UT520-07	RS-485 port	RS-485				
UT350	UT350-01 UT350-21 UT350-31	RS-485 port	RS-485				UT350.Lst
UT320	UT320-01 UT320-21 UT320-31	RS-485 port	RS-485				UT450.Lst
UT450	UT450-01, 02 UT450-11, 12 UT450-21, 22 UT450-31, 32 UT450-41, 42	RS-485 port	RS-485				
UT32A/35A (MODBUS RTU)	UT32A-x10-0x-00 UT32A-NNN-0x-xx/CH1 UT35A-xx1-0x-00 UT35A-NNN-0x-xx/CH3	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 3 - M4	YOKOGAWA UT30A (MODBUS RTU).Lst
	UT32A-x10-0x-00/LP UT32A-NNN-0x-xN/LCH1			Wiring diagram 2 - C4	Wiring diagram 2 - M4		
UT52A/55A (MODBUS RTU)	UT52A-NNN-0x-xx/CH1 UT55A-x10-0x-00 UT55A-x2x-0x-00 UT55A-xx1-0x-00 UT55A-x2x-01-00/MDL UT55A-NNN-0x-xx/CH3 UT55A-NNN-0x-xx/C4	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 3 - M4	YOKOGAWA UT50A (MODBUS RTU).Lst
	UT52A-x10-0x-00 UT52A-010-01-00/MDL UT52A-NNN-0x-xx/RCH1 UT52A-NNN-0x-xN/LCH1 UT55A-x10-0x-00/LP UT55A-x2x-0x-00/LP UT55A-x2x-01-00/LP/MDL UT55A-NNN-0x-xx/AC4 UT55A-NNN-0x-xx/LC4			Wiring diagram 2 - C4	Wiring diagram 2 - M4		
UT75A (MODBUS RTU)	UT75A-xx1-0x-00	Terminal block	RS-485	Wiring diagram 1 - C4	Wiring diagram 1 - M4	Wiring diagram 3 - M4	YOKOGAWA UT75A (MODBUS RTU).Lst
	UT75A-x1x-0x-00 UT75A-x2x-0x-00			Wiring diagram 2 - C4	Wiring diagram 2 - M4		

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## Multi-point Temperature Controller

PLC Selection on the Editor	Model	Port	Signal Level	Connection			Lst File
				CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2	
UT2400/2800	UT2400-1, 1/HB UT2400-2, 2/HB UT2400-3, 3/HB UT2400-4, 4/HB UT2800-1, 1/HB UT2800-2, 2/HB UT2800-3, 3/HB UT2800-4, 4/HB	RS-485 port	RS-422	Wiring diagram 3 - C4	×	Wiring diagram 4 - M4	UT2000.Lst

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## Chart Recorder

PLC Selection on the Editor	CPU	Unit/Port	TCP/IP	UDP/IP	Port No.	Keep Alive *1	Lst File
μR10000/20000 (Ethernet TCP/IP)	436101-x/C7 436102-x/C7 436103-x/C7 436104-x/C7 436106-x/C7	Ethernet port	○	×	34260 (Max. 3 units: 1 for administrator and 2 for users)	○	μR10000_Eth.Lst
	437101-x/C7 437102-x/C7 437103-x/C7 437104-x/C7 437106-x/C7 437112-x/C7 437118-x/C7 437124-x/C7						

\*1 For KeepAlive functions, see "1.3.2 Ethernet Communication".

## 27.2.1 UT100

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>1</u> to 31	
Sum Check	Provided / <u>Not provided</u>	Make the same setting as PSL (communication protocol selection) of the temperature controller.

\* Select "Without Sum Check" for the transmission mode on the editor when "1: PC link communication (with checksum)" is specified for P.SL (Protocol selection) on the controller.

#### Temperature Controller

The communication parameters can be set using keys attached to the temperature controller. Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Parameter	Display	Item	Setting	Example
Communication	PSL	Protocol selection	<u>0</u> : PC link communication 1: PC link communication (with checksum)	0
	ADR	Communication address	<u>1</u> to 31	1
	BPS	Baud rate	4.8: 4800 bps <u>9.6</u> : 9600 bps	9.6
	PRI	Parity	NON: None <u>EVN</u> : Even ODD: Odd	EVN
	STP	Stop bit	<u>1</u> / 2 bits	1
	DLN	Data length	7 / <u>8</u> bits	8

### Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	
I (input relay)	01H	

#### Indirect Device Memory Designation

For the device memory address number, specify the value obtained by subtracting "1" from the actual address.

## 27.2.2 UT750

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>1</u> to 31	
Sum Check	Provided / <u>Not provided</u>	Make the same setting as PSL (communication protocol selection) of the temperature controller.

#### Digital Indicating Controller

The communication parameters can be set using keys attached to the digital indicating controller. Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Parameter	Port	Indication	Item	Setting	Example
Communication	RS-485 port	PSL1	Protocol selection 1	<u>0: Personal computer link communication</u> 1: Personal computer link communication (with sum check)	0
		BPS1	Baud rate 1	3: 4800 bps <u>4: 9600 bps</u>	4
		PRI1	Parity 1	0: None <u>1: Even</u> 2: Odd	1
		STP1	Stop bit 1	<u>1</u> / 2 bits	1
		DLN1	Data length 1	7 / <u>8</u> bits	8
		ADR1	Address 1	<u>1</u> to 31	1
	High-speed RS-485 port	PSL2	Protocol selection 2	<u>0: Personal computer link communication</u> 1: Personal computer link communication (with sum check)	0
		BPS2	Baud rate 2	3: 4800 bps <u>4: 9600 bps</u> 5: 19200 bps 6: 38400 bps	4
		PRI2	Parity 2	0: None <u>1: Even</u> 2: Odd	1
		STP2	Stop bit 2	<u>1</u> / 2 bits	1
		DLN2	Data length 2	7 / <u>8</u> bits	8
		ADR2	Address 2	<u>1</u> to 31	1

#### Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	
I (input relay)	01H	

#### Indirect Device Memory Designation

For the device memory address number, specify the value obtained by subtracting "1" from the actual address.

**27.2.3 UT550**

---

---

Settings are the same as those described in "27.2.1 UT100".

**27.2.4 UT520**

---

---

Settings are the same as those described in "27.2.1 UT100".

**27.2.5 UT350**

---

---

Settings are the same as those described in "27.2.1 UT100".

**27.2.6 UT320**

---

---

Settings are the same as those described in "27.2.1 UT100".

**27.2.7 UT450**

---

---

Settings are the same as those described in "27.2.1 UT100".

## 27.2.8 UT32A/35A (MODBUS RTU)

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1:n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	4800 / 9600 / <u>19200</u> / 38400 bps	
Data Length	<u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>1</u> to 99	0: Broadcast address for Modbus device 249: Broadcast address for UT Advanced device

#### Digital Indicating Controller

The communication parameters can be set using keys attached to the digital indicating controller. Be sure to match the settings to those made under [Communication Setting] of the editor.

(Underlined setting: default)

Menu	Parameter	Name	Setting
RS-485	PSL	Protocol selection	<b><u>MBRTU (8): Modbus communication (RTU)</u></b>
	BPS	Baud Rate	4800 (3): 4800bps 9600 (4): 9600 bps <u>19200 (5): 19200 bps</u> 38400 (6): 38400 bps
	PRI	Parity	NONE (0): None <u>EVEN (1): Even</u> ODD (2): Odd
	STP	Stop Bit	<u>1 (1): 1 bit</u> 2 (2): 2 bits
	DLN	Data Length	<b><u>8bit (8): 8 bits</u></b>
	ADR	Address	<u>1</u> to 99

#### Available Device Memory

The available setting range of device memory varies depending on the connected device. Be sure to set within the range available with the device to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (D Register)	00H	
I (I Relay)	01H	

#### Indirect Device Memory Designation

For the device memory address number, specify the value obtained by subtracting "1" from the actual address.

## 27.2.9 UT52A/55A (MODBUS RTU)

Settings are the same as those described in "27.2.8 UT32A/35A (MODBUS RTU)".

Note however, for UT52A, a baud rate of "38400 bps" is available only with standard models for which the Type 2 suffix code is "1".

For UT55A, a baud rate of "38400 bps" is available only with standard models for which the Type 3 suffix code is "1".

## 27.2.10 UT75A (MODBUS RTU)

Settings are the same as those described in "27.2.8 UT32A/35A (MODBUS RTU)".

Note however, a baud rate of "38400 bps" is available only with standard models for which the Type 3 suffix code is "1".

## 27.2.11 UT2400/2800

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	<u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / Odd / <u>Even</u>	
Target Port No.	<u>1</u> to 16	
CR	<u>Checked</u> / Unchecked	
CPU No. *	01 / 02	01: 1 to 4CH 02: 5 to 8CH (available only with UT2800)


\* Set the CPU number on the [Device Input] dialog.  
"CPU No. 2" is not provided for UT2400. It can be specified only when UT2800 is used.

#### Multi-point Temperature Controller

Be sure to match the settings to those made under [Communication Setting] of the editor.

#### Communication mode selector switch

(Underlined setting: default)

Communication Mode Selector Switch	OFF	ON	Remarks
	Ladder communication mode	<u>Personal computer link communication mode</u>	

#### Communication condition setting switch

Communication Condition Setting Switch	Setting	Baud Rate	Parity	Data Length	Stop Bit	Setting Example
	0	9600 bps	None	8	1	2: 9600 bps Even 8 bits 1 bit
	1		Odd			
	2		Even			
	3	4800 bps	None			
	4		Odd			
5	Even					

#### Unit No. selector switch

Unit No. Selector Switch	Setting	Station Number	Setting Example
	0 to F	1 to 16	0: Station number 1

## Available Device Memory

The available setting range of device memory varies depending on the model. Be sure to set within the range available for the model to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
D (data register)	00H	
I (input relay)	01H	

\* The CPU number is required in addition to the device type and address. The assigned device memory is expressed as shown on the right when editing the screen.

Example: 1 : D00001

Address number  
Device type  
CPU number

## Indirect Device Memory Designation

For the device memory address number, specify the value obtained by subtracting "1" from the actual address. Specify the CPU number in the expansion code.

## 27.2.12 $\mu$ R10000/20000 (Ethernet TCP/IP)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
  - When specified on the screen program:  
[System Setting] → [Hardware Setting] → [Local Port IP Address]
  - When specified on the V9 unit:  
Local mode → [LAN Setting]
- Port number for the V9 unit (for communication with PLC)  
[System Setting] → [Hardware Setting] → [PLC Properties] → [Communication Setting]
- IP address and port number of the PLC  
Register on the [PLC Table] in [System Setting] → [Hardware Setting] → [PLC Properties] → [Target Settings].

#### Chart Recorder

Make the following settings.

After turning on the chart recorder, hold down the [MENU] key for 3 seconds to change to the Setting mode. Then switch to the Basic Setting mode by holding down the [DISP] and [FUNC] keys for 3 seconds. Display the Ethernet menu by pressing the [DISP] key several times.

Basic Setting Mode	Item	Indication	Remarks
Ethernet	IP address	A	IP address
		M	Subnet mask
		G	Gateway

#### Login

For communication with the chart recorder, login is required.

Log in using the PLC\_CTL macro command (command: 67).

#### Limitations

The V9 series can only access the server for settings and measurement. Access to servers for maintenance and diagnosis as well as device information is not available.

## Available Device Memory

The available setting range of device memory varies depending on the connected device. Be sure to set within the range available with the device to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
SN (unit setting)	00H	
SC (chart speed setting)	01H	
VT (recording interval setting)	02H	
SZ (zone recording setting)	03H	
ST (tag setting)	04H	
SG (message setting)	05H	
SE (secondary chart speed setting)	06H	
SV (moving average setting)	07H	
SF (input filter setting)	08H	
BD (alarm delay duration setting)	09H	
VF (display (VFD) and internal light brightness setting)	0AH	
SJ (timer settings for TLOG calculations)	0BH	
FR (interval setting for FIFO buffer writing)	0CH	
VP (start/end printout ON/OFF setting)	0DH	
XI (integration time setting for A/D converter)	0FH	
XB (burnout detection setting)	10H	
UC (dot color change)	11H	
UO (pen offset compensation setting)	12H	
UM (report data type setting for periodic printing)	13H	
UB (bar graph display mode setting)	14H	
UI (moving average ON/OFF setting)	15H	
UJ (input filter ON/OFF setting)	16H	
UK (partial expanded recording ON/OFF setting)	17H	
UL (display/printout language setting)	18H	
XN (date format setting)	19H	
UT (time printout format setting)	1AH	
XR (remote control input setting)	1BH	
UN (recording pen channel assignment change)	1DH	
US (calculation error data setting)	1EH	
YB (host and domain name setting)	1FH	
YA (IP address setting)	20H	
YD (login function ON/OFF setting)	21H	The login function cannot be used.
YK (KeepAlive setting)	22H	
UQ (calibration correction setting mode, correction points setting)	23H	
UH ([FUNC] key menu selection setting)	24H	

## PLC\_CTL

Macro command "PLC\_CTL F0 F1 F2"

Description	F0	F1 (= \$u n)		F2	
Input range setting (SR) Measurement mode: SKIP, VOLT/TC/RTD/DI	1 to 8 (PLC1 to 8)	n	Station number	4/7	
		n + 1	Command: 0		
		n + 2	CH No.		
		n + 3	Measurement mode 0: SKIP		Measurement mode 1: VOLT 2: TC 3: RTD 4: DI
		n + 4	-		Range *1
		n + 5	-		Span left end value
		n + 6	-		Span right end value

Description	F0	F1 (= \$u n)		F2	
Input range setting (SR) Measurement mode: 1-5V, DELTA	1 to 8 (PLC1 to 8)	n	Station number		10/7
		n + 1	Command: 0		
		n + 2	CH No.		
		n + 3	Measurement mode 5: 1-5V	Measurement mode 6: DELTA	
		n + 4	Span left end value	Standard channel	
		n + 5	Span right end value	Span left end value	
		n + 6	Scaling left end value	Span right end value	
		n + 7	Scaling right end value	-	
		n + 8	Scaling decimal place	-	
Input range setting (SR) Measurement mode: SCALE, SQRT	1 to 8 (PLC1 to 8)	n	Station number		11/12
		n + 1	Command: 0		
		n + 2	CH No.		
		n + 3	Measurement mode 7: SCALE	Measurement mode 8: SQRT	
		n + 4	Input type 1: VOLT 2: TC 3: RTD 4: DI	Range <sup>*1</sup>	
		n + 5	Range <sup>*1</sup>	Span left end value	
		n + 6	Span left end value	Span right end value	
		n + 7	Span right end value	Scaling left end value	
		n + 8	Scaling left end value	Scaling right end value	
		n + 9	Scaling right end value	Scaling decimal place	
		n + 10	Scaling decimal place	Low-cut 0: Off 1: On	
n + 11	-	Low-cut value (n + 10 = 1)			
Acquisition of input range setting (SR) Measurement mode: SKIP, VOLT/TC/RTD/DI	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 1		
		n + 2	CH No.		
		n + 3	CH No.		
		n + 4	Measurement mode 0: SKIP	Measurement mode 1: VOLT 2: TC 3: RTD 4: DI	
		n + 5	-	Range <sup>*1</sup>	
		n + 6	-	Span left end value	
n + 7	-	Span right end value			
Acquisition of input range setting (SR) Measurement mode: 1-5V, DELTA	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 1		
		n + 2	CH No.		
		n + 3	CH No.		
		n + 4	Measurement mode 5: 1-5V	Measurement mode 6: DELTA	
		n + 5	Span left end value	Standard channel	
		n + 6	Span right end value	Span left end value	
		n + 7	Scaling left end value	Span right end value	
		n + 8	Scaling right end value	-	
		n + 9	Scaling decimal place	-	
n + 10	1-5V low-cut ON/OFF 0: Off 1: On	-			

Description	F0	F1 (= \$u n)		F2		
Acquisition of input range setting (SR) Measurement mode: SCALE, SQRT	1 to 8 (PLC1 to 8)	n	Station number		3	
		n + 1	Command: 1			
		n + 2	CH No.			
		n + 3	CH No.			
		n + 4	Measurement mode 7: SCALE	Measurement mode 8: SQRT		
		n + 5	Input type 1: VOLT 2: TC 3: RTD 4: DI	Range *1		
		n + 6	Range *1	Span left end value		
		n + 7	Span left end value	Span right end value		
		n + 8	Span right end value	Scaling left end value		
		n + 9	Scaling left end value	Scaling right end value		
		n + 10	Scaling right end value	Scaling decimal place		
		n + 11	Scaling decimal place	Low-cut 0: Off 1: On		
		n + 12	-	Low-cut value		
Calibration correction setting (VL)	1 to 8 (PLC1 to 8)	n	Station number		5+2m	
		n + 1	Command: 2			
		n + 2	CH No.			
		n + 3	Calibration correction function 0: Off 1: On			
		n + 4	Number of settings (both correction point and value): 1 to 16			
		n + 5	Correction point 1 (m = 1)			
		n + 6	Correction value 1 (m = 1)			
		n + 7	Correction point 2 (m = 2)			
		n + 8	Correction value 2 (m = 2)			
		:	:			
Acquisition of calibration correction setting (VL)	1 to 8 (PLC1 to 8)	n	Station number		3	
		n + 1	Command: 3			
		n + 2	CH No.			
		n + 3	CH No.			
		n + 4	Calibration correction function 0: Off 1: On			
		n + 5	Number of settings (both correction point and value): 1 to 16			
		n + 6	Correction point 1			
		n + 7	Correction value 1			
		n + 8	Correction point 2			
		n + 9	Correction value 2			
:	:					
Alarm setting (SA)	1 to 8 (PLC1 to 8)	n	Station number		5/9	
		n + 1	Command: 4			
		n + 2	CH No.			
		n + 3	Alarm number			
		n + 4	Alarm ON/OFF 0: Off	Alarm ON/OFF 1: On		
		n + 5	-	Alarm type 1: H (upper limit) 2: L (lower limit) 3: h (difference upper limit) 4: l (difference lower limit) 5: R (change rate upper limit) 6: r (change rate lower limit) 7: T (delay upper limit) 8: t (delay lower limit)		
		n + 6	-	Alarm value		
		n + 7	-	Relay output 0: No relay output 1: Output relay		
n + 8	-	Relay number (n + 7 = 1)				

Description	F0	F1 (= \$u n)		F2		
Acquisition of alarm setting (SA)	1 to 8 (PLC1 to 8)	n	Station number		4	
		n + 1	Command: 5			
		n + 2	CH No.			
		n + 3	Alarm number			
		n + 4	CH No.			
		n + 5	Alarm number			
		n + 6	Alarm ON/OFF 0: Off	Alarm ON/OFF 1: On		
		n + 7	-	Alarm type 1: H (upper limit) 2: L (lower limit) 3: h (difference upper limit) 4: l (difference lower limit) 5: R (change rate upper limit) 6: r (change rate lower limit) 7: T (delay upper limit) 8: t (delay lower limit)		
		n + 8	-	Alarm value		
		n + 9	-	Relay output 0: No relay output 1: Output relay		
n + 10	-	Relay number				
Channel recording ON/OFF settings (VR)	1 to 8 (PLC1 to 8)	n	Station number		5/6	
		n + 1	Command: 6			
		n + 2	Model 0: Pen	Model 1: Dot		
		n + 3	CH No.			
		n + 4	Periodic printing ON/OFF 0: Off 1: On	Analog recording ON/OFF 0: Off 1: On		
n + 5	-	Periodic printing ON/OFF 0: Off 1: On				
Acquisition of channel recording ON/OFF settings (VR)	1 to 8 (PLC1 to 8)	n	Station number		4	
		n + 1	Command: 7			
		n + 2	Model 0: Pen	Model 1: Dot		
		n + 3	CH No.			
		n + 4	CH No.			
		n + 5	Periodic printing ON/OFF 0: Off 1: On	Analog recording ON/OFF 0: Off 1: On		
n + 6	-	Periodic printing ON/OFF 0: Off 1: On				
Batch and lot number settings (VH) Batch	1 to 8 (PLC1 to 8)	n	Station number		5+m	
		n + 1	Command: 8			
		n + 2	Subcommand 0: Batch			
		n + 3	Item 0: Batch			
		n + 4	No. of characters			
		n + 5	Batch number (m = 1)			
		n + 6	Batch number (m = 2)			
:	:					
Batch and lot number settings (VH) Lot number	1 to 8 (PLC1 to 8)	n	Station number		5/6	
		n + 1	Command: 8			
		n + 2	Subcommand 1: Lot (4 digits)	Subcommand 2: Lot (6 digits)		
		n + 3	Item 1: Lot			
		n + 4	Lot number	Lot number (lower word)		
n + 5	-	Lot number (higher word)				

Description	F0	F1 (= \$u n)			F2	
Acquisition of batch and lot number settings (VH)	1 to 8 (PLC1 to 8)	n	Station number			4
		n + 1	Command: 9			
		n + 2	Subcommand 0: Batch	Subcommand 1: Lot (4 digits)	Subcommand 2: Lot (6 digits)	
		n + 3	Item 0: Batch	Item 1: Lot	Item 1: Lot	
		n + 4	Item 0: Batch	Lot number	Lot number (lower word)	
		n + 5	No. of characters	-	Lot number (higher word)	
		n + 6	Batch number	-	-	
		n + 7	Batch number	-	-	
		:	:	-	-	
Batch comment settings (VC)	1 to 8 (PLC1 to 8)	n	Station number			5+m
		n + 1	Command: 10			
		n + 2	Mode 0: Start printout 1: End printout 2: Start printout 2 3: End printout 2			
		n + 3	Line number			
		n + 4	No. of characters			
		n + 5	Batch comment (m = 1)			
		n + 6	Batch comment (m = 2)			
		:	:			
		Acquisition of batch comment settings (VC)	1 to 8 (PLC1 to 8)	n	Station number	
n + 1	Command: 11					
n + 2	Mode 0: Start printout 1: End printout 2: Start printout 2 3: End printout 2					
n + 3	Line number					
n + 4	Mode 0: Start printout 1: End printout 2: Start printout 2 3: End printout 2					
n + 5	Line number					
n + 6	Batch comment					
n + 7	Batch comment					
:	:					
Start/end printout action settings (VA)	1 to 8 (PLC1 to 8)	n	Station number			4/7
		n + 1	Command: 12			
		n + 2	Mode 0: Start 2: Start2	Mode 1: End 3: End2		
		n + 3	Chart speed before start printout	Chart speed after end printout		
		n + 4	-	Lot number automatic update ON/OFF 0: Off 1: On		
		n + 5	-	Offset compensation record output ON/OFF 0: Off 1: On		
		n + 6	-	Chart speed for offset compensation record output 0: C.Speed 1: 450 mm/h		

Description	F0	F1 (= \$u n)		F2	
Acquisition of start/end printout action settings (VA)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 13		
		n + 2	Mode 0: Start 1: End 2: Start2 3: End2		
		n + 3	Mode 0: Start 2: Start2	Mode 1: End 3: End2	
		n + 4	Chart speed before start printout	Chart speed after end printout	
		n + 5	-	Lot number automatic update ON/OFF 0: Off 1: On	
		n + 6	-	Offset compensation record output ON/OFF 0: Off 1: On	
		n + 7	-	Chart speed for offset compensation record output 0: C.Speed 1: 450 mm/h	
Alarm-related settings (XA)	1 to 8 (PLC1 to 8)	n	Station number		Variable <sup>*3</sup>
		n + 1	Command: 14		
		n + 2	Diagnosis output ON/OFF 0: Off 1: On		
		n + 3	Reflash alarm operation 0: Off 1: On		
		n + 4	AND logic relay <sup>*2</sup>		
		n + 5	Relay energized/de-energized operation 0: Energize 1: De_energize		
		n + 6	Relay hold/non-hold operation 0: Hold 1: Nonhold		
		n + 7	Alarm status display hold/non-hold operation 0: Hold 1: Nonhold		
		n + 8	Interval for change rate upper limit alarm		
		n + 9	Interval for change rate lower limit alarm		
		n + 10	Measurement channel alarm hysteresis 0: Off 1 to 10: 0.1 to 1.0		
n + 11	Computation channel alarm hysteresis 0: Off 1 to 10: 0.1 to 1.0				
Acquisition of alarm-related settings (XA)	1 to 8 (PLC1 to 8)	n	Station number		2
		n + 1	Command: 15		
		n + 2	Diagnosis output ON/OFF 0: Off 1: On		
		n + 3	Reflash alarm operation 0: Off 1: On		
		n + 4	AND logic relay <sup>*2</sup>		
		n + 5	Relay energized/de-energized operation 0: Energize 1: De_energize		
		n + 6	Relay hold/non-hold operation 0: Hold 1: Nonhold		
		n + 7	Alarm status display hold/non-hold operation 0: Hold 1: Nonhold		
		n + 8	Interval for change rate upper limit alarm		
		n + 9	Interval for change rate lower limit alarm		
		n + 10	Measurement channel alarm hysteresis 0: Off 1 to 10: 0.1 to 1.0		
n + 11	Computation channel alarm hysteresis 0: Off 1 to 10: 0.1 to 1.0				

Description	F0	F1 (= \$u n)		F2	
Compensation setting of standard setting (XJ)	1 to 8 (PLC1 to 8)	n	Station number		4/5
		n + 1	Command: 16		
		n + 2	CH No.		
		n + 3	Compensation setting of standard setting 0: Internal	Compensation setting of standard setting 1: External	
		n + 4	-	Compensation voltage	
Acquisition of standard setting compensation setting (XJ)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 17		
		n + 2	CH No.		
		n + 3	CH No.		
		n + 4	Compensation setting of standard setting 0: Internal	Compensation setting of standard setting 1: External	
		n + 5	-	Compensation voltage	
Items-to-print setting (UP)	1 to 8 (PLC1 to 8)	n	Station number		9
		n + 1	Command: 18		
		n + 2	Model 0: Pen	Model 1: Dot	
		n + 3	Channel number / tag selection 0: CH 1: Tag		
		n + 4	Alarm printing setting 0: Off 1: On1 2: On2	Channel printing next to analog recording ON/OFF 0: Off 1: On	
		n + 5	Recording start printout ON/OFF 0: Off 1: On	Alarm printing setting 0: Off 1: On1 2: On2	
		n + 6	New chart speed printout ON/OFF 0: Off 1: On	Recording start printout ON/OFF 0: Off 1: On	
		n + 7	Scaling printout ON/OFF 0: Off 1: On	New chart speed printout ON/OFF 0: Off 1: On	
		n + 8	Recording color printing ON/OFF 0: Off 1: On	Scaling printout ON/OFF 0: Off 1: On	
Acquisition of items-to-print setting (UP)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 19		
		n + 2	Model 0: Pen 1: Dot		
		n + 3	Channel number / tag selection 0: CH	Channel number / tag selection 1: Tag	
		n + 4	Alarm printing setting 0: Off 1: On1 2: On2	Channel printing next to analog recording ON/OFF 0: Off 1: On	
		n + 5	Recording start printout ON/OFF 0: Off 1: On	Alarm printing setting 0: Off 1: On1 2: On2	
		n + 6	New chart speed printout ON/OFF 0: Off 1: On	Recording start printout ON/OFF 0: Off 1: On	
		n + 7	Scaling printout ON/OFF 0: Off 1: On	New chart speed printout ON/OFF 0: Off 1: On	
		n + 8	Recording color printing ON/OFF 0: Off 1: On	Scaling printout ON/OFF 0: Off 1: On	

Description	F0	F1 (= \$u n)		F2	
Periodic printing interval setting (UR)	1 to 8 (PLC1 to 8)	n	Station number		5/6
		n + 1	Command: 20		
		n + 2	Decision of printing interval 0: Auto	Decision of printing interval 1: Manual	
		n + 3	Standard time		
		n + 4	Periodic printing mode 0: No periodic printing 1: Print instantaneous values 2: Print report data between intervals	Interval 0: 10 minutes 1: 12 minutes 2: 25 minutes 3: 20 minutes 4: 30 minutes 5: 1 hour 6: 2 hours 7: 3 hours 8: 4 hours 9: 6 hours 10: 8 hours 11: 12 hours 12: 24 hours	
		n + 5	-	Periodic printing mode 0: No periodic printing 1: Print instantaneous values 2: Print report data between intervals	
Acquisition of periodic printing interval setting (UR)	1 to 8 (PLC1 to 8)	n	Station number		2
		n + 1	Command: 21		
		n + 2	Decision of printing interval 0: Auto	Decision of printing interval 1: Manual	
		n + 3	Standard time		
		n + 4	Periodic printing mode 0: No periodic printing 1: Print instantaneous values 2: Print report data between intervals	Interval 0: 10 minutes 1: 12 minutes 2: 25 minutes 3: 20 minutes 4: 30 minutes 5: 1 hour 6: 2 hours 7: 3 hours 8: 4 hours 9: 6 hours 10: 8 hours 11: 12 hours 12: 24 hours	
		n + 5	-	Periodic printing mode 0: No periodic printing 1: Print instantaneous values 2: Print report data between intervals	
Personalize function ON/OFF setting (UF)	1 to 8 (PLC1 to 8)	n	Station number		Variable <sup>*3</sup>
		n + 1	Command: 22		
		n + 2	Bias function 0: Not 1: Use		
		n + 3	Square root computation low-cut function 0: Not 1: Use		
		n + 4	1-5V input low-cut function 0: Not 1: Use		
		n + 5	Alarm delay function 0: Not 1: Use		
		n + 6	Calibration function 0: Not 1: Use		

Description	F0	F1 (= \$u n)			F2		
Acquisition of personalize function ON/OFF setting (UF)	1 to 8 (PLC1 to 8)	n	Station number			2	
		n + 1	Command: 23				
		n + 2	Bias function 0: Not 1: Use				
		n + 3	Square root computation low-cut function 0: Not 1: Use				
		n + 4	1-5V input low-cut function 0: Not 1: Use				
		n + 5	Alarm delay function 0: Not 1: Use				
		n + 6	Calibration function 0: Not 1: Use				
TLOG timer setting (XQ)	1 to 8 (PLC1 to 8)	n	Station number			4/8	
		n + 1	Command: 24				
		n + 2	Timer No.				
		n + 3	Timer type 0: Off	Timer type 1: Absolute	Timer type 2: Relative		
		n + 4	-	Interval 0: 10 minutes 1: 12 minutes 2: 25 minutes 3: 20 minutes 4: 30 minutes 5: 1 hour 6: 2 hours 7: 3 hours 8: 4 hours 9: 6 hours 10: 8 hours 11: 12 hours 12: 24 hours	Interval (hours)		
		n + 5	-	Standard time	Interval (minutes)		
		n + 6	-	Timeout reset ON/OFF 0: Off 1: On			
n + 7	-	Printout ON/OFF 0: Off 1: On					
Acquisition of TLOG timer setting (XQ)	1 to 8 (PLC1 to 8)	n	Station number			3	
		n + 1	Command: 25				
		n + 2	Timer No.				
		n + 3	Timer No.				
		n + 4	Timer type 0: Off	Timer type 1: Absolute	Timer type 2: Relative		
		n + 5	-	Interval 0: 10 minutes 1: 12 minutes 2: 25 minutes 3: 20 minutes 4: 30 minutes 5: 1 hour 6: 2 hours 7: 3 hours 8: 4 hours 9: 6 hours 10: 8 hours 11: 12 hours 12: 24 hours	Interval (hours)		
		n + 6	-	Standard time	Interval (minutes)		
		n + 7	-	Timeout reset ON/OFF 0: Off 1: On			
n + 8	-	Printout ON/OFF 0: Off 1: On					
DNS setting (XJ) DNS: off	1 to 8 (PLC1 to 8)	n	Station number			3	
		n + 1	Command: 26				
		n + 2	DNS ON/OFF 0: Off				

Description	F0	F1 (= \$u n)		F2	
DNS setting (XJ) DNS: on	1 to 8 (PLC1 to 8)	n	Station number		Variable
		n + 1	Command: 26		
		n + 2	DNS ON/OFF 1: On		
		n + 3	Primary DNS server address (first digit (left-most))		
		n + 4	Primary DNS server address (second digit)		
		n + 5	Primary DNS server address (third digit)		
		n + 6	Primary DNS server address (fourth digit (right-most))		
		n + 7	Secondary DNS server address (first digit (left-most))		
		n + 8	Secondary DNS server address (second digit)		
		n + 9	Secondary DNS server address (third digit)		
		n + 10	Secondary DNS server address (fourth digit (right-most))		
		n + 11	Domain suffix 1 Number of characters *4		
		n + 12	Domain suffix 2 Number of characters *4		
		n + 13	Domain suffix 1		
		:	:		
		n + 44	Domain suffix 1		
n + 45	Domain suffix 2				
:	:				
n + 76	Domain suffix 2				
Acquisition of DNS setting (XJ)	1 to 8 (PLC1 to 8)	n	Station number		2
		n + 1	Command: 27		
		n + 2	DNS ON/OFF 0: Off	DNS ON/OFF 1: On	
		n + 3	-	Primary DNS server address (first digit (left-most))	
		n + 4	-	Primary DNS server address (second digit)	
		n + 5	-	Primary DNS server address (third digit)	
		n + 6	-	Primary DNS server address (fourth digit (right-most))	
		n + 7	-	Secondary DNS server address (first digit (left-most))	
		n + 8	-	Secondary DNS server address (second digit)	
		n + 9	-	Secondary DNS server address (third digit)	
		n + 10	-	Secondary DNS server address (fourth digit (right-most))	
		n + 11	-	Domain suffix 1	
		:	-	:	
		n + 42	-	Domain suffix 1	
		n + 43	-	Domain suffix 2	
		:	-	:	
n + 74	-	Domain suffix 2			
Communication timeout setting (YQ)	1 to 8 (PLC1 to 8)	n	Station number		3/4
		n + 1	Command: 28		
		n + 2	Communication timeout ON/OFF 0: Off	Communication timeout ON/OFF 1: On	
		n + 3	-	Time-out Time	
Acquisition of communication timeout setting (YQ)	1 to 8 (PLC1 to 8)	n	Station number		2
		n + 1	Command: 29		
		n + 2	Communication timeout ON/OFF 0: Off	Communication timeout ON/OFF 1: On	
		n + 3	-	Time-out Time	
Printing position adjustment (JA)	1 to 8 (PLC1 to 8)	n	Station number		6/5
		n + 1	Command: 30		
		n + 2	Model 0: Pen	Model 1: Dot	
		n + 3	Printing position 0: Zero (0 % position) 1: Full (100 % position)	Printing position 0: Zero (0 % position) 1: Full (100 % position) 2: Hysteresis (difference of printing position)	
		n + 4	Pen No.: 1 to 4	Adjustment value	
		n + 5	Adjustment value	-	

Description	F0	F1 (= \$u n)		F2
Setting mode menu selection (UG)	1 to 8 (PLC1 to 8)	n	Station number	Variable *3
		n + 1	Command: 31	
		n + 2	Range 0: Off 1: On	
		n + 3	Bias 0: Off 1: On	
		n + 4	Alarm 0: Off 1: On	
		n + 5	Unit 0: Off 1: On	
		n + 6	Chart speed 0: Off 1: On	
		n + 7	Other Notes 0: Off 1: On	
		n + 8	Calibration correction 0: Off 1: On	
		n + 9	Operation 0: Off 1: On	
		n + 10	Batch name 0: Off 1: On	
		n + 11	Batch details 0: Off 1: On	
Acquisition of Setting mode menu selection (UG)	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 32	
		n + 2	Range 0: Off 1: On	
		n + 3	Bias 0: Off 1: On	
		n + 4	Alarm 0: Off 1: On	
		n + 5	Unit 0: Off 1: On	
		n + 6	Chart speed 0: Off 1: On	
		n + 7	Other Notes 0: Off 1: On	
		n + 8	Calibration correction 0: Off 1: On	
		n + 9	Operation 0: Off 1: On	
		n + 10	Batch name 0: Off 1: On	
		n + 11	Batch details 0: Off 1: On	

Description	F0	F1 (= \$u n)		F2	
Start/end printout and message format ON/OFF setting (UE)	1 to 8 (PLC1 to 8)	n	Station number		4/6
		n + 1	Command: 33		
		n + 2	Start/end printout ON/OFF 0: Not	Start/end printout ON/OFF 1: Use	
		n + 3	Message format ON/OFF 0: Not 1: Use	Lot number digits 0: Not 4: 4 digits 6: 6 digits	
		n + 4	-	Start2/end2 printout ON/OFF 0: Not 1: Use	
		n + 5	-	Message format ON/OFF 0: Not 1: Use	
Acquisition of start/end printout and message format ON/OFF setting (UE)	1 to 8 (PLC1 to 8)	n	Station number		2
		n + 1	Command: 34		
		n + 2	Start/end printout ON/OFF 0: Not	Start/end printout ON/OFF 1: Use	
		n + 3	Message format ON/OFF 0: Not 1: Use	Lot number digits 0: Not 4: 4 digits 6: 6 digits	
		n + 4	-	Start2/end2 printout ON/OFF 0: Not 1: Use	
		n + 5	-	Message format ON/OFF 0: Not 1: Use	
Basic Setting mode exit (YE)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 35		
		n + 2	Settings ON/OFF 0: Store (settings enabled) 1: Abort (settings disabled)		
Basic Setting mode exit (XE)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 36		
		n + 2	Settings ON/OFF 0: Store (settings enabled) 1: Abort (settings disabled)		
Operation mode change (DS)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 37		
		n + 2	Mode type 0: Operation mode 1: Basic Setting mode		
Recording start/stop (PS)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 38		
		n + 2	Recording start/stop 0: Start 1: Stop		
Screen/channel switching (UD)	1 to 8 (PLC1 to 8)	n	Station number		3/4
		n + 1	Command: 39		
		n + 2	Command 0: Return to data display screen 2: Change displayed channel	Command 1: Change to data display screen 2	
		n + 3	-	Screen No.: 1 to 15	
Alarm acknowledgement operation (alarm ACK) (AK)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 40		
		n + 2	0 fixed		
Computation start/stop/reset (TL)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 41		
		n + 2	Operation type 0: Math start 1: Math stop 2: Math reset		
Manual printout start/stop (MP)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 42		
		n + 2	Operation type 0: Printout start 1: Printout stop		

Description	F0	F1 (= \$u n)		F2
List 1 (settings) printout start/stop (LS)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 43	
		n + 2	Recording start/stop 0: Start 1: Stop	
List 2 (basic settings) printout start/stop (SU)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 44	
		n + 2	Recording start/stop 0: Start 1: Stop	
Message printout (MS)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 45	
		n + 2	Message No.: 1 to 5	
Alarm printout buffer clear (AC)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 46	
		n + 2	0 fixed	
Message printout buffer clear (MC)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 47	
		n + 2	0 fixed	
Periodic printing report data reset (VG)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 48	
		n + 2	Fixed to 2	
Settings initialization (YC)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 49	
		n + 2	Initialization type 0: Initialization of Setting mode and Basic Setting mode settings 1: Initialization of Setting mode settings	
Stop printing position adjustment (UY)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 50	
		n + 2	0 fixed	
Acquisition of printing position adjustment status (UY)	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 51	
		n + 2	Execution status 0: Stopped 1: In execution	
Byte output order setting (BO)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 52	
		n + 2	Byte order 0: MSB 1: LSB	
Acquisition of byte output order setting (BO)	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 53	
		n + 2	Byte order 0: MSB 1: LSB	
Status filter setting (IF)	1 to 8 (PLC1 to 8)	n	Station number	6
		n + 1	Command: 56	
		n + 2	Status information filter 1: 0 to 255	
		n + 3	Status information filter 2: 0 to 255	
		n + 4	Status information filter 3: 0 to 255	
		n + 5	Status information filter 4: 0 to 255	
Acquisition of status filter setting (IF)	1 to 8 (PLC1 to 8)	n	Station number	2
		n + 1	Command: 57	
		n + 2	Status information filter 1: 0 to 255	
		n + 3	Status information filter 2: 0 to 255	
		n + 4	Status information filter 3: 0 to 255	
		n + 5	Status information filter 4: 0 to 255	
Ethernet disconnection (CC)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 58	
		n + 2	0 fixed	

Description	F0	F1 (= \$u n)		F2	
Output of decimal point position, unit information, setting data (FE)	1 to 8 (PLC1 to 8)	n	Station number	6	
		n + 1	Command: 59		
		n + 2	Address *5		
		n + 3	Output data type: 1 (decimal point position, unit information)		
		n + 4	First channel for output		
		n + 5	Last channel for output		
		n + 6 and up	Receive data *6		
Output latest measurement/calculation data (FD)	1 to 8 (PLC1 to 8)	n	Station number	5	
		n + 1	Command: 60		
		n + 2	Address *5		
		n + 3	First channel for output		
		n + 4	Last channel for output		
		n + 5 and up	Receive data *6		
Output statistical calculation results (FY)	1 to 8 (PLC1 to 8)	n	Station number	6	
		n + 1	Command: 61		
		n + 2	Address *5		
		n + 3	Output data type 0: Inst 1: Report 2: Tlog1 3: Tlog2		
		n + 4	First channel for output		
		n + 5	Last channel for output		
		n + 6 and up	Receive data *6		
FIFO data output (FF)	1 to 8 (PLC1 to 8)	n	Station number	7/4	
		n + 1	Command: 62		
		n + 2	Address *5		
		n + 3	Operation type 0: Get 3: Get_new		Operation type 1: Resend 2: Reset
		n + 4	First channel for output		Receive data *6
		n + 5	Last channel for output		
		n + 6	Blocks to output 0: All blocks Other than 0: The specified number		
		n + 7 and up	Receive data *6		
Status information output (IS)	1 to 8 (PLC1 to 8)	n	Station number	2	
		n + 1	Command: 63		
		n + 2	Status information 1: 0 to 255		
		n + 3	Status information 2: 0 to 255		
		n + 4	Status information 3: 0 to 255		
		n + 5	Status information 4: 0 to 255		
User information output (FU)	1 to 8 (PLC1 to 8)	n	Station number	2	
		n + 1	Command: 64		
		n + 2	Physical layer		
		n + 3	User level		
		n + 4 to n + 11	User name		
Login	1 to 8 (PLC1 to 8)	n	Station number	4	
		n + 1	Command: 67		
		n + 2	Login function: 0 (not use)		
		n + 3	Login level 0: Admin (administrator) 1: User		
Bias setting (VB)	1 to 8 (PLC1 to 8)	n	Station number	4/5	
		n + 1	Command: 70		
		n + 2	CH No.		
		n + 3	Bias ON/OFF 0: Off		Bias ON/OFF 1: On
		n + 4	-		Bias value

Description	F0	F1 (= \$u n)		F2	
Acquisition of bias setting (VB)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 71		
		n + 2	CH No.		
		n + 3	CH No.		
		n + 4	Bias ON/OFF 0: Off	Bias ON/OFF 1: On	
		n + 5	-	Bias value	
Partial expanded recording setting (SP)	1 to 8 (PLC1 to 8)	n	Station number		4/6
		n + 1	Command: 72		
		n + 2	CH No.		
		n + 3	Partial expanded recording setting ON/OFF 0: Off	Partial expanded recording setting ON/OFF 1: On	
		n + 4	-	Boundary position	
		n + 5	-	Boundary value	
Acquisition of partial expanded recording setting (SP)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 73		
		n + 2	CH No.		
		n + 3	CH No.		
		n + 4	Partial expanded recording setting ON/OFF 0: Off	Partial expanded recording setting ON/OFF 1: On	
		n + 5	-	Boundary position	
n + 6	-	Boundary value			
Computing equation setting (SO)	1 to 8 (PLC1 to 8)	n	Station number		4/Variable
		n + 1	Command: 74		
		n + 2	Computation channel No. <sup>*7</sup>		
		n + 3	Computing equation ON/OFF 0: Off	Computing equation ON/OFF 1: On	
		n + 4	-	No. of characters	
		n + 5 to n + 124	-	Computing equation <sup>*8</sup>	
		n + 125	-	Span left end value (lower word)	
		n + 126	-	Span left end value (higher word)	
		n + 127	-	Span right end value (lower word)	
		n + 128	-	Span right end value (higher word)	
		n + 129	-	Span decimal place	
Acquisition of computing equation setting (SO)	1 to 8 (PLC1 to 8)	n	Station number		3
		n + 1	Command: 75		
		n + 2	Computation channel No. <sup>*7</sup>		
		n + 3	Computation channel No. <sup>*7</sup>		
		n + 4	Computing equation ON/OFF 0: Off	Computing equation ON/OFF 1: On	
		n + 5 to n + 124	-	Computing equation <sup>*8</sup>	
		n + 125	-	Span left end value (lower word)	
		n + 126	-	Span left end value (higher word)	
		n + 127	-	Span right end value (lower word)	
		n + 128	-	Span right end value (higher word)	
		n + 129	-	Span decimal place	
Computing equation constant setting (SK)	1 to 8 (PLC1 to 8)	n	Station number		9
		n + 1	Command: 76		
		n + 2	Constant number: 1 to 30		
		n + 3	Constant sign (+, -)		
		n + 4	Constant significand (characteristic) (lower word)		
		n + 5	Constant significand (characteristic) (higher word)		
		n + 6	Constant significand (mantissa) (lower word)		
		n + 7	Constant significand (mantissa) (higher word)		
		n + 8	Constant exponent (0 if not necessary)		

Description	F0	F1 (= \$u n)		F2
Acquisition of computing equation constant setting (SK)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 77	
		n + 2	Constant number: 1 to 30	
		n + 3	Constant number	
		n + 4	Constant sign (+, -)	
		n + 5	Constant significand (characteristic) (lower word)	
		n + 6	Constant significand (characteristic) (higher word)	
		n + 7	Constant significand (mantissa) (lower word)	
		n + 8	Constant significand (mantissa) (higher word)	
		n + 9	Constant exponent	
Communication input data setting (CM)	1 to 8 (PLC1 to 8)	n	Station number	9
		n + 1	Command: 78	
		n + 2	Communication input data No.	
		n + 3	Communication input data sign (+, -)	
		n + 4	Communication input data significand (characteristic) (lower word)	
		n + 5	Communication input data significand (characteristic) (higher word)	
		n + 6	Communication input data significand (mantissa) (lower word)	
		n + 7	Communication input data significand (mantissa) (higher word)	
Acquisition of communication input data setting (CM)	1 to 8 (PLC1 to 8)	n	Station number	3
		n + 1	Command: 79	
		n + 2	Communication input data No.	
		n + 3	Communication input data No.	
		n + 4	Communication input data No. sign (+, -)	
		n + 5	Communication input data No. significand (characteristic) (lower word)	
		n + 6	Communication input data No. significand (characteristic) (higher word)	
		n + 7	Communication input data No. significand (mantissa) (lower word)	
		n + 8	Communication input data No. significand (mantissa) (higher word)	
		n + 9	Communication input data No. exponent	

 Return data: Data stored from chart recorder to V series

### Command parameters

The available number of parameters for each command varies depending on the device used (model and specifications). If a parameter is unavailable, subsequent parameters are moved up. Be sure to modify the number of words to be transferred in PLC\_CTL [F2] according to the actual parameters.

For more information, refer to the manual issued by the manufacturer.

\*1 Available range setting values vary depending on the setting mode. Set the following values for range settings.

Measurement mode	Range Type	Value
VOLT, SQRT, DELTA	20mV	0
	60mV	1
	200mV	2
	2V	3
	6V	4
	20V	5
	50V	6
1-5V	1-5V	0
TC	R	0
	S	1
	B	2
	K	3
	E	4
	J	5
	T	6
	N	7
	W	8
	L	9
	U	10
Wre	11	
RTD	Pt100	0
	JPt100	1
DI	Voltage	0
	Contact	1

\*2 Set AND logic relays as shown below.

Measurement mode	Value
NONE	0
I01	1
I01-I02	2
I01-I03	3
I01-I04	4
I01-I05	5
I01-I06	6
I01-I11	7
I01-I12	8
I01-I13	9
I01-I14	10
I01-I15	11
I01-I16	12
I01-I21	13
I01-I22	14
I01-I23	15
I01-I24	16
I01-I25	17
I01-I26	18
I01-I31	19
I01-I32	20
I01-I33	21
I01-I34	22
I01-I35	23
I01-I36	24

\*3 The number of parameters for each command varies depending on the device used (special specifications).

\*4 When "0" is specified for the number of characters, subsequent strings can be omitted. Input the second data in the next place.

\*5 Specify the \$u device memory address for storing received data.

\*6 For information on receive data formats, refer to the manual issued by the manufacturer.

\*7 Set computation channel numbers as shown below.

0A: 31, 0B: 32, 0C: 33, ---, 1P: 54


\*8 When a computing equation is shorter than "n + 124", set the next parameter in the next space.

## 27.2.13 Wiring Diagrams


### When Connected at CN1:

#### RS-422/RS-485


Wiring diagram 1 - C4

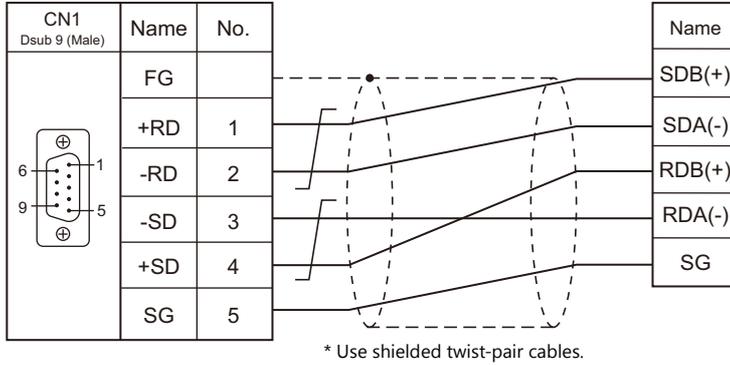

Wiring diagram 2 - C4

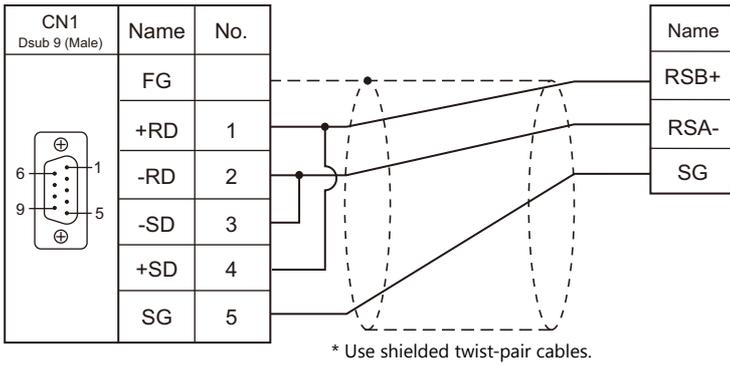


Wiring diagram 3 - C4

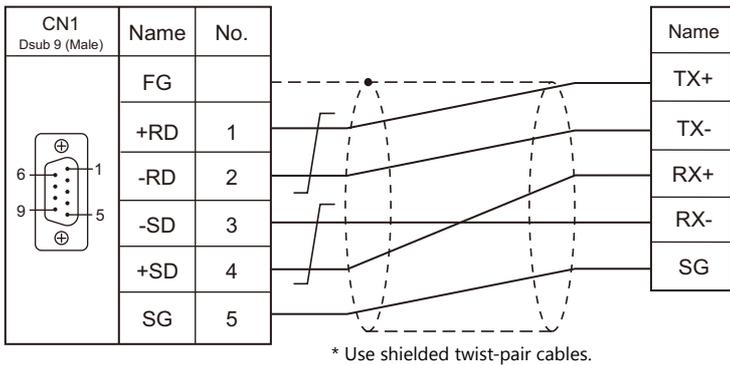


**When Connected at MJ1/MJ2:**

**RS-422/RS-485**


**Wiring diagram 1 - M4**

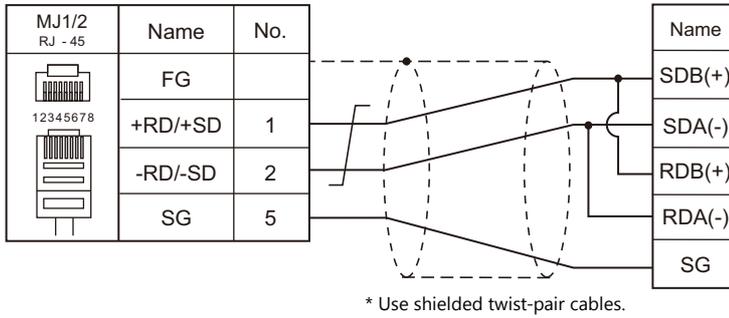


**Wiring diagram 2 - M4**

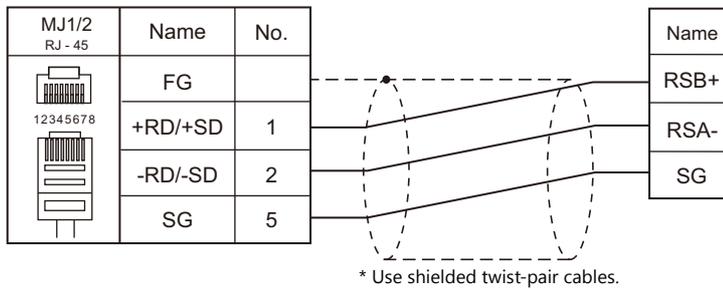

**Wiring diagram 3 - M4**

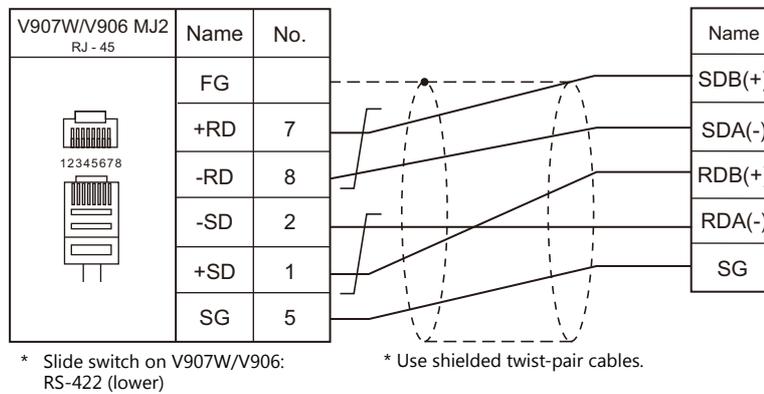


**Wiring diagram 4 - M4**

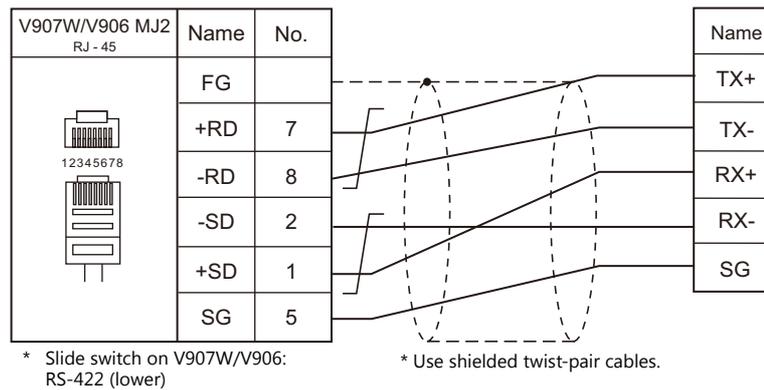

# MEMO

**MONITOUCH**



# 28. MODBUS

---

## 28.1 PLC Connection

## 28.1 PLC Connection

### Serial Connection

The V9 series works as the Modbus RTU master station. It can be connected with devices that support Modbus RTU communication.

PLC Selection on the Editor	Applicable Device	Signal Level	Connection		
			CN1	MJ1/MJ2 *1	MJ2 (4-wire) V907W/V906 *2
MODBUS RTU	Modbus RTU slave device	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2	
		RS-422	Wiring diagram 1 - C4	×	Wiring diagram 2 - M4
		RS-485	Wiring diagram 2 - C4	Wiring diagram 1 - M4	
MODBUS RTU EXT Format	Modbus RTU slave device	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2	
		RS-422	Wiring diagram 1 - C4	×	Wiring diagram 2 - M4
		RS-485	Wiring diagram 2 - C4	Wiring diagram 1 - M4	
MODBUS ASCII	MODBUS ASCII slave device	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2	
		RS-422	Wiring diagram 1 - C4	×	Wiring diagram 2 - M4
		RS-485	Wiring diagram 2 - C4	Wiring diagram 1 - M4	

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

\*2 Set the slide switch for signal level selection to RS-422 position (lower). For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

### Ethernet Connection

The V9 series works as the Modbus TCP/IP master station. It can be connected with devices that support Modbus TCP/IP slave communication.

PLC Selection on the Editor	Applicable Device	TCP/IP	UDP/IP	Port No.
MODBUS TCP/IP (Ethernet)	Modbus TCP/IP slave device	○	×	502 *
MODBUS TCP/IP (Ethernet) Sub Station	Modbus TCP/IP slave device			
MODBUS TCP/IP (Ethernet) EXT Format	Modbus TCP/IP slave device			

\* Depending on the device specification, an arbitrary port number can be specified.

## 28.1.1 MODBUS RTU

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / RS-422/485	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 / 115K bps	
Data Length	8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 255	0: Broadcast

#### Modbus format setting

Make communication format settings for each connected device.

\* If the maximum number of words to be read or written varies among the address ranges, select [MODBUS RTU EXT Format] for [Model] in the connection device selection dialog and make the extended format setting. For more information, see page 28-4.

The screenshot shows a software interface with a 'Modbus Format Setting' dialog box. The dialog box contains a table with the following data:

No.	Device connected	Read Coil	Write to Coil	Read Input F
0	Modbus Free	1-Bit	1-Bit	1-Bit
1		1-Bit	1-Bit	1-Bit
2		1-Bit	1-Bit	1-Bit
3		1-Bit	1-Bit	1-Bit
4		1-Bit	1-Bit	1-Bit
5		1-Bit	1-Bit	1-Bit
6		1-Bit	1-Bit	1-Bit
7		1-Bit	1-Bit	1-Bit
8		1-Bit	1-Bit	1-Bit
9		1-Bit	1-Bit	1-Bit
10		1-Bit	1-Bit	1-Bit
11		1-Bit	1-Bit	1-Bit
12		1-Bit	1-Bit	1-Bit
13		1-Bit	1-Bit	1-Bit
14		1-Bit	1-Bit	1-Bit
15		1-Bit	1-Bit	1-Bit
16		1-Bit	1-Bit	1-Bit
17		1-Bit	1-Bit	1-Bit
18		1-Bit	1-Bit	1-Bit
19		1-Bit	1-Bit	1-Bit

No. 1 to 255	Port number of the connected device
Read Coil	Format setting Set the number of words to be read or written at one time of communication for each device. For details on the maximum value that can be set on V-SFT, see the table shown below.*1 The format setting also serves as the function code*1 setting used for Modbus communication. The available function codes vary depending on the device. Refer to the instruction manual of the connected device as well as the table shown below*1, and set the options on the dialog correctly.
Write to Coil	
Read Input Relay	
Read Holding Register	
Write Holding Register	
Read Input Register	

\*1 Format setting on V-SFT and function code for the Modbus communication

V-SFT Format Setting		Maximum Setting	Modbus Communication Function Code
Operation			
Read Coil		992 bits	01H
Write to Coil	1 bit	1 word	05H
	16 bits or more	992 bits	0FH
Read Input Relay		992 bits	02H
Read Holding Register		62 words	03H
Write Holding Register	1 word	1 word	06H
	2 words or more	62 words	10H
Read Input Register		62 words	04H

## PLC

Make communication settings of the connected device according to the settings made for the V9 series. For more information on settings, refer to the instruction manual issued by the manufacturer.

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
0 (output coil)	00H	
1 (input relay)	01H	
4 (holding register)	02H	
3 (input register)	03H	

### Notes on Creating Screen Programs

On the editor, the device memory address is specified in decimal notation. Thus, when the address of a connected device is expressed in hexadecimal notation, convert the address into decimal one and add "1".

#### Setting example

- When specifying the PV (current value) RAM address "3814H" for Modbus RTU connection with Yamatake's "SDC35":
  - Convert the hexadecimal address into the decimal one.  
3814HEX → 14356DEC
  - Add "1" to the decimal address.  
14356 + 1 = 14357DEC
  - On the editor, specify "14357" for the holding register (4).

## 28.1.2 MODBUS RTU EXT Format

In the case with some Modbus RTU devices, the function code to be used or the maximum value to be read or written at one time varies depending on the address range even in the same device memory.

When [MODBUS RTU EXT Format] is selected, the address range as well as the communication format can be set as desired according to the specifications of the connected device. With [MODBUS RTU EXT Format] selected, since access will not be made to any address other than those specified in the format setting, communication can be performed effectively.

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1:n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 / 115K bps	
Data Length	8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 255	0: Broadcast

#### Extended format setting


Make communication format settings for the connected device.

The image shows a sequence of screenshots from a software editor. At the top, a settings window has a 'Setting...' button circled in red. Two red arrows point from this button to two separate 'Extended Format Setting' dialog boxes. The left dialog box is labeled '[Common]' and has the 'Common' radio button selected. The right dialog box is labeled '[Individual]' and has the 'Individual' radio button selected. In the right dialog box, a table lists station numbers (No.) and names (Station Name). The entry for 'Device2' has a '\*' mark in the 'No.' column. A text box next to it explains: 'A "\*" mark is displayed in the "No." column of a user-specified communication format. For details on the default communication format, see "[Format Detail Display] dialog" on the next page.'

Common	Used to set the communication format commonly to all station numbers.
Discrete	Used to set a communication format for respective station numbers.
Detail	Displays the [Format Detail Display] dialog.
No.	Displays the station number of the connected device.
Station Name	Sets and displays the station name of the connected device.

## [Format Detail Display] dialog

Register the communication format for each of the specified address range. Make the setting according to the device specification.

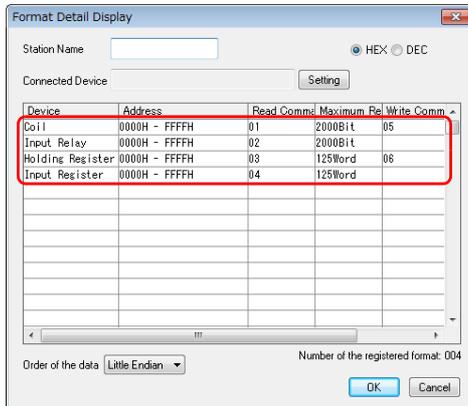

Four types of communication formats shown to the left have been registered by default.


Station Name	Register a desired station name.
Target Port No.	When [Discrete] is selected, the number of the selected station is automatically displayed.
HEX/DEC	Select the address notation. HEX / DEC
Device	Displays the currently registered device memory name. Coil / Input Relay / Holding Register / Input Register (default settings: one each, deletion impossible)
Address	Specify the address range for each device memory. HEX: 0000 to FFFF DEC: 1 to 65536 <b>* The address range must not be duplicated.</b>
Read Command	Set the communication format used for reading from or writing into the specified address range.
Maximum Read Value	<ul style="list-style-type: none"> <li>[Read Command] / [Write Command] Specify the function code<sup>*1</sup> to use for Modbus communication. The available function codes vary depending on the device. Refer to the instruction manual of the connected device as well as the table shown below<sup>*1</sup>, and set the options on the dialog correctly.</li> <li>[Maximum Read Value] / [Maximum Write Value] Set the maximum value to be read or written at one time. Make the setting according to the device specification. For details on the maximum value that can be set for each device memory by using V-SFT, see the table shown below.<sup>*1</sup></li> </ul>
Write Command	
Maximum Write Value	
Order of the data	Specify the ordering of data. Little Endian / Big Endian
Number of the registered format	Displays the number of currently registered formats. Default: 4 (deletion impossible) Max.: 255

\*1 Device memory setting on V-SFT and function code for the Modbus communication

V-SFT Format Setting			Modbus Communication Function Code
Operation	Max. Read/Write Value		
Coil	Read	2000 bits	01H
	Write	1 bit	05H
		2 bits or more	800 bits
Input Relay	Read	2000 bits	02H
Holding Register	Read	125 words	03H
	Write	1 word	06H
		2 words or more	100 words
Input Register	Read	125 words	04H

## Adding a format

To add a format, select a device memory, right-click on the selected device memory and select [Add].

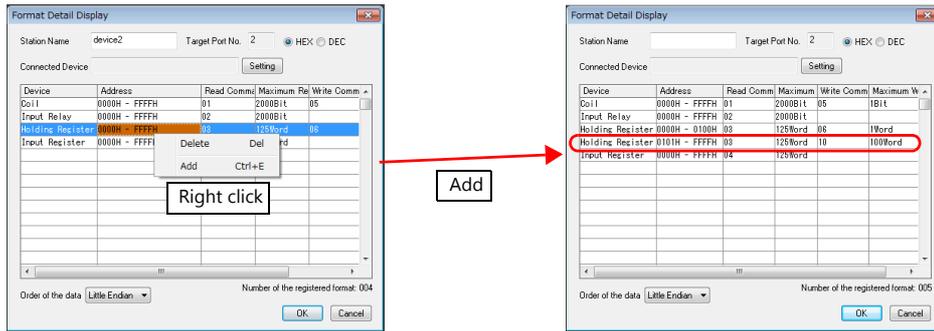

## Setting example

When connecting a device which has the following specifications to station number 1:

Function Code	Operation	Max. Communication Points	Available Address	Example
01H	Read coil	4000	HEX: 0000 to 00FF    DEC: 1 to 256	(1)
			HEX: 2EE0 to 4E1F    DEC: 12001 to 20000	(2)
05H	Write single coil	1	HEX: 0000 to 00FF    DEC: 1 to 256	(1)
0FH	Write multiple coils	1000	HEX: 2EE0 to 4E1F    DEC: 12001 to 20000	(2)
03H	Read holding register	200	HEX: 0000 to 103F    DEC: 1 to 8000	(3)
			HEX: 2EE0 to 2FDF    DEC: 12001 to 12256	(4)
06H	Write single holding register	1	HEX: 2EE0 to 2FDF    DEC: 12001 to 12256	(4)
10H	Write multiple holding registers	50	HEX: 0000 to 1F3F    DEC: 1 to 8000	(3)

- Read/write coil

- (1) 0000 to 00FF (HEX)

- Register "01H" (function code for reading) to [Read Command] or "05H" (function code for writing) to [Write Command].
    - The maximum number of communication points to be read is 4000. Accordingly, register "2000 bits" for [Maximum Read Value] on V-SFT.
    - The maximum number of communication points to be written is 1. Accordingly, register "1 bit" for [Maximum Write Value] on V-SFT.

- (2) 2EE0 to 4E1F (HEX)

- Register "01H" (function code for reading) to [Read Command] or "0FH" (function code for writing) to [Write Command].
    - The maximum number of communication points to be read is 4000. Accordingly, register "2000 bits" for [Maximum Read Value] on V-SFT.
    - The maximum number of communication points to be written is 1000. Accordingly, register "800 bits" for [Maximum Write Value] on V-SFT.

- Read/write holding register

- (3) 0000 to 1F3F (HEX)

- Register "03H" (function code for reading) to [Read Command] or "10H" (function code for writing) to [Write Command].
    - The maximum number of communication points to be read is 200. Accordingly, register "125 words" for [Maximum Read Value] on V-SFT.
    - The maximum number of communication points to be written is 50. Accordingly, register "50 words" for [Maximum Write Value] on V-SFT.

- (4) 2EE0 to 2FDF (HEX)

- Register "03H" (function code for reading) to [Read Command] or "06H" (function code for writing) to [Write Command].
    - The maximum number of communication points to be read is 200. Accordingly, register "125 words" for [Maximum Read Value] on V-SFT.
    - The maximum number of communication points to be written is 1. Accordingly, register "1 word" for [Maximum Write Value] on V-SFT.



## 28.1.3 MODBUS ASCII

### Communication Setting

#### Editor

#### Communication setting

(Underlined setting: default)

Item	Setting	Remarks
Connection Mode	1 : 1 / <u>1 : n</u> / Multi-link2 / Multi-link2 (Ethernet) / 1 : n Multi-link2 (Ethernet)	
Signal Level	RS-232C / <u>RS-422/485</u>	
Baud Rate	4800 / <u>9600</u> / 19200 / 38400 / 57600 / 115K bps	
Data Length	7 / <u>8</u> bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	None / <u>Odd</u> / Even	
Target Port No.	0 to 255	0: Broadcast

#### Format setting

Make communication format settings for each connected device. (See page 28-2.)

#### PLC

Make communication settings of the connected device according to the settings made for the V9 series. For more information on settings, refer to the instruction manual issued by the manufacturer.

### Available Device Memory

The contents of "Available Device Memory" are the same as those described in "28.1.1 MODBUS RTU".

## 28.1.4 MODBUS TCP/IP (Ethernet)

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
- Port number for the V9 unit at [Communication Setting] in the [PLC Properties] window ([Hardware Setting])
- PLC's IP address and port number for [PLC Table] under [Target Settings] in the [PLC Properties] window ([Hardware Setting])
- [Format Setting] in the [PLC Properties] window ([Hardware Setting])

#### Format setting

Make communication format settings for each connected device. (See page 28-2.)

- \* **If the maximum number of words to be read or written varies among the address ranges, select [MODBUS TCP/IP (Ethernet) EXT Format] for [Series] in the [Connection Device Selection] dialog and make extended format settings. For more information, see page 28-10.**

#### PLC

Make communication settings of the connected device according to the settings made for the V9 series. For more information on settings, refer to the instruction manual issued by the manufacturer.

### Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
0 (output coil)	00H	
1 (input relay)	01H	
4 (holding register)	02H	
3 (input register)	03H	

#### Notes on Creating Screen Program

On the editor, the device memory address is specified in decimal notation. Thus, when the address of a connected device is expressed in hexadecimal notation, convert the address into decimal one and add "1". (See page 28-3.)

## 28.1.5 MODBUS TCP/IP (Ethernet) EXT Format

In the case with some Modbus TCP/IP (Ethernet) devices, the function code to be used or the maximum value to be read or written at one time varies depending on the address range even in the same device memory. When [MODBUS TCP/IP (Ethernet) EXT Format] is selected, the address range as well as the communication format can be set as desired according to the specifications of the connected device. With [MODBUS TCP/IP (Ethernet) EXT Format] selected, since access will not be made to any address other than those specified in the format setting, communication can be performed effectively.

### Communication Setting

#### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
- Port number for the V9 unit at [Communication Setting] in the [PLC Properties] window ([Hardware Setting])
- PLC's IP address and port number for [PLC Table] under [Target Settings] in the [PLC Properties] window ([Hardware Setting])
- [Extended Format Setting] in the [PLC Properties] window ([Hardware Setting])


#### Extended format setting

Make communication format settings for the connected device.

Common	Used to set the communication format commonly to all station numbers.
Discrete	Used to set a communication format for respective station numbers.
Detail	Displays the [Format Detail Display] dialog.
No.	Displays the station number of the connected device.
Station Name	Sets and displays the station name of the connected device.
Sub Station	Check the box when Modbus TCP/IP communication is to be performed with a device requiring a unit ID specification. When this box is checked, the unit ID can be specified when setting the device memory address. (Without check: The unit ID is fixed to "FFH".)

**[Format Detail Display] dialog**

Register the communication format for each of the specified address range. Make the setting according to the device specification.

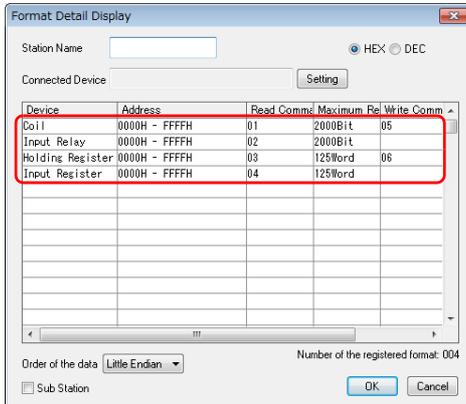

Four types of communication formats shown to the left have been registered by default.


Station Name	Register a desired station name.
Target Port No.	When [Discrete] is selected, the number of the selected station is automatically displayed.
HEX/DEC	Select the address notation. HEX / DEC
Device	Displays the currently registered device memory name. Coil / Input Relay / Holding Register / Input Register (default settings: one each, deletion impossible)
Address	Specify the address range for each device memory. HEX: 0000 to FFFF DEC: 1 to 65536 <b>* The address range must not be duplicated.</b>
Read Command	Set the communication format used for reading from or writing into the specified address range.
Maximum Read Value	<ul style="list-style-type: none"> <li>[Read Command] / [Write Command] Specify the function code<sup>*1</sup> to use for Modbus communication. The available function codes vary depending on the device. Refer to the instruction manual of the connected device as well as the table shown below<sup>*1</sup>, and set the options on the dialog correctly.</li> </ul>
Write Command	<ul style="list-style-type: none"> <li>[Maximum Read Value] / [Maximum Write Value] Set the maximum value to be read or written at one time. Make the setting according to the device specification. For details on the maximum value that can be set for each device memory by using V-SFT, see the table shown below.<sup>*1</sup></li> </ul>
Order of the data	Specify the ordering of data. Little Endian / Big Endian
<input type="checkbox"/> Sub Station	Check this box when using the sub station function.
Number of the registered format	Displays the number of currently registered formats. Default: 4 (deletion impossible) Max.: 255

\*1 Device memory setting on V-SFT and function code for the Modbus communication

V-SFT Format Setting			Modbus Communication Function Code
Operation	Max. Read/Write Value		
Coil	Read	2000 bits	01H
	Write	1 bit	05H
		2 bits or more	800 bits
Input Relay	Read	2000 bits	02H
Holding Register	Read	125 words	03H
	Write	1 word	06H
		2 words or more	100 words
Input Register	Read	125 words	04H

## Adding a format

To add a format, select a device memory, right-click on the selected device memory and select [Add].

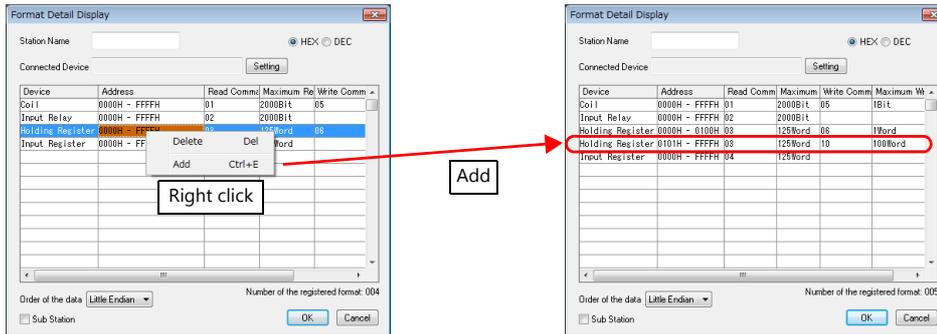

## Example

When connecting a device which has the following specifications to station number 1:

Function Code	Operation	Max. Communication Points	Available Address	Example
01H	Read coil	4000	HEX: 0000 to 00FF    DEC: 1 to 256	(1)
			HEX: 2EE0 to 4E1F    DEC: 12001 to 20000	(2)
05H	Write single coil	1	HEX: 0000 to 00FF    DEC: 1 to 256	(1)
0FH	Write multiple coils	1000	HEX: 2EE0 to 4E1F    DEC: 12001 to 20000	(2)
03H	Read holding register	200	HEX: 0000 to 103F    DEC: 1 to 8000	(3)
			HEX: 2EE0 to 2FDF    DEC: 12001 to 12256	(4)
06H	Write single holding register	1	HEX: 2EE0 to 2FDF    DEC: 12001 to 12256	(4)
10H	Write multiple holding registers	50	HEX: 0000 to 1F3F    DEC: 1 to 8000	(3)

- Read/write coil

- (1) 0000 to 00FF (HEX)

- Register "01H" (function code for reading) to [Read Command] or "05H" (function code for writing) to [Write Command].
    - The maximum number of communication points to be read is 4000. Accordingly, register "2000 bits" for [Maximum Read Value] on V-SFT.
    - The maximum number of communication points to be written is 1. Accordingly, register "1 bit" for [Maximum Write Value] on V-SFT.

- (2) 2EE0 to 4E1F (HEX)

- Register "01H" (function code for reading) to [Read Command] or "0FH" (function code for writing) to [Write Command].
    - The maximum number of communication points to be read is 4000. Accordingly, register "2000 bits" for [Maximum Read Value] on V-SFT.
    - The maximum number of communication points to be written is 1000. Accordingly, register "800 bits" for [Maximum Write Value] on V-SFT.

- Read/write holding register

- (3) 0000 to 1F3F (HEX)

- Register "03H" (function code for reading) to [Read Command] or "10H" (function code for writing) to [Write Command].
    - The maximum number of communication points to be read is 200. Accordingly, register "125 words" for [Maximum Read Value] on V-SFT.
    - The maximum number of communication points to be written is 50. Accordingly, register "50 words" for [Maximum Write Value] on V-SFT.

- (4) 2EE0 to 2FDF (HEX)


- Register "03H" (function code for reading) to [Read Command] or "06H" (function code for writing) to [Write Command].
    - The maximum number of communication points to be read is 200. Accordingly, register "125 words" for [Maximum Read Value] on V-SFT.
    - The maximum number of communication points to be written is 1. Accordingly, register "1 word" for [Maximum Write Value] on V-SFT.



## 28.1.6 MODBUS TCP/IP (Ethernet) Sub Station


- Modbus TCP/IP (Ethernet) communication with devices which require unit ID specifications

- [Connection Mode]: "1 : n"

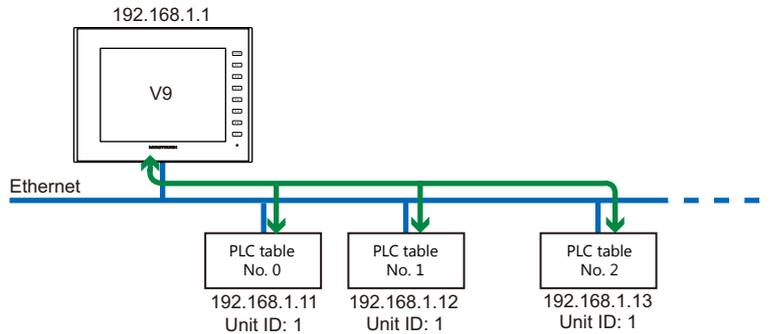

- Serial communication with Modbus devices via relay station

- [Connection Mode]: "1 : 1"

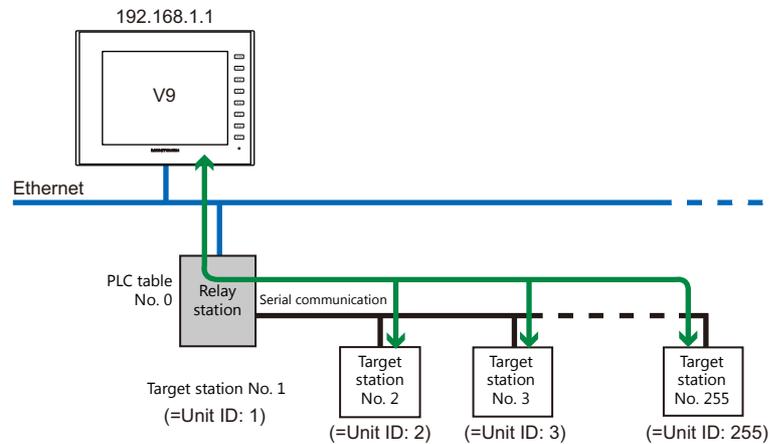

## Communication Setting

### Editor

Make the following settings on the editor. For more information, see "1.3.2 Ethernet Communication".

- IP address for the V9 unit
- Port number for the V9 unit at [Communication Setting] in the [PLC Properties] window ([Hardware Setting])
- PLC's IP address and port number for [PLC Table] under [Target Settings] in the [PLC Properties] window ([Hardware Setting])
- [Format Setting] in the [PLC Properties] window ([Hardware Setting])

### Modbus format setting

Make communication format settings for each connected device. (See page 28-2.)

### PLC

Make communication settings of the connected device according to the settings made for the V8 series. For more information on settings, refer to the instruction manual issued by the manufacturer.

## Available Device Memory

The available setting range of device memory varies depending on the PLC model. Be sure to set within the range available for the PLC to be used. Use [TYPE] when assigning indirect device memory for macro programs.

Device Memory	TYPE	Remarks
0 (output coil)	00H	
1 (input relay)	01H	
4 (holding register)	02H	
3 (input register)	03H	

## Notes on Creating Screen Programs

- On the editor, the device memory address is specified in decimal notation. Thus, when the address of a connected device is expressed in hexadecimal notation, convert the address into decimal one and add "1". (See page 28-3.)
- Set the unit ID when specifying the device memory address.
  - [Connection Mode]: "1 : 1"

The screenshot shows the 'Memory Input' dialog box. The 'Type' is set to 'PLC1' and 'Internal'. The address is '14357'. The 'Unit ID' is set to '1' and is highlighted with a red box. The 'Indirect' checkbox is unchecked. The 'OK' button is visible at the bottom.

- [Connection Mode]: "1 : n"

The screenshot shows the 'Memory Input' dialog box. The 'Type' is set to 'PLC1' and 'Internal'. The address is '14357'. The 'Port No.' is set to '1' and the 'Unit ID' is set to '1', both highlighted with red boxes. The 'Indirect' checkbox is unchecked. The 'OK' button is visible at the bottom. A callout box points to the 'Port No.' field with the text: "For [Port No.], specify the number on [PLC Table]."

The screenshot shows the 'PLC Table' dialog box. The table has four columns: 'No.', 'Port Name', 'IP Address', and 'Port No.'. The first three rows are populated with data, and the 'No.' column for rows 0, 1, and 2 is highlighted with a red box.


No.	Port Name	IP Address	Port No.
0	PLC1	192.168.1.11	502
1	PLC2	192.168.1.12	502
2	PLC3	192.168.1.13	502
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			

## 28.1.7 Wiring Diagrams

### When Connected at CN1:


#### RS-232C

Wiring diagram 1 - C2

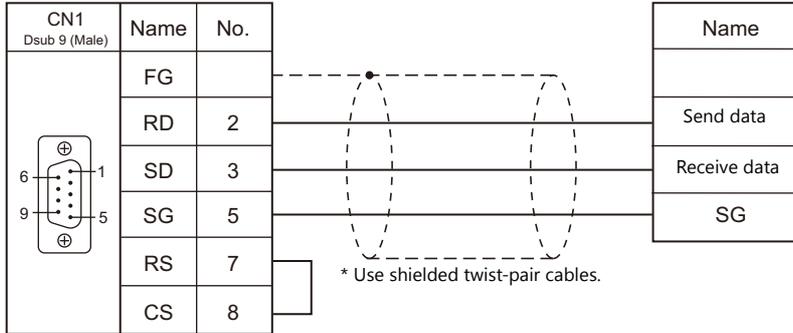


#### RS-422/RS-485

Wiring diagram 1 - C4

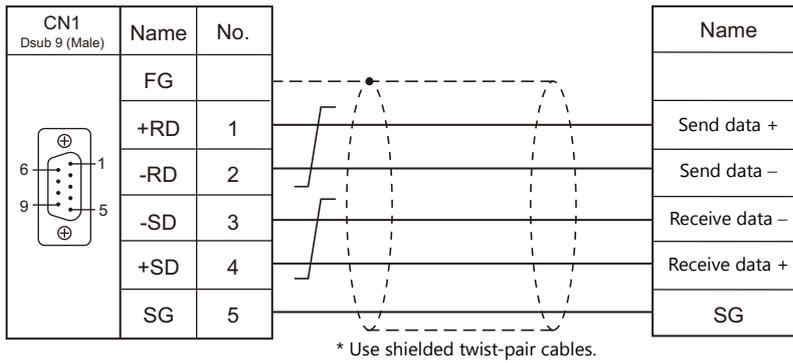


Wiring diagram 2 - C4

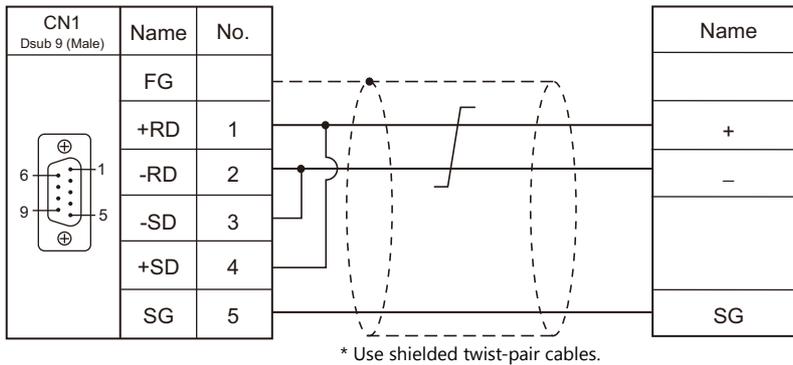

**When Connected at MJ1/MJ2:**


**RS-232C**

**Wiring diagram 1 - M2**

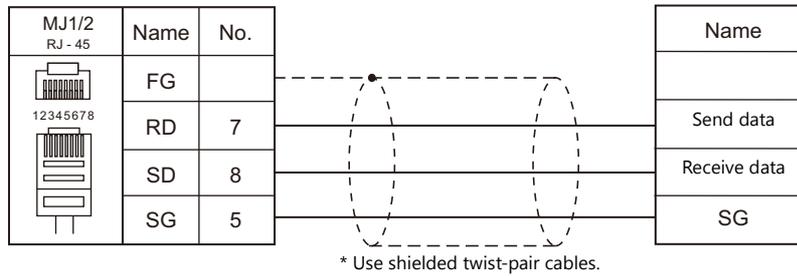


**RS-422/RS-485**


**Wiring diagram 1 - M4**

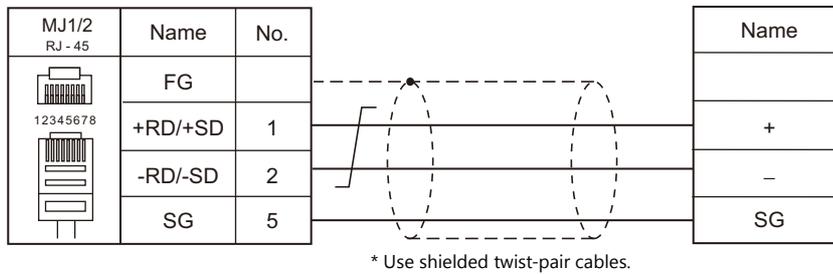

**Wiring diagram 2 - M4**

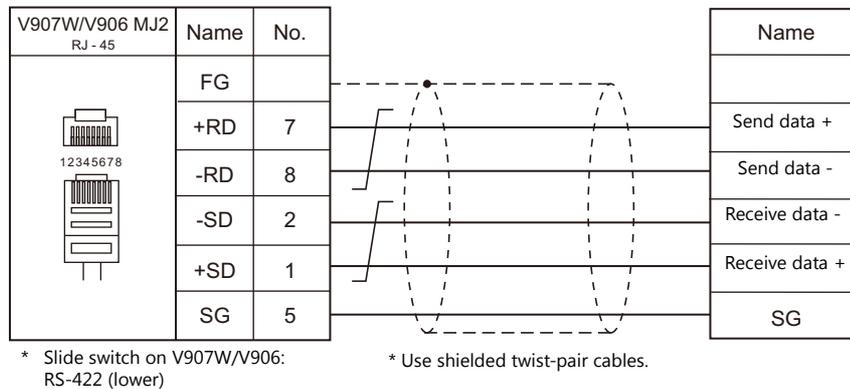

# MEMO



# 29. Barcode Reader

---

## 29.1 Barcode Reader Connection

## 29.1 Barcode Reader Connection

Barcode readers can be connected to the serial port or USB-A port at the V9 series. The controller models shown below can be connected.

### Serial Connection

Manufacturer	Model	Signal Level	Connection	
			CN1	MJ1/MJ2 <sup>*1</sup>
Tohken	THIR-6000 THIR-3000N-RF TFIR3102 THLS-6800 TLMS-3500RV THLS6912	RS-232C	Wiring diagram 1 - C2	Wiring diagram 1 - M2
OMRON	V500-R521b V520-RH series			
KEYENCE	BL-210R BL-600 series BL-N60R BL-80R			
Cognex	In-Sight 5100 In-Sight 5400			
Nichiei Intec	FFTA10ARS			
Unitech	MS210-1			
SICK	LD9000E			
OLYMPUS-symbol	LSH3502			
symbol	LS2104			
WelchAllyn	IT3800			

\*1 Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

Match communication settings of the barcode reader to those made on the V9 series. For more information on settings, refer to the specifications issued by the manufacturer.

### USB Connection

Use a barcode reader which is compatible with USB-HID.


Manufacturer	Model	Remarks
Tohken	THLS-6922USB THLS-6800 THIR-6000U	HID mode
KEYENCE	BL-N60UB	
Cognex	Dataman710	
DENSO	AT10Q-SM	USB keyboard interface
AIMEX	BW-880UB	

## 29.1.1 Communication Setting


### Editor

#### Device selection

Select [Barcode] at [Connected Device] for the logical ports PLC2 to 8. [Barcode] cannot be selected for PLC1.

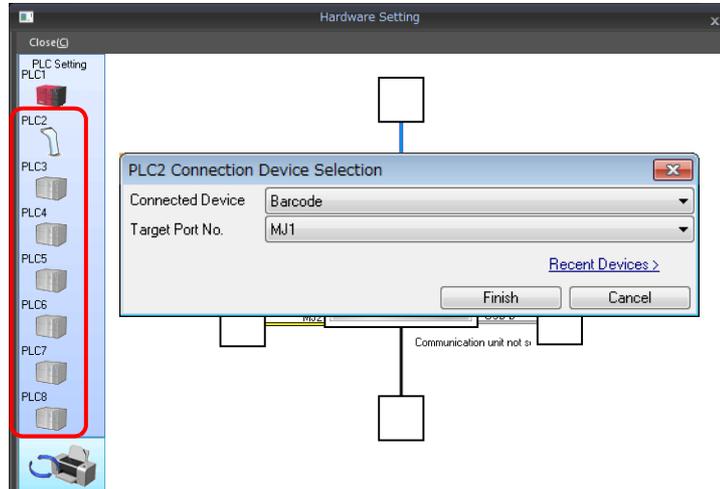

#### Communication setting

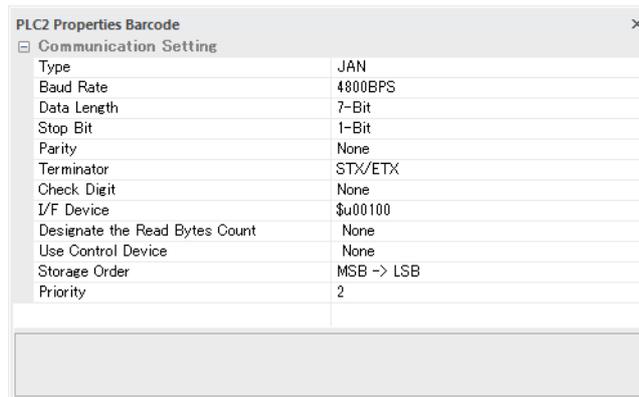

(Underlined setting: default)

Item	Setting	Remarks
Type	<u>JAN</u> /ITF/CODABAR/CODE39/ANY/CODE128 <sup>*1</sup>	
Baud Rate	<u>4800</u> /9600/19200 bps	Valid for serial connection
Data Length	<u>7</u> / 8 bits	
Stop Bit	<u>1</u> / 2 bits	
Parity	<u>None</u> / Odd / Even	
Terminator	<u>STX/ETX</u> /CR/LF/CR	
Check Digit	<u>None</u> / Do Not Delete / Delete	
I/F Device	Refer to "29.1.2 I/F Device Memory" (page 29-3).	
Designate the Read Bytes Count	Refer to "29.1.3 Control Device Memory" (page 29-4).	
Use Control Device	<ul style="list-style-type: none"> <li>Yes Data is saved with "*" attached.</li> <li><u>None</u> Data is saved without "*".</li> </ul>	Enabled when [CODABAR] or [CODE39] is selected for [Type].
Storage Order	LSB→MSB/MSB→LSB	Data is stored into the I/F device in order according to the setting specified here.

\*1 When [CODE128] is selected, 128 characters of ASCII code (numbers, alphabet, symbols, control characters) can be used; however, control characters cannot be read on a USB barcode reader. When using control characters, connect the barcode reader via serial connection.

## 29.1.2 I/F Device Memory

I/F device memory stores barcode information. The number of words used varies depending on the setting.

### I/F Device Memory

**Type: JAN / ITF / CORDABAR / CODE39**

Device Memory	Contents																		
n	Flag / the number of bytes read <table border="1" style="margin-left: 20px;"> <tr> <td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>-</td><td>0</td> </tr> <tr> <td>0</td><td></td><td>0</td><td></td><td>0</td><td>0</td><td>0</td><td></td><td></td> </tr> </table> <p style="margin-left: 20px;">             Communication error      Reading complete      The number of bytes read (0 to 256 bytes)           </p> <p>* Be sure to reset the bits not in use to "0".</p>	15	14	13	12	11	10	9	-	0	0		0		0	0	0		
15	14	13	12	11	10	9	-	0											
0		0		0	0	0													
n + 1	Data read (ASCII) * "0" (null code) is attached to the last.																		
:																			
n + m																			

**Type : ANY**

Device Memory	Contents																		
n	Flag <table border="1" style="margin-left: 20px;"> <tr> <td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>-</td><td>0</td> </tr> <tr> <td>0</td><td></td><td>0</td><td></td><td>0</td><td>0</td><td>0</td><td></td><td>0</td> </tr> </table> <p style="margin-left: 20px;">             Communication error      Reading complete           </p> <p>* Be sure to reset the bits not in use to "0".</p>	15	14	13	12	11	10	9	-	0	0		0		0	0	0		0
15	14	13	12	11	10	9	-	0											
0		0		0	0	0		0											
n + 1	The number of bytes read (0 to 2048 bytes)																		
n + 2	Data read (ASCII) * "0" (null code) is attached to the last.																		
:																			
n + m																			

### Details of flag

Communication error	When an error occurs in communication between the barcode reader and the V9 series, "1" is set. Check the communication settings and wiring.
Reading complete	When data received from the barcode reader has been written into the I/F device memory, "1" is set. When this bit is set, reset it to "0" before reading the next data.
The number of bytes read	Stores the number of bytes read from the barcode reader.

### Read Bytes Setting


The number of bytes that can be read is determined according to the settings at [Type] and [Read Bytes Setting].

Type	Read Bytes Setting	Allowable Number of Bytes
JAN ITF CODERBAR CODE39 CODE128	Not specified	Variable according to the code to be read Max. 254 bytes
	Specified	Fixed to the specified number of words (2 to 254 bytes)
ANY	Not specified	Variable according to the code to be read Max. 2046 bytes
	Specified	Fixed to the specified number of words (2 to 2046 bytes)

• Example

I/F Device Memory: D100  
 Read Bytes Setting: Specified  
 Bytes: 10 bytes  
 Text Process: LSB → MSB


- If data greater than 10 bytes ("4902580302474") is read:  
 10 bytes of data are stored and the remaining data is discarded.

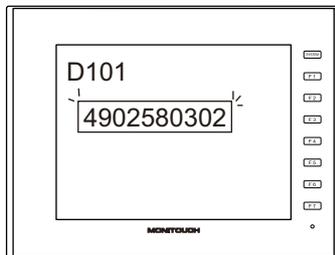

I/F Device Memory	Value
D100	Flag Number of read data
D101	3934HEX
D102	3230HEX
D103	3835HEX
D104	3330HEX
D105	3230HEX
D106	Not used

10 bytes

- If data of 10 bytes or smaller ("12345") is read:  
 "HEX 0" is assigned to the address where no data is stored.

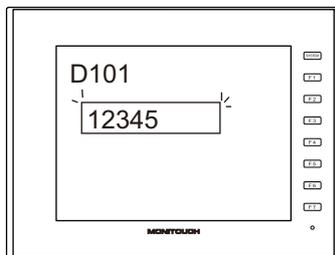

I/F Device Memory	Value
D100	Flag Number of read data
D101	3231HEX
D102	3433HEX
D103	0035HEX
D104	0000HEX
D105	0000HEX
D106	Not used

10 bytes

### 29.1.3 Control Device Memory

Reading operation of the barcode reader can be controlled by using read enable bit of the control device memory.

#### Control Device Memory

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Not used

Read enable bit  
 0: Disabled  
 1: Enabled

- Bit 0: Read enable bit  
 Data is stored into I/F device memory when bit 0 is set.


\* A bit array of the PLC control device memory may be different from the one shown above depending on the PLC model. Set the bit according to the PLC specification.

## 29.1.4 Wiring Diagrams

### When Connected at CN1:

#### RS-232C

Wiring diagram 1 - C2

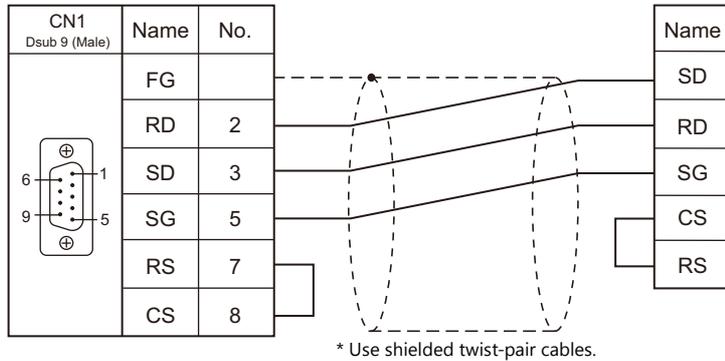


### When Connected at MJ1/MJ2:

#### CAUTION

- For barcode readers with CS/RS control, it may be necessary to install a jumper between the CS and RS to maintain proper operation.
- Allowable current for the external power supply +5V at MJ1/MJ2 is 150 mA in total. There are restrictions on the total current value when an extension unit, communication unit or USB device is used. For details, refer to the V9 Series Hardware Specifications manual.


#### RS-232C

Wiring diagram 1 - M2

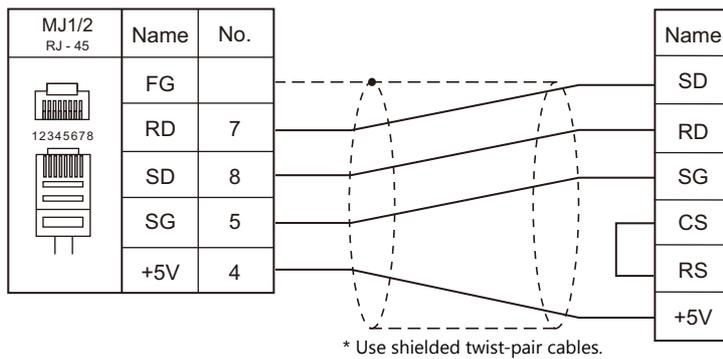

# MEMO

**MONITOUCH**



# 30. Slave Communication Function


---

- 30.1 V-Link
- 30.2 Modbus RTU Slave Communication
- 30.3 Modbus TCP/IP Slave Communication
- 30.4 Modbus ASCII Slave Communication


## 30.1 V-Link

### 30.1.1 Overview

- "V-Link" is the network where the computer reads from and writes to the internal device memory of the V9 series, memory card device memory, or PLC1 to 8 device memory using a dedicated protocol.

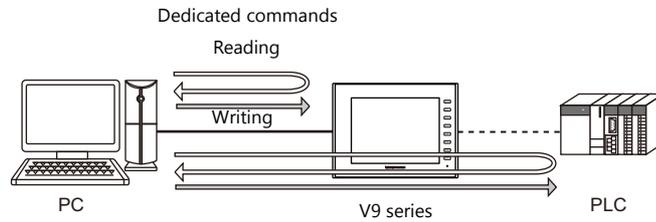

- Use CN1, MJ1 or MJ2 for connection with a general-purpose computer.
  - Data of the connected devices can be collected through communications with the V9 series. Data collection is available even between devices of different manufacturers.
  - Either signal level RS-232C or RS-485 can be selected.  
With RS-232C, one V9 series unit can be connected; with RS-485, a maximum of 31 V9 series units can be connected.
- RS-485 connection

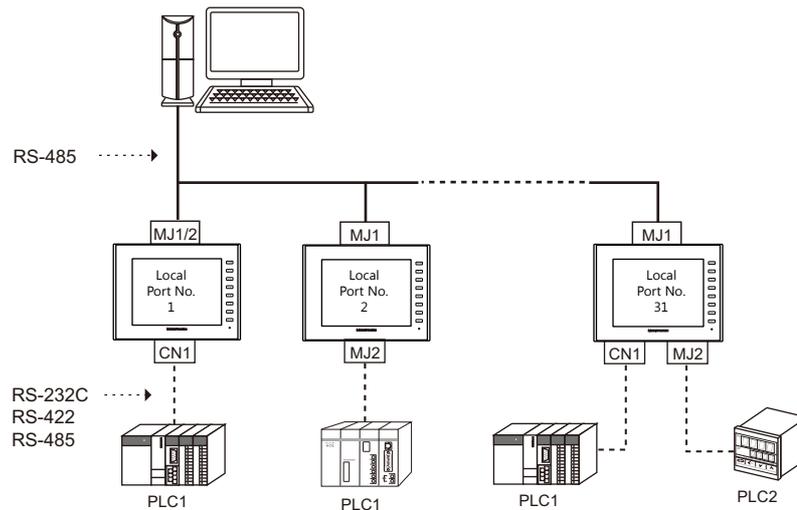


## 30.1.2 Communication Setting


### Editor

#### Device selection

Select [V-Link] at [Connected Device] for the logical ports PLC2 to 8. [V-Link] cannot be selected for PLC1.

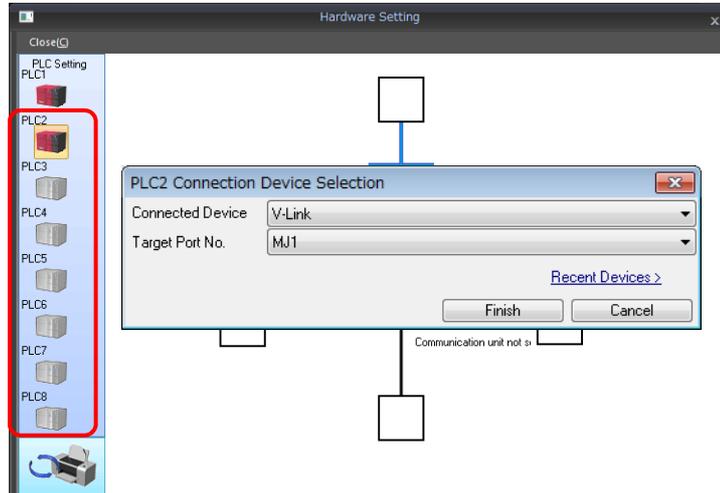

#### Communication setting

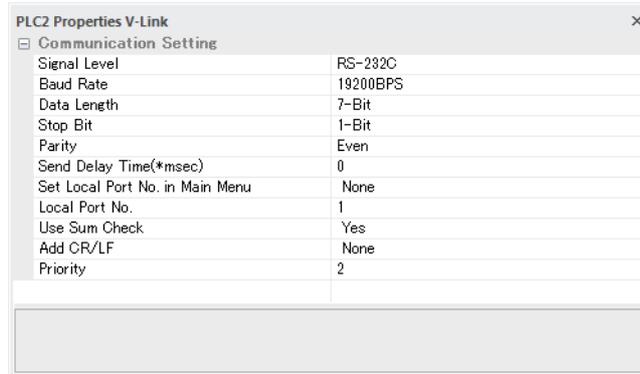

(Underlined setting: default)


Item	Setting
Signal Level	<u>RS-232C</u> / RS-485
Baud Rate	4800 / 9600 / <u>19200</u> / 38400 / 57600 / 115 Kbps
Data Length	<u>7</u> / 8 bits
Stop Bit	<u>1</u> / 2 bits
Parity	None / Odd / <u>Even</u>
Send Delay Time	<u>0</u> to 255 msec
Local Port No.	<u>1</u> to 254 (Maximum connectable units: 31)
Use Sum Check	<u>Yes</u> / None
Add CR/LF	Yes / <u>None</u>

## MONITOUCH


### Local port setting (Local mode)

The local port can be set on the V9 series unit in Local mode.

1. Transfer the screen program.
2. Switch to Local mode on MONITOUCH.
3. Press [Communication Setting] to display the Communication Setting screen, and then select the communication setting for "V-Link".

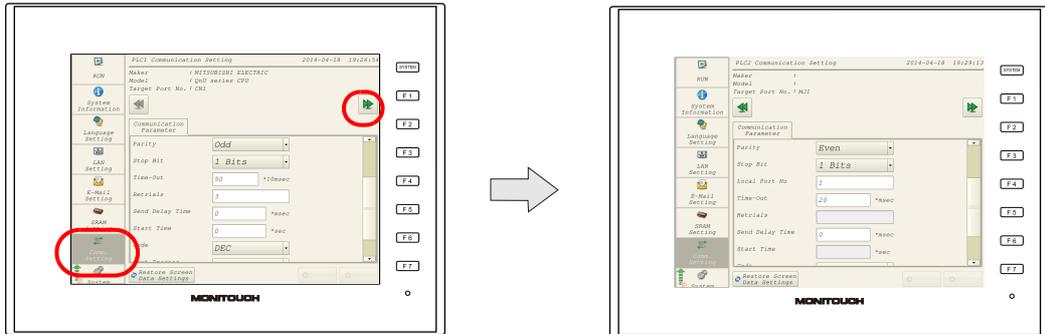

4. Configure [Local Port No.] and press the [Apply] switch.

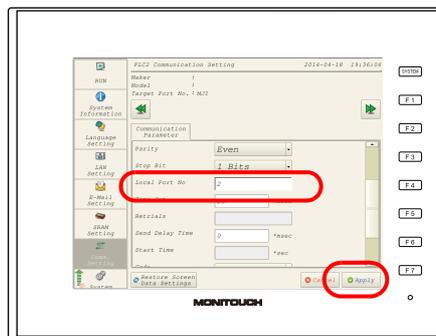


### 30.1.3 Wiring Diagrams


#### When Connected at CN1:

#### RS-232C

Connect the CN1 port at the V9 to the computer via RS-232C.

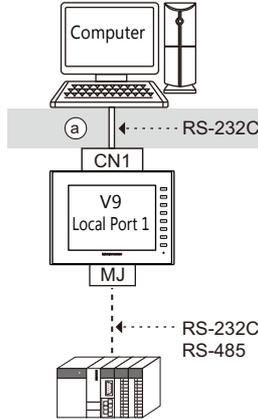


- Wiring example of above (a)

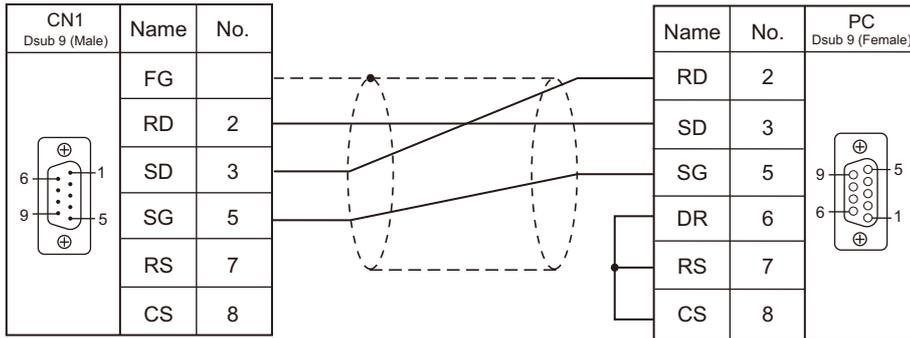


**RS-485**

Connect the CN1 port at the V9 to the computer via RS-485. A maximum of 31 units of the V9 series can be connected.

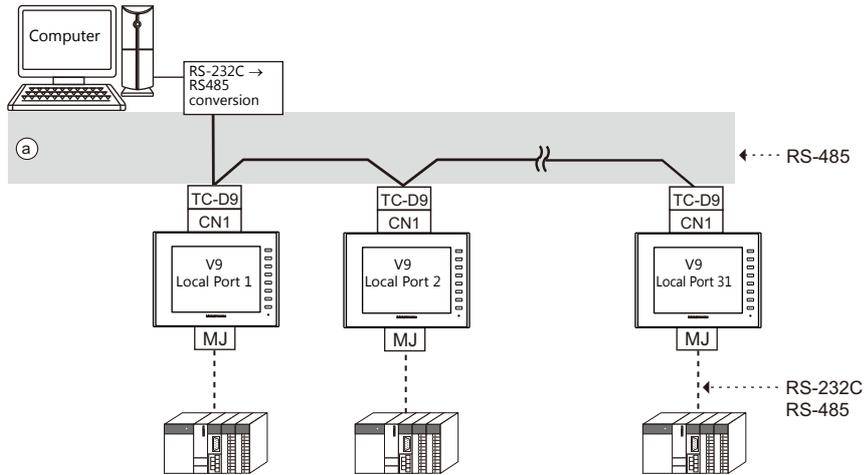


- Wiring example of above (a)

- When a TC-D9 is used:

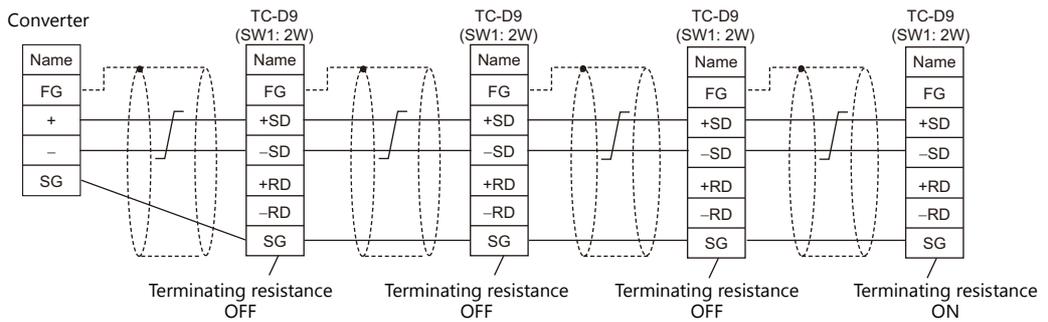

- When no TC-D9 is used

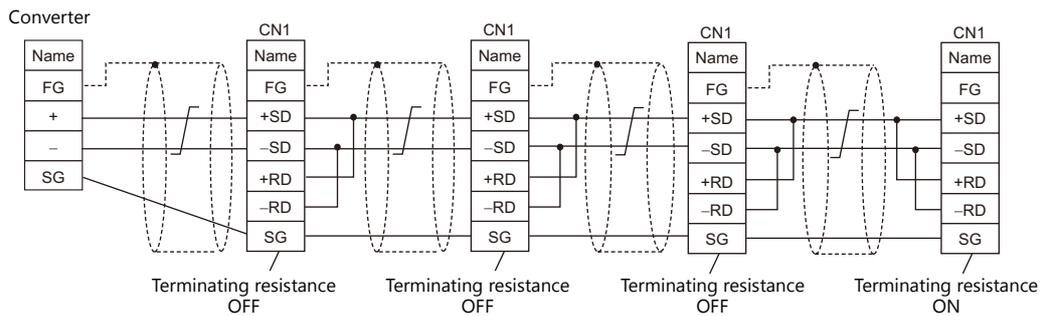

**When Connected at MJ1/MJ2:**

Use Hakko Electronics' cable "V6-TMP" (3, 5, or 10 m) for connection with a computer.


**CAUTION**

- There are six wires in the V6-TMP cable as shown on the right. The wires to be used are determined depending on the signal level setting. For the wires not used, be sure to properly insulate with tape, etc.


V6-TMP

Pin No.	
Black	: 1
Green	: 2
Brown	: 4
Red	: 5
Orange	: 7
Yellow	: 8

**RS-232C**

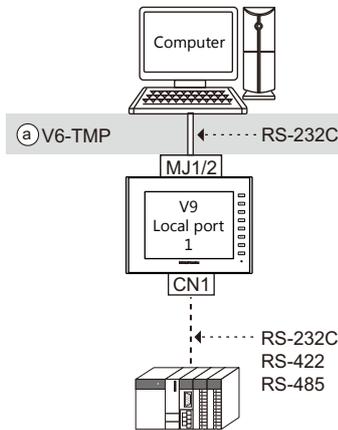


- Wiring example of above (a)

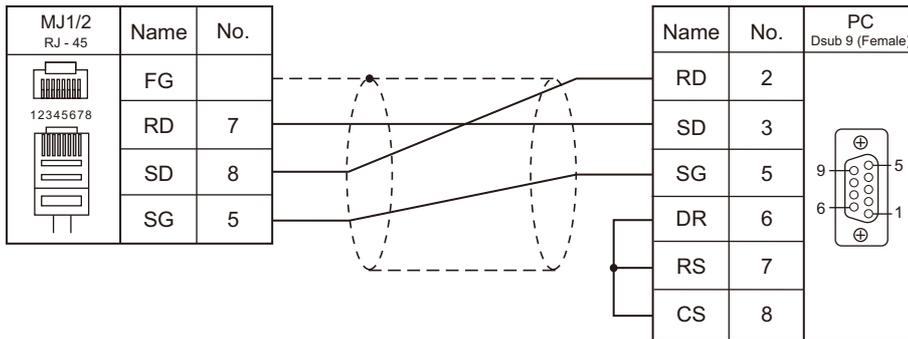


\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

**RS-485 (V9 Series: Max. 31 Units)**

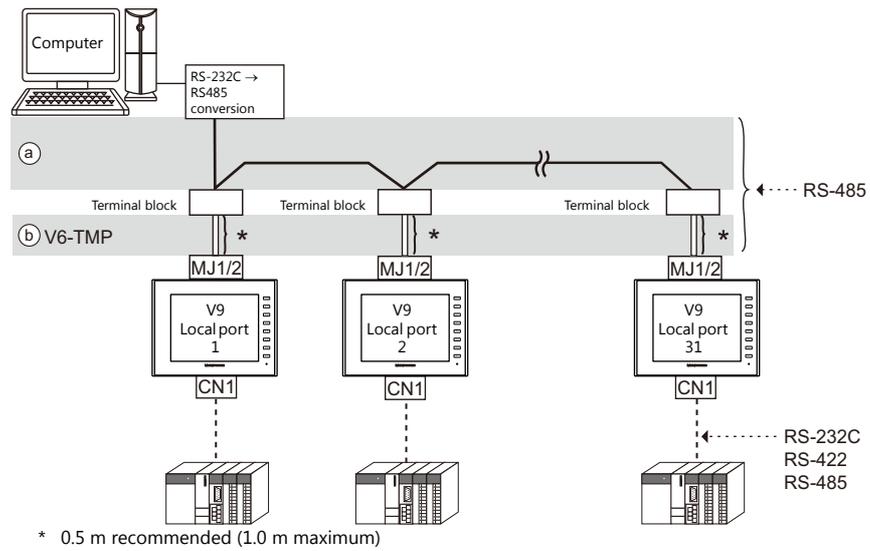


- Wiring example of above (a) and (b)

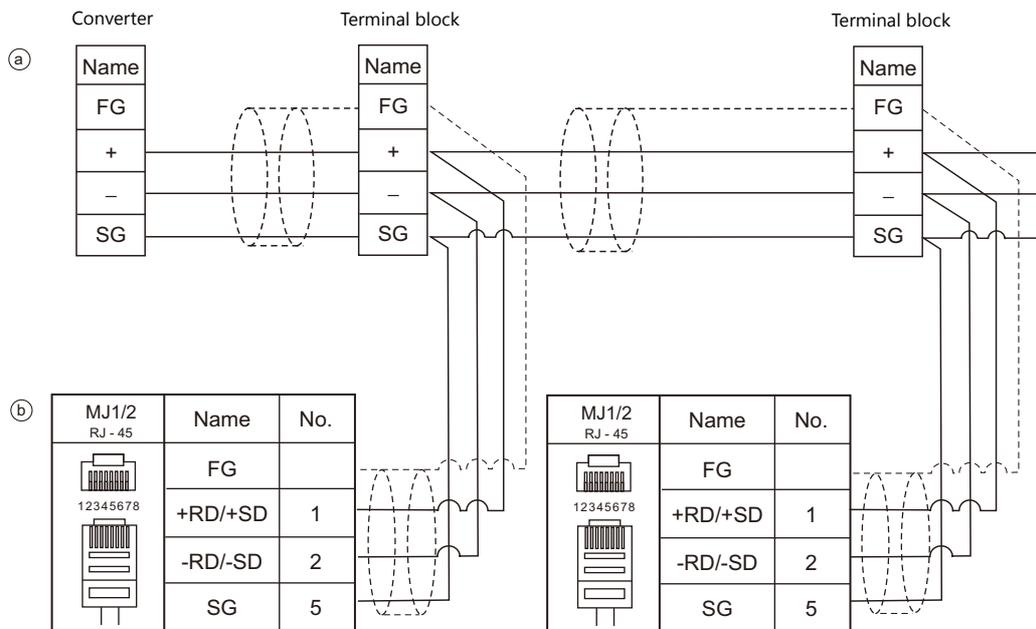

\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

### 30.1.4 Protocol

#### Read (with Sum Check and CR/LF)

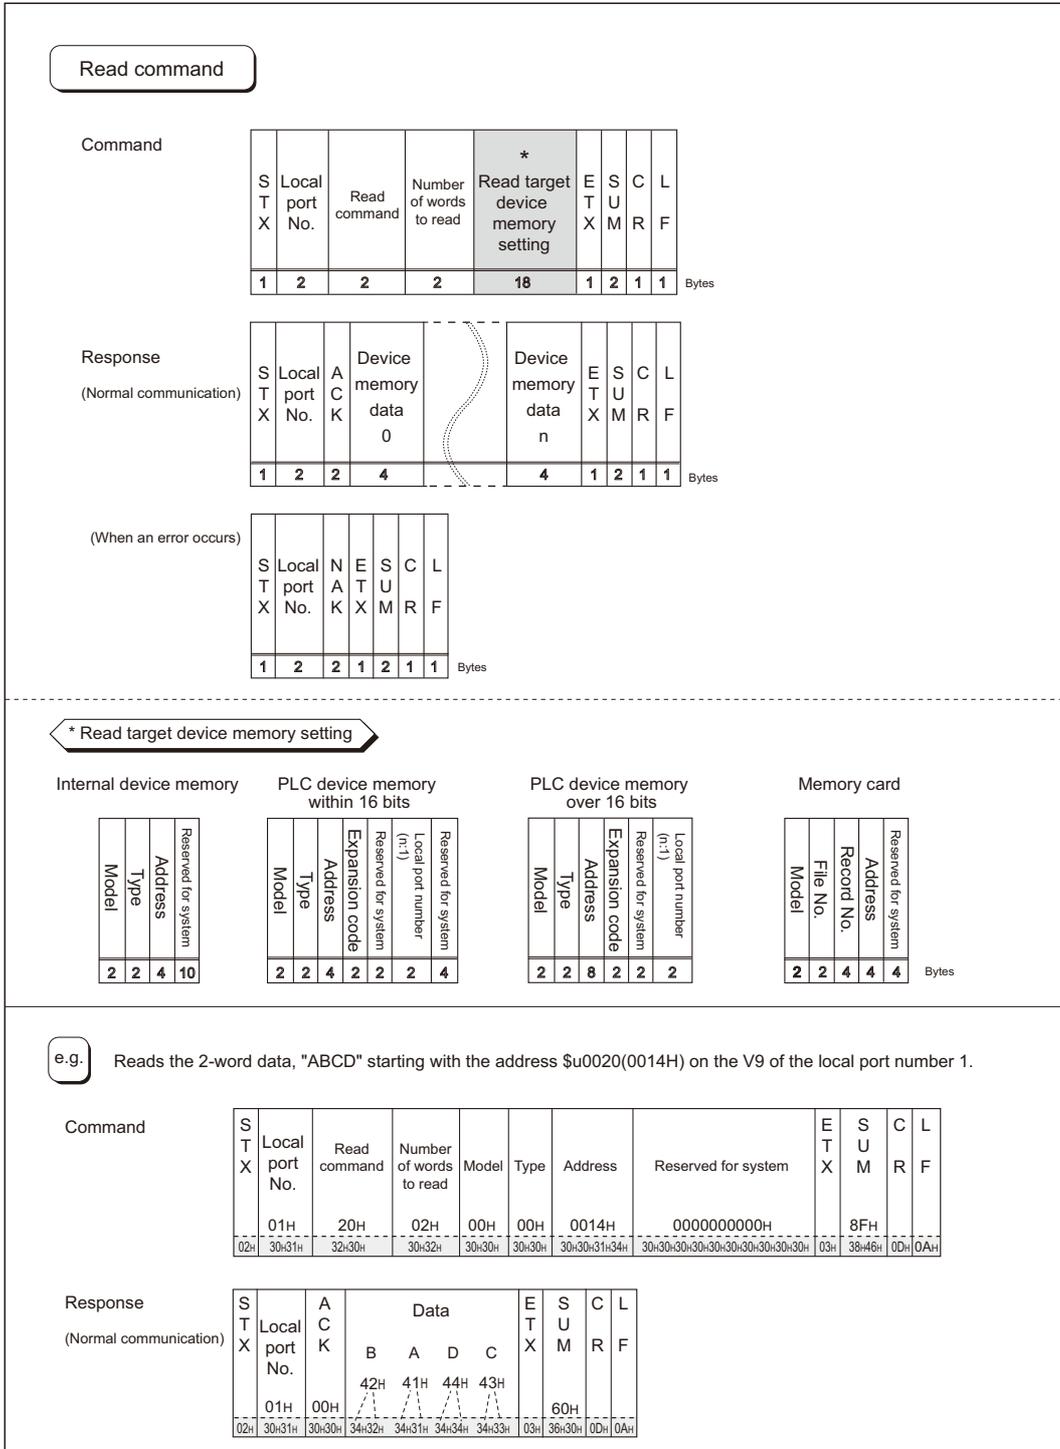



## Items for Protocols

### Transmission control code: 1 byte

Signal Name	Code (Hexadecimal)	Content
STX	02H	Start of transmission block
ETX	03H	End of transmission block
CR	0DH	Carriage return
LF	0AH	Line feed

### Local port number: 2 bytes

Local port numbers are used so that the host computer can identify each V9 series for access. The data range is from 01H to 1FH (1 to 31). Convert into ASCII codes before use. Set the V9 series' local port number for [Local Port No.] on the editor. See page 30-2.

### Command: 2 bytes

Available commands are shown below. Convert into ASCII codes before use.

Name	Code (Hexadecimal)	ASCII	Content
Read	20H	32 30	Read from device memory
Write	21H	32 31	Write to device memory

### The number of words to be read or written: 2 bytes

Set the number of words to be read or written by one command. The data range is from 01H to FFH (1 to 255). Convert into ASCII codes before use.

### Device Memory address to be read or written: 18 bytes

Specify the device memory address to be accessed. Set the following code in the format as shown for "Read target device memory setting" on page 30-8 and "Write target device memory setting" on page 30-9. Convert into ASCII codes before use.

- Model

Device Memory	Word Address		Double-word Address	
	Code (Hexadecimal)	ASCII	Code (Hexadecimal)	ASCII
Internal device memory	00H	3030	80H	3830
PLC1 device memory	11H	3131	91H	3931
PLC2 device memory	12H	3132	92H	3932
PLC3 device memory	13H	3133	93H	3933
PLC4 device memory	14H	3134	94H	3934
PLC5 device memory	15H	3135	95H	3935
PLC6 device memory	16H	3136	96H	3936
PLC7 device memory	17H	3137	97H	3937
PLC8 device memory	18H	3138	98H	3938
Memory card	02H	3032	-	-

- Type

	Type	Code (Hexadecimal)	ASCII
Internal device memory	\$u (user device memory)	00H	3030
	\$s (system device memory)	01H	3031
	\$L (non-volatile word device memory)	02H	3032
	\$LD (non-volatile double-word device memory)	03H	3033
	\$T (temporary user device memory)	04H	3034
	\$P (device memory for 8-way communication)	05H	3035
PLC1-to-8 device memory	Depends on the PLC to be used. Set [TYPE No.] of the device memory used for each device memory.		

- Address  
Specify the device memory address to be accessed.

- Expansion code

When accessing to the device memory shown below, set the expansion code in addition to the type and address.

Model	Expansion Code
\$P	PLC 1 to 8
Fuji Electric PLC	File No. of the MICREX-F series, CPU No. of MICREX-SX series
JTEKT PLC	PRG No.
MITSUBISHI ELECTRIC PLC	Unit No. of SPU device memory
OMRON PLC	Bank No.
SHARP PLC	File No. of Fn device memory
Yokogawa Electric PLC	CPU No.

\* If there is no need to set the expansion code, set "00" (= 3030 in the ASCII code).

- Port number

Set the port number used for 1 : n connection (multi-drop)

For 1 : 1 connection or n:1 connection (multi-link), the port number setting is not used. Alternatively, set "00" (= 3030 in the ASCII code).

- File number

Specify the file number set in the [Memory Card Setting] dialog of the V-SFT editor.

- Record number

Specify the record number set in the [Memory Card Setting] dialog of the V-SFT editor.

- System reserved

Enter "0" (= 30 in the ASCII code) for the number of bytes.

The number of bytes for "system reserved" varies depending on the model.

Example:

Model	Bytes	Code (Hexadecimal)	ASCII
V9 internal device memory	10	0000000000H	30303030303030303030

## Sum Check Code (SUM): 2 Bytes

Data is added up (SUM), and the lower one byte (8 bits) of the sum is converted into a two-digit ASCII code (hexadecimal). A sum check code is shown below.

Example: Transmission mode: without CR/LF, with sum check

Command: 20 (data read)

Address: 10 words from \$u1000 (03E8H)

When reading, a sum check will be performed as shown below.

STX	Port No.	Command	Read words	Device model	Device type	Address	System reserved	ETX	SUM
02H	30H31H	32H30H	30H41H	30H30H	30H30H	30H 33H 45H 38H	30H	03H	42H39H

$$02H + 30H + 31H + 32H + 30H + 30H + 41H + 30H + 30H + 30H + 30H + 30H + 33H + 45H + 38H$$

$$+ 30H + 03H = 4B9H$$

## Response Code: 2 Bytes

"ACK" code is received at normal termination, and "NAK" code at abnormal termination. These are converted to ASCII codes and received. The following table shows the details of each code.

Signal Name	Code (Hexadecimal)	ASCII	Contents
ACK	00H	30 30	Normal termination
NAK	02H	30 32	Overrun/Framing error An overrun or framing error is detected in the received data. Send the command again.
	03H	30 33	Parity error A parity error is detected in the received data. Send the command again.
	04H	30 34	Sum check error A sum error occurs with the received data.
	06H	30 36	Count error The device memory read/write count is "0".
	0FH	30 46	ETX error No ETX code is found.
	11H	31 31	Character error A character not used in the received data is found (other than 0 to F). Check the character and send the command again.
	12H	31 32	Command error An invalid command is given.
	13H	31 33	Device Memory setting error The address or device memory number is invalid.



## 30.2 Modbus RTU Slave Communication

---

For details on Modbus RTU slave communication, refer to the Modbus Slave Communication Specifications manual provided separately.

## 30.3 Modbus TCP/IP Slave Communication

---

For details on Modbus TCP/IP slave communication, refer to the Modbus Slave Communication Specifications manual provided separately.

## 30.4 Modbus ASCII Slave Communication

---

For details on Modbus ASCII slave communication, refer to the Modbus Slave Communication Specifications manual provided separately.

# 31. Universal Serial Communication


---

- 31.1 Overview
- 31.2 Wiring Diagrams
- 31.3 Hardware Settings
- 31.4 Standard Type Protocol
- 31.5 Device Memory Map

## 31.1 Overview

### Overview of Communication

- As shown in the diagram below, when a general-purpose computer communicates with the V series, the general-purpose computer acts as the host and the V series acts as the slave.
- Switch, lamp, data display, etc., are allocated within the internal user device memory (\$u0 to 32767). Assign device memory addresses for system, lamp, data display, and mode within this range.
- When a screen number is specified from the host, a write action takes place to the internal device memory address specified for the screen. When a screen is changed internally by a switch, etc., the changed screen number is read, and written in the internal device memory address specified for the screen.

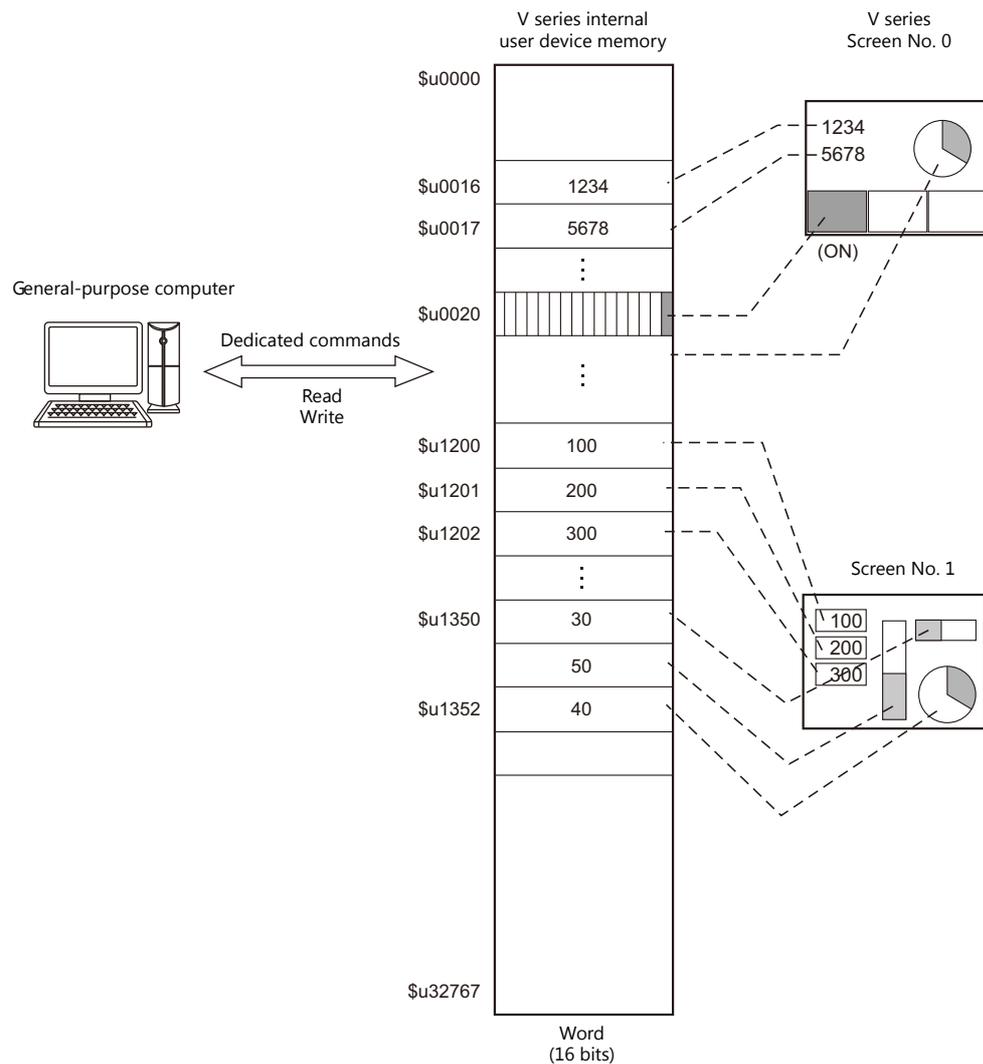

## Differences between Connecting to General-purpose Computer and Connecting to PLC


- Input format (code)  
The input format used for screen number, block number, message number, etc, is fixed in [DEC].
- Write area  
When connecting to the PLC, only the three words shaded in the diagram below are used, but when connecting to a general-purpose computer, all 16 words shown below are used.

Address	Name	Contents
n + 0	CFMDAT	Sub command/data
n + 1	SCRN_COM	Screen status
n + 2	SCRN_No	Displayed screen
n + 3	SW0	No. 0 switch data
n + 4	SW1	No. 1 switch data
n + 5	ENT0	Entry information 0
n + 6	ENT1	Entry information 1
n + 7	ENT2	Entry information 2
n + 8	GREPNS	Global response
n + 9 • • n + 15		Reserved (7 words)

## System Configuration


### 1 : 1 connection

- The transmission distance available via RS-232C is 15 m and RS-422/485 is 500 m at the maximum.
- It is possible to use an interrupt\* when connecting a computer to a V series in a 1 : 1 connection.
  - \* For RS-485 (2-wire connection), interrupts cannot be used. For details on interrupts, see page 31-32.

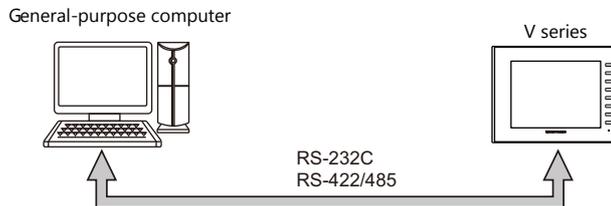

### 1 : n connection

- 1 : n connection is available via RS-422/485. A maximum of 32 V series units can be connected.
- The transmission distance available is 500 m at the maximum.
- For 1 : n connection, interrupts cannot be used.

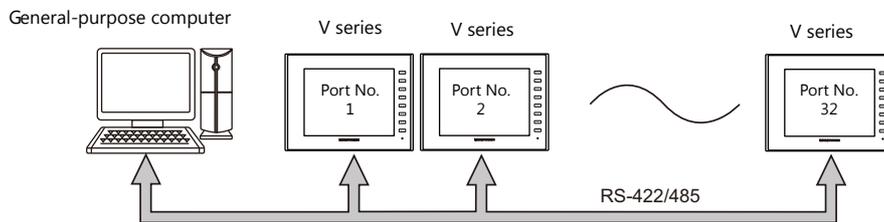


# 31.2 Wiring Diagrams


## When Connected at CN1:

### RS-232C

#### Without flow control

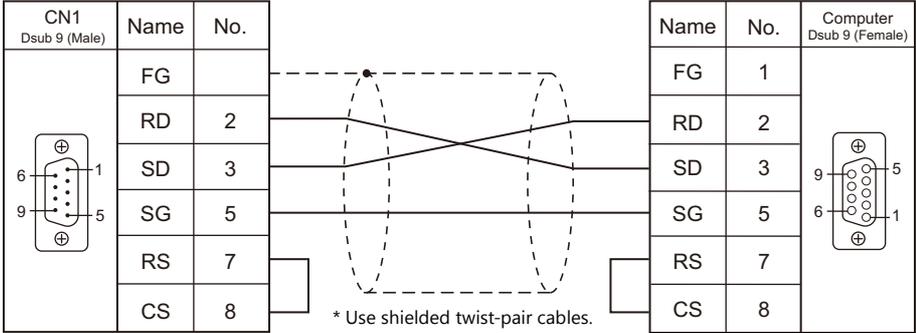


#### With flow control

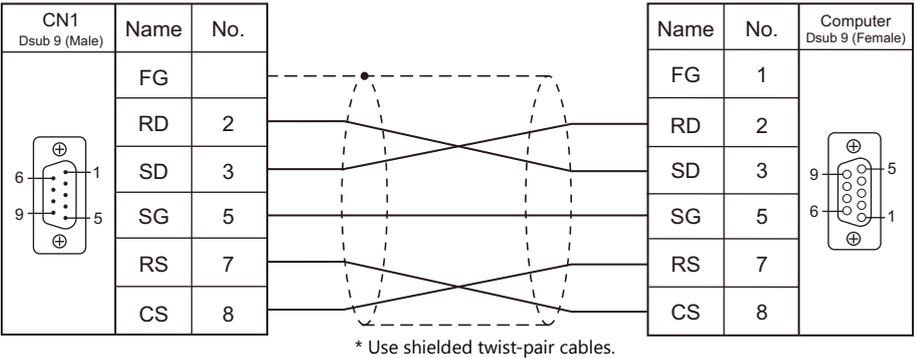


### RS-422

#### 1 : 1 connection

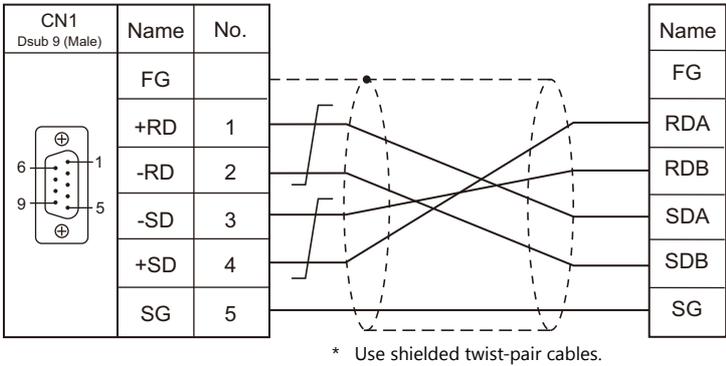


**1 : n connection**

\* It is convenient to use the optional terminal converter "TC-D9".

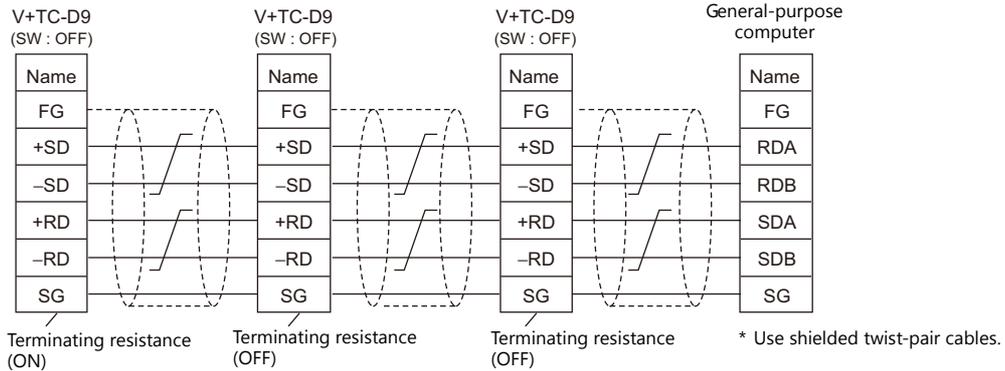


**RS-485**

**1 : 1 connection**

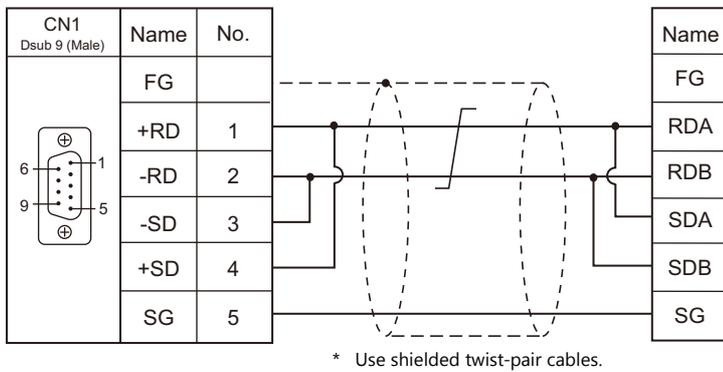


**1 : n connection**

- With TC-D9

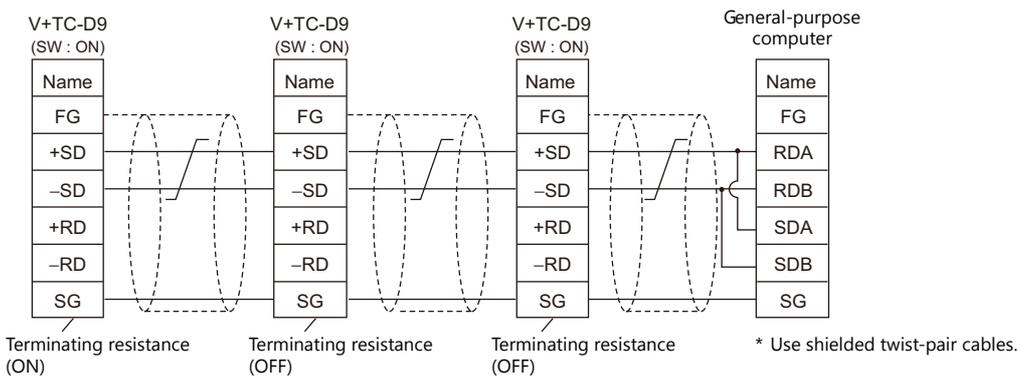


- Without TC-D9

Install jumpers between +RD/+SD and -RD/-SD.

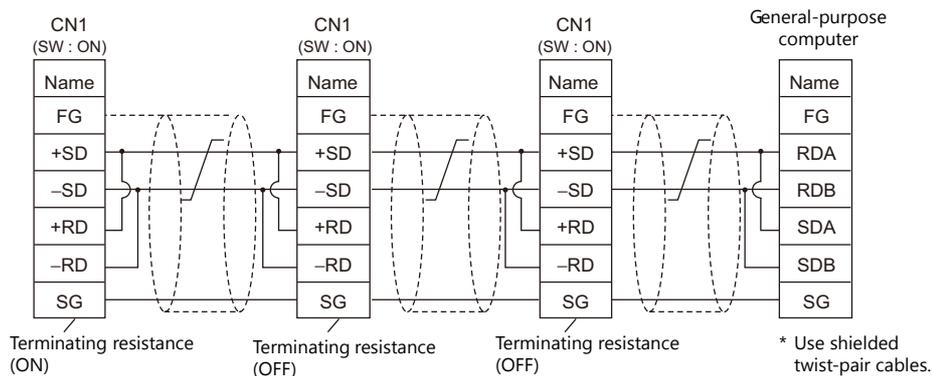

When Connected at MJ1/MJ2:


RS-232C

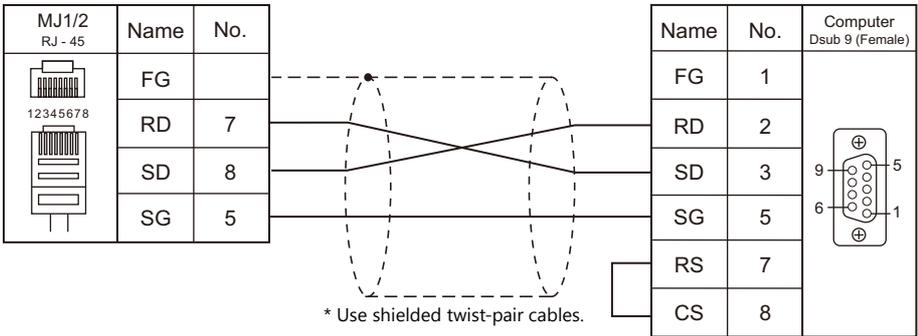

\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).


RS-485

1 : 1 connection

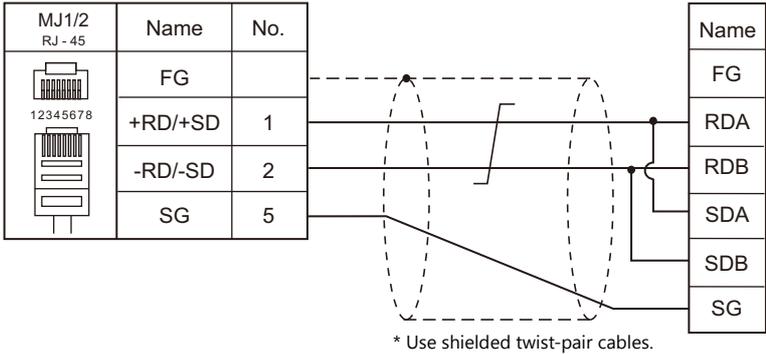

\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

**1 : n connection**

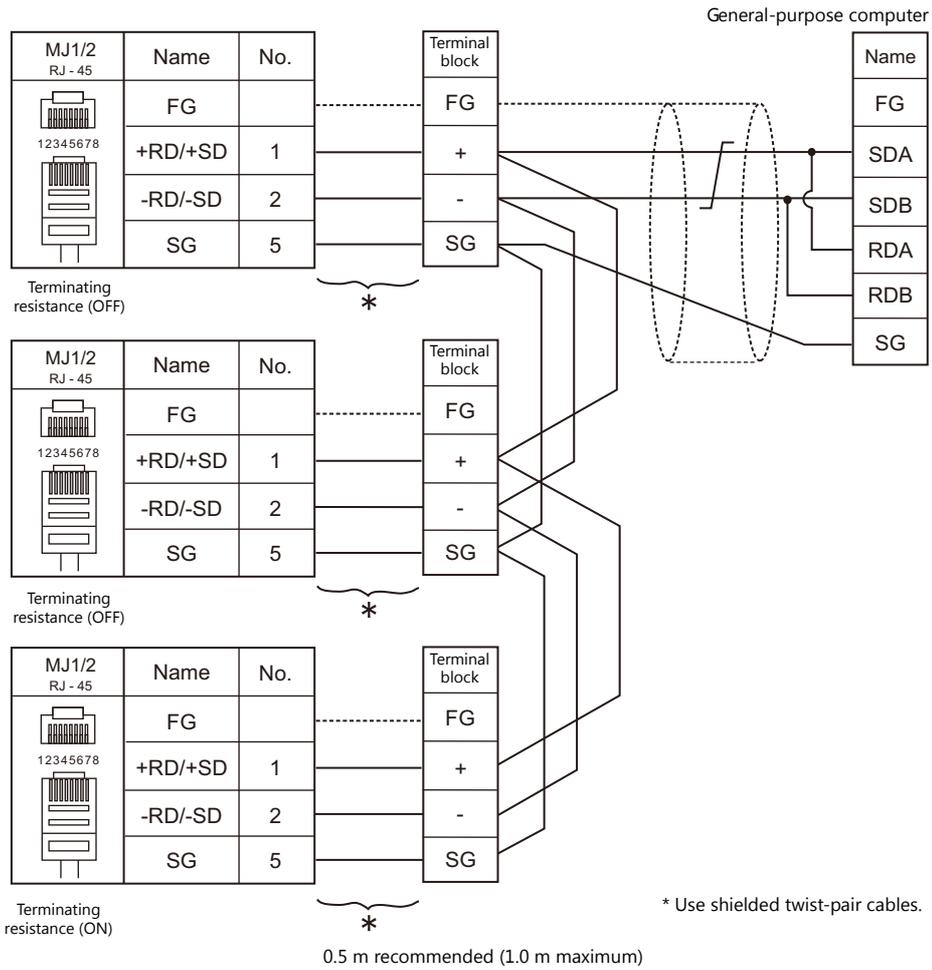

\* Set the slide switch for signal level selection to RS-232C/485 position (upper) when using the MJ2 port of V907W or V906. For details, refer to "1.2.2 MJ1/MJ2" (page 1-6).

## 31.3 Hardware Settings

### PLC Settings

#### Connecting Device Selection


#### PLC Properties

	Item	Contents
Communication Setting	Connection Mode	Set the connection method for the V series and host. 1 : 1 Select when connecting one V series unit to one host. 1 : n Select when connecting multiple V series units to one host.
	Signal Level	Set the signal level used for communication between the host and the V series. RS-232C/RS-422/485
	Baud Rate	Set the communication speed between the host and the V series. 4800/9600/19200/38400/57600/76800/115K bps
	Data Length	8 bits (fixed)
	Stop Bit	Select a stop bit. 1 bit / 2 bits
	Parity	Select an option for parity bit. None / Odd / Even
	Local Port No.	This option is valid when 1 : n connection is used. Set the port number of the V series.
	Use CR/LF	Set whether or not to use a CR/LF code at the end of transmission data.
	Sum Check	Set whether or not to add a sum check code at the end of transmission data.
	Busy Time	Refer to page 31-24.
	Send Delay Time	Set the time for V series to send a response to a host after receiving a command from a host.
	Code	DEC (fixed)

Item		Contents
Communication Setting	Text Process	When using text process, choose either [LSB → MSB] or [MSB → LSB] in order to make arrangements for the order of the first and the second bytes in one word.
		<div style="display: flex; justify-content: space-around; align-items: center;"> <div style="text-align: center;"> <p>[LSB → MSB]</p> </div> <div style="text-align: center;"> <p>[MSB → LSB]</p> </div> </div>
Universal Serial	Specify as a Main	<p>Specify which connection to use as the main connection when multiple universal serial connections are made at PLCs 1 to 8. This is set to [Yes] when there is only one universal serial connection.</p> <p>* When [None] is selected, the following limitations apply.</p> <ul style="list-style-type: none"> <li>The following interruption communications occur simultaneously when the connection specified as the main interrupts. <ul style="list-style-type: none"> <li>- Interruption function of a switch</li> <li>- Interruption function of a "Write" switch on the keypad or on the keyboard</li> <li>- Interruption function of screen internal switching</li> </ul> </li> <li>Responses to commands for global stations cannot be output.</li> <li>The read clear functions are not available.</li> <li>\$s111 cannot be used. The contents of the connection specified as the main are displayed.</li> </ul>
	Read Clear Top Address* <sup>2</sup>	<p>This setting is available when [Specify as a Main] is set to [Yes]. Set the top address number of the read clear area. The read clear area is the starting area from which the V series clears data that was previously read. Due to the fact that it is cleared to "0", once this area is read, the data remains at "0" even if you attempt to read again when a read response error occurs.</p>
	Read Clear Word Counts* <sup>2</sup>	<p>This setting is available when [Specify as a Main] is set to [Yes]. Set the number of words that will be used for clearing the read area.</p>
	Read Clear Saving Address* <sup>2</sup>	<p>This setting is available when [Specify as a Main] is set to [Yes]. Set the top address for the read clear backup area. The area size will be the same as the previously described read clear area. The number of words written in the read clear backup area is the same as the number specified for the read clear area.</p>
	Switch ON Interrupt* <sup>1</sup>	Select whether or not to enable or disable an interrupt when the switch changes from OFF to ON.
	Switch OFF Interrupt* <sup>1</sup>	Select whether or not to enable or disable an interrupt when the switch changes from ON to OFF.
	Keypad Interrupt* <sup>1</sup>	Select whether or not to enable or disable an interrupt when the "Write" switch on the keypad or on the keyboard is pressed and it changes from OFF to ON.
	Screen Interrupt* <sup>1</sup>	Select whether or not to enable or disable an interrupt when the screen change switch is pressed.
	Flow Control	<p>This option is valid only for 1 : 1 communication via RS-232C using CN1. Select [Yes] when disabling an interrupt from the V series (e.g. when the host cannot receive interrupt data). This following actions take place.</p> <ul style="list-style-type: none"> <li>Interrupt enabled when CS (pin 8) on the V series side is ON</li> <li>Interrupt disabled when CS (pin 8) on the V series side is OFF</li> </ul> <p>When CS is ON, interruption information stored by then is output in succession. (Interruption information for 3 times can be stored at the most.)</p>
	Output OFF	<p>This option is valid only for 1 : 1 communication via RS-422 using 4-wire connection. Normally, V series uses the same cables to send or receive data regardless of 4-wire or 2-wire connections. For this reason, send output remains OFF (High impedance) except for sending signals from V series. However, depending on the host specifications, send output OFF operation from the V series is not required. In this case, specify [None].</p>
	2-Wire System	Select [Yes] for 1 : 1 communication via RS-422/485 using 2-wire connection. Interruptions are disabled.
ACK response after the completion of memory write	To send an ACK response upon receiving the initial write request of a write command (WM, WC), specify [None]. To send an ACK response after completing command processing, specify [Yes].	


\*1 Interruption settings can be changed from the host using the [W] command during communication. For details on interruption, refer to "31.4.4 Interrupt (ENQ)".

- \*2 Read clear and read clear backup action  
 The action that occurs when a read command from the host tries to access to the read clear area is shown in the following diagram.  
 Backup data of the write area in the system device memory is allocated following the read clear backup area.

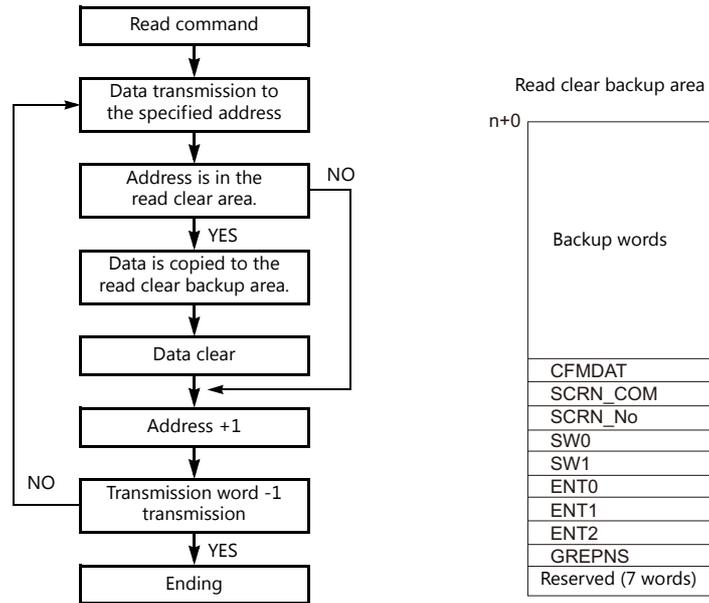

## Control Device Memory

### Read/Write Area

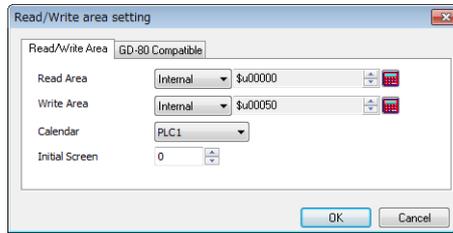

### Read Area

This device memory area is necessary to change the screen display status by giving a command from the host. Be sure to set the \$u device memory. Address allocation is shown in the table below. For more information, see "1.4.2 MONITOUCH Settings" (page 1-53).

Address	Name	Contents
n + 0	RCVDAT	Sub command/data
n + 1	SCRN_COM	Screen status command
n + 2	SCRN_No	External screen command

Read area "n" (sub command/data)	
(1) Free	When data is saved in this area, the same data is written to [Write Area] "n" after the screen has been displayed. Utilizing this operation, these bits can be used for watchdog monitoring <sup>*1</sup> or display scanning <sup>*2</sup> .
(2) BZ0	A beep (peep) sounds at the leading edge [0 → 1].
(3) BZ1	An error buzzer (peep-peep) sounds at the leading edge [0 → 1].
(4) BZ2	A buzzer (fieee) sounds continuously while the bit remains [1]. When setting this bit, check [Use Continuous Buzzer Sound] ([System Setting] → [Unit Setting] → [General Setting]).
(5) Calendar setting <sup>*3</sup>	<p>This bit is valid when the built-in clock is not used. This bit should be used differently depending on whether the connected PLC is equipped with the calendar function.</p> <p>When MONITOUCH is connected to a PLC with calendar function: When calendar data in the PLC is updated, it can forcibly be read by setting this bit (at the leading edge of [0 → 1]). In addition to calendar data update using this bit, calendar data in the PLC is automatically read and updated when:</p> <ul style="list-style-type: none"> <li>The power is turned on.</li> <li>STOP → RUN</li> <li>The date changes (AM 00:00:00).</li> </ul> <p>When MONITOUCH is connected to a PLC without calendar function: A virtual calendar area can be provided by setting [Calendar device] in [GD-80 Compatible] ([Read/Write Area] → [GD-80 Compatible]). Then setting this bit (ON) updates the calendar data.</p>
(6) System reserve	This bit is reserved by the system. This bit must be "0".



(6) Global macro execution	The macro set for [Macro Block] is executed once at [0 → 1] (leading edge). The macro block number should be specified for [Global Macro Device] in the window that is displayed by selecting [System Setting] → [Macro Setting]. For more information, refer to the Macro Reference manual provided separately.
(7) Data sheet output	The data sheet is printed out at [0 → 1] (leading edge). This bit becomes valid when the data sheet function is set.
(8) Screen data output	The V series screen image is printed out at [0 → 1] (leading edge). This bit becomes valid when a printer is connected. It is also possible to make a screen hard copy using an internal switch [Function: Hard Copy].
(9) Backlight	This bit becomes valid when an option other than [Always ON] is selected in the [Backlight] tab window that is displayed by selecting [System Setting] → [Unit Setting]. [0] (level): OFF when the conditions are satisfied [1] (level): ON
(10) Analog RGB input	These bits are used for controlling show/hide operations of the analog RGB input screen. [0] (level): RGB input screen not displayed (in RUN mode) [1] (level): RGB input screen displayed
(11) Screen internal switching	This bit controls screen switching by internal switches. [0]: Screen switching by internal switches is enabled. [1]: Screen switching by internal switches is disabled. * An "internal switch" means a switch you can create for internal processing within MONITOUCH by selecting [Screen] or [Return] for [Function:] of the switch.
(12) Screen forced switching	This bit is used for switching the screen using the read area "n + 2" when the required screen number has already been specified in "n + 2". *3
(13) Data read refresh	All the data display items on the screen are refreshed at [0 → 1] (leading edge). This is applied to every data display item regardless of the setting for [Process Cycle].

\*1 It is possible to make this function work with the bit in the level. For more information, refer to the V9 Series Reference Manual.

\*2 As an exception, a multi-overlap may appear/disappear at the edge. For more information, refer to the V9 Series Reference Manual.


\*3 Usage Example

Step a: Screen change according to read area "n + 2"

Step b: Screen change with an internal switch

Step c: Screen change to the same screen number as step a according to read area "n + 2"

In this case, however, the same value is stored in read area "n + 2" so the command is not valid. In such a case, it is possible to forcibly switch the screen to the screen number contained in read area "n + 2" at the leading edge [0 → 1] of bit 14.

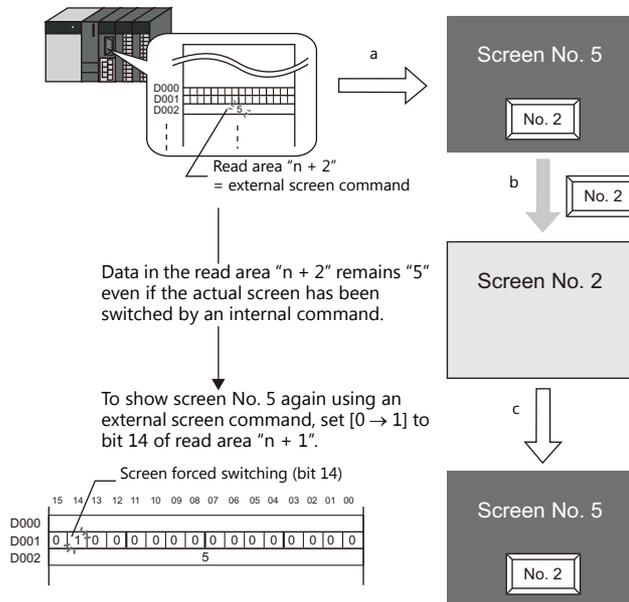


Reset this bit (OFF) after checking that bit 14 of write area "n + 1" is ON, or the value stored in write area "n + 2" is the same as the value in read area "n + 2".

Read area "n + 2" (screen number command)															
15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00
└── (1) Screen number															
(1) Screen number command <sup>*1</sup>				0 - 9999 These bits are used for switching the screen by an external command. When a screen number is specified in these bits, the screen is displayed. Even if the screen has been switched using an internal switch, it is possible to switch the screen using an external command from the PLC. External commands have priority over internal switches.											

<sup>\*1</sup> Screen No. Error

When MONITOUCH has started communications with the PLC, the screen of the screen number specified in read area "n + 2" is displayed. If the screen number specified in read area "n + 2" does not exist in the screen data, "Screen No. Error" is displayed on MONITOUCH.



Before starting communications with the PLC, check the data in [Read Area] "n + 2" and confirm that the screen number to be displayed initially is specified.

### Write Area

This device memory area is used to store information regarding screen number, overlap display, and entry mode when the screen display status is changed by a command received from the host. Be sure to set the \$u device memory. Address allocation is shown in the table below.

Address	Name	Contents
n + 0	CFMDAT	Sub command/data
n + 1	SCRN_COM	Screen status
n + 2	SCRN_No	Displayed screen
n + 3	SW0	No. 0 switch data
n + 4	SW1	No. 1 switch data
n + 5	ENT0	Entry information 0
n + 6	ENT1	Entry information 1
n + 7	ENT2	Entry information 2
n + 8	GREPNS	Global response
n + 9 : n + 15		Reserved (7 words)

**n + 0 - n + 2**

Write Area "n" (output of read area "n")															
15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00
0	0	0	0												

(1) Free

(2) BZ0

(3) BZ1

(4) BZ2

(5) Calendar setting

(6) System reserved

(1) Free	These bits reflect the data in read area "n" at the time MONITOUCH has finished display processing.
(2) BZ0	
(3) BZ1	
(4) BZ2	
(5) Calendar setting	
(6) System reserve	Always "0"

Write area "n + 1" (screen status)															
15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00
									0	0	0				

(1) Overlap 0

(2) Overlap 1

(3) Overlap 2

(4) Overlap 3

(5) System reserved

(6) Serial extension I/O

(7) Global macro execution

(8) Printer busy

(9) Print data transferring

(10) Backlight

(11) Analog RGB input

(12) Screen internal switching


(13) Screen forced switching

(14) Data read refresh

(1) Overlap 0 (2) Overlap 1 (3) Overlap 2 (4) Overlap 3	Overlap status *1 [0]: Hide [1]: Show
(5) System reserve	Always "0"
(6) Serial extension I/O	Serial extension I/O (V-I/O) status [0]: Normal [1]: Error
(7) Global macro execution	This bit reflects the data in bit 8 of read area "n + 1".
(8) Printer	Printer status *2 [0]: Not busy [1]: Busy
(9) Print data transferring	Print data transferring status when a print command (hard copy, sample print or data sheet) is executed *2 [0 → 1]: Print data transferring start [1 → 0]: Print data transferring end

(10) Backlight	Backlight ON/OFF status *3 [0]: OFF [1]: ON * Even if bit 11 (backlight) in read area "n + 1" is reset (0: OFF), this bit shows "1" if the backlight is on.
(11) Analog RGB input	Analog RGB input screen status [0]: RGB input screen not displayed (in RUN mode) [1]: RGB input screen displayed
(12) Screen internal switching	This bit reflects the data in bit 13 of read area "n + 1".
(13) Screen forced switching	This bit reflects the data in bit 14 of read area "n + 1".
(14) Data read refresh	This bit reflects the data in bit 15 of read area "n + 1".

- \*1 Example:  
 a. Display overlap No. 0 from read area (n + 1) using an external command.  
 b. Display overlap No. 0 internally using the [Function: Overlap = ON] switch.  
 In either case (a or b), bit 0 of write area "n + 1" is set (ON).  
 In the case of b, the bit in read area "n + 1" remains "0".

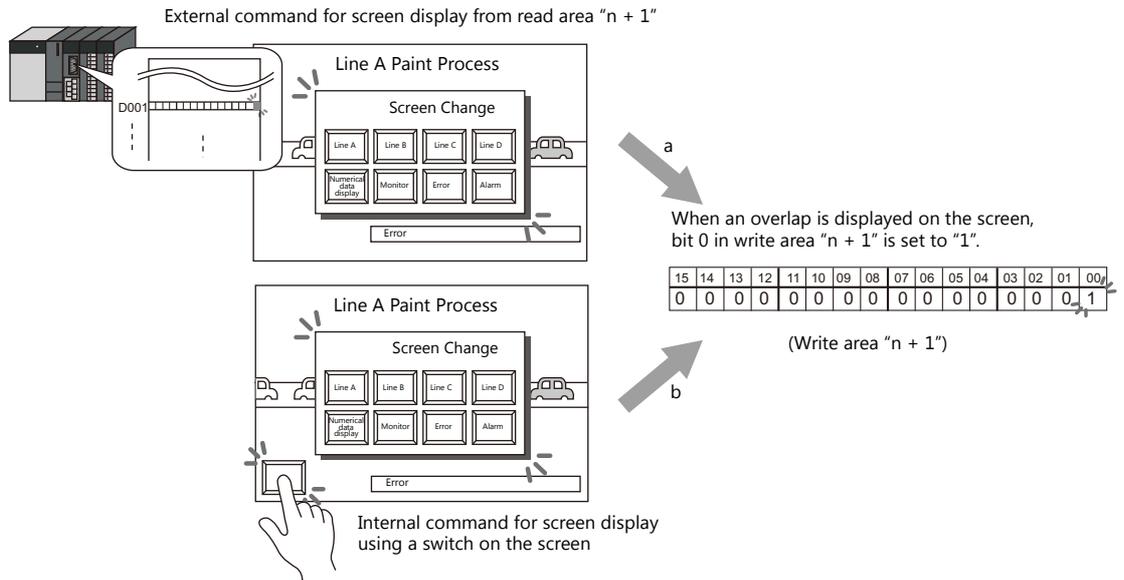


- \*2 Data of bits 9 and 10 is output to internal device memory address \$s16. For more information on the internal device memory (\$s), refer to the V9 Series Reference Manual.  
 \*3 Data of bit 11 is output to internal device memory address \$s17. For more information on the internal device memory (\$s), refer to the V9 Series Reference Manual.

Write area "n + 2" (displayed screen number)															
15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00
└── (1) Screen number															
(1) Screen number	0 - 9999 Screen number currently displayed														

**n + 3 (SW0) switch data No. 0, n + 4 (SW1) switch data No. 1**

When a switch, for which [Output Action] is set to [Momentary/Momentary W] and [Output Device] is set in location from \$s0080 to 0095, is pressed, the status and the number of the switch is stored.

n + 3, n + 4 (SW0/SW1)

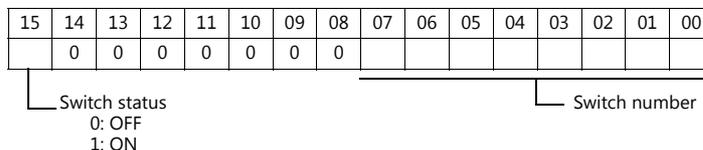

For the relationship between the switch output device memory and the switch number, see page 31-36.

**n + 5 (ENT0) entry information 0, n + 6 (ENT1) entry information 1**

The same contents as n + 0 and n + 1 of the [Info. Output Device] that is set in the entry mode are written. Write operation occurs when the key whose function is set to "Write" is pressed in the entry mode.

When the entry selection has changed, write operation will not occur.

When (n + 5) entry information 0 is read by the host, the writing completed bit (bit 15) is reset.

Data is written in the backup (escape) area before it is read (see page 31-9).

**n + 7 (ENT2) entry information 2**

The entry mode window number where a write operation was executed is written.

The relationship between the window number and base and the window number and overlap is shown in the following table.

Window No.	Contents
0	Base entry mode
1	Overlap 0 entry mode
2	Overlap 1 entry mode
3	Overlap 2 entry mode

- In case of using the entry mode for the table data display

When the bit No. 12 of "Command Device" in the [Entry] dialog is ON [1], the line number and the column number will be output to the address n + 1 and the block number to the address n + 2 of the "Info. Output Device". Note that therefore, in only this case the window number cannot be referred because the block number is output to the address n + 7 (ENT2) of the write area.

**n + 8 (GREPNS) global response**

A response is written when a global port number is used in 1 : n communication. The contents of a response are shown in the following table.

For details on the global port number, see page 31-22.

Device Contents	Description
0000	Global command not received
0100	ACK
Others	Identical to NAK code (see page 31-23).

**n + 9 to n + 15**

System reserved

**Calendar**

Select a device memory from which the calendar data is read without using the V9 series' built-in clock. For more information on the built-in clock, refer to the V9 Series Reference Manual.

**PLC1 to 8**

Calendar data is read from the selected device memory.

The calendar data will be updated when:

- The power is turned on.
- STOP→RUN
- The date changes.
- At the leading edge of a bit (0 → 1) in the calendar device memory in the reading area

**Initial Screen**

Set the number of the screen to be displayed when power to the V series is turned on.

**GD-80 Compatible**

This setting is not valid because the GD-80 series cannot be used for universal serial communication.

---

## 31.4 Standard Type Protocol

---

### 31.4.1 Standard Type Protocol

---

---

The connection mode and transmission mode are set under [System Setting] → [Communication Setting]. The mode contents are as follows.

- Connection mode

1 : 1: Select it when connecting one V series unit to one host.

1 : n: Select it when connecting multiple V series units to one host. A maximum of 32 units can be connected.  
(Multi-drop specifications)



- Transmission mode

There are four transmission modes, depending on whether or not a sum check or CR/LF code is attached to the end of transmission and received data, as shown below.

Transmission Mode	Sum Check	CR/LF
1	Not provided	Not provided
2	Provided	Not provided
3	Not provided	Provided
4	Provided	Provided

### Connection (1 : 1), Transmission Mode (with Sum Check)

This protocol is used when one host communicates with one V series unit (1 : 1).

Contents	Protocol																	
<p>Reading the V series data at the host side</p>	<div style="display: flex; justify-content: space-between;"> <div style="width: 30%;">  <p>Host side</p> </div> <div style="width: 60%;"> <table border="1" style="border-collapse: collapse; text-align: center; width: 100%;"> <tr> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">S T X</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">C o m m a n d</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">D L E</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">T r a n s m i s s i o n d a A</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">D L E</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">T r a n s m i s s i o n d a B</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">E T X</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">S U M</td> </tr> </table> </div> </div> <hr/> <div style="display: flex; justify-content: space-between;"> <div style="width: 30%;">  <p>V series side</p> </div> <div style="width: 60%;"> <p>Transmission sequence</p>  </div> </div> <div style="display: flex; justify-content: space-around; margin-top: 10px;"> <table border="1" style="border-collapse: collapse; text-align: center; width: 40%;"> <tr> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">S T X</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">D L E</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">T r a n s m i s s i o n d a A</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">D L E</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">T r a n s m i s s i o n d a B</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">E T X</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">S U M</td> </tr> </table> <p>or</p> <table border="1" style="border-collapse: collapse; text-align: center; width: 20%;"> <tr> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">N A K</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">E r r o r c o d e</td> </tr> </table> </div>	S T X	C o m m a n d	D L E	T r a n s m i s s i o n d a A	D L E	T r a n s m i s s i o n d a B	E T X	S U M	S T X	D L E	T r a n s m i s s i o n d a A	D L E	T r a n s m i s s i o n d a B	E T X	S U M	N A K	E r r o r c o d e
S T X	C o m m a n d	D L E	T r a n s m i s s i o n d a A	D L E	T r a n s m i s s i o n d a B	E T X	S U M											
S T X	D L E	T r a n s m i s s i o n d a A	D L E	T r a n s m i s s i o n d a B	E T X	S U M												
N A K	E r r o r c o d e																	
<p>Writing data from the host to the V series</p>	<div style="display: flex; justify-content: space-between;"> <div style="width: 30%;">  <p>Host side</p> </div> <div style="width: 60%;"> <table border="1" style="border-collapse: collapse; text-align: center; width: 100%;"> <tr> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">S T X</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">C o m m a n d</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">D L E</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">T r a n s m i s s i o n d a A</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">D L E</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">T r a n s m i s s i o n d a B</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">E T X</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">S U M</td> </tr> </table> </div> </div> <hr/> <div style="display: flex; justify-content: space-between;"> <div style="width: 30%;">  <p>V series side</p> </div> <div style="width: 60%;"> <p>Transmission sequence</p>  </div> </div> <div style="display: flex; justify-content: space-around; margin-top: 10px;"> <table border="1" style="border-collapse: collapse; text-align: center; width: 40%;"> <tr> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">A C K</td> </tr> </table> <p>or</p> <table border="1" style="border-collapse: collapse; text-align: center; width: 20%;"> <tr> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">N A K</td> <td style="writing-mode: vertical-rl; transform: rotate(180deg);">E r r o r c o d e</td> </tr> </table> </div>	S T X	C o m m a n d	D L E	T r a n s m i s s i o n d a A	D L E	T r a n s m i s s i o n d a B	E T X	S U M	A C K	N A K	E r r o r c o d e						
S T X	C o m m a n d	D L E	T r a n s m i s s i o n d a A	D L E	T r a n s m i s s i o n d a B	E T X	S U M											
A C K																		
N A K	E r r o r c o d e																	

- When 1 : 1 connection is used, an interrupt can be used. For more information, see page 31-32.

**Connection (1 : 1), Transmission Mode (with Sum Check and CR/LF)**

This protocol is used when one host communicates with one V series unit (1 : 1).

Contents	Protocol
Reading the V series data at the host side	<p>Host side</p> <p>V series side</p> <p>Transmission sequence</p> <p>or</p> <p>Error code</p> <p>CR LF</p>
Writing data from the host to the V series	<p>Host side</p> <p>V series side</p> <p>Transmission sequence</p> <p>or</p> <p>Error code</p> <p>CR LF</p>

- When 1 : 1 connection is used, an interrupt can be used. For more information, see page 31-32.

### Connection (1 : n), Transmission Mode (with Sum Check)

It is possible to connect as many as 32 V series units to one host.  
 (For information on the global command, see page 31-25.)

Contents	Protocol
<p>Reading the V series data at the host side</p>	<p>Host side</p> <p>V series side</p> <p>Transmission sequence</p> <p>or</p> <p>Error code</p> <p>Port No.</p>
<p>Writing data from the host to the V series</p>	<p>Host side</p> <p>V series side</p> <p>Transmission sequence</p> <p>or</p> <p>Error code</p> <p>Port No.</p>

### Connection (1 : n), Transmission Mode (with Sum Check and CR/LF)

It is possible to connect as many as 32 V series units to one host.  
(For information on the global command, see page 31-25.)

Contents	Protocol
<p>Reading the V series data at the host side</p>	<p>Host side</p> <p>STX Command Port No. DEL Transmission data A DEL Transmission data B STX M CR LF</p> <p>V series side</p> <p>STX Port No. DEL Transmission data A DEL Transmission data B STX M CR LF</p> <p>Transmission sequence</p> <p>or</p> <p>NAK Error code Port No. CR LF</p>
<p>Writing data from the host to the V series</p>	<p>Host side</p> <p>STX Command Port No. DEL Transmission data A DEL Transmission data B STX M CR LF</p> <p>V series side</p> <p>ACK Port No. CR LF</p> <p>Transmission sequence</p> <p>or</p> <p>NAK Error code Port No. CR LF</p>

## 31.4.2 Protocol Contents

### Transmission Control Code

The transmission control codes are shown in the table below.

Signal Name	Code (Hexadecimal)	Contents
STX	02H	Start of transmission block
ETX	03H	End of transmission block
ENQ	05H	Interrupt
ACK	06H	Positive acknowledge
CR	0DH	Carriage return
DLE	10H	Change contents within a block
NAK	15H	Negative acknowledge
LF	0AH	Line feed

### Port Number

Port numbers can be set for connection mode "1 : n".

They are used so that the host computer can identify each V series for access.

The data range is from 00H to 1FH (0 to 31) and is converted into a two-digit ASCII code (HEX) before use. Set port numbers of the V series at [Local Port No.] under [Communication Setting].

#### Global port number (FFH)

When the global port number [FFH] is set, commands are sent to all V series units at one time.

Commands for which global port numbers are active are shown below. If commands other than these are used, a command error will occur.

Signal Name	Name	Contents
WM	Write	Write data device memory
WC	Write CHR	Write data device memory as characters

Responses to global port numbers are not transmitted to the host. However, responses are written in write area n + 8.

Device Contents	Description
0000H	Global command not received
0100H	ACK
Others	Identical to NAK code (see page 31-23.)

### Command

Available commands are shown below. The details on commands are described on pages shown at "Refer to:".

Signal Name	Name	Contents	Refer to:
RM	Read	Read data device memory	page 31-26
WM	Write	Write data device memory (1024 words maximum)	page 31-28
TR	Retry	Retry when NAK [01] is BUSY	page 31-29
WI	Interrupt Setting	Allow interrupt (Connection mode 1 : 1)	page 31-30
RI	Read interrupt status	Read interrupt setting status (Connection mode 1 : 1)	page 31-31
RC	Read CHR	Read data device memory as characters	page 31-25
WC	Write CHR	Write data device memory as characters (2048 bytes maximum)	page 31-27

## Sum Check Code (SUM)

Data is added up (SUM), and the lower one byte (8 bits) of the sum is converted into a two-digit ASCII code (HEX).

### Example:

Transmission mode: without CR/LF, with sum check

The sum check code is added as shown below when data "3882" (OF2AH) is transmitted to the address "\$u1453" (05ADH) using the command [WM] (data writing).

STX	Command	DLE	Address	Count	Device memory data	ETX	SUM
	"W" "M"		"0" "5" "A" "D"	"0" "0" "0" "1"	"0" "F" "2" "A"		"4" "D"
02H	57H 4DH	10H	30H 35H 41H 44H	30H 30H 30H 31H	30H 46H 32H 41H	03H	34H 44H

$$02H + 57H + 4DH + 10H + 30H + 35H + 41H + 44H + 30H + 30H + 30H + 31H + 30H + 46H + 32H + 41H + 03H = 34DH$$

\* In the case of an interrupt, data from ENQ to ETX is subject to a sum check.

## Error Codes

An error code is sent along with an NAK response as a two-digit ASCII code (HEX).


Error Codes	Contents
01H	The V series is currently engaged in display processing. The received command is on standby due to display processing. Wait a few moments and re-transmit the command.
02H	Overrun/Framing error An overrun or framing error is detected in the received data. Send the command again.
03H	Parity error A parity error is detected in the received data. Send the command again.
04H	Sum check error A sum error occurs with the received data.
05H	Address error The address specified by the device memory read/write command is incorrect. Check the address or counter and re-transmit the command.
06H	Count error The device memory read/write count is "0".
07H	Screen error The data to be written in read area n + 2 (screen status command), as specified by a write command, is not registered on the screen. Check the screen number and re-transmit the data.
08H	Format error The number of DLEs is 0 or greater than 6.
09H	Received data over The number of write command data received from the host exceeded that of data shown below. <ul style="list-style-type: none"> <li>Write memory command = 1024 words</li> <li>Write CHR command = 2048 bytes</li> </ul>
0BH	Retry command error When a retry command is received, there is no BUSY status (NAK [01]) command.
0FH	ETX error No ETX code is found.
10H	DLE error No DLE code is found.
11H	Character error A character not used in the received data is found (other than 0 to F). Check the character and send the command again.
12H	Command error An invalid command is given.

## Response Time and BUSY

Response time varies depending on the type of command.

### RM / RI / RC

These commands immediately send a response once receipt of data is complete. No NAK [01] (BUSY) signal is given.

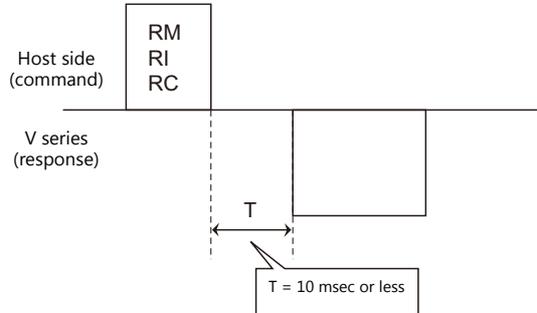


### WM / TR / WI / WC

Once receipt of data is complete, these commands first check the display status. If the display status is found to be complete, a response is sent and a command is executed.

If the status is BUSY and the display is completed within the time set in [Busy Time], a response is sent.

If the display is not completed within the specified time, an NAK [01] (BUSY) signal is sent. In this case, it is necessary to retransmit the command.

When [Busy Time] is set as [0], the machine waits until the display is complete, and then a response is transmitted after a command is executed.

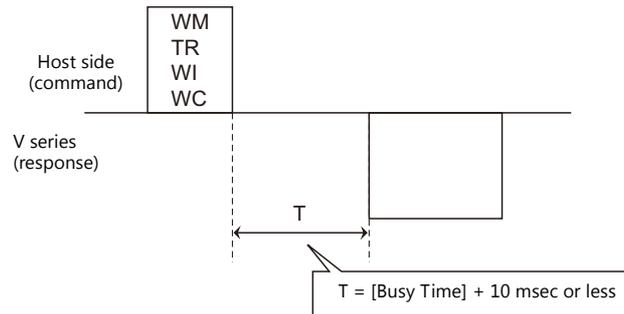


### 31.4.3 Command

#### RC: Read CHR

This command is used to read data in device memory as characters.


- \* When character data is sent, 1 character (1 byte) is converted into a two-byte ASCII code and transmitted by the read memory command. When the read CHR command is given, character data is not converted into the ASCII code before transmission, and thus, the transmission time is decreased by approximately 1/2.

#### Details of read CHR

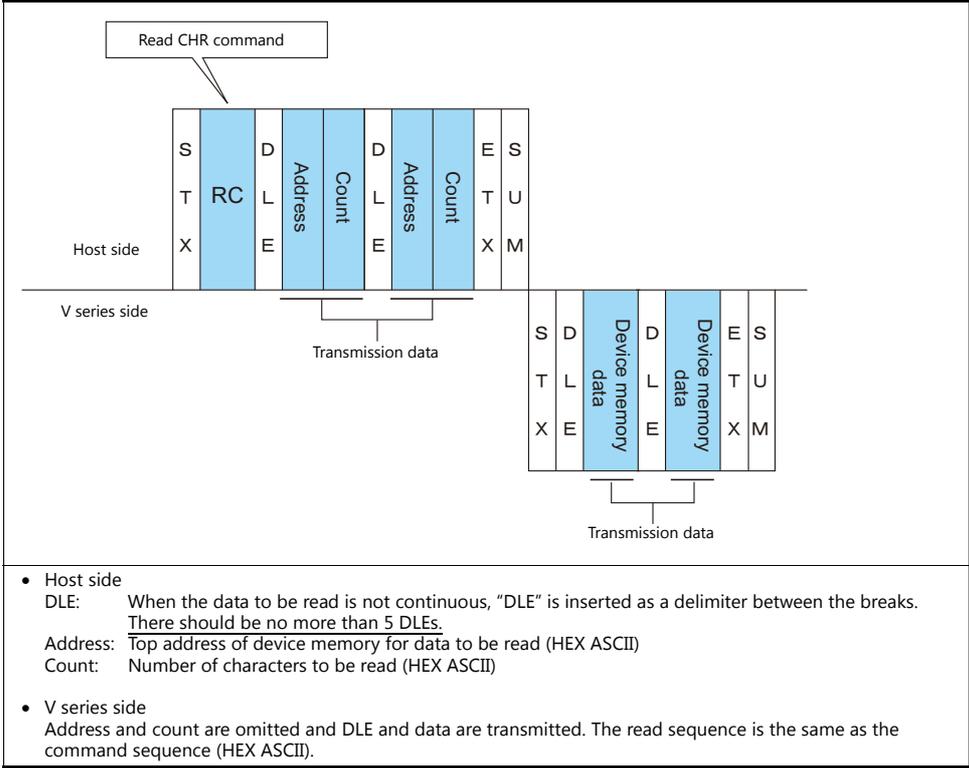

#### Example:

Call up 4 characters that are written at the top of the address \$u0020 (0014H).

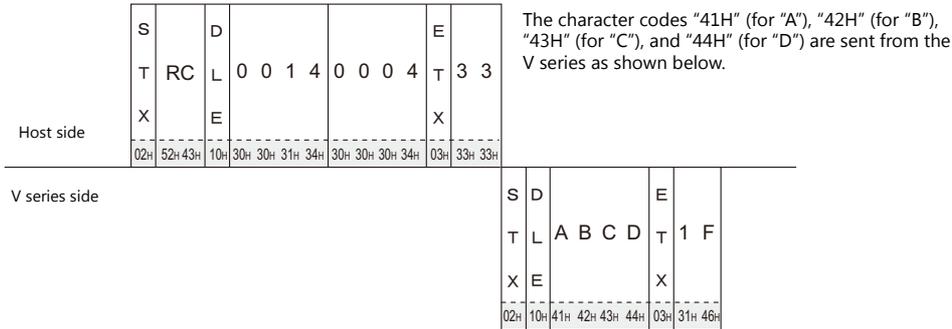


## RM: Read Memory

This command is used to read data in device memory.


\* Communication speed is increased when you use the read CHR command to read characters.

### Details of read memory

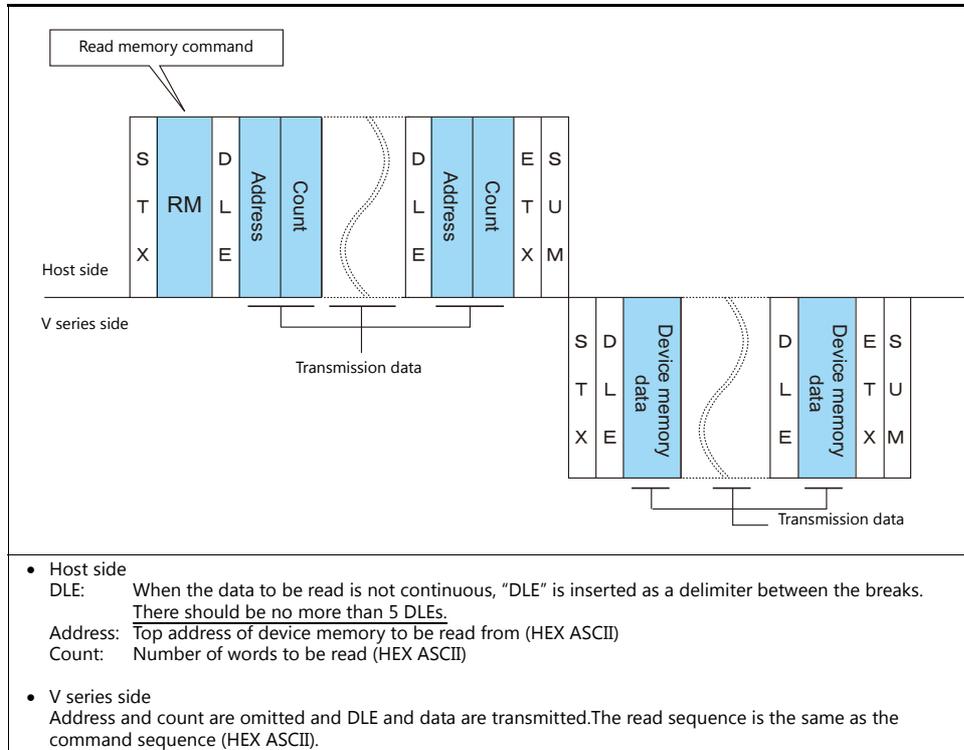

### Example:

Read the double-word data "75,000" (DEC) contained in the address \$u0020 (0014H).

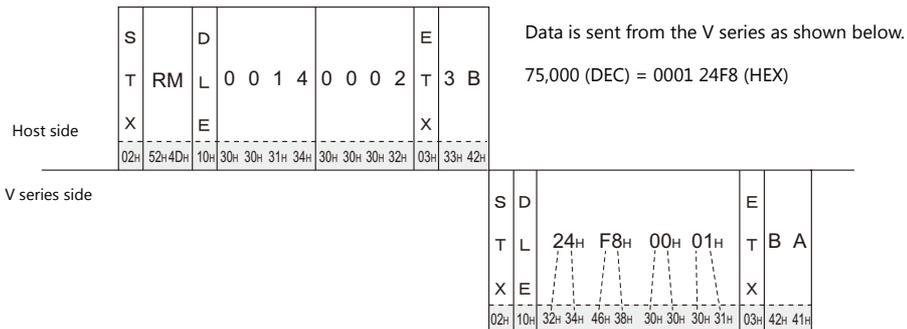


# WC: Write CHR

This command is used to write data to device memory as characters.


- \* When character data is sent, 1 character (1 byte) is converted into a two-byte ASCII code and transmitted by the write memory command. When the write CHR command is given, character data is not converted into the ASCII code before transmission, and thus, the transmission time is decreased by approximately 1/2. (Character codes from 00 to 1F cannot be used.)

## Details of write CHR

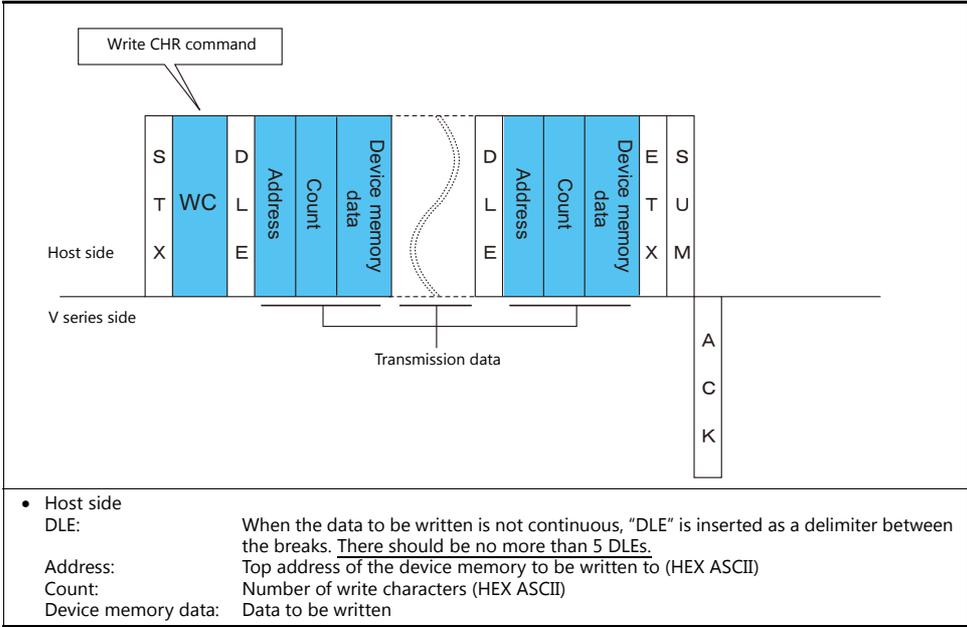

### Example:

Send data to display the following characters on the V series.  
 \$u0100 (0064H), EF  
 \$u0101 (0065H), GH  
 \$u0102 (0066H), IJ  
 \$u0103 (0067H), KL

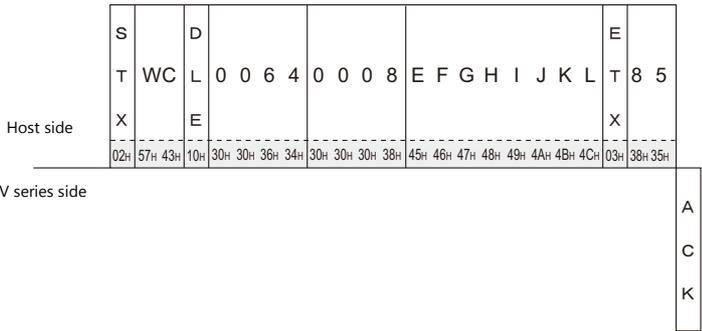




# TR: Retry Command

This command is used to re-send a write command/write CHR command when an NAK error code [01] is returned.

## Details of retry

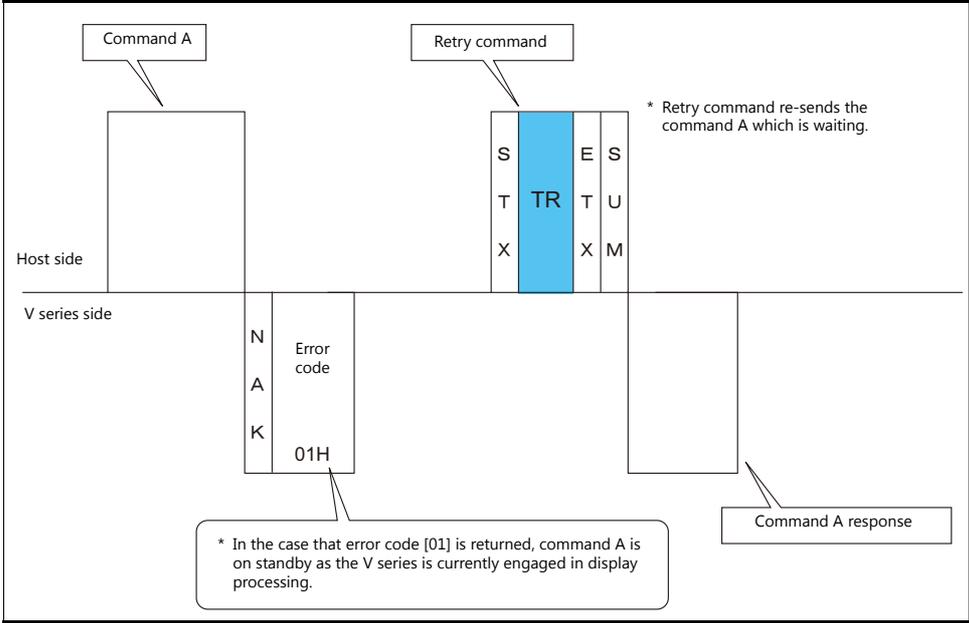

## WI: Interrupt Setting Command

This command is used to send interrupt conditions. It can be used for 1 : 1 connection.

### Details of interrupt setting command

- Host side  
Data: Interrupt conditions is specified when the interrupt data bit is set. (HEX ASCII)

Interrupt conditions

07	06	05	04	03	02	01	00

0: Interrupt prohibited  
 1: Interrupt allowed

Switch ON

Switch OFF

Keypad write & character entry

Screen internal switching

Switch ON	Interrupt when the switch changes from OFF to ON Valid only when [Action] of the switch is [Normal], [Block], [+Block], [-Block] or [Mode]
Switch OFF	Interrupt when the switch changes from ON to OFF Valid only when [Action] of the switch is [Normal], [Block], [+Block], [-Block] or [Mode]
Keypad write	Interrupt when the [ENTER] switch on the keypad is pressed
Screen internal switching	Interrupt when the screen changes based on an internal switch

\* Macro (OUT\_ENQ): Interrupt enabled all the time

### Example:

Interrupt settings are as shown below.

07	06	05	04	03	02	01	00
0	0	0	0	1	1	0	0

Switch ON: disabled

Switch OFF: disabled

Keypad write & character entry: enabled

Screen internal switching: enabled

S			E	
T	WI	0C	T	18
X			X	

Host side  
 02h 57h 49h 30h 43h 03h 31h 38h


V series side

A  
C  
K

# RI: Interrupt Status Read Command


This command is used to read interrupt setting status. It can be used for 1 : 1 connection.

## Details of interrupt status read command

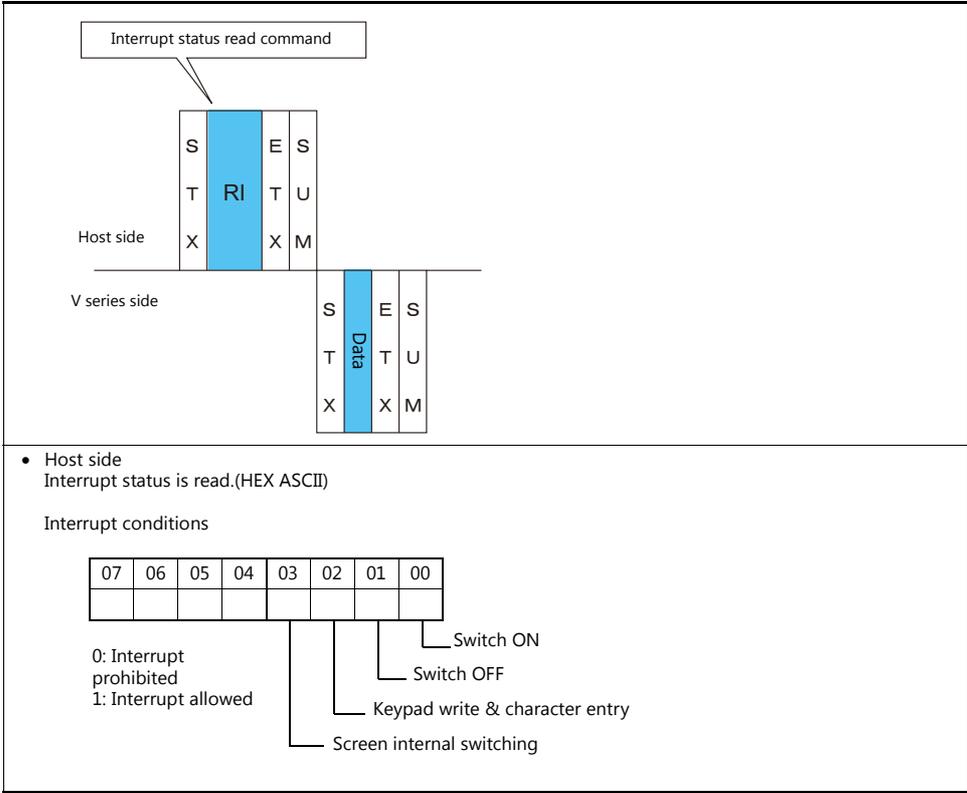

### Example:

Interrupt status is read.

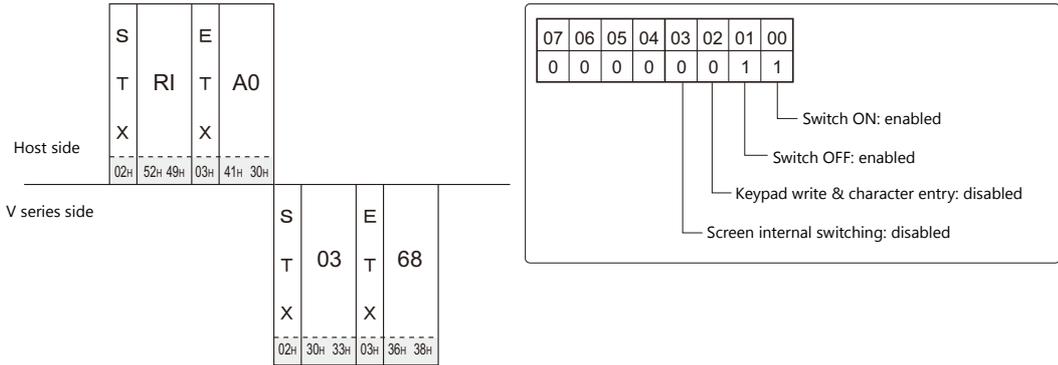

### 31.4.4 Interrupt (ENQ)

The interrupt command can be used for 1 : 1 connection.\* Interrupt data becomes the contents of write areas n + 2 to n + 7. (See page 31-13.)

\* For RS-485 (2-wire connection), interrupts cannot be used.

#### Interrupt codes and conditions


An interrupt code is sent to the host for the following actions.

Interrupt Codes	Interrupt Conditions
00H	The regular switch is changed from ON to OFF or OFF to ON when it is pressed. * When universal serial connection is made at multiple ports, all ports are interrupted at the same time.
01H	The "Write" switch on the keypad or on the keyboard is changed from OFF to ON when it is pressed. * If [Control Prohibition/Enabled of Write Key] is checked, the write enable bit must be set in order to send an interrupt code. * When universal serial connection is made at multiple ports, all ports are interrupted at the same time.
02H	The screen is switched by an internal switch. * When universal serial connection is made at multiple ports, all ports are interrupted at the same time.
10H to 2FH	The macro command [OUT_ENQ] is executed (for PLC1). The macro command [OUT_ENQ_EX] is executed (PLC1 to 8 selected by user).
30H to 3FH	The macro command [OUT_ENQ] is executed (for PLC2).
40H to 4FH	The macro command [OUT_ENQ] is executed (for PLC3).
50H to 5FH	The macro command [OUT_ENQ] is executed (for PLC4).
60H to 6FH	The macro command [OUT_ENQ] is executed (for PLC5).
70H to 7FH	The macro command [OUT_ENQ] is executed (for PLC6).
80H to 8FH	The macro command [OUT_ENQ] is executed (for PLC7).
90H to 9FH	The macro command [OUT_ENQ] is executed (for PLC8).

#### Interrupt timing

When an interrupt condition occurs while the host is transmitting a command or before the V series transmits a response, the interrupt code will be transmitted before the response is transmitted.

To use an interrupt, it is necessary to enable interrupt code detection when a response is received on the host program.

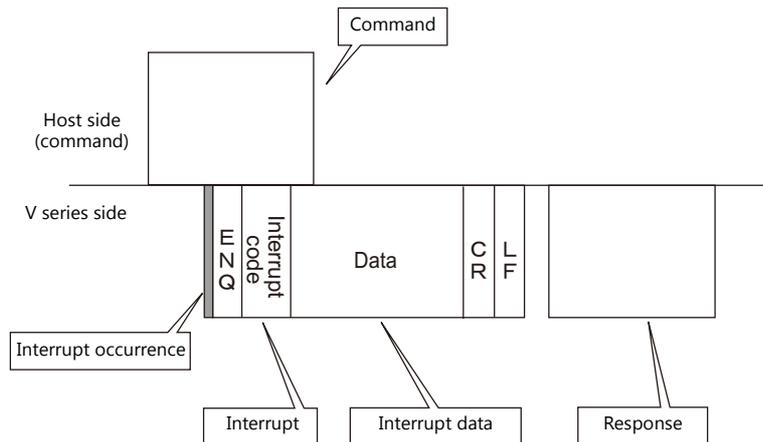





## 31.5 Device Memory Map


### Device Memory

Inside the V series, there is internal device memory necessary for screen display called "user device memory (\$u)", as well as device memory that the V series uses for the system called "system device memory (\$s)".

### User Device Memory (\$u)

32768 words are available for user device memory. This area is usable as desired for screen programs. Also the host computer can write to and read from the area.

The device memory map is as shown below.

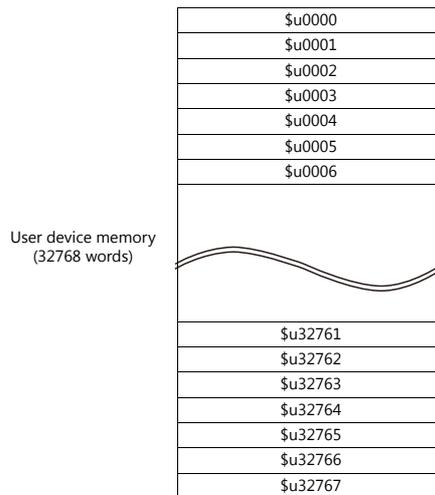

## System Device Memory (\$s)

2048 words are available for system device memory. System device memory is device memory that writes V series action status when the V Series is currently displaying something. With this written information, it is possible to check overlap status, buffer area, printer, backlight, and slave station status in multi-drop connection mode. In the table below, a small part (\$s80 to 95) of system device memory is extracted. For other device memory addresses, refer to the Reference Manual.

\* System device memory cannot be read or written from the host computer.

### Address \$s0080 to 95

Set [Output Device] in location (\$s0080 to 95) of system device memory, and select [Momentary] for [Output Action] of a switch. When the switch is pressed, output device memory is set (0 → 1) and the corresponding switch number is written in system setting areas  $n + 3$  and  $n + 4$ . (See page 31-15.)

The relationship between the output device memory and the switch number is shown in the following diagram. For details about the output of a switch, see page 31-34.

Address	Contents																																	
:																																		
\$s80	Universal serial switch output 0 Switch No. 0 to 15																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
LSB																																		
\$s81	Universal serial switch output 1 Switch No. 16 to 31																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>31</td><td>30</td><td>29</td><td>28</td><td>27</td><td>26</td><td>25</td><td>24</td><td>23</td><td>22</td><td>21</td><td>20</td><td>19</td><td>18</td><td>17</td><td>16</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	31	30	29	28	27	26	25	24	23	22	21	20	19	18	17
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	31	30	29	28	27	26	25	24	23	22	21	20	19	18	17	16																		
LSB																																		
\$s82	Universal serial switch output 2 Switch No. 32 to 47																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>47</td><td>46</td><td>45</td><td>44</td><td>43</td><td>42</td><td>41</td><td>40</td><td>39</td><td>38</td><td>37</td><td>36</td><td>35</td><td>34</td><td>33</td><td>32</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	47	46	45	44	43	42	41	40	39	38	37	36	35	34	33
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	47	46	45	44	43	42	41	40	39	38	37	36	35	34	33	32																		
LSB																																		
\$s83	Universal serial switch output 3 Switch No. 48 to 63																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>63</td><td>62</td><td>61</td><td>60</td><td>59</td><td>58</td><td>57</td><td>56</td><td>55</td><td>54</td><td>53</td><td>52</td><td>51</td><td>50</td><td>49</td><td>48</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	63	62	61	60	59	58	57	56	55	54	53	52	51	50	49
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	63	62	61	60	59	58	57	56	55	54	53	52	51	50	49	48																		
LSB																																		
\$s84	Universal serial switch output 4 Switch No. 64 to 79																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>79</td><td>78</td><td>77</td><td>76</td><td>75</td><td>74</td><td>73</td><td>72</td><td>71</td><td>70</td><td>69</td><td>68</td><td>67</td><td>66</td><td>65</td><td>64</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	79	78	77	76	75	74	73	72	71	70	69	68	67	66	65
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	79	78	77	76	75	74	73	72	71	70	69	68	67	66	65	64																		
LSB																																		
\$s85	Universal serial switch output 5 Switch No. 80 to 95																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>95</td><td>94</td><td>93</td><td>92</td><td>91</td><td>90</td><td>89</td><td>88</td><td>87</td><td>86</td><td>85</td><td>84</td><td>83</td><td>82</td><td>81</td><td>80</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	95	94	93	92	91	90	89	88	87	86	85	84	83	82	81
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	95	94	93	92	91	90	89	88	87	86	85	84	83	82	81	80																		
LSB																																		
\$s86	Universal serial switch output 6 Switch No. 96 to 111																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>111</td><td>110</td><td>109</td><td>108</td><td>107</td><td>106</td><td>105</td><td>104</td><td>103</td><td>102</td><td>101</td><td>100</td><td>99</td><td>98</td><td>97</td><td>96</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	111	110	109	108	107	106	105	104	103	102	101	100	99	98	97
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	111	110	109	108	107	106	105	104	103	102	101	100	99	98	97	96																		
LSB																																		
\$s87	Universal serial switch output 7 Switch No. 112 to 127																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>127</td><td>126</td><td>125</td><td>124</td><td>123</td><td>122</td><td>121</td><td>120</td><td>119</td><td>118</td><td>117</td><td>116</td><td>115</td><td>114</td><td>113</td><td>112</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	127	126	125	124	123	122	121	120	119	118	117	116	115	114	113
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	127	126	125	124	123	122	121	120	119	118	117	116	115	114	113	112																		
LSB																																		
\$s88	Universal serial switch output 8 Switch No. 128 to 143																																	
	MSB																																	
	<table border="1" style="width: 100%; text-align: center;"> <tr> <td></td><td>15</td><td>14</td><td>13</td><td>12</td><td>11</td><td>10</td><td>9</td><td>8</td><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td> </tr> <tr> <td>No.</td><td>143</td><td>142</td><td>141</td><td>140</td><td>139</td><td>138</td><td>137</td><td>136</td><td>135</td><td>134</td><td>133</td><td>132</td><td>131</td><td>130</td><td>129</td><td>128</td> </tr> </table>		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	No.	143	142	141	140	139	138	137	136	135	134	133	132	131	130	129
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0																		
No.	143	142	141	140	139	138	137	136	135	134	133	132	131	130	129	128																		
LSB																																		

Address	Contents																
\$s89	Universal serial switch output 9 Switch No. 144 to 159																
	MSB															LSB	
	No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	159	158	157	156	155	154	153	152	151	150	149	148	147	146	145	144	
\$s90	Universal serial switch output 10 Switch No. 160 to 175																
	MSB															LSB	
	No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	175	174	173	172	171	170	169	168	167	166	165	164	163	162	161	160	
\$s91	Universal serial switch output 11 Switch No. 176 to 191																
	MSB															LSB	
	No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	191	190	189	188	187	186	185	184	183	182	181	180	179	178	177	176	
\$s92	Universal serial switch output 12 Switch No. 192 to 207																
	MSB															LSB	
	No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	207	206	205	204	203	202	201	200	199	198	197	196	195	194	193	192	
\$s93	Universal serial switch output 13 Switch No. 208 to 223																
	MSB															LSB	
	No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	223	222	221	220	219	217	218	216	215	214	213	212	211	210	209	208	
\$s94	Universal serial switch output 14 Switch No. 224 to 239																
	MSB															LSB	
	No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	239	238	237	236	235	234	233	232	231	230	229	228	227	226	225	224	
\$s95	Universal serial switch output 15 Switch No. 240 to 255																
	MSB															LSB	
	No.	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	255	254	253	252	251	250	249	248	247	246	245	244	243	242	241	240	
:																	


### Address \$s0111

This address stores the local port number.

- \* The local port number specified for [Specify as a Main] in the [PLC Properties] window is stored.

# MEMO

**MONITOUCH**



# Connection Compatibility List

February, 2016

Manufacturer	Models	1 : 1	1 : n Multi-drop	n : 1 Multi-link2	Multi-link2 Ethernet	1 : n Multi-link2 Ethernet	n : 1 Multi-link	Network
Allen-Bradley	PLC-5	○	○	○	○	○	○	
	PLC-5 (Ethernet)	○	○					
	Control Logix / Compact Logix	○		○	○			
	Control Logix (Ethernet)	○	○					
	SLC500	○	○	○	○	○		
	SLC500 (Ethernet TCP/IP)	○	○					
	NET-ENI (SLC500 Ethernet TCP/IP)	○	○					
	NET-ENI (MicroLogix Ethernet TCP/IP)	○	○					
	Micro Logix	○	○	○	○	○		
	Micro Logix (Ethernet TCP/IP)	○	○					
	Micro800 Controllers	○		○				
Micro800 Controllers (Ethernet TCP/IP)	○	○						
Automationdirect	Direct LOGIC (K-Sequence)	○		○	○			
	Direct LOGIC (Ethernet UDP/IP)	○	○					
	Direct LOGIC (MODBUS RTU)	○	○	○	○	○		
Azbil	MX series	○	○	○	○	○		
	SDC10	○	○	○	○	○		
	SDC15	○	○	○	○	○		
	SDC20	○	○	○	○	○		
	SDC21	○	○	○	○	○		
	SDC25/26	○	○	○	○	○		
	SDC30/31	○	○	○	○	○		
	SDC35/36	○	○	○	○	○		
	SDC45/46	○	○	○	○	○		
	SDC40A	○	○	○	○	○		
	SDC40G	○	○	○	○	○		
	DMC10	○	○	○	○	○		
	DMC50(COM)	○	○	○	○	○		
	AHC2001	○	○	○	○	○		
	AHC2001+DCP31/32	○	○	○	○	○		
	DCP31/32	○	○	○	○	○		
	NX(CPL)	○	○	○	○	○		
	NX(MODBUS RTU)	○	○	○	○	○		
NX(MODBUS TCP/IP)	○	○						
Baumuller	BMx-x-PLC	○		○	○			
BECKHOFF	ADS protocol (Ethernet)	○	○					
CHINO	LT400 Series (MODBUS RTU)	○	○	○	○	○		
	DP1000	○	○	○	○	○		
	DB100B (MODBUS RTU)	○	○	○	○	○		
	KR2000 (MODBUS RTU)	○	○	○	○	○		
	LT230 (MODBUS RTU)	○	○	○	○	○		
	LT300 (MODBUS RTU)	○	○	○	○	○		
	LT830 (MODBUS RTU)	○	○	○	○	○		
CIMON	BP series	○		○	○			
	CP series	○		○	○			
	S series	○	○	○	○	○		
	S series (Ethernet)	○	○					
DELTA	DVP series	○	○	○	○	○		
DELTA TAU DATA SYSTEMS	PMAC	○		○	○			
	PMAC(Ethernet TCP/IP)	○	○					
EATON Cutler-Hammer	ELC	○	○	○	○	○		
EMERSON	EC10/20/20H (MODBUS RTU)	○	○	○	○	○		
FANUC	Power Mate	○		○	○			
Fatek Automation	FACON FB Series	○	○	○	○	○		
FUFENG	APC Series Controller	○	○	○	○	○		
Fuji Electric	MICREX-F series	○	○	○	○	○	○	
	MICREX-F series V4-compatible	○	○	○	○	○		
	MICREX-F T-Link							○
	MICREX-F T-Link V4-compatible							○
	SPB (N mode) & FLEX-PC series	○	○	○	○	○		
SPB (N mode) & FLEX-PC CPU	○		○	○				

Manufacturer	Models	1 : 1	1 : n Multi-drop	n : 1 Multi-link2	Multi-link2 Ethernet	1 : n Multi-link2 Ethernet	n : 1 Multi-link	Network
Fuji Electric	MICREX-SX (T-Link)							○
	MICREX-SX (OPCN1)							○
	MICREX-SX (SX BUS)							○
	MICREX-SX SPH/SPB/SPM/SPE series	○		○	○			
	MICREX-SX SPH/SPB/SPM/SPE CPU	○		○	○			
	MICREX-SX (Ethernet)	○	○					
	PYX (MODBUS RTU)	○	○	○	○	○		
	PXR (MODBUS RTU)	○	○	○	○	○		
	PXF (MODBUS RTU)	○	○	○	○	○		
	PXG (MODBUS RTU)	○	○	○	○	○		
	PXH (MODBUS RTU)	○	○	○	○	○		
	PUM (MODBUS RTU)	○	○	○	○	○		
	F-MPC04P (loader)	○	○	○	○	○		
	F-MPC series / FePSU	○	○	○	○	○		
	FVR-E11S	○	○	○	○	○		
	FVR-E11S (MODBUS RTU)	○	○	○	○	○		
	FVR-C11S (MODBUS RTU)	○	○	○	○	○		
	FRENIC5000 G11S/P11S	○	○	○	○	○		
	FRENIC5000 G11S/P11S (MODBUS RTU)	○	○	○	○	○		
	FRENIC5000 VG7S (MODBUS RTU)	○	○	○	○	○		
	FRENIC-Ace (MODBUS RTU)	○	○	○	○	○		
	FRENIC-HVAC/AQUA (MODBUS RTU)	○	○	○	○	○		
	FRENIC-Mini (MODBUS RTU)	○	○	○	○	○		
	FRENIC-Eco (MODBUS RTU)	○	○	○	○	○		
	FRENIC-Multi (MODBUS RTU)	○	○	○	○	○		
	FRENIC-MEGA (MODBUS RTU)	○	○	○	○	○		
	FRENIC-MEGA SERVO(MODBUS RTU)	○	○	○	○	○		
	FRENIC-VG1(MODBUS RTU)	○	○	○	○	○		
	HFR-C9K	○	○	○	○	○		
	HFR-C11K	○	○	○	○	○		
	HFR-K1K	○	○	○	○	○		
	PPMC (MODBUS RTU)	○	○	○	○	○		
	FALDIC-α series	○	○	○	○	○		
	FALDIC-W series	○	○	○	○	○		
	PH series	○	○	○	○	○		
	PHR (MODBUS RTU)	○	○	○	○	○		
	WA5000	○	○	○	○	○		
	APR-N (MODBUS RTU)	○	○	○	○	○		
	ALPHA5 (MODBUS RTU)	○	○	○	○	○		
	ALPHA5 Smart (MODBUS RTU)	○	○	○	○	○		
WE1MA (Ver. A)(MODBUS RTU)	○	○	○	○	○			
WE1MA (Ver. B)(MODBUS RTU)	○	○	○	○	○			
WSZ series	○	○	○	○	○			
WSZ series (Ethernet)	○	○						
Gammaflux	TTC2100	○	○	○	○	○		
GE Fanuc	90 series	○	○	○	○	○		
	90 series (SNP-X)	○		○	○			
	90 series (SNP)	○	○	○	○	○		
	90 series (Ethernet TCP/IP)	○	○					
	RX3i (Ethernet TCP/IP)	○	○					
Hitachi	HIDIC-S10/2α, S10mini	○		○	○			
	HIDIC-S10/2α, S10mini (Ethernet)	○	○					
	HIDIC-S10/4α	○		○	○			
	HIDIC-S10V	○		○	○			
Hitachi Industrial Equipment Systems	HIDIC-S10V (Ethernet)	○	○					
	HIDIC-H	○	○	○	○	○	○	
	HIDIC-H (Ethernet)	○	○					
	HIDIC-EHV	○	○	○	○	○	○	
	HIDIC-EHV (Ethernet)	○	○					
HYUNDAI	SJ300 series	○	○	○	○	○		
	SJ700 series	○	○	○	○	○		
HYUNDAI	Hi5 Robot (MODBUS RTU)	○	○	○	○	○		
	Hi4 Robot (MODBUS RTU)	○	○	○	○	○		
IAI	X-SEL controller	○	○	○	○	○		
	ROBO CYLINDER (RCP2/ERC)	○	○	○	○	○		
	ROBO CYLINDER (RCS/E-CON)	○	○	○	○	○		
	PCON/ACON/SCON (MODBUS RTU)	○	○	○	○	○		

Manufacturer	Models	1 : 1	1 : n Multi-drop	n : 1 Multi-link2	Multi-link2 Ethernet	1 : n Multi-link2 Ethernet	n : 1 Multi-link	Network
IDEC	MICRO 3	○	○	○	○	○		
	MICRO Smart	○	○	○	○	○		
	MICRO Smart pentra	○	○	○	○	○		
JTEKT	TOYOPUC	○	○	○	○	○	○	
	TOYOPUC (Ethernet)	○	○					
	TOYOPUC (Ethernet PC10 mode)	○	○					
	TOYOPUC-Plus	○	○	○	○	○		
KEYENCE	TOYOPUC-Plus (Ethernet)	○	○					
	KZ Series Link	○	○	○	○	○	○	
	KZ-A500 CPU	○		○	○			
	KV10/24 CPU	○		○	○			
	KV-700	○		○	○			
	KV-700 (Ethernet TCP/IP)	○	○					
	KV-1000	○		○	○			
	KV-1000 (Ethernet TCP/IP)	○	○					
KOGANEI	KBFL-TC	○	○	○	○	○		
	SU/SG	○	○	○	○	○		
KOYO ELECTRONICS	SR-T (K protocol)	○		○	○			
	SU/SG (K-Sequence)	○		○	○			
	SU/SG (Modbus RTU)	○	○	○	○	○		
	MASTER-KxxxS	○		○	○			
LS	MASTER-KxxxS CNET	○	○	○	○	○		
	MASTER-K series (Ethernet)	○	○					
	GLOFA CNET	○	○	○	○	○	○	
	GLOFA GM7 CNET	○	○	○	○	○		
	GLOFA GM series CPU	○		○	○			
	XGT/XGK series CNET	○	○	○	○	○		
	XGT/XGK series CPU	○		○	○			
	XGT/XGK series (Ethernet)	○	○					
	XGT/XGI series CNET	○	○	○	○	○		
	XGT/XGI series CPU	○		○	○			
	XGT/XGI series (Ethernet)	○	○					
MITSUBISHI ELECTRIC	A series link	○	○	○	○	○	○	
	A series CPU	○		○	○			
	A series (OPCN1)							○
	QnA series link	○	○	○	○	○		
	QnA series CPU	○		○	○			
	QnA series (Ethernet)	○	○					
	QnH (Q) series link	○	○	○	○	○		
	QnH (Q) series CPU	○		○	○			
	QnU series CPU	○		○	○			
	Q00J/00/01CPU	○		○	○			
	QnH (Q) series (Ethernet)	○	○					
	QnH (Q) series link (multi CPU)	○	○	○	○	○		
	QnH (Q) series (multi CPU) (Ethernet)	○	○					
	QnH (Q) series CPU (multi CPU)	○		○	○			
	QnH (Q) series (Ethernet ASCII)	○	○					
	QnH (Q) series (multi CPU) (Ethernet ASCII)	○	○					
	QnU series (built-in Ethernet)	○	○					
	L series link	○	○	○	○	○		
	L series (built-in Ethernet)	○	○					
	L series CPU	○		○	○			
	A series (CC-Link)							○
	QnA series (CC-Link)							○
	QnH (Q) series (CC-LINK)							○
	FX series CPU	○		○	○			
FX2N/1N series CPU	○		○	○				
FX1S series CPU	○		○	○				
FX series link (A protocol)	○	○	○	○	○	○		
FX-3U/3UC/3G series CPU	○		○	○				
FX-3U/3GE series (Ethernet)	○	○						
FX3U/3UC/3UG series link(A protocol)	○	○	○	○	○	○		

**List-4**

Manufacturer	Models	1 : 1	1 : n Multi-drop	n : 1 Multi-link2	Multi-link2 Ethernet	1 : n Multi-link2 Ethernet	n : 1 Multi-link	Network
MITSUBISHI ELECTRIC	FX-5U/5UC series	○	○	○				
	FX-5U/5UC series (Ethernet)	○	○					
	A-Link + Net10		○					
	Q170MCP (multi CPU)	○		○	○			
	Q170 series (multi CPU) (Ethernet)	○	○					
	iQ-R series (Built-in Ethernet)	○	○					
	iQ-R series link	○	○	○	○	○		
	iQ-R series (Ethernet)	○	○					
	FR-*500	○	○	○	○	○		
	FR-V500	○	○	○	○	○		
	MR-J2S-*A	○	○	○	○	○		
	MR-J3-*A	○	○	○	○	○		
	MR-J3-*T	○	○	○	○	○		
FR-E700	○	○	○	○	○			
MODICON	Modbus RTU	○		○	○			
MOELLER	PS4	○		○	○			
M-SYSTEM	R1M series (MODBUS RTU)	○	○	○	○	○		
OMRON	SYSMAC C	○	○	○	○	○	○	
	SYSMAC CV	○	○	○	○	○	○	
	SYSMAC CS1/CJ1	○	○	○	○	○		
	SYSMAC CS1/CJ1 DNA	○	○					
	SYSMAC CS1/CJ1 (Ethernet)	○	○					
	SYSMAC CS1/CJ1 (Ethernet Auto)	○	○					
	SYSMAC CS1/CJ1 DNA (Ethernet)	○	○					
	E5AK	○	○	○	○	○		
	E5AK-T	○	○	○	○	○		
	E5AN/E5EN/E5CN/E5GN	○	○	○	○	○		
	E5AR/E5ER	○	○	○	○	○		
	E5CK	○	○	○	○	○		
	E5CK-T	○	○	○	○	○		
	E5CN-HT	○	○	○	○	○		
	E5EK	○	○	○	○	○		
	E5ZD	○	○	○	○	○		
	E5ZE	○	○	○	○	○		
	E5ZN	○	○	○	○	○		
	V600/620/680	○	○	○	○	○		
KM20	○	○	○	○	○			
KM100	○	○	○	○	○			
V680S (Ethernet TCP/IP)	○	○						
Oriental Motor	High-efficiency AR series (MODBUS RTU)	○	○	○	○	○		
	CRK series (MODBUS RTU)	○	○	○	○	○		
Panasonic	FP Series (RS232C/422)	○	○	○	○	○	○	
	FP Series (TCP/IP)	○	○					
	FP Series (UDP/IP)	○	○					
	FP-X (TCP/IP)	○	○					
	FP7 Series (RS232C/422)	○	○	○	○	○		
	FP7 Series (Ethernet)	○	○					
	LP-400	○		○	○			
	KW Series	○	○	○	○	○		
	MINAS A4 series	○	○	○	○	○		
RKC	SR-Mini (MODBUS RTU)	○	○	○	○	○		
	CB100/CB400/CB500/CB700/CB900 (MODBUS RTU)	○	○	○	○	○		
	SR-Mini (Standard Protocol)	○	○	○	○	○		
	REX-F400/F700/F900(Standard Protocol)	○	○	○	○	○		
	SRV (MODBUS RTU)	○	○	○	○	○		
	MA900/MA901 (MODBUS RTU)	○	○	○	○	○		
	SRZ (MODBUS RTU)	○	○	○	○	○		
FB100/FB400/FB900 (MODBUS RTU)	○	○	○	○	○			
RS Automation	NX7/NX Plus Series (70P/700P/CCU+)	○	○	○	○	○	○	
	N7/NX Series (70/700/750/CCU)	○	○	○	○	○	○	
	NX700 Series (Ethernet)	○	○					
	X8 Series	○	○	○	○	○		
	X8 Series (Ethernet)	○	○					
	CSD5 (MODBUS RTU)	○	○	○	○	○		
Moscon-F50 (MODBUS RTU)	○	○	○	○	○			

Manufacturer	Models	1 : 1	1 : n Multi-drop	n : 1 Multi-link2	Multi-link2 Ethernet	1 : n Multi-link2 Ethernet	n : 1 Multi-link	Network
SAIA	PCD	○	○	○	○	○		
	PCD S-BUS (Ethernet)	○	○					
SAMSUNG	SPC series	○	○	○	○	○	○	
	N_plus	○	○	○	○	○	○	
	SECNET	○	○	○	○	○	○	
SANMEI	Cuty Axis	○	○	○	○	○		
SanRex	DC AUTO (HKD type)	○	○	○	○	○		
SHARP	JW series	○	○	○	○	○	○	
	JW100/70H COM port	○	○	○	○	○	○	
	JW20 COM port	○	○	○	○	○	○	
	JW series (Ethernet)	○	○					
	JW300 series	○	○	○	○	○	○	
	JW311/312/321/322 series (Ethernet)	○	○					
SHIMADEN	JW331/332/341/342/352/362 series (Ethernet)	○	○					
	SHIMADEN standard protocol	○	○	○	○	○		
SHINKO TECHNOS	C Series	○	○	○	○	○		
	FC Series	○	○	○	○	○		
	GC Series	○	○	○	○	○		
	DCL-33A	○	○	○	○	○		
	JCx-300 Series	○	○	○	○	○		
	PC-900	○	○	○	○	○		
	PCD-33A	○	○	○	○	○		
	ACS-13A	○	○	○	○	○		
	ACD/ACR Series	○	○	○	○	○		
WCL-13A	○	○	○	○	○			
Siemens	S5 PG port	○	○	○	○	○		
	S7	○		○	○			
	S7-200 PPI	○	○				○	
	S7-200 (Ethernet ISOTCP)	○	○					
	S7-300/400 MPI	○	○					
	S7-300/400 (Ethernet ISOTCP)	○	○					
	S7-300/400 (Ethernet TCP/IP PG protocol)	○	○					
S7-1200 (Ethernet ISOTCP)	○	○						
TI500/505	○	○	○	○	○			
SINFONIA TECHNOLOGY	SELMART	○	○	○	○	○	○	
SUS	XA-A*	○		○	○			
TECO	TP-03 (MODBUS RTU)	○	○	○	○	○		
Telemecanique	TSX Micro						○	
TOHO	TTM-000	○	○	○	○	○		
	TTM-00BT	○	○	○	○	○		
	TTM-200	○	○	○	○	○		
Tokyo Chokoku Marking Products	MB3315/1010	○						
TOSHIBA	T series / V series (T compatible)	○	○	○	○	○	○	
	T series / V series (T compatible) (Ethernet UDP/IP)	○	○					
	EX series	○	○	○	○	○		
	nv series (Ethernet UDP/IP)	○	○					
	VF-S7	○	○	○	○	○		
	VF-S9	○	○	○	○	○		
	VF-S11	○	○	○	○	○		
	VF-S15	○	○	○	○	○		
	VF-A7	○	○	○	○	○		
	VF-AS1	○	○	○	○	○		
	VF-P7	○	○	○	○	○		
	VF-PS1	○	○	○	○	○		
	VF-FS1	○	○	○	○	○		
	VF-MB1	○	○	○	○	○		
VF-nC1	○	○	○	○	○			
VF-nC3	○	○	○	○	○			
TOSHIBA MACHINE	TC200	○	○	○	○	○		
	VELCONIC series		○					
TURCK	BL Series Distributed I/O (MODBUS TCP/IP)	○	○					
ULVAC	G-TRAN series	○	○	○	○	○		

**List-6**

Manufacturer	Models	1 : 1	1 : n Multi-drop	n : 1 Multi-link2	Multi-link2 Ethernet	1 : n Multi-link2 Ethernet	n : 1 Multi-link	Network
UNIPULSE	F340A	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	F371	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	F800	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	F805A	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	F720A	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
UNITRONICS	M90/M91/Vision Series (ASCII)	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	Vision Series (ASCII Ethernet TCP/IP)	<input type="radio"/>	<input type="radio"/>					
VIGOR	M series	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
WAGO	750 series (MODBUS RTU)	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	750 series (MODBUS ETHERNET)	<input type="radio"/>	<input type="radio"/>					
XINJE	XC Series (MODBUS RTU)	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
YAMAHA	RCX142	<input type="radio"/>		<input type="radio"/>	<input type="radio"/>			
Yaskawa Electric	Memobus	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	CP9200SH/MP900	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	MP2000 series	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	MP2300 (MODBUS TCP/IP)	<input type="radio"/>	<input type="radio"/>					
	CP MP expansion memobus (UDP/IP)	<input type="radio"/>	<input type="radio"/>					
	MP2000 series (UDP/IP)	<input type="radio"/>	<input type="radio"/>					
Yokogawa Electric	FA-M3	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	
	FA-M3R	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	
	FA-M3/FA-M3R (Ethernet UDP/IP)	<input type="radio"/>	<input type="radio"/>					
	FA-M3/FA-M3R (Ethernet UDP/IP ASCII)	<input type="radio"/>	<input type="radio"/>					
	FA-M3/FA-M3R (Ethernet TCP/IP)	<input type="radio"/>	<input type="radio"/>					
	FA-M3/FA-M3R (Ethernet TCP/IP ASCII)	<input type="radio"/>	<input type="radio"/>					
	FA-M3V	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	
	FA-M3V (Ethernet)	<input type="radio"/>	<input type="radio"/>					
	FA-M3V(Ethernet ASCII)	<input type="radio"/>	<input type="radio"/>					
	UT100	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT750	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT550	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT520	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT350	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT320	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT2400/2800	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT450	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT32A/35A (MODBUS RTU)	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	UT52A/55A (MODBUS RTU)	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
UT75A (MODBUS RTU)	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>			
μR10000/20000 (Ethernet TCP/IP)	<input type="radio"/>	<input type="radio"/>						
None	Universal serial	<input type="radio"/>	<input type="radio"/>					
	Universal FL-Net							<input type="radio"/>
	General-purpose PROFIBUS-DP							<input type="radio"/>
	Universal DeviceNet							<input type="radio"/>
	Without PLC Connection							
	MODBUS RTU	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	MODBUS RTU EXT Format	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		
	MODBUS TCP/IP (Ethernet)	<input type="radio"/>	<input type="radio"/>					
	MODBUS TCP/IP (Ethernet) Sub Station	<input type="radio"/>	<input type="radio"/>					
	MODBUS TCP/IP (Ethernet) EXT Format	<input type="radio"/>	<input type="radio"/>					
MODBUS ASCII	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>			

**Slave Communication**

Manufacturer	Models	Setting	Remarks
None	Universal serial	<input type="radio"/>	
	V-Link	<input type="radio"/>	
	Modbus slave (RTU)	<input type="radio"/>	
	Modbus slave (TCP/IP)	<input type="radio"/>	
	Modbus slave (ASCII)	<input type="radio"/>	

**Hakko Electronics Co., Ltd.**  
**[www.monitouch.com](http://www.monitouch.com)**

**Sales** 890-1, Kamikashiwano-machi, Hakusan-shi, Ishikawa,  
924-0035 Japan  
TEL +81-76-274-2144 FAX +81-76-274-5136